

Discounted Cash Flow Method

Case 1 - G0

Discount rate = 12(X)

B = 212.08 S = 1
 C = 183.74 kW Value B1 = 68 US\$/kW C1 = 0.063853658
 B/C = 1.154 kWh Value B2 = 0.063 US\$/kWh C2 = 0.052677395
 B-C = 28.34 kWh Value B3 = 0.005 US\$/kWh C3 = 0.041516562 UNIT: Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|-------|---------------|-----------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|--------|
| | | | | Salable Energy (GWh/Yr) | Surplus Energy (GWh/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 21.58 | 13.71 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 39.89 | 22.63 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 57.63 | 29.19 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 98.67 | 44.63 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 50.49 | 20.39 | 179.00 | 691.10 | 52.00 | 4.55 | 1.39 | 1.42 | 7.37 |
| 1995 | 9 | 7.25 | 2.61 | 256.00 | 614.10 | 69.00 | 5.81 | 1.10 | 1.69 | 8.61 |
| 1996 | 10 | 12.85 | 4.13 | 333.00 | 537.10 | 86.10 | 6.75 | 0.86 | 1.88 | 9.50 |
| 1997 | 11 | 9.02 | 2.59 | 415.00 | 888.50 | 104.20 | 7.51 | 1.27 | 2.03 | 10.83 |
| 1998 | 12 | 3.60 | 0.92 | 500.00 | 803.50 | 123.20 | 8.08 | 1.03 | 2.15 | 11.26 |
| 1999 | 13 | 3.60 | 0.82 | 588.00 | 715.50 | 143.00 | 8.48 | 0.81 | 2.22 | 11.53 |
| 2000 | 14 | 3.60 | 0.73 | 680.00 | 623.50 | 149.40 | 8.76 | 0.63 | 2.07 | 11.48 |
| 2001 | 15 | 3.60 | 0.65 | 776.00 | 527.50 | 149.40 | 8.93 | 0.48 | 1.85 | 11.26 |
| 2002 | 16 | 3.60 | 0.58 | 876.00 | 427.50 | 149.40 | 9.00 | 0.34 | 1.65 | 11.00 |
| 2003 | 17 | 3.60 | 0.52 | 980.00 | 323.50 | 149.40 | 8.99 | 0.23 | 1.47 | 10.70 |
| 2004 | 18 | 3.60 | 0.46 | 1089.00 | 214.50 | 149.40 | 8.92 | 0.13 | 1.32 | 10.38 |
| 2005 | 19 | 3.60 | 0.41 | 1201.00 | 102.50 | 149.40 | 8.78 | 0.05 | 1.17 | 10.02 |
| 2006 | 20 | 3.60 | 0.37 | 1303.50 | 0.00 | 149.40 | 8.51 | 0.00 | 1.05 | 9.56 |
| 2007 | 21 | 3.60 | 0.33 | 1303.50 | 0.00 | 149.40 | 7.60 | 0.00 | 0.94 | 8.54 |
| 2008 | 22 | 3.60 | 0.29 | 1303.50 | 0.00 | 149.40 | 6.78 | 0.00 | 0.83 | 7.62 |
| 2009 | 23 | 3.60 | 0.26 | 1303.50 | 0.00 | 149.40 | 6.05 | 0.00 | 0.74 | 6.80 |
| 2010 | 24 | 3.60 | 0.23 | 1303.50 | 0.00 | 149.40 | 5.41 | 0.00 | 0.66 | 6.07 |
| 2011 | 25 | 3.60 | 0.21 | 1303.50 | 0.00 | 149.40 | 4.83 | 0.00 | 0.59 | 5.42 |
| 2012 | 26 | 3.60 | 0.18 | 1303.50 | 0.00 | 149.40 | 4.31 | 0.00 | 0.53 | 4.84 |
| 2013 | 27 | 3.60 | 0.16 | 1303.50 | 0.00 | 149.40 | 3.85 | 0.00 | 0.47 | 4.32 |
| 2014 | 28 | 3.60 | 0.15 | 1303.50 | 0.00 | 149.40 | 3.43 | 0.00 | 0.42 | 3.86 |
| 2015 | 29 | 3.60 | 0.13 | 1303.50 | 0.00 | 149.40 | 3.06 | 0.00 | 0.37 | 3.44 |
| 2016 | 30 | 3.60 | 0.12 | 1303.50 | 0.00 | 149.40 | 2.74 | 0.00 | 0.33 | 3.08 |
| 2017 | 31 | 3.60 | 0.10 | 1303.50 | 0.00 | 149.40 | 2.44 | 0.00 | 0.30 | 2.75 |
| 2018 | 32 | 3.60 | 0.09 | 1303.50 | 0.00 | 149.40 | 2.18 | 0.00 | 0.27 | 2.45 |
| 2019 | 33 | 3.60 | 0.08 | 1303.50 | 0.00 | 149.40 | 1.95 | 0.00 | 0.24 | 2.19 |
| 2020 | 34 | 3.60 | 0.07 | 1303.50 | 0.00 | 149.40 | 1.74 | 0.00 | 0.21 | 1.95 |
| 2021 | 35 | 3.60 | 0.06 | 1303.50 | 0.00 | 149.40 | 1.55 | 0.00 | 0.19 | 1.74 |
| 2022 | 36 | 3.60 | 0.06 | 1303.50 | 0.00 | 149.40 | 1.38 | 0.00 | 0.17 | 1.56 |
| 2023 | 37 | 3.60 | 0.05 | 1303.50 | 0.00 | 149.40 | 1.23 | 0.00 | 0.15 | 1.39 |
| 2024 | 38 | 3.60 | 0.04 | 1303.50 | 0.00 | 149.40 | 1.10 | 0.00 | 0.13 | 1.24 |
| 2025 | 39 | 3.60 | 0.04 | 1303.50 | 0.00 | 149.40 | 0.98 | 0.00 | 0.12 | 1.11 |
| 2026 | 40 | 3.60 | 0.03 | 1303.50 | 0.00 | 149.40 | 0.88 | 0.00 | 0.10 | 0.99 |
| 2027 | 41 | 3.60 | 0.03 | 1303.50 | 0.00 | 149.40 | 0.78 | 0.00 | 0.09 | 0.88 |
| 2028 | 42 | 3.60 | 0.03 | 1303.50 | 0.00 | 149.40 | 0.70 | 0.00 | 0.08 | 0.79 |
| 2029 | 43 | 3.60 | 0.02 | 1303.50 | 0.00 | 149.40 | 0.62 | 0.00 | 0.07 | 0.70 |
| 2030 | 44 | 3.60 | 0.02 | 1303.50 | 0.00 | 149.40 | 0.56 | 0.00 | 0.06 | 0.63 |
| 2031 | 45 | 3.60 | 0.02 | 1303.50 | 0.00 | 149.40 | 0.50 | 0.00 | 0.06 | 0.56 |
| 2032 | 46 | 3.60 | 0.01 | 1303.50 | 0.00 | 149.40 | 0.44 | 0.00 | 0.05 | 0.50 |
| 2033 | 47 | 3.60 | 0.01 | 1303.50 | 0.00 | 149.40 | 0.39 | 0.00 | 0.04 | 0.44 |
| 2034 | 48 | 3.60 | 0.01 | 1303.50 | 0.00 | 149.40 | 0.35 | 0.00 | 0.04 | 0.40 |
| 2035 | 49 | 3.60 | 0.01 | 1303.50 | 0.00 | 149.40 | 0.31 | 0.00 | 0.03 | 0.35 |
| 2036 | 50 | 3.60 | 0.01 | 1303.50 | 0.00 | 149.40 | 0.28 | 0.00 | 0.03 | 0.31 |
| 2037 | 51 | 3.60 | 0.01 | 1303.50 | 0.00 | 149.40 | 0.25 | 0.00 | 0.03 | 0.28 |
| 2038 | 52 | 3.60 | 0.00 | 1303.50 | 0.00 | 149.40 | 0.22 | 0.00 | 0.02 | 0.25 |
| 2039 | 53 | 3.60 | 0.00 | 1303.50 | 0.00 | 149.40 | 0.20 | 0.00 | 0.02 | 0.22 |
| 2040 | 54 | 3.60 | 0.00 | 1303.50 | 0.00 | 149.40 | 0.18 | 0.00 | 0.02 | 0.20 |
| 2041 | 55 | 3.60 | 0.00 | 1303.50 | 0.00 | 149.40 | 0.16 | 0.00 | 0.01 | 0.18 |
| 2042 | 56 | 3.60 | 0.00 | 1303.50 | 0.00 | 149.40 | 0.14 | 0.00 | 0.01 | 0.16 |
| 2043 | 57 | 3.60 | 0.00 | 1303.50 | 0.00 | 149.40 | 0.12 | 0.00 | 0.01 | 0.14 |
| Total | | 508.93 | 183.74 | | | | 172.99 | 8.39 | 30.69 | 212.08 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case - 1 - 70

Discount rate= 12(X)
 B = 228.20
 C = 188.88
 B/C = 1.208
 B-C = 39.32

S = I
 kW Value B1= 68 US\$/kW
 kWh Value B2= 0.063 US\$/kWh
 kWh Value B3= 0.005 US\$/kWh

C1= 0.061117172
 C2= 0.049534151
 C3= 0.037754520

UNIT=Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|--------------|---------------|---------------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|---------------|
| | | | | Salable Energy (GWH/Yr) | Surplus Energy (GWH/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 22.25 | 14.14 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 41.94 | 23.79 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 61.20 | 31.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 102.14 | 46.20 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 52.10 | 21.04 | 179.00 | 836.10 | 52.00 | 4.55 | 1.68 | 1.42 | 7.67 |
| 1995 | 9 | 2.48 | 0.89 | 256.00 | 759.10 | 69.00 | 5.81 | 1.36 | 1.69 | 8.87 |
| 1996 | 10 | 7.61 | 2.45 | 333.00 | 682.10 | 86.10 | 6.75 | 1.09 | 1.88 | 9.73 |
| 1997 | 11 | 13.21 | 3.79 | 415.00 | 600.10 | 104.20 | 7.51 | 0.86 | 2.03 | 10.41 |
| 1998 | 12 | 9.24 | 2.37 | 500.00 | 1014.40 | 123.20 | 8.08 | 1.30 | 2.15 | 11.53 |
| 1999 | 13 | 3.73 | 0.85 | 588.00 | 926.40 | 143.00 | 8.48 | 1.06 | 2.22 | 11.77 |
| 2000 | 14 | 3.73 | 0.76 | 680.00 | 834.40 | 163.70 | 8.76 | 0.85 | 2.27 | 11.89 |
| 2001 | 15 | 3.73 | 0.68 | 776.00 | 738.40 | 174.90 | 8.93 | 0.67 | 2.17 | 11.77 |
| 2002 | 16 | 3.73 | 0.60 | 876.00 | 638.40 | 174.90 | 9.00 | 0.52 | 1.94 | 11.46 |
| 2003 | 17 | 3.73 | 0.54 | 980.00 | 534.40 | 174.90 | 8.99 | 0.38 | 1.73 | 11.11 |
| 2004 | 18 | 3.73 | 0.48 | 1089.00 | 425.40 | 174.90 | 8.92 | 0.27 | 1.54 | 10.74 |
| 2005 | 19 | 3.73 | 0.43 | 1201.00 | 313.40 | 174.90 | 8.78 | 0.18 | 1.38 | 10.34 |
| 2006 | 20 | 3.73 | 0.38 | 1318.00 | 196.40 | 174.90 | 8.60 | 0.10 | 1.23 | 9.94 |
| 2007 | 21 | 3.73 | 0.34 | 1440.00 | 74.40 | 174.90 | 8.39 | 0.03 | 1.10 | 9.53 |
| 2008 | 22 | 3.73 | 0.30 | 1514.40 | 0.00 | 174.90 | 7.88 | 0.00 | 0.98 | 8.86 |
| 2009 | 23 | 3.73 | 0.27 | 1514.40 | 0.00 | 174.90 | 7.03 | 0.00 | 0.87 | 7.91 |
| 2010 | 24 | 3.73 | 0.24 | 1514.40 | 0.00 | 174.90 | 6.28 | 0.00 | 0.78 | 7.06 |
| 2011 | 25 | 3.73 | 0.21 | 1514.40 | 0.00 | 174.90 | 5.61 | 0.00 | 0.69 | 6.31 |
| 2012 | 26 | 3.73 | 0.19 | 1514.40 | 0.00 | 174.90 | 5.01 | 0.00 | 0.62 | 5.63 |
| 2013 | 27 | 3.73 | 0.17 | 1514.40 | 0.00 | 174.90 | 4.47 | 0.00 | 0.55 | 5.03 |
| 2014 | 28 | 3.73 | 0.15 | 1514.40 | 0.00 | 174.90 | 3.99 | 0.00 | 0.49 | 4.49 |
| 2015 | 29 | 3.73 | 0.13 | 1514.40 | 0.00 | 174.90 | 3.56 | 0.00 | 0.44 | 4.01 |
| 2016 | 30 | 3.73 | 0.12 | 1514.40 | 0.00 | 174.90 | 3.18 | 0.00 | 0.39 | 3.58 |
| 2017 | 31 | 3.73 | 0.11 | 1514.40 | 0.00 | 174.90 | 2.84 | 0.00 | 0.35 | 3.19 |
| 2018 | 32 | 3.73 | 0.09 | 1514.40 | 0.00 | 174.90 | 2.53 | 0.00 | 0.31 | 2.85 |
| 2019 | 33 | 3.73 | 0.08 | 1514.40 | 0.00 | 174.90 | 2.26 | 0.00 | 0.28 | 2.54 |
| 2020 | 34 | 3.73 | 0.07 | 1514.40 | 0.00 | 174.90 | 2.02 | 0.00 | 0.25 | 2.27 |
| 2021 | 35 | 3.73 | 0.07 | 1514.40 | 0.00 | 174.90 | 1.80 | 0.00 | 0.22 | 2.03 |
| 2022 | 36 | 3.73 | 0.06 | 1514.40 | 0.00 | 174.90 | 1.61 | 0.00 | 0.20 | 1.81 |
| 2023 | 37 | 3.73 | 0.05 | 1514.40 | 0.00 | 174.90 | 1.44 | 0.00 | 0.17 | 1.62 |
| 2024 | 38 | 3.73 | 0.05 | 1514.40 | 0.00 | 174.90 | 1.28 | 0.00 | 0.16 | 1.44 |
| 2025 | 39 | 3.73 | 0.04 | 1514.40 | 0.00 | 174.90 | 1.14 | 0.00 | 0.14 | 1.29 |
| 2026 | 40 | 3.73 | 0.04 | 1514.40 | 0.00 | 174.90 | 1.02 | 0.00 | 0.12 | 1.15 |
| 2027 | 41 | 3.73 | 0.03 | 1514.40 | 0.00 | 174.90 | 0.91 | 0.00 | 0.11 | 1.02 |
| 2028 | 42 | 3.73 | 0.03 | 1514.40 | 0.00 | 174.90 | 0.81 | 0.00 | 0.10 | 0.91 |
| 2029 | 43 | 3.73 | 0.02 | 1514.40 | 0.00 | 174.90 | 0.72 | 0.00 | 0.09 | 0.82 |
| 2030 | 44 | 3.73 | 0.02 | 1514.40 | 0.00 | 174.90 | 0.65 | 0.00 | 0.08 | 0.73 |
| 2031 | 45 | 3.73 | 0.02 | 1514.40 | 0.00 | 174.90 | 0.58 | 0.00 | 0.07 | 0.65 |
| 2032 | 46 | 3.73 | 0.02 | 1514.40 | 0.00 | 174.90 | 0.51 | 0.00 | 0.06 | 0.58 |
| 2033 | 47 | 3.73 | 0.01 | 1514.40 | 0.00 | 174.90 | 0.46 | 0.00 | 0.05 | 0.52 |
| 2034 | 48 | 3.73 | 0.01 | 1514.40 | 0.00 | 174.90 | 0.41 | 0.00 | 0.05 | 0.46 |
| 2035 | 49 | 3.73 | 0.01 | 1514.40 | 0.00 | 174.90 | 0.36 | 0.00 | 0.04 | 0.41 |
| 2036 | 50 | 3.73 | 0.01 | 1514.40 | 0.00 | 174.90 | 0.33 | 0.00 | 0.04 | 0.37 |
| 2037 | 51 | 3.73 | 0.01 | 1514.40 | 0.00 | 174.90 | 0.29 | 0.00 | 0.03 | 0.33 |
| 2038 | 52 | 3.73 | 0.01 | 1514.40 | 0.00 | 174.90 | 0.26 | 0.00 | 0.03 | 0.29 |
| 2039 | 53 | 3.73 | 0.00 | 1514.40 | 0.00 | 174.90 | 0.23 | 0.00 | 0.02 | 0.26 |
| 2040 | 54 | 3.73 | 0.00 | 1514.40 | 0.00 | 174.90 | 0.20 | 0.00 | 0.02 | 0.23 |
| 2041 | 55 | 3.73 | 0.00 | 1514.40 | 0.00 | 174.90 | 0.18 | 0.00 | 0.02 | 0.21 |
| 2042 | 56 | 3.73 | 0.00 | 1514.40 | 0.00 | 174.90 | 0.16 | 0.00 | 0.02 | 0.18 |
| 2043 | 57 | 3.73 | 0.00 | 1514.40 | 0.00 | 174.90 | 0.14 | 0.00 | 0.01 | 0.16 |
| Total | | 525.97 | 188.88 | | | | 183.96 | 10.41 | 33.82 | 228.20 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case - 1 - 80

Discount rate = 12(%)
 B = 242.02
 C = 193.17
 B/C = 1.252
 B-C = 48.85

S = 1
 kW Value B1 = 68 US\$/kW
 kWh Value B2 = 0.063 US\$/kWh
 kWh Value B3 = 0.005 US\$/kWh

C1 = 0.059009402
 C2 = 0.047048685
 C3 = 0.034799634

UNIT-Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|-------|---------------|-----------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|--------|
| | | | | Salable Energy (GWh/Yr) | Surplus Energy (GWh/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 22.77 | 14.47 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 43.60 | 24.73 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 64.18 | 32.51 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 105.08 | 47.53 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 53.59 | 21.64 | 179.00 | 980.70 | 52.00 | 4.55 | 1.98 | 1.42 | 7.96 |
| 1995 | 9 | 2.56 | 0.92 | 256.00 | 903.70 | 69.00 | 5.81 | 1.62 | 1.69 | 9.13 |
| 1996 | 10 | 2.56 | 0.82 | 333.00 | 826.70 | 86.10 | 6.75 | 1.33 | 1.88 | 9.97 |
| 1997 | 11 | 8.10 | 2.32 | 415.00 | 744.70 | 104.20 | 7.51 | 1.07 | 2.03 | 10.62 |
| 1998 | 12 | 13.70 | 3.51 | 500.00 | 659.70 | 123.20 | 8.08 | 0.84 | 2.15 | 11.08 |
| 1999 | 13 | 9.36 | 2.14 | 588.00 | 1133.60 | 143.00 | 8.48 | 1.29 | 2.22 | 12.01 |
| 2000 | 14 | 3.84 | 0.78 | 680.00 | 1041.60 | 163.70 | 8.76 | 1.06 | 2.27 | 12.10 |
| 2001 | 15 | 3.84 | 0.70 | 776.00 | 945.60 | 185.40 | 8.93 | 0.86 | 2.30 | 12.09 |
| 2002 | 16 | 3.84 | 0.62 | 876.00 | 845.60 | 201.00 | 9.00 | 0.68 | 2.22 | 11.92 |
| 2003 | 17 | 3.84 | 0.55 | 980.00 | 741.60 | 201.00 | 8.99 | 0.54 | 1.99 | 11.52 |
| 2004 | 18 | 3.84 | 0.49 | 1089.00 | 632.60 | 201.00 | 8.92 | 0.41 | 1.77 | 11.11 |
| 2005 | 19 | 3.84 | 0.44 | 1201.00 | 520.60 | 201.00 | 8.78 | 0.39 | 1.58 | 10.67 |
| 2006 | 20 | 3.84 | 0.39 | 1318.00 | 403.60 | 201.00 | 8.60 | 0.20 | 1.41 | 10.23 |
| 2007 | 21 | 3.84 | 0.35 | 1440.00 | 281.60 | 201.00 | 8.39 | 0.13 | 1.26 | 9.79 |
| 2008 | 22 | 3.84 | 0.31 | 1567.00 | 154.60 | 201.00 | 8.15 | 0.06 | 1.12 | 9.35 |
| 2009 | 23 | 3.84 | 0.28 | 1699.00 | 22.60 | 201.00 | 7.89 | 0.00 | 1.00 | 8.91 |
| 2010 | 24 | 3.84 | 0.25 | 1721.60 | 0.00 | 201.00 | 7.14 | 0.00 | 0.90 | 8.04 |
| 2011 | 25 | 3.84 | 0.22 | 1721.60 | 0.00 | 201.00 | 6.38 | 0.00 | 0.80 | 7.18 |
| 2012 | 26 | 3.84 | 0.20 | 1721.60 | 0.00 | 201.00 | 5.69 | 0.00 | 0.71 | 6.41 |
| 2013 | 27 | 3.84 | 0.18 | 1721.60 | 0.00 | 201.00 | 5.08 | 0.00 | 0.64 | 5.72 |
| 2014 | 28 | 3.84 | 0.16 | 1721.60 | 0.00 | 201.00 | 4.54 | 0.00 | 0.57 | 5.11 |
| 2015 | 29 | 3.84 | 0.14 | 1721.60 | 0.00 | 201.00 | 4.05 | 0.00 | 0.51 | 4.56 |
| 2016 | 30 | 3.84 | 0.12 | 1721.60 | 0.00 | 201.00 | 3.62 | 0.00 | 0.45 | 4.07 |
| 2017 | 31 | 3.84 | 0.11 | 1721.60 | 0.00 | 201.00 | 3.23 | 0.00 | 0.40 | 3.63 |
| 2018 | 32 | 3.84 | 0.10 | 1721.60 | 0.00 | 201.00 | 2.88 | 0.00 | 0.36 | 3.24 |
| 2019 | 33 | 3.84 | 0.09 | 1721.60 | 0.00 | 201.00 | 2.57 | 0.00 | 0.32 | 2.90 |
| 2020 | 34 | 3.84 | 0.08 | 1721.60 | 0.00 | 201.00 | 2.30 | 0.00 | 0.28 | 2.59 |
| 2021 | 35 | 3.84 | 0.07 | 1721.60 | 0.00 | 201.00 | 2.05 | 0.00 | 0.25 | 2.31 |
| 2022 | 36 | 3.84 | 0.06 | 1721.60 | 0.00 | 201.00 | 1.83 | 0.00 | 0.23 | 2.06 |
| 2023 | 37 | 3.84 | 0.05 | 1721.60 | 0.00 | 201.00 | 1.63 | 0.00 | 0.20 | 1.84 |
| 2024 | 38 | 3.84 | 0.05 | 1721.60 | 0.00 | 201.00 | 1.46 | 0.00 | 0.18 | 1.64 |
| 2025 | 39 | 3.84 | 0.04 | 1721.60 | 0.00 | 201.00 | 1.30 | 0.00 | 0.16 | 1.46 |
| 2026 | 40 | 3.84 | 0.04 | 1721.60 | 0.00 | 201.00 | 1.16 | 0.00 | 0.14 | 1.31 |
| 2027 | 41 | 3.84 | 0.03 | 1721.60 | 0.00 | 201.00 | 1.04 | 0.00 | 0.13 | 1.17 |
| 2028 | 42 | 3.84 | 0.03 | 1721.60 | 0.00 | 201.00 | 0.92 | 0.00 | 0.11 | 1.04 |
| 2029 | 43 | 3.84 | 0.02 | 1721.60 | 0.00 | 201.00 | 0.82 | 0.00 | 0.10 | 0.93 |
| 2030 | 44 | 3.84 | 0.02 | 1721.60 | 0.00 | 201.00 | 0.74 | 0.00 | 0.09 | 0.83 |
| 2031 | 45 | 3.84 | 0.02 | 1721.60 | 0.00 | 201.00 | 0.66 | 0.00 | 0.08 | 0.74 |
| 2032 | 46 | 3.84 | 0.02 | 1721.60 | 0.00 | 201.00 | 0.59 | 0.00 | 0.07 | 0.66 |
| 2033 | 47 | 3.84 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.52 | 0.00 | 0.06 | 0.59 |
| 2034 | 48 | 3.84 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.47 | 0.00 | 0.05 | 0.53 |
| 2035 | 49 | 3.84 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.42 | 0.00 | 0.05 | 0.47 |
| 2036 | 50 | 3.84 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.37 | 0.00 | 0.04 | 0.42 |
| 2037 | 51 | 3.84 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.33 | 0.00 | 0.04 | 0.37 |
| 2038 | 52 | 3.84 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.29 | 0.00 | 0.03 | 0.33 |
| 2039 | 53 | 3.84 | 0.00 | 1721.60 | 0.00 | 201.00 | 0.26 | 0.00 | 0.03 | 0.30 |
| 2040 | 54 | 3.84 | 0.00 | 1721.60 | 0.00 | 201.00 | 0.23 | 0.00 | 0.03 | 0.26 |
| 2041 | 55 | 3.84 | 0.00 | 1721.60 | 0.00 | 201.00 | 0.21 | 0.00 | 0.02 | 0.23 |
| 2042 | 56 | 3.84 | 0.00 | 1721.60 | 0.00 | 201.00 | 0.19 | 0.00 | 0.02 | 0.21 |
| 2043 | 57 | 3.84 | 0.00 | 1721.60 | 0.00 | 201.00 | 0.16 | 0.00 | 0.02 | 0.19 |
| Total | | 540.41 | 193.17 | | | | 192.95 | 12.44 | 36.63 | 242.02 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case- 1 - 90

Discount rate = 12(X)
 B = 250.57
 C = 202.27
 B/C = 1.238
 B C = 48.30

S = 1
 kW Value B1 = 68 US\$/kW
 kWh Value B2 = 0.063 US\$/kWh
 kWh Value B3 = 0.005 US\$/kWh

C1 = 0.060009441
 C2 = 0.047647882
 C3 = 0.034636752

UNIT: Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|--------------|---------------|---------------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|---------------|
| | | | | Salable Energy (GWh/Yr) | Surplus Energy (GWh/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 23.71 | 15.06 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 46.04 | 26.12 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 67.67 | 34.28 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 107.61 | 48.67 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 54.39 | 21.96 | 179.00 | 799.80 | 52.00 | 4.55 | 1.61 | 1.42 | 7.59 |
| 1995 | 9 | 6.96 | 2.50 | 256.00 | 722.80 | 69.00 | 5.81 | 1.30 | 1.69 | 8.81 |
| 1996 | 10 | 12.74 | 4.10 | 333.00 | 645.80 | 86.10 | 6.75 | 1.03 | 1.88 | 9.67 |
| 1997 | 11 | 8.56 | 2.46 | 415.00 | 1047.10 | 104.20 | 7.51 | 1.50 | 2.03 | 11.05 |
| 1998 | 12 | 7.98 | 2.04 | 500.00 | 962.10 | 123.20 | 8.08 | 1.23 | 2.15 | 11.47 |
| 1999 | 13 | 7.66 | 1.75 | 588.00 | 874.10 | 143.00 | 8.48 | 1.00 | 2.22 | 11.71 |
| 2000 | 14 | 5.49 | 1.12 | 680.00 | 1242.10 | 163.70 | 8.76 | 1.27 | 2.27 | 12.31 |
| 2001 | 15 | 4.08 | 0.74 | 776.00 | 1146.10 | 185.40 | 8.93 | 1.04 | 2.30 | 12.28 |
| 2002 | 16 | 4.08 | 0.66 | 876.00 | 1046.10 | 208.30 | 9.00 | 0.85 | 2.31 | 12.16 |
| 2003 | 17 | 4.08 | 0.59 | 980.00 | 942.10 | 224.80 | 8.99 | 0.68 | 2.22 | 11.90 |
| 2004 | 18 | 4.08 | 0.53 | 1089.00 | 833.10 | 224.80 | 8.92 | 0.54 | 1.98 | 11.45 |
| 2005 | 19 | 4.08 | 0.47 | 1201.00 | 721.10 | 224.80 | 8.78 | 0.41 | 1.77 | 10.97 |
| 2006 | 20 | 4.08 | 0.42 | 1318.00 | 604.10 | 224.80 | 8.60 | 0.31 | 1.58 | 10.50 |
| 2007 | 21 | 4.08 | 0.37 | 1440.00 | 482.10 | 224.80 | 8.39 | 0.22 | 1.41 | 10.03 |
| 2008 | 22 | 4.08 | 0.33 | 1567.00 | 355.10 | 224.80 | 8.15 | 0.14 | 1.26 | 9.56 |
| 2009 | 23 | 4.08 | 0.30 | 1699.00 | 223.10 | 224.80 | 7.89 | 0.08 | 1.12 | 9.10 |
| 2010 | 24 | 4.08 | 0.26 | 1837.00 | 85.10 | 224.80 | 7.62 | 0.02 | 1.00 | 8.65 |
| 2011 | 25 | 4.08 | 0.23 | 1863.20 | 58.90 | 224.80 | 6.90 | 0.01 | 0.89 | 7.82 |
| 2012 | 26 | 4.08 | 0.21 | 1863.20 | 58.90 | 224.80 | 6.16 | 0.01 | 0.80 | 6.98 |
| 2013 | 27 | 4.08 | 0.19 | 1863.20 | 58.90 | 224.80 | 5.50 | 0.01 | 0.71 | 6.23 |
| 2014 | 28 | 4.08 | 0.17 | 1863.20 | 58.90 | 224.80 | 4.91 | 0.01 | 0.64 | 5.56 |
| 2015 | 29 | 4.08 | 0.15 | 1863.20 | 58.90 | 224.80 | 4.38 | 0.01 | 0.57 | 4.97 |
| 2016 | 30 | 4.08 | 0.13 | 1863.20 | 58.90 | 224.80 | 3.91 | 0.00 | 0.51 | 4.43 |
| 2017 | 31 | 4.08 | 0.12 | 1863.20 | 58.90 | 224.80 | 3.49 | 0.00 | 0.45 | 3.96 |
| 2018 | 32 | 4.08 | 0.10 | 1863.20 | 58.90 | 224.80 | 3.12 | 0.00 | 0.40 | 3.53 |
| 2019 | 33 | 4.08 | 0.09 | 1863.20 | 58.90 | 224.80 | 2.78 | 0.00 | 0.36 | 3.15 |
| 2020 | 34 | 4.08 | 0.08 | 1863.20 | 58.90 | 224.80 | 2.48 | 0.00 | 0.32 | 2.82 |
| 2021 | 35 | 4.08 | 0.07 | 1863.20 | 58.90 | 224.80 | 2.22 | 0.00 | 0.28 | 2.51 |
| 2022 | 36 | 4.08 | 0.06 | 1863.20 | 58.90 | 224.80 | 1.98 | 0.00 | 0.25 | 2.24 |
| 2023 | 37 | 4.08 | 0.06 | 1863.20 | 58.90 | 224.80 | 1.77 | 0.00 | 0.23 | 2.00 |
| 2024 | 38 | 4.08 | 0.05 | 1863.20 | 58.90 | 224.80 | 1.58 | 0.00 | 0.20 | 1.79 |
| 2025 | 39 | 4.08 | 0.04 | 1863.20 | 58.90 | 224.80 | 1.41 | 0.00 | 0.18 | 1.60 |
| 2026 | 40 | 4.08 | 0.04 | 1863.20 | 58.90 | 224.80 | 1.26 | 0.00 | 0.16 | 1.42 |
| 2027 | 41 | 4.08 | 0.03 | 1863.20 | 58.90 | 224.80 | 1.12 | 0.00 | 0.14 | 1.27 |
| 2028 | 42 | 4.08 | 0.03 | 1863.20 | 58.90 | 224.80 | 1.00 | 0.00 | 0.13 | 1.13 |
| 2029 | 43 | 4.08 | 0.03 | 1863.20 | 58.90 | 224.80 | 0.89 | 0.00 | 0.11 | 1.01 |
| 2030 | 44 | 4.08 | 0.02 | 1863.20 | 58.90 | 224.80 | 0.80 | 0.00 | 0.10 | 0.90 |
| 2031 | 45 | 4.08 | 0.02 | 1863.20 | 58.90 | 224.80 | 0.71 | 0.00 | 0.09 | 0.81 |
| 2032 | 46 | 4.08 | 0.02 | 1863.20 | 58.90 | 224.80 | 0.63 | 0.00 | 0.08 | 0.72 |
| 2033 | 47 | 4.08 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.57 | 0.00 | 0.07 | 0.64 |
| 2034 | 48 | 4.08 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.50 | 0.00 | 0.06 | 0.57 |
| 2035 | 49 | 4.08 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.45 | 0.00 | 0.05 | 0.51 |
| 2036 | 50 | 4.08 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.40 | 0.00 | 0.05 | 0.46 |
| 2037 | 51 | 4.08 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.36 | 0.00 | 0.04 | 0.41 |
| 2038 | 52 | 4.08 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.32 | 0.00 | 0.04 | 0.36 |
| 2039 | 53 | 4.08 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.28 | 0.00 | 0.03 | 0.32 |
| 2040 | 54 | 4.08 | 0.00 | 1863.20 | 58.90 | 224.80 | 0.25 | 0.00 | 0.03 | 0.29 |
| 2041 | 55 | 4.08 | 0.00 | 1863.20 | 58.90 | 224.80 | 0.23 | 0.00 | 0.03 | 0.26 |
| 2042 | 56 | 4.08 | 0.00 | 1863.20 | 58.90 | 224.80 | 0.20 | 0.00 | 0.02 | 0.23 |
| 2043 | 57 | 4.08 | 0.00 | 1863.20 | 58.90 | 224.80 | 0.18 | 0.00 | 0.02 | 0.20 |
| Total | | 570.20 | 202.27 | | | | 198.21 | 13.46 | 38.89 | 250.57 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case- 1 - 100

Discount rate= 12(X)

B = 254.41 S = 1
 C = 210.45 kW Value B1= 68 US\$/kW CI= 0.062076650
 B/C= 1.208 kWh Value B2= 0.063 US\$/kWh C2= 0.049027168
 B C 43.96 kWh Value B3= 0.005 US\$/kWh C3= 0.034078518

UNIT: Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|-------|---------------|-----------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|--------|
| | | | | Salable Energy (GWH/Yr) | Surplus Energy (GWH/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 24.35 | 15.47 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 48.02 | 27.24 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 71.04 | 35.99 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 111.03 | 50.22 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 55.90 | 22.57 | 179.00 | 908.50 | 52.00 | 4.55 | 1.83 | 1.42 | 7.81 |
| 1995 | 9 | 2.21 | 0.79 | 256.00 | 831.50 | 69.00 | 5.81 | 1.49 | 1.69 | 9.00 |
| 1996 | 10 | 7.29 | 2.34 | 333.00 | 754.50 | 86.10 | 6.75 | 1.21 | 1.88 | 9.85 |
| 1997 | 11 | 13.00 | 3.73 | 415.00 | 672.50 | 104.20 | 7.51 | 0.96 | 2.03 | 10.51 |
| 1998 | 12 | 8.93 | 2.29 | 500.00 | 1118.50 | 123.20 | 8.08 | 1.43 | 2.15 | 11.67 |
| 1999 | 13 | 8.39 | 1.92 | 588.00 | 1030.50 | 143.00 | 8.48 | 1.18 | 2.22 | 11.89 |
| 2000 | 14 | 17.82 | 3.64 | 680.00 | 938.50 | 163.70 | 8.76 | 0.96 | 2.27 | 12.00 |
| 2001 | 15 | 12.55 | 2.29 | 776.00 | 1330.20 | 185.40 | 8.93 | 1.21 | 2.30 | 12.45 |
| 2002 | 16 | 4.41 | 0.71 | 876.00 | 1230.20 | 208.30 | 9.00 | 1.00 | 2.31 | 12.31 |
| 2003 | 17 | 4.41 | 0.64 | 980.00 | 1126.10 | 232.30 | 8.99 | 0.82 | 2.30 | 12.11 |
| 2004 | 18 | 4.41 | 0.57 | 1089.00 | 1017.20 | 250.40 | 8.92 | 0.66 | 2.21 | 11.79 |
| 2005 | 19 | 4.41 | 0.51 | 1201.00 | 905.20 | 250.40 | 8.78 | 0.52 | 1.97 | 11.28 |
| 2006 | 20 | 4.41 | 0.45 | 1318.00 | 788.20 | 250.40 | 8.60 | 0.40 | 1.76 | 10.78 |
| 2007 | 21 | 4.41 | 0.40 | 1440.00 | 666.20 | 250.40 | 8.39 | 0.30 | 1.57 | 10.28 |
| 2008 | 22 | 4.41 | 0.36 | 1567.00 | 539.20 | 250.40 | 8.15 | 0.22 | 1.40 | 9.78 |
| 2009 | 23 | 4.41 | 0.32 | 1699.00 | 407.20 | 250.40 | 7.89 | 0.15 | 1.25 | 9.30 |
| 2010 | 24 | 4.41 | 0.29 | 1837.00 | 269.20 | 250.40 | 7.62 | 0.08 | 1.12 | 8.83 |
| 2011 | 25 | 4.41 | 0.25 | 1863.20 | 243.00 | 250.40 | 6.90 | 0.07 | 1.00 | 7.97 |
| 2012 | 26 | 4.41 | 0.23 | 1863.20 | 243.00 | 250.40 | 6.16 | 0.06 | 0.89 | 7.12 |
| 2013 | 27 | 4.41 | 0.20 | 1863.20 | 243.00 | 250.40 | 5.50 | 0.05 | 0.79 | 6.35 |
| 2014 | 28 | 4.41 | 0.18 | 1863.20 | 243.00 | 250.40 | 4.91 | 0.05 | 0.71 | 5.67 |
| 2015 | 29 | 4.41 | 0.16 | 1863.20 | 243.00 | 250.40 | 4.38 | 0.04 | 0.63 | 5.07 |
| 2016 | 30 | 4.41 | 0.14 | 1863.20 | 243.00 | 250.40 | 3.91 | 0.04 | 0.56 | 4.52 |
| 2017 | 31 | 4.41 | 0.13 | 1863.20 | 243.00 | 250.40 | 3.49 | 0.03 | 0.50 | 4.04 |
| 2018 | 32 | 4.41 | 0.11 | 1863.20 | 243.00 | 250.40 | 3.12 | 0.03 | 0.45 | 3.60 |
| 2019 | 33 | 4.41 | 0.10 | 1863.20 | 243.00 | 250.40 | 2.78 | 0.02 | 0.40 | 3.22 |
| 2020 | 34 | 4.41 | 0.09 | 1863.20 | 243.00 | 250.40 | 2.48 | 0.02 | 0.36 | 2.87 |
| 2021 | 35 | 4.41 | 0.08 | 1863.20 | 243.00 | 250.40 | 2.22 | 0.02 | 0.32 | 2.56 |
| 2022 | 36 | 4.41 | 0.07 | 1863.20 | 243.00 | 250.40 | 1.98 | 0.02 | 0.28 | 2.29 |
| 2023 | 37 | 4.41 | 0.06 | 1863.20 | 243.00 | 250.40 | 1.77 | 0.01 | 0.25 | 2.04 |
| 2024 | 38 | 4.41 | 0.05 | 1863.20 | 243.00 | 250.40 | 1.58 | 0.01 | 0.22 | 1.82 |
| 2025 | 39 | 4.41 | 0.05 | 1863.20 | 243.00 | 250.40 | 1.41 | 0.01 | 0.20 | 1.63 |
| 2026 | 40 | 4.41 | 0.04 | 1863.20 | 243.00 | 250.40 | 1.26 | 0.01 | 0.18 | 1.45 |
| 2027 | 41 | 4.41 | 0.04 | 1863.20 | 243.00 | 250.40 | 1.12 | 0.01 | 0.16 | 1.30 |
| 2028 | 42 | 4.41 | 0.03 | 1863.20 | 243.00 | 250.40 | 1.00 | 0.01 | 0.14 | 1.16 |
| 2029 | 43 | 4.41 | 0.03 | 1863.20 | 243.00 | 250.40 | 0.89 | 0.00 | 0.13 | 1.03 |
| 2030 | 44 | 4.41 | 0.03 | 1863.20 | 243.00 | 250.40 | 0.80 | 0.00 | 0.11 | 0.92 |
| 2031 | 45 | 4.41 | 0.02 | 1863.20 | 243.00 | 250.40 | 0.71 | 0.00 | 0.10 | 0.82 |
| 2032 | 46 | 4.41 | 0.02 | 1863.20 | 243.00 | 250.40 | 0.63 | 0.00 | 0.09 | 0.73 |
| 2033 | 47 | 4.41 | 0.02 | 1863.20 | 243.00 | 250.40 | 0.57 | 0.00 | 0.08 | 0.65 |
| 2034 | 48 | 4.41 | 0.01 | 1863.20 | 243.00 | 250.40 | 0.50 | 0.00 | 0.07 | 0.58 |
| 2035 | 49 | 4.41 | 0.01 | 1863.20 | 243.00 | 250.40 | 0.45 | 0.00 | 0.06 | 0.52 |
| 2036 | 50 | 4.41 | 0.01 | 1863.20 | 243.00 | 250.40 | 0.40 | 0.00 | 0.05 | 0.46 |
| 2037 | 51 | 4.41 | 0.01 | 1863.20 | 243.00 | 250.40 | 0.36 | 0.00 | 0.05 | 0.41 |
| 2038 | 52 | 4.41 | 0.01 | 1863.20 | 243.00 | 250.40 | 0.32 | 0.00 | 0.04 | 0.37 |
| 2039 | 53 | 4.41 | 0.01 | 1863.20 | 243.00 | 250.40 | 0.28 | 0.00 | 0.04 | 0.33 |
| 2040 | 54 | 4.41 | 0.00 | 1863.20 | 243.00 | 250.40 | 0.25 | 0.00 | 0.03 | 0.29 |
| 2041 | 55 | 4.41 | 0.00 | 1863.20 | 243.00 | 250.40 | 0.23 | 0.00 | 0.03 | 0.26 |
| 2042 | 56 | 4.41 | 0.00 | 1863.20 | 243.00 | 250.40 | 0.20 | 0.00 | 0.02 | 0.23 |
| 2043 | 57 | 4.41 | 0.00 | 1863.20 | 243.00 | 250.40 | 0.18 | 0.00 | 0.02 | 0.21 |
| Total | | 611.70 | 210.45 | | | | 198.21 | 15.14 | 41.05 | 254.41 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case- 1-80-830

Discount rate= 12(%)

B = 238.07
C = 189.49
B/C = 1.256
R C = 48.58

S = 1
kW Value B1= 68 US\$/kW
kWh Value B2= 0.063 US\$/kWh
kWh Value B3= 0.005 US\$/kWh

C1= 0.058803134
C2= 0.046933589
C3= 0.035365278

UNIT: Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|-------|---------------|-----------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|--------|
| | | | | Salable Energy (GWH/Yr) | Surplus Energy (GWH/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 21.96 | 13.95 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 41.11 | 23.32 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 61.59 | 31.20 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 103.28 | 46.71 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 52.61 | 21.24 | 179.00 | 940.40 | 52.00 | 4.55 | 1.89 | 1.42 | 7.88 |
| 1995 | 9 | 2.51 | 0.90 | 256.00 | 863.40 | 69.00 | 5.81 | 1.55 | 1.69 | 9.06 |
| 1996 | 10 | 8.01 | 2.57 | 333.00 | 786.40 | 86.10 | 6.75 | 1.26 | 1.88 | 9.90 |
| 1997 | 11 | 13.61 | 3.91 | 415.00 | 704.40 | 104.20 | 7.51 | 1.01 | 2.03 | 10.56 |
| 1998 | 12 | 9.27 | 2.37 | 500.00 | 619.40 | 123.20 | 8.08 | 0.79 | 2.15 | 11.03 |
| 1999 | 13 | 3.77 | 0.86 | 588.00 | 1073.80 | 143.00 | 8.48 | 1.23 | 2.22 | 11.94 |
| 2000 | 14 | 3.77 | 0.77 | 680.00 | 981.80 | 163.70 | 8.76 | 1.00 | 2.27 | 12.04 |
| 2001 | 15 | 3.77 | 0.68 | 776.00 | 885.80 | 185.40 | 8.93 | 0.80 | 2.30 | 12.04 |
| 2002 | 16 | 3.77 | 0.61 | 876.00 | 785.80 | 193.80 | 9.00 | 0.64 | 2.14 | 11.79 |
| 2003 | 17 | 3.77 | 0.54 | 980.00 | 681.80 | 193.80 | 8.99 | 0.49 | 1.91 | 11.40 |
| 2004 | 18 | 3.77 | 0.49 | 1089.00 | 572.80 | 193.80 | 8.92 | 0.37 | 1.71 | 11.00 |
| 2005 | 19 | 3.77 | 0.43 | 1201.00 | 460.80 | 193.80 | 8.78 | 0.26 | 1.53 | 10.58 |
| 2006 | 20 | 3.77 | 0.39 | 1318.00 | 343.80 | 193.80 | 8.60 | 0.17 | 1.36 | 10.15 |
| 2007 | 21 | 3.77 | 0.34 | 1440.00 | 221.80 | 193.80 | 8.39 | 0.10 | 1.21 | 9.71 |
| 2008 | 22 | 3.77 | 0.31 | 1567.00 | 94.80 | 193.80 | 8.15 | 0.03 | 1.08 | 9.28 |
| 2009 | 23 | 3.77 | 0.27 | 1661.80 | 0.00 | 193.80 | 7.72 | 0.00 | 0.97 | 8.69 |
| 2010 | 24 | 3.77 | 0.24 | 1661.80 | 0.00 | 193.80 | 6.89 | 0.00 | 0.86 | 7.76 |
| 2011 | 25 | 3.77 | 0.22 | 1661.80 | 0.00 | 193.80 | 6.15 | 0.00 | 0.77 | 6.93 |
| 2012 | 26 | 3.77 | 0.19 | 1661.80 | 0.00 | 193.80 | 5.49 | 0.00 | 0.69 | 6.19 |
| 2013 | 27 | 3.77 | 0.17 | 1661.80 | 0.00 | 193.80 | 4.90 | 0.00 | 0.61 | 5.52 |
| 2014 | 28 | 3.77 | 0.15 | 1661.80 | 0.00 | 193.80 | 4.38 | 0.00 | 0.55 | 4.93 |
| 2015 | 29 | 3.77 | 0.14 | 1661.80 | 0.00 | 193.80 | 3.91 | 0.00 | 0.49 | 4.40 |
| 2016 | 30 | 3.77 | 0.12 | 1661.80 | 0.00 | 193.80 | 3.49 | 0.00 | 0.43 | 3.93 |
| 2017 | 31 | 3.77 | 0.11 | 1661.80 | 0.00 | 193.80 | 3.12 | 0.00 | 0.39 | 3.51 |
| 2018 | 32 | 3.77 | 0.10 | 1661.80 | 0.00 | 193.80 | 2.78 | 0.00 | 0.35 | 3.13 |
| 2019 | 33 | 3.77 | 0.08 | 1661.80 | 0.00 | 193.80 | 2.48 | 0.00 | 0.31 | 2.80 |
| 2020 | 34 | 3.77 | 0.07 | 1661.80 | 0.00 | 193.80 | 2.22 | 0.00 | 0.27 | 2.50 |
| 2021 | 35 | 3.77 | 0.07 | 1661.80 | 0.00 | 193.80 | 1.98 | 0.00 | 0.24 | 2.23 |
| 2022 | 36 | 3.77 | 0.06 | 1661.80 | 0.00 | 193.80 | 1.77 | 0.00 | 0.22 | 1.99 |
| 2023 | 37 | 3.77 | 0.05 | 1661.80 | 0.00 | 193.80 | 1.58 | 0.00 | 0.19 | 1.77 |
| 2024 | 38 | 3.77 | 0.05 | 1661.80 | 0.00 | 193.80 | 1.41 | 0.00 | 0.17 | 1.58 |
| 2025 | 39 | 3.77 | 0.04 | 1661.80 | 0.00 | 193.80 | 1.26 | 0.00 | 0.15 | 1.41 |
| 2026 | 40 | 3.77 | 0.04 | 1661.80 | 0.00 | 193.80 | 1.12 | 0.00 | 0.14 | 1.26 |
| 2027 | 41 | 3.77 | 0.03 | 1661.80 | 0.00 | 193.80 | 1.00 | 0.00 | 0.12 | 1.13 |
| 2028 | 42 | 3.77 | 0.03 | 1661.80 | 0.00 | 193.80 | 0.89 | 0.00 | 0.11 | 1.00 |
| 2029 | 43 | 3.77 | 0.02 | 1661.80 | 0.00 | 193.80 | 0.80 | 0.00 | 0.10 | 0.90 |
| 2030 | 44 | 3.77 | 0.02 | 1661.80 | 0.00 | 193.80 | 0.71 | 0.00 | 0.09 | 0.80 |
| 2031 | 45 | 3.77 | 0.02 | 1661.80 | 0.00 | 193.80 | 0.63 | 0.00 | 0.08 | 0.71 |
| 2032 | 46 | 3.77 | 0.02 | 1661.80 | 0.00 | 193.80 | 0.57 | 0.00 | 0.07 | 0.64 |
| 2033 | 47 | 3.77 | 0.01 | 1661.80 | 0.00 | 193.80 | 0.50 | 0.00 | 0.06 | 0.57 |
| 2034 | 48 | 3.77 | 0.01 | 1661.80 | 0.00 | 193.80 | 0.45 | 0.00 | 0.05 | 0.51 |
| 2035 | 49 | 3.77 | 0.01 | 1661.80 | 0.00 | 193.80 | 0.40 | 0.00 | 0.05 | 0.45 |
| 2036 | 50 | 3.77 | 0.01 | 1661.80 | 0.00 | 193.80 | 0.36 | 0.00 | 0.04 | 0.40 |
| 2037 | 51 | 3.77 | 0.01 | 1661.80 | 0.00 | 193.80 | 0.32 | 0.00 | 0.04 | 0.36 |
| 2038 | 52 | 3.77 | 0.01 | 1661.80 | 0.00 | 193.80 | 0.28 | 0.00 | 0.03 | 0.32 |
| 2039 | 53 | 3.77 | 0.00 | 1661.80 | 0.00 | 193.80 | 0.25 | 0.00 | 0.03 | 0.29 |
| 2040 | 54 | 3.77 | 0.00 | 1661.80 | 0.00 | 193.80 | 0.23 | 0.00 | 0.02 | 0.25 |
| 2041 | 55 | 3.77 | 0.00 | 1661.80 | 0.00 | 193.80 | 0.20 | 0.00 | 0.02 | 0.23 |
| 2042 | 56 | 3.77 | 0.00 | 1661.80 | 0.00 | 193.80 | 0.18 | 0.00 | 0.02 | 0.20 |
| 2043 | 57 | 3.77 | 0.00 | 1661.80 | 0.00 | 193.80 | 0.16 | 0.00 | 0.02 | 0.18 |
| Total | | 529.55 | 189.49 | | | | 190.51 | 11.67 | 35.89 | 238.07 |

C1: average net cost of useful salable energy and capacity
C2: average net cost of useful salable energy
C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case- 1-80-855

Discount rate 12(%)
 B = 247.61
 C = 205.53
 B/C = 1.204
 B-C = 42.08

S = 1
 kW Value B1 = 68 US\$/kW
 kWh Value B2 = 0.063 US\$/kWh
 kWh Value B3 = 0.005 US\$/kWh

C1 = 0.061575991
 C2 = 0.049496865
 C3 = 0.035193049

UNIT: Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|-------|---------------|-----------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|--------|
| | | | | Salable Energy (GWh/Yr) | Surplus Energy (GWh/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 24.51 | 15.57 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 49.64 | 28.16 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 71.00 | 35.97 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 110.37 | 49.92 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 56.68 | 22.89 | 179.00 | 1041.10 | 52.00 | 4.55 | 2.10 | 1.42 | 8.08 |
| 1995 | 9 | 2.70 | 0.97 | 256.00 | 964.10 | 69.00 | 5.81 | 1.73 | 1.69 | 9.24 |
| 1996 | 10 | 2.70 | 0.86 | 333.00 | 887.10 | 86.10 | 6.75 | 1.42 | 1.88 | 10.06 |
| 1997 | 11 | 8.42 | 2.42 | 415.00 | 805.10 | 104.20 | 7.51 | 1.15 | 2.03 | 10.71 |
| 1998 | 12 | 14.01 | 3.59 | 500.00 | 720.10 | 123.20 | 8.08 | 0.92 | 2.15 | 11.15 |
| 1999 | 13 | 9.65 | 2.21 | 588.00 | 1223.30 | 143.00 | 8.48 | 1.40 | 2.22 | 12.11 |
| 2000 | 14 | 4.05 | 0.82 | 680.00 | 1131.30 | 163.70 | 8.76 | 1.15 | 2.27 | 12.20 |
| 2001 | 15 | 4.05 | 0.73 | 776.00 | 1035.30 | 185.40 | 8.93 | 0.94 | 2.30 | 12.18 |
| 2002 | 16 | 4.05 | 0.66 | 876.00 | 935.30 | 208.30 | 9.00 | 0.76 | 2.31 | 12.07 |
| 2003 | 17 | 4.05 | 0.58 | 980.00 | 831.30 | 211.20 | 8.99 | 0.60 | 2.09 | 11.68 |
| 2004 | 18 | 4.05 | 0.52 | 1089.00 | 722.30 | 211.20 | 8.92 | 0.46 | 1.86 | 11.25 |
| 2005 | 19 | 4.05 | 0.47 | 1201.00 | 610.30 | 211.20 | 8.78 | 0.35 | 1.66 | 10.80 |
| 2006 | 20 | 4.05 | 0.41 | 1318.00 | 493.30 | 211.20 | 8.60 | 0.25 | 1.48 | 10.35 |
| 2007 | 21 | 4.05 | 0.37 | 1440.00 | 371.30 | 211.20 | 8.39 | 0.17 | 1.32 | 9.89 |
| 2008 | 22 | 4.05 | 0.33 | 1567.00 | 244.30 | 211.20 | 8.15 | 0.10 | 1.18 | 9.44 |
| 2009 | 23 | 4.05 | 0.29 | 1699.00 | 112.30 | 211.20 | 7.89 | 0.04 | 1.05 | 8.99 |
| 2010 | 24 | 4.05 | 0.26 | 1811.30 | 0.00 | 211.20 | 7.51 | 0.00 | 0.94 | 8.46 |
| 2011 | 25 | 4.05 | 0.23 | 1811.30 | 0.00 | 211.20 | 6.71 | 0.00 | 0.84 | 7.55 |
| 2012 | 26 | 4.05 | 0.21 | 1811.30 | 0.00 | 211.20 | 5.99 | 0.00 | 0.75 | 6.74 |
| 2013 | 27 | 4.05 | 0.18 | 1811.30 | 0.00 | 211.20 | 5.35 | 0.00 | 0.67 | 6.02 |
| 2014 | 28 | 4.05 | 0.16 | 1811.30 | 0.00 | 211.20 | 4.77 | 0.00 | 0.60 | 5.37 |
| 2015 | 29 | 4.05 | 0.15 | 1811.30 | 0.00 | 211.20 | 4.26 | 0.00 | 0.53 | 4.80 |
| 2016 | 30 | 4.05 | 0.13 | 1811.30 | 0.00 | 211.20 | 3.80 | 0.00 | 0.47 | 4.28 |
| 2017 | 31 | 4.05 | 0.12 | 1811.30 | 0.00 | 211.20 | 3.40 | 0.00 | 0.42 | 3.82 |
| 2018 | 32 | 4.05 | 0.10 | 1811.30 | 0.00 | 211.20 | 3.03 | 0.00 | 0.38 | 3.41 |
| 2019 | 33 | 4.05 | 0.09 | 1811.30 | 0.00 | 211.20 | 2.71 | 0.00 | 0.34 | 3.05 |
| 2020 | 34 | 4.05 | 0.08 | 1811.30 | 0.00 | 211.20 | 2.42 | 0.00 | 0.30 | 2.72 |
| 2021 | 35 | 4.05 | 0.07 | 1811.30 | 0.00 | 211.20 | 2.16 | 0.00 | 0.27 | 2.43 |
| 2022 | 36 | 4.05 | 0.06 | 1811.30 | 0.00 | 211.20 | 1.92 | 0.00 | 0.24 | 2.17 |
| 2023 | 37 | 4.05 | 0.06 | 1811.30 | 0.00 | 211.20 | 1.72 | 0.00 | 0.21 | 1.93 |
| 2024 | 38 | 4.05 | 0.05 | 1811.30 | 0.00 | 211.20 | 1.53 | 0.00 | 0.19 | 1.73 |
| 2025 | 39 | 4.05 | 0.04 | 1811.30 | 0.00 | 211.20 | 1.37 | 0.00 | 0.17 | 1.54 |
| 2026 | 40 | 4.05 | 0.04 | 1811.30 | 0.00 | 211.20 | 1.22 | 0.00 | 0.15 | 1.38 |
| 2027 | 41 | 4.05 | 0.03 | 1811.30 | 0.00 | 211.20 | 1.09 | 0.00 | 0.13 | 1.23 |
| 2028 | 42 | 4.05 | 0.03 | 1811.30 | 0.00 | 211.20 | 0.97 | 0.00 | 0.12 | 1.10 |
| 2029 | 43 | 4.05 | 0.03 | 1811.30 | 0.00 | 211.20 | 0.87 | 0.00 | 0.10 | 0.98 |
| 2030 | 44 | 4.05 | 0.02 | 1811.30 | 0.00 | 211.20 | 0.77 | 0.00 | 0.09 | 0.87 |
| 2031 | 45 | 4.05 | 0.02 | 1811.30 | 0.00 | 211.20 | 0.69 | 0.00 | 0.08 | 0.78 |
| 2032 | 46 | 4.05 | 0.02 | 1811.30 | 0.00 | 211.20 | 0.62 | 0.00 | 0.07 | 0.69 |
| 2033 | 47 | 4.05 | 0.01 | 1811.30 | 0.00 | 211.20 | 0.55 | 0.00 | 0.06 | 0.62 |
| 2034 | 48 | 4.05 | 0.01 | 1811.30 | 0.00 | 211.20 | 0.49 | 0.00 | 0.06 | 0.55 |
| 2035 | 49 | 4.05 | 0.01 | 1811.30 | 0.00 | 211.20 | 0.44 | 0.00 | 0.05 | 0.49 |
| 2036 | 50 | 4.05 | 0.01 | 1811.30 | 0.00 | 211.20 | 0.39 | 0.00 | 0.04 | 0.44 |
| 2037 | 51 | 4.05 | 0.01 | 1811.30 | 0.00 | 211.20 | 0.35 | 0.00 | 0.04 | 0.39 |
| 2038 | 52 | 4.05 | 0.01 | 1811.30 | 0.00 | 211.20 | 0.31 | 0.00 | 0.03 | 0.35 |
| 2039 | 53 | 4.05 | 0.00 | 1811.30 | 0.00 | 211.20 | 0.28 | 0.00 | 0.03 | 0.31 |
| 2040 | 54 | 4.05 | 0.00 | 1811.30 | 0.00 | 211.20 | 0.25 | 0.00 | 0.03 | 0.28 |
| 2041 | 55 | 4.05 | 0.00 | 1811.30 | 0.00 | 211.20 | 0.22 | 0.00 | 0.02 | 0.25 |
| 2042 | 56 | 4.05 | 0.00 | 1811.30 | 0.00 | 211.20 | 0.20 | 0.00 | 0.02 | 0.22 |
| 2043 | 57 | 4.05 | 0.00 | 1811.30 | 0.00 | 211.20 | 0.17 | 0.00 | 0.02 | 0.20 |
| Total | | 573.83 | 205.53 | | | | 196.35 | 13.61 | 37.64 | 247.61 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method.

Case- 1 -80-875

Discount rate 12(%)
 B = 252.63
 C = 236.63
 B/C = 1.067
 B-C = 16.00

S = 1
 kW Value B1 = 68 US\$/kW
 kWh Value B2 = 0.063 US\$/kWh
 kWh Value B3 = 0.005 US\$/kWh

C1 = 0.070158249
 C2 = 0.057971944
 C3 = 0.040429358

UNIT-Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost. Flow | Project Sales | | | Discounted Benefit Flow | | | |
|--------------|---------------|---------------|-----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|---------------|
| | | | | Salable Energy (GWH/Yr) | Surplus Energy (GWH/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 29.60 | 18.81 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 65.09 | 36.93 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 86.55 | 43.84 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 120.37 | 54.44 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 61.75 | 24.93 | 179.00 | 796.80 | 52.00 | 4.55 | 1.60 | 1.42 | 7.59 |
| 1995 | 9 | 7.22 | 2.60 | 256.00 | 719.80 | 69.00 | 5.81 | 1.29 | 1.69 | 8.80 |
| 1996 | 10 | 13.00 | 4.18 | 333.00 | 642.80 | 86.10 | 6.75 | 1.03 | 1.88 | 9.67 |
| 1997 | 11 | 8.95 | 2.57 | 415.00 | 1046.90 | 104.20 | 7.51 | 1.50 | 2.03 | 11.05 |
| 1998 | 12 | 8.37 | 2.14 | 500.00 | 961.90 | 123.20 | 8.08 | 1.23 | 2.15 | 11.47 |
| 1999 | 13 | 8.05 | 1.84 | 588.00 | 873.90 | 143.00 | 8.48 | 1.00 | 2.22 | 11.71 |
| 2000 | 14 | 6.07 | 1.24 | 680.00 | 1250.80 | 163.70 | 8.76 | 1.27 | 2.27 | 12.32 |
| 2001 | 15 | 4.61 | 0.84 | 776.00 | 1154.80 | 185.40 | 8.93 | 1.05 | 2.30 | 12.28 |
| 2002 | 16 | 4.61 | 0.75 | 876.00 | 1054.80 | 208.30 | 9.00 | 0.86 | 2.31 | 12.17 |
| 2003 | 17 | 4.61 | 0.67 | 980.00 | 950.80 | 223.60 | 8.99 | 0.69 | 2.21 | 11.89 |
| 2004 | 18 | 4.61 | 0.59 | 1089.00 | 841.80 | 223.60 | 8.92 | 0.54 | 1.97 | 11.44 |
| 2005 | 19 | 4.61 | 0.53 | 1201.00 | 729.80 | 223.60 | 8.78 | 0.42 | 1.76 | 10.97 |
| 2006 | 20 | 4.61 | 0.47 | 1318.00 | 612.80 | 223.60 | 8.60 | 0.31 | 1.57 | 10.50 |
| 2007 | 21 | 4.61 | 0.42 | 1440.00 | 490.80 | 223.60 | 8.39 | 0.22 | 1.40 | 10.03 |
| 2008 | 22 | 4.61 | 0.38 | 1567.00 | 363.80 | 223.60 | 8.15 | 0.15 | 1.25 | 9.56 |
| 2009 | 23 | 4.61 | 0.34 | 1699.00 | 231.80 | 223.60 | 7.89 | 0.08 | 1.12 | 9.10 |
| 2010 | 24 | 4.61 | 0.30 | 1837.00 | 93.80 | 223.60 | 7.62 | 0.03 | 1.00 | 8.65 |
| 2011 | 25 | 4.61 | 0.27 | 1930.80 | 0.00 | 223.60 | 7.15 | 0.00 | 0.89 | 8.04 |
| 2012 | 26 | 4.61 | 0.24 | 1930.80 | 0.00 | 223.60 | 6.38 | 0.00 | 0.79 | 7.18 |
| 2013 | 27 | 4.61 | 0.21 | 1930.80 | 0.00 | 223.60 | 5.70 | 0.00 | 0.71 | 6.41 |
| 2014 | 28 | 4.61 | 0.19 | 1930.80 | 0.00 | 223.60 | 5.09 | 0.00 | 0.63 | 5.72 |
| 2015 | 29 | 4.61 | 0.17 | 1930.80 | 0.00 | 223.60 | 4.54 | 0.00 | 0.56 | 5.11 |
| 2016 | 30 | 4.61 | 0.15 | 1930.80 | 0.00 | 223.60 | 4.06 | 0.00 | 0.50 | 4.56 |
| 2017 | 31 | 4.61 | 0.13 | 1930.80 | 0.00 | 223.60 | 3.62 | 0.00 | 0.45 | 4.07 |
| 2018 | 32 | 4.61 | 0.12 | 1930.80 | 0.00 | 223.60 | 3.23 | 0.00 | 0.40 | 3.64 |
| 2019 | 33 | 4.61 | 0.10 | 1930.80 | 0.00 | 223.60 | 2.88 | 0.00 | 0.36 | 3.25 |
| 2020 | 34 | 4.61 | 0.09 | 1930.80 | 0.00 | 223.60 | 2.58 | 0.00 | 0.32 | 2.90 |
| 2021 | 35 | 4.61 | 0.08 | 1930.80 | 0.00 | 223.60 | 2.30 | 0.00 | 0.28 | 2.59 |
| 2022 | 36 | 4.61 | 0.07 | 1930.80 | 0.00 | 223.60 | 2.05 | 0.00 | 0.25 | 2.31 |
| 2023 | 37 | 4.61 | 0.06 | 1930.80 | 0.00 | 223.60 | 1.83 | 0.00 | 0.22 | 2.06 |
| 2024 | 38 | 4.61 | 0.06 | 1930.80 | 0.00 | 223.60 | 1.63 | 0.00 | 0.20 | 1.84 |
| 2025 | 39 | 4.61 | 0.05 | 1930.80 | 0.00 | 223.60 | 1.46 | 0.00 | 0.18 | 1.64 |
| 2026 | 40 | 4.61 | 0.04 | 1930.80 | 0.00 | 223.60 | 1.30 | 0.00 | 0.16 | 1.47 |
| 2027 | 41 | 4.61 | 0.04 | 1930.80 | 0.00 | 223.60 | 1.16 | 0.00 | 0.14 | 1.31 |
| 2028 | 42 | 4.61 | 0.03 | 1930.80 | 0.00 | 223.60 | 1.04 | 0.00 | 0.13 | 1.17 |
| 2029 | 43 | 4.61 | 0.03 | 1930.80 | 0.00 | 223.60 | 0.93 | 0.00 | 0.11 | 1.04 |
| 2030 | 44 | 4.61 | 0.03 | 1930.80 | 0.00 | 223.60 | 0.83 | 0.00 | 0.10 | 0.93 |
| 2031 | 45 | 4.61 | 0.02 | 1930.80 | 0.00 | 223.60 | 0.74 | 0.00 | 0.09 | 0.83 |
| 2032 | 46 | 4.61 | 0.02 | 1930.80 | 0.00 | 223.60 | 0.66 | 0.00 | 0.08 | 0.74 |
| 2033 | 47 | 4.61 | 0.02 | 1930.80 | 0.00 | 223.60 | 0.59 | 0.00 | 0.07 | 0.66 |
| 2034 | 48 | 4.61 | 0.02 | 1930.80 | 0.00 | 223.60 | 0.52 | 0.00 | 0.06 | 0.59 |
| 2035 | 49 | 4.61 | 0.01 | 1930.80 | 0.00 | 223.60 | 0.47 | 0.00 | 0.05 | 0.53 |
| 2036 | 50 | 4.61 | 0.01 | 1930.80 | 0.00 | 223.60 | 0.42 | 0.00 | 0.05 | 0.47 |
| 2037 | 51 | 4.61 | 0.01 | 1930.80 | 0.00 | 223.60 | 0.37 | 0.00 | 0.04 | 0.42 |
| 2038 | 52 | 4.61 | 0.01 | 1930.80 | 0.00 | 223.60 | 0.33 | 0.00 | 0.04 | 0.37 |
| 2039 | 53 | 4.61 | 0.01 | 1930.80 | 0.00 | 223.60 | 0.29 | 0.00 | 0.03 | 0.33 |
| 2040 | 54 | 4.61 | 0.01 | 1930.80 | 0.00 | 223.60 | 0.26 | 0.00 | 0.03 | 0.30 |
| 2041 | 55 | 4.61 | 0.00 | 1930.80 | 0.00 | 223.60 | 0.23 | 0.00 | 0.02 | 0.26 |
| 2042 | 56 | 4.61 | 0.00 | 1930.80 | 0.00 | 223.60 | 0.21 | 0.00 | 0.02 | 0.23 |
| 2043 | 57 | 4.61 | 0.00 | 1930.80 | 0.00 | 223.60 | 0.19 | 0.00 | 0.02 | 0.21 |
| Total | | 659.20 | 236.63 | | | | 200.49 | 13.35 | 38.78 | 252.63 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case- 1-80-S

Discount rate= 12(%)
 B = 209.11
 C = 180.00
 B/C = 1.161
 B-C = 29.11

S = I
 kW Value B1= 68 US\$/kW
 kWh Value B2= 0.063 US\$/kWh
 kWh Value B3= 0.005 US\$/kWh

C1= 0.063375943
 C2= 0.052328944
 C3= 0.043436698

UNIT=Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost. Flow | Project Sales | | | Discounted Benefit Flow | | | |
|-------|---------------|-----------|-----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|--------|
| | | | | Salable Energy (GWh/Yr) | Surplus Energy (GWh/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 20.64 | 13.11 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 38.65 | 21.93 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 55.65 | 28.19 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 96.69 | 43.73 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 49.95 | 20.17 | 179.00 | 686.80 | 52.00 | 4.55 | 1.38 | 1.42 | 7.36 |
| 1995 | 9 | 7.05 | 2.54 | 256.00 | 609.80 | 69.00 | 5.81 | 1.09 | 1.69 | 8.60 |
| 1996 | 10 | 12.68 | 4.08 | 333.00 | 532.80 | 86.10 | 6.75 | 0.85 | 1.88 | 9.49 |
| 1997 | 11 | 8.92 | 2.56 | 415.00 | 450.80 | 99.40 | 7.51 | 0.64 | 1.94 | 10.10 |
| 1998 | 12 | 3.53 | 0.90 | 500.00 | 365.80 | 99.40 | 8.08 | 0.46 | 1.73 | 10.28 |
| 1999 | 13 | 3.53 | 0.80 | 588.00 | 697.20 | 143.00 | 8.48 | 0.79 | 2.22 | 11.51 |
| 2000 | 14 | 3.53 | 0.72 | 680.00 | 605.20 | 149.10 | 8.76 | 0.61 | 2.07 | 11.45 |
| 2001 | 15 | 3.53 | 0.64 | 776.00 | 509.20 | 149.10 | 8.93 | 0.46 | 1.85 | 11.24 |
| 2002 | 16 | 3.53 | 0.57 | 876.00 | 409.20 | 149.10 | 9.00 | 0.33 | 1.65 | 10.98 |
| 2003 | 17 | 3.53 | 0.51 | 980.00 | 305.20 | 149.10 | 8.99 | 0.22 | 1.47 | 10.69 |
| 2004 | 18 | 3.53 | 0.45 | 1089.00 | 196.20 | 149.10 | 8.92 | 0.12 | 1.31 | 10.36 |
| 2005 | 19 | 3.53 | 0.40 | 1201.00 | 84.20 | 149.10 | 8.78 | 0.04 | 1.17 | 10.01 |
| 2006 | 20 | 3.53 | 0.36 | 1285.20 | 0.00 | 149.10 | 8.39 | 0.00 | 1.05 | 9.44 |
| 2007 | 21 | 3.53 | 0.32 | 1285.20 | 0.00 | 149.10 | 7.49 | 0.00 | 0.93 | 8.43 |
| 2008 | 22 | 3.53 | 0.29 | 1285.20 | 0.00 | 149.10 | 6.69 | 0.00 | 0.83 | 7.52 |
| 2009 | 23 | 3.53 | 0.26 | 1285.20 | 0.00 | 149.10 | 5.97 | 0.00 | 0.74 | 6.72 |
| 2010 | 24 | 3.53 | 0.23 | 1285.20 | 0.00 | 149.10 | 5.33 | 0.00 | 0.66 | 6.00 |
| 2011 | 25 | 3.53 | 0.20 | 1285.20 | 0.00 | 149.10 | 4.76 | 0.00 | 0.59 | 5.35 |
| 2012 | 26 | 3.53 | 0.18 | 1285.20 | 0.00 | 149.10 | 4.25 | 0.00 | 0.53 | 4.78 |
| 2013 | 27 | 3.53 | 0.16 | 1285.20 | 0.00 | 149.10 | 3.79 | 0.00 | 0.47 | 4.27 |
| 2014 | 28 | 3.53 | 0.14 | 1285.20 | 0.00 | 149.10 | 3.39 | 0.00 | 0.42 | 3.81 |
| 2015 | 29 | 3.53 | 0.13 | 1285.20 | 0.00 | 149.10 | 3.02 | 0.00 | 0.37 | 3.40 |
| 2016 | 30 | 3.53 | 0.11 | 1285.20 | 0.00 | 149.10 | 2.70 | 0.00 | 0.33 | 3.04 |
| 2017 | 31 | 3.53 | 0.10 | 1285.20 | 0.00 | 149.10 | 2.41 | 0.00 | 0.30 | 2.71 |
| 2018 | 32 | 3.53 | 0.09 | 1285.20 | 0.00 | 149.10 | 2.15 | 0.00 | 0.26 | 2.42 |
| 2019 | 33 | 3.53 | 0.08 | 1285.20 | 0.00 | 149.10 | 1.92 | 0.00 | 0.24 | 2.16 |
| 2020 | 34 | 3.53 | 0.07 | 1285.20 | 0.00 | 149.10 | 1.71 | 0.00 | 0.21 | 1.93 |
| 2021 | 35 | 3.53 | 0.06 | 1285.20 | 0.00 | 149.10 | 1.53 | 0.00 | 0.19 | 1.72 |
| 2022 | 36 | 3.53 | 0.05 | 1285.20 | 0.00 | 149.10 | 1.36 | 0.00 | 0.17 | 1.54 |
| 2023 | 37 | 3.53 | 0.05 | 1285.20 | 0.00 | 149.10 | 1.22 | 0.00 | 0.15 | 1.37 |
| 2024 | 38 | 3.53 | 0.04 | 1285.20 | 0.00 | 149.10 | 1.09 | 0.00 | 0.13 | 1.22 |
| 2025 | 39 | 3.53 | 0.04 | 1285.20 | 0.00 | 149.10 | 0.97 | 0.00 | 0.12 | 1.09 |
| 2026 | 40 | 3.53 | 0.03 | 1285.20 | 0.00 | 149.10 | 0.87 | 0.00 | 0.10 | 0.97 |
| 2027 | 41 | 3.53 | 0.03 | 1285.20 | 0.00 | 149.10 | 0.77 | 0.00 | 0.09 | 0.87 |
| 2028 | 42 | 3.53 | 0.03 | 1285.20 | 0.00 | 149.10 | 0.69 | 0.00 | 0.08 | 0.78 |
| 2029 | 43 | 3.53 | 0.02 | 1285.20 | 0.00 | 149.10 | 0.61 | 0.00 | 0.07 | 0.69 |
| 2030 | 44 | 3.53 | 0.02 | 1285.20 | 0.00 | 149.10 | 0.55 | 0.00 | 0.06 | 0.62 |
| 2031 | 45 | 3.53 | 0.02 | 1285.20 | 0.00 | 149.10 | 0.49 | 0.00 | 0.06 | 0.55 |
| 2032 | 46 | 3.53 | 0.01 | 1285.20 | 0.00 | 149.10 | 0.44 | 0.00 | 0.05 | 0.49 |
| 2033 | 47 | 3.53 | 0.01 | 1285.20 | 0.00 | 149.10 | 0.39 | 0.00 | 0.04 | 0.44 |
| 2034 | 48 | 3.53 | 0.01 | 1285.20 | 0.00 | 149.10 | 0.35 | 0.00 | 0.04 | 0.39 |
| 2035 | 49 | 3.53 | 0.01 | 1285.20 | 0.00 | 149.10 | 0.31 | 0.00 | 0.03 | 0.35 |
| 2036 | 50 | 3.53 | 0.01 | 1285.20 | 0.00 | 149.10 | 0.28 | 0.00 | 0.03 | 0.31 |
| 2037 | 51 | 3.53 | 0.01 | 1285.20 | 0.00 | 149.10 | 0.25 | 0.00 | 0.03 | 0.28 |
| 2038 | 52 | 3.53 | 0.00 | 1285.20 | 0.00 | 149.10 | 0.22 | 0.00 | 0.02 | 0.25 |
| 2039 | 53 | 3.53 | 0.00 | 1285.20 | 0.00 | 149.10 | 0.19 | 0.00 | 0.02 | 0.22 |
| 2040 | 54 | 3.53 | 0.00 | 1285.20 | 0.00 | 149.10 | 0.17 | 0.00 | 0.02 | 0.20 |
| 2041 | 55 | 3.53 | 0.00 | 1285.20 | 0.00 | 149.10 | 0.15 | 0.00 | 0.01 | 0.17 |
| 2042 | 56 | 3.53 | 0.00 | 1285.20 | 0.00 | 149.10 | 0.14 | 0.00 | 0.01 | 0.15 |
| 2043 | 57 | 3.53 | 0.00 | 1285.20 | 0.00 | 149.10 | 0.12 | 0.00 | 0.01 | 0.14 |
| Total | | 498.56 | 180.00 | | | | 171.89 | 7.07 | 30.14 | 209.11 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case- 1 -80-K

Discount rate= 12(%)

B = 247.67
C = 200.12
B/C= 1.237
B-C= 47.55

S = I
kW Value B1= 68 US\$/kW
kWh Value B2= 0.063 US\$/kWh
kWh Value B3= 0.005 US\$/kWh

C1= 0.059839744
C2= 0.047742994
C3= 0.034266461

UNIT=Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|-------|---------------|-----------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|--------|
| | | | | Salable Energy (GWh/Yr) | Surplus Energy (GWh/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 23.51 | 14.94 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 45.83 | 26.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 67.63 | 34.26 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 109.30 | 49.44 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 56.00 | 22.61 | 179.00 | 1041.10 | 52.00 | 4.55 | 2.10 | 1.42 | 8.08 |
| 1995 | 9 | 2.67 | 0.96 | 256.00 | 964.10 | 69.00 | 5.81 | 1.73 | 1.69 | 9.24 |
| 1996 | 10 | 2.67 | 0.85 | 333.00 | 887.10 | 86.10 | 6.75 | 1.42 | 1.88 | 10.06 |
| 1997 | 11 | 8.34 | 2.39 | 415.00 | 805.10 | 104.20 | 7.51 | 1.15 | 2.03 | 10.71 |
| 1998 | 12 | 13.99 | 3.59 | 500.00 | 720.10 | 123.20 | 8.08 | 0.92 | 2.15 | 11.15 |
| 1999 | 13 | 9.63 | 2.20 | 588.00 | 1223.30 | 143.00 | 8.48 | 1.40 | 2.22 | 12.11 |
| 2000 | 14 | 4.00 | 0.81 | 680.00 | 1131.30 | 163.70 | 8.76 | 1.15 | 2.27 | 12.20 |
| 2001 | 15 | 4.00 | 0.73 | 776.00 | 1035.30 | 185.40 | 8.93 | 0.94 | 2.30 | 12.18 |
| 2002 | 16 | 4.00 | 0.65 | 876.00 | 935.30 | 208.30 | 9.00 | 0.76 | 2.31 | 12.07 |
| 2003 | 17 | 4.00 | 0.58 | 980.00 | 831.30 | 211.80 | 8.99 | 0.60 | 2.09 | 11.69 |
| 2004 | 18 | 4.00 | 0.52 | 1089.00 | 722.30 | 211.80 | 8.92 | 0.46 | 1.87 | 11.26 |
| 2005 | 19 | 4.00 | 0.46 | 1201.00 | 610.30 | 211.80 | 8.78 | 0.35 | 1.67 | 10.81 |
| 2006 | 20 | 4.00 | 0.41 | 1318.00 | 493.30 | 211.80 | 8.60 | 0.25 | 1.49 | 10.35 |
| 2007 | 21 | 4.00 | 0.37 | 1440.00 | 371.30 | 211.80 | 8.39 | 0.17 | 1.33 | 9.90 |
| 2008 | 22 | 4.00 | 0.33 | 1567.00 | 244.30 | 211.80 | 8.15 | 0.10 | 1.19 | 9.44 |
| 2009 | 23 | 4.00 | 0.29 | 1699.00 | 112.30 | 211.80 | 7.89 | 0.04 | 1.06 | 9.00 |
| 2010 | 24 | 4.00 | 0.26 | 1811.30 | 0.00 | 211.80 | 7.51 | 0.00 | 0.94 | 8.46 |
| 2011 | 25 | 4.00 | 0.23 | 1811.30 | 0.00 | 211.80 | 6.71 | 0.00 | 0.84 | 7.55 |
| 2012 | 26 | 4.00 | 0.21 | 1811.30 | 0.00 | 211.80 | 5.99 | 0.00 | 0.75 | 6.74 |
| 2013 | 27 | 4.00 | 0.18 | 1811.30 | 0.00 | 211.80 | 5.35 | 0.00 | 0.67 | 6.02 |
| 2014 | 28 | 4.00 | 0.16 | 1811.30 | 0.00 | 211.80 | 4.77 | 0.00 | 0.60 | 5.38 |
| 2015 | 29 | 4.00 | 0.14 | 1811.30 | 0.00 | 211.80 | 4.26 | 0.00 | 0.53 | 4.80 |
| 2016 | 30 | 4.00 | 0.13 | 1811.30 | 0.00 | 211.80 | 3.80 | 0.00 | 0.48 | 4.28 |
| 2017 | 31 | 4.00 | 0.11 | 1811.30 | 0.00 | 211.80 | 3.40 | 0.00 | 0.42 | 3.82 |
| 2018 | 32 | 4.00 | 0.10 | 1811.30 | 0.00 | 211.80 | 3.03 | 0.00 | 0.38 | 3.41 |
| 2019 | 33 | 4.00 | 0.09 | 1811.30 | 0.00 | 211.80 | 2.71 | 0.00 | 0.34 | 3.05 |
| 2020 | 34 | 4.00 | 0.08 | 1811.30 | 0.00 | 211.80 | 2.42 | 0.00 | 0.30 | 2.72 |
| 2021 | 35 | 4.00 | 0.07 | 1811.30 | 0.00 | 211.80 | 2.16 | 0.00 | 0.27 | 2.43 |
| 2022 | 36 | 4.00 | 0.06 | 1811.30 | 0.00 | 211.80 | 1.92 | 0.00 | 0.24 | 2.17 |
| 2023 | 37 | 4.00 | 0.06 | 1811.30 | 0.00 | 211.80 | 1.72 | 0.00 | 0.21 | 1.94 |
| 2024 | 38 | 4.00 | 0.05 | 1811.30 | 0.00 | 211.80 | 1.53 | 0.00 | 0.19 | 1.73 |
| 2025 | 39 | 4.00 | 0.04 | 1811.30 | 0.00 | 211.80 | 1.37 | 0.00 | 0.17 | 1.54 |
| 2026 | 40 | 4.00 | 0.04 | 1811.30 | 0.00 | 211.80 | 1.22 | 0.00 | 0.15 | 1.38 |
| 2027 | 41 | 4.00 | 0.03 | 1811.30 | 0.00 | 211.80 | 1.09 | 0.00 | 0.13 | 1.23 |
| 2028 | 42 | 4.00 | 0.03 | 1811.30 | 0.00 | 211.80 | 0.97 | 0.00 | 0.12 | 1.10 |
| 2029 | 43 | 4.00 | 0.03 | 1811.30 | 0.00 | 211.80 | 0.87 | 0.00 | 0.11 | 0.98 |
| 2030 | 44 | 4.00 | 0.02 | 1811.30 | 0.00 | 211.80 | 0.77 | 0.00 | 0.09 | 0.87 |
| 2031 | 45 | 4.00 | 0.02 | 1811.30 | 0.00 | 211.80 | 0.69 | 0.00 | 0.08 | 0.78 |
| 2032 | 46 | 4.00 | 0.02 | 1811.30 | 0.00 | 211.80 | 0.62 | 0.00 | 0.07 | 0.69 |
| 2033 | 47 | 4.00 | 0.01 | 1811.30 | 0.00 | 211.80 | 0.55 | 0.00 | 0.07 | 0.62 |
| 2034 | 48 | 4.00 | 0.01 | 1811.30 | 0.00 | 211.80 | 0.49 | 0.00 | 0.06 | 0.55 |
| 2035 | 49 | 4.00 | 0.01 | 1811.30 | 0.00 | 211.80 | 0.44 | 0.00 | 0.05 | 0.49 |
| 2036 | 50 | 4.00 | 0.01 | 1811.30 | 0.00 | 211.80 | 0.39 | 0.00 | 0.04 | 0.44 |
| 2037 | 51 | 4.00 | 0.01 | 1811.30 | 0.00 | 211.80 | 0.35 | 0.00 | 0.04 | 0.39 |
| 2038 | 52 | 4.00 | 0.01 | 1811.30 | 0.00 | 211.80 | 0.31 | 0.00 | 0.03 | 0.35 |
| 2039 | 53 | 4.00 | 0.00 | 1811.30 | 0.00 | 211.80 | 0.28 | 0.00 | 0.03 | 0.31 |
| 2040 | 54 | 4.00 | 0.00 | 1811.30 | 0.00 | 211.80 | 0.25 | 0.00 | 0.03 | 0.28 |
| 2041 | 55 | 4.00 | 0.00 | 1811.30 | 0.00 | 211.80 | 0.22 | 0.00 | 0.02 | 0.25 |
| 2042 | 56 | 4.00 | 0.00 | 1811.30 | 0.00 | 211.80 | 0.20 | 0.00 | 0.02 | 0.22 |
| 2043 | 57 | 4.00 | 0.00 | 1811.30 | 0.00 | 211.80 | 0.17 | 0.00 | 0.02 | 0.20 |
| Total | | 561.52 | 200.12 | | | | 196.35 | 13.61 | 37.70 | 247.67 |

C1: average net cost of useful salable energy and capacity
C2: average net cost of useful salable energy
C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case - II - 60

Discount rate = 12 (%)
 B = 212.08
 C = 195.84
 B/C = 1.082
 B-C = 16.24

S = 1
 kW Value B1 = 68 US\$/kW
 kWh Value B2 = 0.063 US\$/kWh
 kWh Value B3 = 0.005 US\$/kWh

C1 = 0.068261793
 C2 = 0.057085530
 C3 = 0.044251650

UNIT=Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|-------|---------------|-----------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|--------|
| | | | | Salable Energy (GWH/Yr) | Surplus Energy (GWH/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 22.47 | 14.28 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 44.67 | 25.34 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 64.78 | 32.81 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 105.54 | 47.74 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 53.88 | 21.76 | 179.00 | 691.10 | 52.00 | 4.55 | 1.39 | 1.42 | 7.37 |
| 1995 | 9 | 7.38 | 2.66 | 256.00 | 614.10 | 69.00 | 5.81 | 1.10 | 1.69 | 8.61 |
| 1996 | 10 | 13.19 | 4.24 | 333.00 | 537.10 | 86.10 | 6.75 | 0.86 | 1.88 | 9.50 |
| 1997 | 11 | 9.35 | 2.68 | 415.00 | 888.50 | 104.20 | 7.51 | 1.27 | 2.03 | 10.83 |
| 1998 | 12 | 3.80 | 0.97 | 500.00 | 803.50 | 123.20 | 8.08 | 1.03 | 2.15 | 11.26 |
| 1999 | 13 | 3.80 | 0.87 | 588.00 | 715.50 | 143.00 | 8.48 | 0.81 | 2.22 | 11.53 |
| 2000 | 14 | 3.80 | 0.77 | 680.00 | 623.50 | 149.40 | 8.76 | 0.63 | 2.07 | 11.48 |
| 2001 | 15 | 3.80 | 0.69 | 776.00 | 527.50 | 149.40 | 8.93 | 0.48 | 1.85 | 11.26 |
| 2002 | 16 | 3.80 | 0.61 | 876.00 | 427.50 | 149.40 | 9.00 | 0.34 | 1.65 | 11.00 |
| 2003 | 17 | 3.80 | 0.55 | 980.00 | 323.50 | 149.40 | 8.99 | 0.23 | 1.47 | 10.70 |
| 2004 | 18 | 3.80 | 0.49 | 1089.00 | 214.50 | 149.40 | 8.92 | 0.13 | 1.32 | 10.38 |
| 2005 | 19 | 3.80 | 0.44 | 1201.00 | 102.50 | 149.40 | 8.78 | 0.05 | 1.17 | 10.02 |
| 2006 | 20 | 3.80 | 0.39 | 1303.50 | 0.00 | 149.40 | 8.51 | 0.00 | 1.05 | 9.56 |
| 2007 | 21 | 3.80 | 0.35 | 1303.50 | 0.00 | 149.40 | 7.60 | 0.00 | 0.94 | 8.54 |
| 2008 | 22 | 3.80 | 0.31 | 1303.50 | 0.00 | 149.40 | 6.78 | 0.00 | 0.83 | 7.62 |
| 2009 | 23 | 3.80 | 0.28 | 1303.50 | 0.00 | 149.40 | 6.05 | 0.00 | 0.74 | 6.80 |
| 2010 | 24 | 3.80 | 0.25 | 1303.50 | 0.00 | 149.40 | 5.41 | 0.00 | 0.66 | 6.07 |
| 2011 | 25 | 3.80 | 0.22 | 1303.50 | 0.00 | 149.40 | 4.83 | 0.00 | 0.59 | 5.42 |
| 2012 | 26 | 3.80 | 0.19 | 1303.50 | 0.00 | 149.40 | 4.31 | 0.00 | 0.53 | 4.84 |
| 2013 | 27 | 3.80 | 0.17 | 1303.50 | 0.00 | 149.40 | 3.85 | 0.00 | 0.47 | 4.32 |
| 2014 | 28 | 3.80 | 0.15 | 1303.50 | 0.00 | 149.40 | 3.43 | 0.00 | 0.42 | 3.86 |
| 2015 | 29 | 3.80 | 0.14 | 1303.50 | 0.00 | 149.40 | 3.06 | 0.00 | 0.37 | 3.44 |
| 2016 | 30 | 3.80 | 0.12 | 1303.50 | 0.00 | 149.40 | 2.74 | 0.00 | 0.33 | 3.08 |
| 2017 | 31 | 3.80 | 0.11 | 1303.50 | 0.00 | 149.40 | 2.44 | 0.00 | 0.30 | 2.75 |
| 2018 | 32 | 3.80 | 0.10 | 1303.50 | 0.00 | 149.40 | 2.18 | 0.00 | 0.27 | 2.45 |
| 2019 | 33 | 3.80 | 0.09 | 1303.50 | 0.00 | 149.40 | 1.95 | 0.00 | 0.24 | 2.19 |
| 2020 | 34 | 3.80 | 0.08 | 1303.50 | 0.00 | 149.40 | 1.74 | 0.00 | 0.21 | 1.95 |
| 2021 | 35 | 3.80 | 0.07 | 1303.50 | 0.00 | 149.40 | 1.55 | 0.00 | 0.19 | 1.74 |
| 2022 | 36 | 3.80 | 0.06 | 1303.50 | 0.00 | 149.40 | 1.38 | 0.00 | 0.17 | 1.56 |
| 2023 | 37 | 3.80 | 0.05 | 1303.50 | 0.00 | 149.40 | 1.23 | 0.00 | 0.15 | 1.39 |
| 2024 | 38 | 3.80 | 0.05 | 1303.50 | 0.00 | 149.40 | 1.10 | 0.00 | 0.13 | 1.24 |
| 2025 | 39 | 3.80 | 0.04 | 1303.50 | 0.00 | 149.40 | 0.98 | 0.00 | 0.12 | 1.11 |
| 2026 | 40 | 3.80 | 0.04 | 1303.50 | 0.00 | 149.40 | 0.88 | 0.00 | 0.10 | 0.99 |
| 2027 | 41 | 3.80 | 0.03 | 1303.50 | 0.00 | 149.40 | 0.78 | 0.00 | 0.09 | 0.88 |
| 2028 | 42 | 3.80 | 0.03 | 1303.50 | 0.00 | 149.40 | 0.70 | 0.00 | 0.08 | 0.79 |
| 2029 | 43 | 3.80 | 0.02 | 1303.50 | 0.00 | 149.40 | 0.62 | 0.00 | 0.07 | 0.70 |
| 2030 | 44 | 3.80 | 0.02 | 1303.50 | 0.00 | 149.40 | 0.56 | 0.00 | 0.06 | 0.63 |
| 2031 | 45 | 3.80 | 0.02 | 1303.50 | 0.00 | 149.40 | 0.50 | 0.00 | 0.06 | 0.56 |
| 2032 | 46 | 3.80 | 0.02 | 1303.50 | 0.00 | 149.40 | 0.44 | 0.00 | 0.05 | 0.50 |
| 2033 | 47 | 3.80 | 0.01 | 1303.50 | 0.00 | 149.40 | 0.39 | 0.00 | 0.04 | 0.44 |
| 2034 | 48 | 3.80 | 0.01 | 1303.50 | 0.00 | 149.40 | 0.35 | 0.00 | 0.04 | 0.40 |
| 2035 | 49 | 3.80 | 0.01 | 1303.50 | 0.00 | 149.40 | 0.31 | 0.00 | 0.03 | 0.35 |
| 2036 | 50 | 3.80 | 0.01 | 1303.50 | 0.00 | 149.40 | 0.28 | 0.00 | 0.03 | 0.31 |
| 2037 | 51 | 3.80 | 0.01 | 1303.50 | 0.00 | 149.40 | 0.25 | 0.00 | 0.03 | 0.28 |
| 2038 | 52 | 3.80 | 0.01 | 1303.50 | 0.00 | 149.40 | 0.22 | 0.00 | 0.02 | 0.25 |
| 2039 | 53 | 3.80 | 0.00 | 1303.50 | 0.00 | 149.40 | 0.20 | 0.00 | 0.02 | 0.22 |
| 2040 | 54 | 3.80 | 0.00 | 1303.50 | 0.00 | 149.40 | 0.18 | 0.00 | 0.02 | 0.20 |
| 2041 | 55 | 3.80 | 0.00 | 1303.50 | 0.00 | 149.40 | 0.16 | 0.00 | 0.01 | 0.18 |
| 2042 | 56 | 3.80 | 0.00 | 1303.50 | 0.00 | 149.40 | 0.14 | 0.00 | 0.01 | 0.16 |
| 2043 | 57 | 3.80 | 0.00 | 1303.50 | 0.00 | 149.40 | 0.12 | 0.00 | 0.01 | 0.14 |
| Total | | 542.01 | 195.84 | | | | 172.99 | 8.39 | 30.69 | 212.08 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case- II - 70

Discount rate 12(%)

B 228.20
C 201.57
B/C 1.132
B-C 26.62

S = 1
kW Value B1= 68 US\$/kW
kWh Value B2= 0.063 US\$/kWh
kWh Value B3= 0.005 US\$/kWh

C1= 0.065465495
C2= 0.053882473
C3= 0.040292552

UNIT: Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|--------------|---------------|---------------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|---------------|
| | | | | Salable Energy (GWh/Yr) | Surplus Energy (GWh/Yr) | Useful Capacity (kW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 23.10 | 14.68 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 46.98 | 26.65 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 68.75 | 34.83 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 109.39 | 49.48 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 55.79 | 22.53 | 179.00 | 836.10 | 52.00 | 4.55 | 1.68 | 1.42 | 7.67 |
| 1995 | 9 | 2.62 | 0.94 | 256.00 | 759.10 | 69.00 | 5.81 | 1.36 | 1.69 | 8.87 |
| 1996 | 10 | 7.74 | 2.49 | 333.00 | 682.10 | 86.10 | 6.75 | 1.09 | 1.88 | 9.73 |
| 1997 | 11 | 13.55 | 3.89 | 415.00 | 600.10 | 104.20 | 7.51 | 0.86 | 2.03 | 10.41 |
| 1998 | 12 | 9.58 | 2.45 | 500.00 | 1014.40 | 123.20 | 8.08 | 1.30 | 2.15 | 11.53 |
| 1999 | 13 | 3.93 | 0.90 | 588.00 | 926.40 | 143.00 | 8.48 | 1.06 | 2.22 | 11.77 |
| 2000 | 14 | 3.93 | 0.80 | 680.00 | 834.40 | 163.70 | 8.76 | 0.85 | 2.27 | 11.89 |
| 2001 | 15 | 3.93 | 0.71 | 776.00 | 738.40 | 174.90 | 8.93 | 0.67 | 2.17 | 11.77 |
| 2002 | 16 | 3.93 | 0.64 | 876.00 | 638.40 | 174.90 | 9.00 | 0.52 | 1.94 | 11.46 |
| 2003 | 17 | 3.93 | 0.57 | 980.00 | 534.40 | 174.90 | 8.99 | 0.38 | 1.73 | 11.11 |
| 2004 | 18 | 3.93 | 0.51 | 1089.00 | 425.40 | 174.90 | 8.92 | 0.27 | 1.54 | 10.74 |
| 2005 | 19 | 3.93 | 0.45 | 1201.00 | 313.40 | 174.90 | 8.78 | 0.18 | 1.38 | 10.34 |
| 2006 | 20 | 3.93 | 0.40 | 1318.00 | 196.40 | 174.90 | 8.60 | 0.10 | 1.23 | 9.94 |
| 2007 | 21 | 3.93 | 0.36 | 1440.00 | 74.40 | 174.90 | 8.39 | 0.03 | 1.10 | 9.53 |
| 2008 | 22 | 3.93 | 0.32 | 1514.40 | 0.00 | 174.90 | 7.88 | 0.00 | 0.98 | 8.86 |
| 2009 | 23 | 3.93 | 0.28 | 1514.40 | 0.00 | 174.90 | 7.03 | 0.00 | 0.87 | 7.91 |
| 2010 | 24 | 3.93 | 0.25 | 1514.40 | 0.00 | 174.90 | 6.28 | 0.00 | 0.78 | 7.06 |
| 2011 | 25 | 3.93 | 0.23 | 1514.40 | 0.00 | 174.90 | 5.61 | 0.00 | 0.69 | 6.31 |
| 2012 | 26 | 3.93 | 0.20 | 1514.40 | 0.00 | 174.90 | 5.01 | 0.00 | 0.62 | 5.63 |
| 2013 | 27 | 3.93 | 0.18 | 1514.40 | 0.00 | 174.90 | 4.47 | 0.00 | 0.55 | 5.03 |
| 2014 | 28 | 3.93 | 0.16 | 1514.40 | 0.00 | 174.90 | 3.99 | 0.00 | 0.49 | 4.49 |
| 2015 | 29 | 3.93 | 0.14 | 1514.40 | 0.00 | 174.90 | 3.56 | 0.00 | 0.44 | 4.01 |
| 2016 | 30 | 3.93 | 0.13 | 1514.40 | 0.00 | 174.90 | 3.18 | 0.00 | 0.39 | 3.58 |
| 2017 | 31 | 3.93 | 0.11 | 1514.40 | 0.00 | 174.90 | 2.84 | 0.00 | 0.35 | 3.19 |
| 2018 | 32 | 3.93 | 0.10 | 1514.40 | 0.00 | 174.90 | 2.53 | 0.00 | 0.31 | 2.85 |
| 2019 | 33 | 3.93 | 0.09 | 1514.40 | 0.00 | 174.90 | 2.26 | 0.00 | 0.28 | 2.54 |
| 2020 | 34 | 3.93 | 0.08 | 1514.40 | 0.00 | 174.90 | 2.02 | 0.00 | 0.25 | 2.27 |
| 2021 | 35 | 3.93 | 0.07 | 1514.40 | 0.00 | 174.90 | 1.80 | 0.00 | 0.22 | 2.03 |
| 2022 | 36 | 3.93 | 0.06 | 1514.40 | 0.00 | 174.90 | 1.61 | 0.00 | 0.20 | 1.81 |
| 2023 | 37 | 3.93 | 0.05 | 1514.40 | 0.00 | 174.90 | 1.44 | 0.00 | 0.17 | 1.62 |
| 2024 | 38 | 3.93 | 0.05 | 1514.40 | 0.00 | 174.90 | 1.28 | 0.00 | 0.16 | 1.44 |
| 2025 | 39 | 3.93 | 0.04 | 1514.40 | 0.00 | 174.90 | 1.14 | 0.00 | 0.14 | 1.29 |
| 2026 | 40 | 3.93 | 0.04 | 1514.40 | 0.00 | 174.90 | 1.02 | 0.00 | 0.12 | 1.15 |
| 2027 | 41 | 3.93 | 0.03 | 1514.40 | 0.00 | 174.90 | 0.91 | 0.00 | 0.11 | 1.02 |
| 2028 | 42 | 3.93 | 0.03 | 1514.40 | 0.00 | 174.90 | 0.81 | 0.00 | 0.10 | 0.91 |
| 2029 | 43 | 3.93 | 0.03 | 1514.40 | 0.00 | 174.90 | 0.72 | 0.00 | 0.09 | 0.82 |
| 2030 | 44 | 3.93 | 0.02 | 1514.40 | 0.00 | 174.90 | 0.65 | 0.00 | 0.08 | 0.73 |
| 2031 | 45 | 3.93 | 0.02 | 1514.40 | 0.00 | 174.90 | 0.58 | 0.00 | 0.07 | 0.65 |
| 2032 | 46 | 3.93 | 0.02 | 1514.40 | 0.00 | 174.90 | 0.51 | 0.00 | 0.06 | 0.58 |
| 2033 | 47 | 3.93 | 0.01 | 1514.40 | 0.00 | 174.90 | 0.46 | 0.00 | 0.05 | 0.52 |
| 2034 | 48 | 3.93 | 0.01 | 1514.40 | 0.00 | 174.90 | 0.41 | 0.00 | 0.05 | 0.46 |
| 2035 | 49 | 3.93 | 0.01 | 1514.40 | 0.00 | 174.90 | 0.36 | 0.00 | 0.04 | 0.41 |
| 2036 | 50 | 3.93 | 0.01 | 1514.40 | 0.00 | 174.90 | 0.33 | 0.00 | 0.04 | 0.37 |
| 2037 | 51 | 3.93 | 0.01 | 1514.40 | 0.00 | 174.90 | 0.29 | 0.00 | 0.03 | 0.33 |
| 2038 | 52 | 3.93 | 0.01 | 1514.40 | 0.00 | 174.90 | 0.26 | 0.00 | 0.03 | 0.29 |
| 2039 | 53 | 3.93 | 0.00 | 1514.40 | 0.00 | 174.90 | 0.23 | 0.00 | 0.02 | 0.26 |
| 2040 | 54 | 3.93 | 0.00 | 1514.40 | 0.00 | 174.90 | 0.20 | 0.00 | 0.02 | 0.23 |
| 2041 | 55 | 3.93 | 0.00 | 1514.40 | 0.00 | 174.90 | 0.18 | 0.00 | 0.02 | 0.21 |
| 2042 | 56 | 3.93 | 0.00 | 1514.40 | 0.00 | 174.90 | 0.16 | 0.00 | 0.02 | 0.18 |
| 2043 | 57 | 3.93 | 0.00 | 1514.40 | 0.00 | 174.90 | 0.14 | 0.00 | 0.01 | 0.16 |
| Total | | 560.30 | 201.57 | | | | 183.96 | 10.41 | 33.82 | 228.20 |

C1: average net cost of useful salable energy and capacity

C2: average net cost of useful salable energy

C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case- II - 80

Discount rate= 12(%)
 B = 242.02
 C = 207.05
 B/C = 1.168
 B-C = 34.96

S = 1
 kW Value B1 = 68 US\$/kW
 kWh Value B2 = 0.063 US\$/kWh
 kWh Value B3 = 0.005 US\$/kWh

C1 = 0.063543053
 C2 = 0.051582336
 C3 = 0.037301072

UNIT=Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|--------------|---------------|---------------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|---------------|
| | | | | Salable Energy (GWH/Yr) | Surplus Energy (GWH/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 23.67 | 15.04 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 49.08 | 27.84 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 72.41 | 36.68 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 113.06 | 51.14 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 57.72 | 23.31 | 179.00 | 980.70 | 52.00 | 4.55 | 1.98 | 1.42 | 7.96 |
| 1995 | 9 | 2.71 | 0.97 | 256.00 | 903.70 | 69.00 | 5.81 | 1.62 | 1.69 | 9.13 |
| 1996 | 10 | 2.71 | 0.87 | 333.00 | 826.70 | 86.10 | 6.75 | 1.33 | 1.88 | 9.97 |
| 1997 | 11 | 8.25 | 2.37 | 415.00 | 744.70 | 104.20 | 7.51 | 1.07 | 2.03 | 10.62 |
| 1998 | 12 | 14.06 | 3.60 | 500.00 | 659.70 | 123.20 | 8.08 | 0.84 | 2.15 | 11.08 |
| 1999 | 13 | 9.72 | 2.22 | 588.00 | 1133.60 | 143.00 | 8.48 | 1.29 | 2.22 | 12.01 |
| 2000 | 14 | 4.07 | 0.83 | 680.00 | 1041.60 | 163.70 | 8.76 | 1.06 | 2.27 | 12.10 |
| 2001 | 15 | 4.07 | 0.74 | 776.00 | 945.60 | 185.40 | 8.93 | 0.86 | 2.30 | 12.09 |
| 2002 | 16 | 4.07 | 0.66 | 876.00 | 845.60 | 201.00 | 9.00 | 0.68 | 2.22 | 11.92 |
| 2003 | 17 | 4.07 | 0.59 | 980.00 | 741.60 | 201.00 | 8.99 | 0.54 | 1.99 | 11.52 |
| 2004 | 18 | 4.07 | 0.52 | 1089.00 | 632.60 | 201.00 | 8.92 | 0.41 | 1.77 | 11.11 |
| 2005 | 19 | 4.07 | 0.47 | 1201.00 | 520.60 | 201.00 | 8.78 | 0.30 | 1.58 | 10.67 |
| 2006 | 20 | 4.07 | 0.42 | 1318.00 | 403.60 | 201.00 | 8.60 | 0.20 | 1.41 | 10.23 |
| 2007 | 21 | 4.07 | 0.37 | 1440.00 | 281.60 | 201.00 | 8.39 | 0.13 | 1.26 | 9.79 |
| 2008 | 22 | 4.07 | 0.33 | 1567.00 | 154.60 | 201.00 | 8.15 | 0.06 | 1.12 | 9.35 |
| 2009 | 23 | 4.07 | 0.30 | 1699.00 | 22.60 | 201.00 | 7.89 | 0.00 | 1.00 | 8.91 |
| 2010 | 24 | 4.07 | 0.26 | 1721.60 | 0.00 | 201.00 | 7.14 | 0.00 | 0.90 | 8.04 |
| 2011 | 25 | 4.07 | 0.23 | 1721.60 | 0.00 | 201.00 | 6.38 | 0.00 | 0.80 | 7.18 |
| 2012 | 26 | 4.07 | 0.21 | 1721.60 | 0.00 | 201.00 | 5.69 | 0.00 | 0.71 | 6.41 |
| 2013 | 27 | 4.07 | 0.19 | 1721.60 | 0.00 | 201.00 | 5.08 | 0.00 | 0.64 | 5.72 |
| 2014 | 28 | 4.07 | 0.17 | 1721.60 | 0.00 | 201.00 | 4.54 | 0.00 | 0.57 | 5.11 |
| 2015 | 29 | 4.07 | 0.15 | 1721.60 | 0.00 | 201.00 | 4.05 | 0.00 | 0.51 | 4.56 |
| 2016 | 30 | 4.07 | 0.13 | 1721.60 | 0.00 | 201.00 | 3.62 | 0.00 | 0.45 | 4.07 |
| 2017 | 31 | 4.07 | 0.12 | 1721.60 | 0.00 | 201.00 | 3.23 | 0.00 | 0.40 | 3.63 |
| 2018 | 32 | 4.07 | 0.10 | 1721.60 | 0.00 | 201.00 | 2.88 | 0.00 | 0.36 | 3.24 |
| 2019 | 33 | 4.07 | 0.09 | 1721.60 | 0.00 | 201.00 | 2.57 | 0.00 | 0.32 | 2.90 |
| 2020 | 34 | 4.07 | 0.08 | 1721.60 | 0.00 | 201.00 | 2.30 | 0.00 | 0.28 | 2.59 |
| 2021 | 35 | 4.07 | 0.07 | 1721.60 | 0.00 | 201.00 | 2.05 | 0.00 | 0.25 | 2.31 |
| 2022 | 36 | 4.07 | 0.06 | 1721.60 | 0.00 | 201.00 | 1.83 | 0.00 | 0.23 | 2.06 |
| 2023 | 37 | 4.07 | 0.06 | 1721.60 | 0.00 | 201.00 | 1.63 | 0.00 | 0.20 | 1.84 |
| 2024 | 38 | 4.07 | 0.05 | 1721.60 | 0.00 | 201.00 | 1.46 | 0.00 | 0.18 | 1.64 |
| 2025 | 39 | 4.07 | 0.04 | 1721.60 | 0.00 | 201.00 | 1.30 | 0.00 | 0.16 | 1.46 |
| 2026 | 40 | 4.07 | 0.04 | 1721.60 | 0.00 | 201.00 | 1.16 | 0.00 | 0.14 | 1.31 |
| 2027 | 41 | 4.07 | 0.03 | 1721.60 | 0.00 | 201.00 | 1.04 | 0.00 | 0.13 | 1.17 |
| 2028 | 42 | 4.07 | 0.03 | 1721.60 | 0.00 | 201.00 | 0.92 | 0.00 | 0.11 | 1.04 |
| 2029 | 43 | 4.07 | 0.03 | 1721.60 | 0.00 | 201.00 | 0.82 | 0.00 | 0.10 | 0.93 |
| 2030 | 44 | 4.07 | 0.02 | 1721.60 | 0.00 | 201.00 | 0.74 | 0.00 | 0.09 | 0.83 |
| 2031 | 45 | 4.07 | 0.02 | 1721.60 | 0.00 | 201.00 | 0.66 | 0.00 | 0.08 | 0.74 |
| 2032 | 46 | 4.07 | 0.02 | 1721.60 | 0.00 | 201.00 | 0.59 | 0.00 | 0.07 | 0.66 |
| 2033 | 47 | 4.07 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.52 | 0.00 | 0.06 | 0.59 |
| 2034 | 48 | 4.07 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.47 | 0.00 | 0.05 | 0.53 |
| 2035 | 49 | 4.07 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.42 | 0.00 | 0.05 | 0.47 |
| 2036 | 50 | 4.07 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.37 | 0.00 | 0.04 | 0.42 |
| 2037 | 51 | 4.07 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.33 | 0.00 | 0.04 | 0.37 |
| 2038 | 52 | 4.07 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.29 | 0.00 | 0.03 | 0.33 |
| 2039 | 53 | 4.07 | 0.01 | 1721.60 | 0.00 | 201.00 | 0.26 | 0.00 | 0.03 | 0.30 |
| 2040 | 54 | 4.07 | 0.00 | 1721.60 | 0.00 | 201.00 | 0.23 | 0.00 | 0.03 | 0.26 |
| 2041 | 55 | 4.07 | 0.00 | 1721.60 | 0.00 | 201.00 | 0.21 | 0.00 | 0.02 | 0.23 |
| 2042 | 56 | 4.07 | 0.00 | 1721.60 | 0.00 | 201.00 | 0.19 | 0.00 | 0.02 | 0.21 |
| 2043 | 57 | 4.07 | 0.00 | 1721.60 | 0.00 | 201.00 | 0.16 | 0.00 | 0.02 | 0.19 |
| Total | | 578.42 | 207.05 | | | | 192.95 | 12.44 | 36.63 | 242.02 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case- II - 90

Discount rate= 12(X)

B = 250.57
C = 217.46
B/C = 1.152
B-C = 33.10

S = 1
kW Value B1 = 68 US\$/kW
kWh Value B2 = 0.063 US\$/kWh
kWh Value B3 = 0.005 US\$/kWh

C1 = 0.064839325
C2 = 0.052477766
C3 = 0.037238889

UNIT=Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|--------------|---------------|---------------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|---------------|
| | | | | Salable Energy (GWH/Yr) | Surplus Energy (GWH/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 24.60 | 15.63 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 52.06 | 29.54 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 76.71 | 38.86 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 116.10 | 52.51 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 59.10 | 23.86 | 179.00 | 799.80 | 52.00 | 4.55 | 1.61 | 1.42 | 7.59 |
| 1995 | 9 | 7.08 | 2.55 | 256.00 | 722.80 | 69.00 | 5.81 | 1.30 | 1.69 | 8.81 |
| 1996 | 10 | 13.06 | 4.20 | 333.00 | 645.80 | 86.10 | 6.75 | 1.03 | 1.88 | 9.67 |
| 1997 | 11 | 8.88 | 2.55 | 415.00 | 1047.10 | 104.20 | 7.51 | 1.50 | 2.03 | 11.05 |
| 1998 | 12 | 8.17 | 2.09 | 500.00 | 962.10 | 123.20 | 8.08 | 1.23 | 2.15 | 11.47 |
| 1999 | 13 | 8.04 | 1.84 | 588.00 | 874.10 | 143.00 | 8.48 | 1.00 | 2.22 | 11.71 |
| 2000 | 14 | 5.87 | 1.20 | 680.00 | 1242.10 | 163.70 | 8.76 | 1.27 | 2.27 | 12.31 |
| 2001 | 15 | 4.34 | 0.79 | 776.00 | 1146.10 | 185.40 | 8.93 | 1.04 | 2.30 | 12.28 |
| 2002 | 16 | 4.34 | 0.70 | 876.00 | 1046.10 | 208.30 | 9.00 | 0.85 | 2.31 | 12.16 |
| 2003 | 17 | 4.34 | 0.63 | 980.00 | 942.10 | 224.80 | 8.99 | 0.68 | 2.22 | 11.90 |
| 2004 | 18 | 4.34 | 0.56 | 1089.00 | 833.10 | 224.80 | 8.92 | 0.54 | 1.98 | 11.45 |
| 2005 | 19 | 4.34 | 0.50 | 1201.00 | 721.10 | 224.80 | 8.78 | 0.41 | 1.77 | 10.97 |
| 2006 | 20 | 4.34 | 0.44 | 1318.00 | 604.10 | 224.80 | 8.60 | 0.31 | 1.58 | 10.50 |
| 2007 | 21 | 4.34 | 0.40 | 1440.00 | 482.10 | 224.80 | 8.39 | 0.22 | 1.41 | 10.03 |
| 2008 | 22 | 4.34 | 0.35 | 1567.00 | 355.10 | 224.80 | 8.15 | 0.14 | 1.26 | 9.56 |
| 2009 | 23 | 4.34 | 0.32 | 1699.00 | 223.10 | 224.80 | 7.89 | 0.08 | 1.12 | 9.10 |
| 2010 | 24 | 4.34 | 0.28 | 1837.00 | 85.10 | 224.80 | 7.62 | 0.02 | 1.00 | 8.65 |
| 2011 | 25 | 4.34 | 0.25 | 1863.20 | 58.90 | 224.80 | 6.90 | 0.01 | 0.89 | 7.82 |
| 2012 | 26 | 4.34 | 0.22 | 1863.20 | 58.90 | 224.80 | 6.16 | 0.01 | 0.80 | 6.98 |
| 2013 | 27 | 4.34 | 0.20 | 1863.20 | 58.90 | 224.80 | 5.50 | 0.01 | 0.71 | 6.23 |
| 2014 | 28 | 4.34 | 0.18 | 1863.20 | 58.90 | 224.80 | 4.91 | 0.01 | 0.64 | 5.56 |
| 2015 | 29 | 4.34 | 0.16 | 1863.20 | 58.90 | 224.80 | 4.38 | 0.01 | 0.57 | 4.97 |
| 2016 | 30 | 4.34 | 0.14 | 1863.20 | 58.90 | 224.80 | 3.91 | 0.00 | 0.51 | 4.43 |
| 2017 | 31 | 4.34 | 0.12 | 1863.20 | 58.90 | 224.80 | 3.49 | 0.00 | 0.45 | 3.96 |
| 2018 | 32 | 4.34 | 0.11 | 1863.20 | 58.90 | 224.80 | 3.12 | 0.00 | 0.40 | 3.53 |
| 2019 | 33 | 4.34 | 0.10 | 1863.20 | 58.90 | 224.80 | 2.78 | 0.00 | 0.36 | 3.15 |
| 2020 | 34 | 4.34 | 0.09 | 1863.20 | 58.90 | 224.80 | 2.48 | 0.00 | 0.32 | 2.82 |
| 2021 | 35 | 4.34 | 0.08 | 1863.20 | 58.90 | 224.80 | 2.22 | 0.00 | 0.28 | 2.51 |
| 2022 | 36 | 4.34 | 0.07 | 1863.20 | 58.90 | 224.80 | 1.98 | 0.00 | 0.25 | 2.24 |
| 2023 | 37 | 4.34 | 0.06 | 1863.20 | 58.90 | 224.80 | 1.77 | 0.00 | 0.23 | 2.00 |
| 2024 | 38 | 4.34 | 0.05 | 1863.20 | 58.90 | 224.80 | 1.58 | 0.00 | 0.20 | 1.79 |
| 2025 | 39 | 4.34 | 0.05 | 1863.20 | 58.90 | 224.80 | 1.41 | 0.00 | 0.18 | 1.60 |
| 2026 | 40 | 4.34 | 0.04 | 1863.20 | 58.90 | 224.80 | 1.26 | 0.00 | 0.16 | 1.42 |
| 2027 | 41 | 4.34 | 0.04 | 1863.20 | 58.90 | 224.80 | 1.12 | 0.00 | 0.14 | 1.27 |
| 2028 | 42 | 4.34 | 0.03 | 1863.20 | 58.90 | 224.80 | 1.00 | 0.00 | 0.13 | 1.13 |
| 2029 | 43 | 4.34 | 0.03 | 1863.20 | 58.90 | 224.80 | 0.89 | 0.00 | 0.11 | 1.01 |
| 2030 | 44 | 4.34 | 0.02 | 1863.20 | 58.90 | 224.80 | 0.80 | 0.00 | 0.10 | 0.90 |
| 2031 | 45 | 4.34 | 0.02 | 1863.20 | 58.90 | 224.80 | 0.71 | 0.00 | 0.09 | 0.81 |
| 2032 | 46 | 4.34 | 0.02 | 1863.20 | 58.90 | 224.80 | 0.63 | 0.00 | 0.08 | 0.72 |
| 2033 | 47 | 4.34 | 0.02 | 1863.20 | 58.90 | 224.80 | 0.57 | 0.00 | 0.07 | 0.64 |
| 2034 | 48 | 4.34 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.50 | 0.00 | 0.06 | 0.57 |
| 2035 | 49 | 4.34 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.45 | 0.00 | 0.05 | 0.51 |
| 2036 | 50 | 4.34 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.40 | 0.00 | 0.05 | 0.46 |
| 2037 | 51 | 4.34 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.36 | 0.00 | 0.04 | 0.41 |
| 2038 | 52 | 4.34 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.32 | 0.00 | 0.04 | 0.36 |
| 2039 | 53 | 4.34 | 0.01 | 1863.20 | 58.90 | 224.80 | 0.28 | 0.00 | 0.03 | 0.32 |
| 2040 | 54 | 4.34 | 0.00 | 1863.20 | 58.90 | 224.80 | 0.25 | 0.00 | 0.03 | 0.29 |
| 2041 | 55 | 4.34 | 0.00 | 1863.20 | 58.90 | 224.80 | 0.23 | 0.00 | 0.03 | 0.26 |
| 2042 | 56 | 4.34 | 0.00 | 1863.20 | 58.90 | 224.80 | 0.20 | 0.00 | 0.02 | 0.23 |
| 2043 | 57 | 4.34 | 0.00 | 1863.20 | 58.90 | 224.80 | 0.18 | 0.00 | 0.02 | 0.20 |
| Total | | 612.24 | 217.46 | | | | 198.21 | 13.46 | 38.89 | 250.57 |

C1: average net cost of useful salable energy and capacity
C2: average net cost of useful salable energy
C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case - II - 100

Discount rate 12(%)
 B = 254.41
 C = 226.53
 B/C = 1.123
 B-C = 27.87

S = I
 kW Value B1 = 68 US\$/kW
 kWh Value B2 = 0.063 US\$/kWh
 kWh Value B3 = 0.005 US\$/kWh

C1 = 0.067188234
 C2 = 0.054138751
 C3 = 0.036682687

UNIT-Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | Discounted Benefit Flow | | | |
|-------|---------------|-----------|----------------------|-------------------------|-------------------------|----------------------|-------------------------|----------------|-----------------|--------|
| | | | | Salable Energy (GWH/Yr) | Surplus Energy (GWH/Yr) | Useful Capacity (MW) | Salable Energy | Surplus Energy | Useful Capacity | Total |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 25.18 | 16.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 54.38 | 30.85 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 80.62 | 40.84 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 120.16 | 54.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 61.10 | 24.67 | 179.00 | 908.50 | 52.00 | 4.55 | 1.83 | 1.42 | 7.81 |
| 1995 | 9 | 2.34 | 0.84 | 256.00 | 831.50 | 69.00 | 5.81 | 1.49 | 1.69 | 9.00 |
| 1996 | 10 | 7.42 | 2.38 | 333.00 | 754.50 | 86.10 | 6.75 | 1.21 | 1.88 | 9.85 |
| 1997 | 11 | 13.31 | 3.82 | 415.00 | 672.50 | 104.20 | 7.51 | 0.96 | 2.03 | 10.51 |
| 1998 | 12 | 9.25 | 2.37 | 500.00 | 1118.50 | 123.20 | 8.08 | 1.43 | 2.15 | 11.67 |
| 1999 | 13 | 8.59 | 1.96 | 588.00 | 1030.50 | 143.00 | 8.48 | 1.18 | 2.22 | 11.89 |
| 2000 | 14 | 18.20 | 3.72 | 680.00 | 938.50 | 163.70 | 8.76 | 0.96 | 2.27 | 12.00 |
| 2001 | 15 | 12.94 | 2.36 | 776.00 | 1330.20 | 185.40 | 8.93 | 1.21 | 2.30 | 12.45 |
| 2002 | 16 | 4.68 | 0.76 | 876.00 | 1230.20 | 208.30 | 9.00 | 1.00 | 2.31 | 12.31 |
| 2003 | 17 | 4.68 | 0.68 | 980.00 | 1126.10 | 232.30 | 8.99 | 0.82 | 2.30 | 12.11 |
| 2004 | 18 | 4.68 | 0.60 | 1089.00 | 1017.20 | 250.40 | 8.92 | 0.66 | 2.21 | 11.79 |
| 2005 | 19 | 4.68 | 0.54 | 1201.00 | 905.20 | 250.40 | 8.78 | 0.52 | 1.97 | 11.28 |
| 2006 | 20 | 4.68 | 0.48 | 1318.00 | 788.20 | 250.40 | 8.60 | 0.40 | 1.76 | 10.78 |
| 2007 | 21 | 4.68 | 0.43 | 1440.00 | 666.20 | 250.40 | 8.39 | 0.30 | 1.57 | 10.28 |
| 2008 | 22 | 4.68 | 0.38 | 1567.00 | 539.20 | 250.40 | 8.15 | 0.22 | 1.40 | 9.78 |
| 2009 | 23 | 4.68 | 0.34 | 1699.00 | 407.20 | 250.40 | 7.89 | 0.15 | 1.25 | 9.30 |
| 2010 | 24 | 4.68 | 0.30 | 1837.00 | 269.20 | 250.40 | 7.62 | 0.08 | 1.12 | 8.83 |
| 2011 | 25 | 4.68 | 0.27 | 1863.20 | 243.00 | 250.40 | 6.90 | 0.07 | 1.00 | 7.97 |
| 2012 | 26 | 4.68 | 0.24 | 1863.20 | 243.00 | 250.40 | 6.16 | 0.06 | 0.89 | 7.12 |
| 2013 | 27 | 4.68 | 0.21 | 1863.20 | 243.00 | 250.40 | 5.50 | 0.05 | 0.79 | 6.35 |
| 2014 | 28 | 4.68 | 0.19 | 1863.20 | 243.00 | 250.40 | 4.91 | 0.05 | 0.71 | 5.67 |
| 2015 | 29 | 4.68 | 0.17 | 1863.20 | 243.00 | 250.40 | 4.38 | 0.04 | 0.63 | 5.07 |
| 2016 | 30 | 4.68 | 0.15 | 1863.20 | 243.00 | 250.40 | 3.91 | 0.04 | 0.56 | 4.52 |
| 2017 | 31 | 4.68 | 0.13 | 1863.20 | 243.00 | 250.40 | 3.49 | 0.03 | 0.50 | 4.04 |
| 2018 | 32 | 4.68 | 0.12 | 1863.20 | 243.00 | 250.40 | 3.12 | 0.03 | 0.45 | 3.60 |
| 2019 | 33 | 4.68 | 0.11 | 1863.20 | 243.00 | 250.40 | 2.78 | 0.02 | 0.40 | 3.22 |
| 2020 | 34 | 4.68 | 0.09 | 1863.20 | 243.00 | 250.40 | 2.48 | 0.02 | 0.36 | 2.87 |
| 2021 | 35 | 4.68 | 0.08 | 1863.20 | 243.00 | 250.40 | 2.22 | 0.02 | 0.32 | 2.56 |
| 2022 | 36 | 4.68 | 0.07 | 1863.20 | 243.00 | 250.40 | 1.98 | 0.02 | 0.28 | 2.29 |
| 2023 | 37 | 4.68 | 0.07 | 1863.20 | 243.00 | 250.40 | 1.77 | 0.01 | 0.25 | 2.04 |
| 2024 | 38 | 4.68 | 0.06 | 1863.20 | 243.00 | 250.40 | 1.58 | 0.01 | 0.22 | 1.82 |
| 2025 | 39 | 4.68 | 0.05 | 1863.20 | 243.00 | 250.40 | 1.41 | 0.01 | 0.20 | 1.63 |
| 2026 | 40 | 4.68 | 0.05 | 1863.20 | 243.00 | 250.40 | 1.26 | 0.01 | 0.18 | 1.45 |
| 2027 | 41 | 4.68 | 0.04 | 1863.20 | 243.00 | 250.40 | 1.12 | 0.01 | 0.16 | 1.30 |
| 2028 | 42 | 4.68 | 0.04 | 1863.20 | 243.00 | 250.40 | 1.00 | 0.01 | 0.14 | 1.16 |
| 2029 | 43 | 4.68 | 0.03 | 1863.20 | 243.00 | 250.40 | 0.89 | 0.00 | 0.13 | 1.03 |
| 2030 | 44 | 4.68 | 0.03 | 1863.20 | 243.00 | 250.40 | 0.80 | 0.00 | 0.11 | 0.92 |
| 2031 | 45 | 4.68 | 0.02 | 1863.20 | 243.00 | 250.40 | 0.71 | 0.00 | 0.10 | 0.82 |
| 2032 | 46 | 4.68 | 0.02 | 1863.20 | 243.00 | 250.40 | 0.63 | 0.00 | 0.09 | 0.73 |
| 2033 | 47 | 4.68 | 0.02 | 1863.20 | 243.00 | 250.40 | 0.57 | 0.00 | 0.08 | 0.65 |
| 2034 | 48 | 4.68 | 0.02 | 1863.20 | 243.00 | 250.40 | 0.50 | 0.00 | 0.07 | 0.58 |
| 2035 | 49 | 4.68 | 0.01 | 1863.20 | 243.00 | 250.40 | 0.45 | 0.00 | 0.06 | 0.52 |
| 2036 | 50 | 4.68 | 0.01 | 1863.20 | 243.00 | 250.40 | 0.40 | 0.00 | 0.05 | 0.46 |
| 2037 | 51 | 4.68 | 0.01 | 1863.20 | 243.00 | 250.40 | 0.36 | 0.00 | 0.05 | 0.41 |
| 2038 | 52 | 4.68 | 0.01 | 1863.20 | 243.00 | 250.40 | 0.32 | 0.00 | 0.04 | 0.37 |
| 2039 | 53 | 4.68 | 0.01 | 1863.20 | 243.00 | 250.40 | 0.28 | 0.00 | 0.04 | 0.33 |
| 2040 | 54 | 4.68 | 0.01 | 1863.20 | 243.00 | 250.40 | 0.25 | 0.00 | 0.03 | 0.29 |
| 2041 | 55 | 4.68 | 0.00 | 1863.20 | 243.00 | 250.40 | 0.23 | 0.00 | 0.03 | 0.26 |
| 2042 | 56 | 4.68 | 0.00 | 1863.20 | 243.00 | 250.40 | 0.20 | 0.00 | 0.02 | 0.23 |
| 2043 | 57 | 4.68 | 0.00 | 1863.20 | 243.00 | 250.40 | 0.18 | 0.00 | 0.02 | 0.21 |
| Total | | 656.00 | 226.53 | | | | 198.21 | 15.14 | 41.05 | 254.41 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case - III - 120

Discount rate= 12 (%)
 B = 370.42
 C = 229.12
 B/C = 1.616
 B-C = 141.30

S = 1
 KW Value B1 = 68 US\$/KW
 KWH Value B2 = 0.063 US\$/KWH
 KWH Value B3 = 0.048 US\$/KWH
 KWH Value B4 = 0.005 US\$/KWH

C1 = 0.039282102
 C2 = 0.031454502
 C3 = 0.033578778

UNIT = Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | | Discounted Benefit Flow | | | | Total |
|-------|---------------|-----------|----------------------|---------------------------------|-------------------------------|------------------------|----------------------|-------------------------|-----------------------|----------------|-----------------|--------|
| | | | | Salable Domestic Energy (GM/Yr) | Salable Export Energy (GM/Yr) | Surplus Energy (GM/Yr) | Useful Capacity (MW) | Salable Domestic Energy | Salable Export Energy | Surplus Energy | Useful Capacity | |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 22.56 | 14.33 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 44.85 | 25.44 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 65.08 | 32.97 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 105.75 | 47.83 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 57.18 | 23.09 | 179.00 | 0.00 | 691.10 | 52.00 | 4.55 | 0.00 | 1.39 | 1.42 | 7.37 |
| 1995 | 9 | 14.56 | 5.25 | 256.00 | 0.00 | 614.10 | 69.00 | 5.81 | 0.00 | 1.10 | 1.69 | 8.61 |
| 1996 | 10 | 19.40 | 6.24 | 333.00 | 0.00 | 537.10 | 86.10 | 6.75 | 0.00 | 0.86 | 1.88 | 9.50 |
| 1997 | 11 | 58.72 | 16.88 | 415.00 | 0.00 | 888.50 | 104.20 | 7.51 | 0.00 | 1.27 | 2.03 | 10.83 |
| 1998 | 12 | 39.37 | 10.10 | 500.00 | 0.00 | 803.50 | 123.20 | 8.08 | 0.00 | 1.03 | 2.15 | 11.26 |
| 1999 | 13 | 8.60 | 1.97 | 588.00 | 1843.30 | 0.00 | 143.00 | 8.48 | 20.27 | 0.00 | 2.22 | 30.99 |
| 2000 | 14 | 5.13 | 1.04 | 680.00 | 1751.30 | 0.00 | 163.70 | 8.76 | 17.20 | 0.00 | 2.27 | 28.24 |
| 2001 | 15 | 5.13 | 0.99 | 776.00 | 1655.30 | 0.00 | 185.40 | 8.93 | 14.51 | 0.00 | 2.30 | 25.75 |
| 2002 | 16 | 5.13 | 0.83 | 876.00 | 1555.30 | 0.00 | 208.30 | 9.00 | 12.17 | 0.00 | 2.31 | 23.49 |
| 2003 | 17 | 5.13 | 0.74 | 980.00 | 1451.30 | 0.00 | 232.30 | 8.99 | 10.14 | 0.00 | 2.30 | 21.43 |
| 2004 | 18 | 5.13 | 0.66 | 1089.00 | 1342.30 | 0.00 | 257.50 | 8.92 | 8.37 | 0.00 | 2.27 | 19.57 |
| 2005 | 19 | 5.13 | 0.59 | 1201.00 | 1230.30 | 0.00 | 283.80 | 8.78 | 6.85 | 0.00 | 2.24 | 17.88 |
| 2006 | 20 | 5.13 | 0.53 | 1318.00 | 1113.30 | 0.00 | 298.80 | 8.60 | 5.53 | 0.00 | 2.10 | 16.25 |
| 2007 | 21 | 5.13 | 0.47 | 1440.00 | 991.30 | 0.00 | 298.80 | 8.39 | 4.40 | 0.00 | 1.88 | 14.68 |
| 2008 | 22 | 5.13 | 0.42 | 1567.00 | 864.30 | 0.00 | 298.80 | 8.15 | 3.42 | 0.00 | 1.67 | 13.26 |
| 2009 | 23 | 5.13 | 0.37 | 1699.00 | 732.30 | 0.00 | 298.80 | 7.89 | 2.59 | 0.00 | 1.49 | 11.99 |
| 2010 | 24 | 5.13 | 0.33 | 1837.00 | 594.30 | 0.00 | 298.80 | 7.62 | 1.87 | 0.00 | 1.33 | 10.84 |
| 2011 | 25 | 5.13 | 0.30 | 1863.20 | 568.10 | 0.00 | 298.80 | 6.90 | 1.60 | 0.00 | 1.19 | 9.70 |
| 2012 | 26 | 5.13 | 0.26 | 1863.20 | 568.10 | 0.00 | 298.80 | 6.16 | 1.43 | 0.00 | 1.06 | 8.66 |
| 2013 | 27 | 5.13 | 0.24 | 1863.20 | 568.10 | 0.00 | 298.80 | 5.50 | 1.27 | 0.00 | 0.95 | 7.73 |
| 2014 | 28 | 5.13 | 0.21 | 1863.20 | 568.10 | 0.00 | 298.80 | 4.91 | 1.14 | 0.00 | 0.85 | 6.90 |
| 2015 | 29 | 5.13 | 0.19 | 1863.20 | 568.10 | 0.00 | 298.80 | 4.38 | 1.01 | 0.00 | 0.75 | 6.16 |
| 2016 | 30 | 5.13 | 0.17 | 1863.20 | 568.10 | 0.00 | 298.80 | 3.91 | 0.91 | 0.00 | 0.67 | 5.50 |
| 2017 | 31 | 5.13 | 0.15 | 1863.20 | 568.10 | 0.00 | 298.80 | 3.49 | 0.81 | 0.00 | 0.60 | 4.91 |
| 2018 | 32 | 5.13 | 0.13 | 1863.20 | 568.10 | 0.00 | 298.80 | 3.12 | 0.72 | 0.00 | 0.54 | 4.38 |
| 2019 | 33 | 5.13 | 0.12 | 1863.20 | 568.10 | 0.00 | 298.80 | 2.78 | 0.64 | 0.00 | 0.48 | 3.91 |
| 2020 | 34 | 5.13 | 0.10 | 1863.20 | 568.10 | 0.00 | 298.80 | 2.48 | 0.57 | 0.00 | 0.43 | 3.49 |
| 2021 | 35 | 5.13 | 0.09 | 1863.20 | 568.10 | 0.00 | 298.80 | 2.22 | 0.51 | 0.00 | 0.38 | 3.12 |
| 2022 | 36 | 5.13 | 0.08 | 1863.20 | 568.10 | 0.00 | 298.80 | 1.98 | 0.46 | 0.00 | 0.34 | 2.78 |
| 2023 | 37 | 5.13 | 0.07 | 1863.20 | 568.10 | 0.00 | 298.80 | 1.77 | 0.41 | 0.00 | 0.30 | 2.49 |
| 2024 | 38 | 5.13 | 0.06 | 1863.20 | 568.10 | 0.00 | 298.80 | 1.58 | 0.36 | 0.00 | 0.27 | 2.22 |
| 2025 | 39 | 5.13 | 0.06 | 1863.20 | 568.10 | 0.00 | 298.80 | 1.41 | 0.32 | 0.00 | 0.24 | 1.98 |
| 2026 | 40 | 5.13 | 0.05 | 1863.20 | 568.10 | 0.00 | 298.80 | 1.26 | 0.29 | 0.00 | 0.21 | 1.77 |
| 2027 | 41 | 5.13 | 0.04 | 1863.20 | 568.10 | 0.00 | 298.80 | 1.12 | 0.26 | 0.00 | 0.19 | 1.58 |
| 2028 | 42 | 5.13 | 0.04 | 1863.20 | 568.10 | 0.00 | 298.80 | 1.00 | 0.23 | 0.00 | 0.17 | 1.41 |
| 2029 | 43 | 5.13 | 0.03 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.89 | 0.20 | 0.00 | 0.15 | 1.26 |
| 2030 | 44 | 5.13 | 0.03 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.80 | 0.18 | 0.00 | 0.13 | 1.12 |
| 2031 | 45 | 5.13 | 0.03 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.71 | 0.16 | 0.00 | 0.12 | 1.00 |
| 2032 | 46 | 5.13 | 0.02 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.63 | 0.14 | 0.00 | 0.11 | 0.89 |
| 2033 | 47 | 5.13 | 0.02 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.57 | 0.13 | 0.00 | 0.09 | 0.80 |
| 2034 | 48 | 5.13 | 0.02 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.50 | 0.11 | 0.00 | 0.08 | 0.71 |
| 2035 | 49 | 5.13 | 0.01 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.45 | 0.10 | 0.00 | 0.07 | 0.63 |
| 2036 | 50 | 5.13 | 0.01 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.40 | 0.09 | 0.00 | 0.07 | 0.57 |
| 2037 | 51 | 5.13 | 0.01 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.36 | 0.08 | 0.00 | 0.06 | 0.50 |
| 2038 | 52 | 5.13 | 0.01 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.32 | 0.07 | 0.00 | 0.05 | 0.45 |
| 2039 | 53 | 5.13 | 0.01 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.28 | 0.06 | 0.00 | 0.05 | 0.40 |
| 2040 | 54 | 5.13 | 0.01 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.25 | 0.05 | 0.00 | 0.04 | 0.36 |
| 2041 | 55 | 5.13 | 0.01 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.23 | 0.05 | 0.00 | 0.03 | 0.32 |
| 2042 | 56 | 5.13 | 0.00 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.20 | 0.04 | 0.00 | 0.03 | 0.28 |
| 2043 | 57 | 5.13 | 0.00 | 1863.20 | 568.10 | 0.00 | 298.80 | 0.18 | 0.04 | 0.00 | 0.03 | 0.25 |
| Total | | 707.74 | 229.12 | | | | | 198.21 | 122.01 | 5.67 | 44.52 | 370.42 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case - III - 140

Discount rate= 12 (%)

B = 402.55
C = 237.72
B/C = 1.693
B-C = 164.82

S = 1
kW Value B1 = 68 US\$/kW
kWh Value B2 = 0.063 US\$/kWh
kWh Value B3 = 0.048 US\$/kWh
kWh Value B4 = 0.005 US\$/kWh

C1 = 0.036836160
C2 = 0.029274397
C3 = 0.031503644

UNIT= Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | | Discounted Benefit Flow | | | | Total | |
|-------|---------------|-----------|----------------------|----------------------------------|--------------------------------|-------------------------|----------------------|-------------------------|-----------------------|----------------|-----------------|--------|--------|
| | | | | Salable Domestic Energy (GWh/Yr) | Salable Export Energy (GWh/Yr) | Surplus Energy (GWh/Yr) | Useful Capacity (MW) | Salable Domestic Energy | Salable Export Energy | Surplus Energy | Useful Capacity | | |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 23.19 | 14.73 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 47.16 | 26.75 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 69.04 | 34.97 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 109.58 | 49.56 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 59.49 | 24.02 | 179.00 | 0.00 | 836.10 | 52.00 | 4.55 | 0.00 | 1.68 | 1.42 | 7.67 | 7.67 |
| 1995 | 9 | 10.66 | 3.84 | 256.00 | 0.00 | 759.10 | 69.00 | 5.81 | 0.00 | 1.36 | 1.69 | 8.87 | 8.87 |
| 1996 | 10 | 21.26 | 6.84 | 333.00 | 0.00 | 682.10 | 86.10 | 6.75 | 0.00 | 1.09 | 1.88 | 9.73 | 9.73 |
| 1997 | 11 | 64.86 | 18.64 | 415.00 | 0.00 | 600.10 | 104.20 | 7.51 | 0.00 | 0.86 | 2.03 | 10.41 | 10.41 |
| 1998 | 12 | 42.27 | 10.84 | 500.00 | 0.00 | 1014.40 | 123.20 | 8.08 | 0.00 | 1.30 | 2.15 | 11.53 | 11.53 |
| 1999 | 13 | 9.04 | 2.07 | 588.00 | 2122.60 | 0.00 | 143.00 | 8.48 | 23.34 | 0.00 | 2.22 | 34.06 | 34.06 |
| 2000 | 14 | 5.35 | 1.09 | 680.00 | 2030.60 | 0.00 | 163.70 | 8.76 | 19.94 | 0.00 | 2.27 | 30.98 | 30.98 |
| 2001 | 15 | 5.35 | 0.97 | 776.00 | 1934.60 | 0.00 | 185.40 | 8.93 | 16.96 | 0.00 | 2.30 | 28.20 | 28.20 |
| 2002 | 16 | 5.35 | 0.87 | 876.00 | 1834.60 | 0.00 | 208.30 | 9.00 | 14.36 | 0.00 | 2.31 | 25.67 | 25.67 |
| 2003 | 17 | 5.35 | 0.77 | 980.00 | 1730.60 | 0.00 | 232.30 | 8.99 | 12.09 | 0.00 | 2.30 | 23.39 | 23.39 |
| 2004 | 18 | 5.35 | 0.69 | 1089.00 | 1621.60 | 0.00 | 257.50 | 8.92 | 10.12 | 0.00 | 2.27 | 21.32 | 21.32 |
| 2005 | 19 | 5.35 | 0.62 | 1201.00 | 1509.60 | 0.00 | 283.80 | 8.78 | 8.41 | 0.00 | 2.24 | 19.43 | 19.43 |
| 2006 | 20 | 5.35 | 0.55 | 1318.00 | 1392.60 | 0.00 | 311.30 | 8.60 | 6.92 | 0.00 | 2.19 | 17.73 | 17.73 |
| 2007 | 21 | 5.35 | 0.49 | 1440.00 | 1270.60 | 0.00 | 340.10 | 8.39 | 5.64 | 0.00 | 2.14 | 16.18 | 16.18 |
| 2008 | 22 | 5.35 | 0.44 | 1567.00 | 1143.60 | 0.00 | 349.80 | 8.15 | 4.53 | 0.00 | 1.96 | 14.66 | 14.66 |
| 2009 | 23 | 5.35 | 0.39 | 1699.00 | 1011.60 | 0.00 | 349.80 | 7.89 | 3.58 | 0.00 | 1.75 | 13.23 | 13.23 |
| 2010 | 24 | 5.35 | 0.35 | 1837.00 | 873.60 | 0.00 | 349.80 | 7.62 | 2.76 | 0.00 | 1.56 | 11.95 | 11.95 |
| 2011 | 25 | 5.35 | 0.31 | 1863.20 | 847.40 | 0.00 | 349.80 | 6.90 | 2.39 | 0.00 | 1.39 | 10.69 | 10.69 |
| 2012 | 26 | 5.35 | 0.28 | 1863.20 | 847.40 | 0.00 | 349.80 | 6.16 | 2.13 | 0.00 | 1.24 | 9.55 | 9.55 |
| 2013 | 27 | 5.35 | 0.25 | 1863.20 | 847.40 | 0.00 | 349.80 | 5.50 | 1.90 | 0.00 | 1.11 | 8.52 | 8.52 |
| 2014 | 28 | 5.35 | 0.22 | 1863.20 | 847.40 | 0.00 | 349.80 | 4.91 | 1.70 | 0.00 | 0.99 | 7.61 | 7.61 |
| 2015 | 29 | 5.35 | 0.20 | 1863.20 | 847.40 | 0.00 | 349.80 | 4.38 | 1.52 | 0.00 | 0.88 | 6.79 | 6.79 |
| 2016 | 30 | 5.35 | 0.17 | 1863.20 | 847.40 | 0.00 | 349.80 | 3.91 | 1.35 | 0.00 | 0.79 | 6.06 | 6.06 |
| 2017 | 31 | 5.35 | 0.15 | 1863.20 | 847.40 | 0.00 | 349.80 | 3.49 | 1.21 | 0.00 | 0.70 | 5.41 | 5.41 |
| 2018 | 32 | 5.35 | 0.14 | 1863.20 | 847.40 | 0.00 | 349.80 | 3.12 | 1.08 | 0.00 | 0.63 | 4.83 | 4.83 |
| 2019 | 33 | 5.35 | 0.12 | 1863.20 | 847.40 | 0.00 | 349.80 | 2.78 | 0.96 | 0.00 | 0.56 | 4.32 | 4.32 |
| 2020 | 34 | 5.35 | 0.11 | 1863.20 | 847.40 | 0.00 | 349.80 | 2.48 | 0.86 | 0.00 | 0.50 | 3.85 | 3.85 |
| 2021 | 35 | 5.35 | 0.10 | 1863.20 | 847.40 | 0.00 | 349.80 | 2.22 | 0.77 | 0.00 | 0.45 | 3.44 | 3.44 |
| 2022 | 36 | 5.35 | 0.09 | 1863.20 | 847.40 | 0.00 | 349.80 | 1.98 | 0.68 | 0.00 | 0.40 | 3.07 | 3.07 |
| 2023 | 37 | 5.35 | 0.08 | 1863.20 | 847.40 | 0.00 | 349.80 | 1.77 | 0.61 | 0.00 | 0.35 | 2.74 | 2.74 |
| 2024 | 38 | 5.35 | 0.07 | 1863.20 | 847.40 | 0.00 | 349.80 | 1.58 | 0.54 | 0.00 | 0.32 | 2.45 | 2.45 |
| 2025 | 39 | 5.35 | 0.06 | 1863.20 | 847.40 | 0.00 | 349.80 | 1.41 | 0.48 | 0.00 | 0.28 | 2.18 | 2.18 |
| 2026 | 40 | 5.35 | 0.05 | 1863.20 | 847.40 | 0.00 | 349.80 | 1.26 | 0.43 | 0.00 | 0.25 | 1.95 | 1.95 |
| 2027 | 41 | 5.35 | 0.05 | 1863.20 | 847.40 | 0.00 | 349.80 | 1.12 | 0.39 | 0.00 | 0.22 | 1.74 | 1.74 |
| 2028 | 42 | 5.35 | 0.04 | 1863.20 | 847.40 | 0.00 | 349.80 | 1.00 | 0.34 | 0.00 | 0.20 | 1.55 | 1.55 |
| 2029 | 43 | 5.35 | 0.04 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.89 | 0.31 | 0.00 | 0.18 | 1.39 | 1.39 |
| 2030 | 44 | 5.35 | 0.03 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.80 | 0.27 | 0.00 | 0.16 | 1.24 | 1.24 |
| 2031 | 45 | 5.35 | 0.03 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.71 | 0.24 | 0.00 | 0.14 | 1.10 | 1.10 |
| 2032 | 46 | 5.35 | 0.02 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.63 | 0.22 | 0.00 | 0.12 | 0.99 | 0.99 |
| 2033 | 47 | 5.35 | 0.02 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.57 | 0.19 | 0.00 | 0.11 | 0.88 | 0.88 |
| 2034 | 48 | 5.35 | 0.02 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.50 | 0.17 | 0.00 | 0.10 | 0.78 | 0.78 |
| 2035 | 49 | 5.35 | 0.02 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.45 | 0.15 | 0.00 | 0.09 | 0.70 | 0.70 |
| 2036 | 50 | 5.35 | 0.01 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.40 | 0.14 | 0.00 | 0.08 | 0.62 | 0.62 |
| 2037 | 51 | 5.35 | 0.01 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.36 | 0.12 | 0.00 | 0.07 | 0.56 | 0.56 |
| 2038 | 52 | 5.35 | 0.01 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.32 | 0.11 | 0.00 | 0.06 | 0.50 | 0.50 |
| 2039 | 53 | 5.35 | 0.01 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.28 | 0.10 | 0.00 | 0.05 | 0.44 | 0.44 |
| 2040 | 54 | 5.35 | 0.01 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.25 | 0.08 | 0.00 | 0.05 | 0.39 | 0.39 |
| 2041 | 55 | 5.35 | 0.01 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.23 | 0.07 | 0.00 | 0.04 | 0.35 | 0.35 |
| 2042 | 56 | 5.35 | 0.00 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.20 | 0.07 | 0.00 | 0.04 | 0.31 | 0.31 |
| 2043 | 57 | 5.35 | 0.00 | 1863.20 | 847.40 | 0.00 | 349.80 | 0.18 | 0.06 | 0.00 | 0.03 | 0.28 | 0.28 |
| Total | | 737.90 | 237.72 | | | | | 198.21 | 150.51 | 6.31 | 47.50 | 402.55 | 402.55 |

C1: average net cost of useful salable energy and capacity
C2: average net cost of useful salable energy
C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case - III - 100

Discount rates= 12 (X)
 B = 428.78
 C = 245.49
 B/C = 1.746
 B-C = 183.29

S = 1
 kW Value B1= 68 US\$/kW
 kWh Value B2= 0.063 US\$/kWh
 kWh Value B3= 0.048 US\$/kWh
 kWh Value B4= 0.005 US\$/kWh

C1= 0.035027288
 C2= 0.028022395
 C3= 0.029995237

UNIT= Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | | Discounted Benefit Flow | | | | Total |
|-------|---------------|-----------|----------------------|----------------------------------|--------------------------------|-------------------------|----------------------|-------------------------|-----------------------|----------------|-----------------|--------|
| | | | | Salable Domestic Energy (GWh/Yr) | Salable Export Energy (GWh/Yr) | Surplus Energy (GWh/Yr) | Useful Capacity (MW) | Salable Domestic Energy | Salable Export Energy | Surplus Energy | Useful Capacity | |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 23.69 | 15.05 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 49.10 | 27.86 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 72.47 | 36.71 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 112.97 | 51.10 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 61.61 | 24.88 | 179.00 | 0.00 | 980.70 | 52.00 | 4.55 | 0.00 | 1.98 | 1.42 | 7.96 |
| 1995 | 9 | 11.33 | 4.08 | 256.00 | 0.00 | 903.70 | 69.00 | 5.81 | 0.00 | 1.62 | 1.69 | 9.13 |
| 1996 | 10 | 17.16 | 5.52 | 339.00 | 0.00 | 826.70 | 86.10 | 6.75 | 0.00 | 1.33 | 1.88 | 9.97 |
| 1997 | 11 | 69.43 | 19.95 | 415.00 | 0.00 | 744.70 | 104.20 | 7.51 | 0.00 | 1.07 | 2.03 | 10.62 |
| 1998 | 12 | 46.95 | 12.05 | 500.00 | 0.00 | 659.70 | 123.20 | 8.08 | 0.00 | 0.84 | 2.15 | 11.08 |
| 1999 | 13 | 10.65 | 2.44 | 588.00 | 2372.30 | 0.00 | 143.00 | 8.48 | 26.09 | 0.00 | 2.22 | 36.81 |
| 2000 | 14 | 5.57 | 1.13 | 680.00 | 2280.30 | 0.00 | 163.70 | 8.76 | 22.39 | 0.00 | 2.27 | 33.44 |
| 2001 | 15 | 5.57 | 1.01 | 776.00 | 2184.30 | 0.00 | 185.40 | 8.93 | 19.15 | 0.00 | 2.30 | 30.38 |
| 2002 | 16 | 5.57 | 0.90 | 876.00 | 2084.30 | 0.00 | 208.30 | 9.00 | 16.31 | 0.00 | 2.31 | 27.63 |
| 2003 | 17 | 5.57 | 0.81 | 980.00 | 1980.30 | 0.00 | 232.30 | 8.99 | 13.84 | 0.00 | 2.30 | 25.13 |
| 2004 | 18 | 5.57 | 0.72 | 1089.00 | 1871.30 | 0.00 | 257.50 | 8.92 | 11.68 | 0.00 | 2.27 | 22.87 |
| 2005 | 19 | 5.57 | 0.64 | 1201.00 | 1759.30 | 0.00 | 283.80 | 8.78 | 9.80 | 0.00 | 2.24 | 20.83 |
| 2006 | 20 | 5.57 | 0.57 | 1318.00 | 1642.30 | 0.00 | 311.30 | 8.60 | 8.17 | 0.00 | 2.19 | 18.97 |
| 2007 | 21 | 5.57 | 0.51 | 1440.00 | 1520.30 | 0.00 | 340.10 | 8.39 | 6.75 | 0.00 | 2.14 | 17.29 |
| 2008 | 22 | 5.57 | 0.46 | 1567.00 | 1393.30 | 0.00 | 354.00 | 8.15 | 5.52 | 0.00 | 1.98 | 15.67 |
| 2009 | 23 | 5.57 | 0.41 | 1699.00 | 1261.30 | 0.00 | 354.00 | 7.89 | 4.46 | 0.00 | 1.77 | 14.14 |
| 2010 | 24 | 5.57 | 0.36 | 1837.00 | 1123.30 | 0.00 | 354.00 | 7.62 | 3.55 | 0.00 | 1.58 | 12.76 |
| 2011 | 25 | 5.57 | 0.32 | 1863.20 | 1097.10 | 0.00 | 354.00 | 6.90 | 3.09 | 0.00 | 1.41 | 11.41 |
| 2012 | 26 | 5.57 | 0.29 | 1863.20 | 1097.10 | 0.00 | 354.00 | 6.16 | 2.76 | 0.00 | 1.26 | 10.19 |
| 2013 | 27 | 5.57 | 0.26 | 1863.20 | 1097.10 | 0.00 | 354.00 | 5.50 | 2.46 | 0.00 | 1.12 | 9.10 |
| 2014 | 28 | 5.57 | 0.23 | 1863.20 | 1097.10 | 0.00 | 354.00 | 4.91 | 2.20 | 0.00 | 1.00 | 8.12 |
| 2015 | 29 | 5.57 | 0.20 | 1863.20 | 1097.10 | 0.00 | 354.00 | 4.38 | 1.96 | 0.00 | 0.89 | 7.25 |
| 2016 | 30 | 5.57 | 0.18 | 1863.20 | 1097.10 | 0.00 | 354.00 | 3.91 | 1.75 | 0.00 | 0.80 | 6.47 |
| 2017 | 31 | 5.57 | 0.16 | 1863.20 | 1097.10 | 0.00 | 354.00 | 3.49 | 1.56 | 0.00 | 0.71 | 5.78 |
| 2018 | 32 | 5.57 | 0.14 | 1863.20 | 1097.10 | 0.00 | 354.00 | 3.12 | 1.40 | 0.00 | 0.64 | 5.16 |
| 2019 | 33 | 5.57 | 0.13 | 1863.20 | 1097.10 | 0.00 | 354.00 | 2.78 | 1.25 | 0.00 | 0.57 | 4.61 |
| 2020 | 34 | 5.57 | 0.11 | 1863.20 | 1097.10 | 0.00 | 354.00 | 2.48 | 1.11 | 0.00 | 0.51 | 4.11 |
| 2021 | 35 | 5.57 | 0.10 | 1863.20 | 1097.10 | 0.00 | 354.00 | 2.22 | 0.99 | 0.00 | 0.45 | 3.67 |
| 2022 | 36 | 5.57 | 0.09 | 1863.20 | 1097.10 | 0.00 | 354.00 | 1.98 | 0.89 | 0.00 | 0.40 | 3.28 |
| 2023 | 37 | 5.57 | 0.08 | 1863.20 | 1097.10 | 0.00 | 354.00 | 1.77 | 0.79 | 0.00 | 0.36 | 2.93 |
| 2024 | 38 | 5.57 | 0.07 | 1863.20 | 1097.10 | 0.00 | 354.00 | 1.58 | 0.70 | 0.00 | 0.32 | 2.61 |
| 2025 | 39 | 5.57 | 0.06 | 1863.20 | 1097.10 | 0.00 | 354.00 | 1.41 | 0.63 | 0.00 | 0.28 | 2.33 |
| 2026 | 40 | 5.57 | 0.05 | 1863.20 | 1097.10 | 0.00 | 354.00 | 1.26 | 0.56 | 0.00 | 0.25 | 2.08 |
| 2027 | 41 | 5.57 | 0.05 | 1863.20 | 1097.10 | 0.00 | 354.00 | 1.12 | 0.50 | 0.00 | 0.23 | 1.86 |
| 2028 | 42 | 5.57 | 0.04 | 1863.20 | 1097.10 | 0.00 | 354.00 | 1.00 | 0.45 | 0.00 | 0.20 | 1.66 |
| 2029 | 43 | 5.57 | 0.04 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.89 | 0.40 | 0.00 | 0.18 | 1.48 |
| 2030 | 44 | 5.57 | 0.03 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.80 | 0.35 | 0.00 | 0.16 | 1.32 |
| 2031 | 45 | 5.57 | 0.03 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.71 | 0.32 | 0.00 | 0.14 | 1.18 |
| 2032 | 46 | 5.57 | 0.03 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.63 | 0.28 | 0.00 | 0.13 | 1.05 |
| 2033 | 47 | 5.57 | 0.02 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.57 | 0.25 | 0.00 | 0.11 | 0.94 |
| 2034 | 48 | 5.57 | 0.02 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.50 | 0.22 | 0.00 | 0.10 | 0.84 |
| 2035 | 49 | 5.57 | 0.02 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.45 | 0.20 | 0.00 | 0.09 | 0.75 |
| 2036 | 50 | 5.57 | 0.01 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.40 | 0.18 | 0.00 | 0.08 | 0.67 |
| 2037 | 51 | 5.57 | 0.01 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.36 | 0.16 | 0.00 | 0.07 | 0.59 |
| 2038 | 52 | 5.57 | 0.01 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.32 | 0.14 | 0.00 | 0.06 | 0.53 |
| 2039 | 53 | 5.57 | 0.01 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.28 | 0.12 | 0.00 | 0.05 | 0.47 |
| 2040 | 54 | 5.57 | 0.01 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.25 | 0.11 | 0.00 | 0.05 | 0.42 |
| 2041 | 55 | 5.57 | 0.01 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.23 | 0.10 | 0.00 | 0.04 | 0.38 |
| 2042 | 56 | 5.57 | 0.00 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.20 | 0.09 | 0.00 | 0.04 | 0.34 |
| 2043 | 57 | 5.57 | 0.00 | 1863.20 | 1097.10 | 0.00 | 354.00 | 0.18 | 0.08 | 0.00 | 0.03 | 0.30 |
| Total | | 766.39 | 245.49 | | | | | 198.21 | 175.99 | 6.85 | 47.71 | 428.78 |

- C1: average net cost of useful salable energy and capacity
- C2: average net cost of useful salable energy
- C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case - III - 180

Discount rate= 12 (X)
 B = 424.16
 C = 260.41
 B/C = 1.628
 B-C = 163.74

S = 1
 kW Value B1 = 68 US\$/kW
 kWh Value B2 = 0.063 US\$/kWh
 kWh Value B3 = 0.048 US\$/kWh
 kWh Value B4 = 0.005 US\$/kWh

C1 = 0.037725133
 C2 = 0.030001720
 C3 = 0.031608604

UNIT = Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | | Discounted Benefit Flow | | | | Total |
|-------|---------------|-----------|----------------------|----------------------------------|--------------------------------|-------------------------|----------------------|-------------------------|-----------------------|----------------|-----------------|--------|
| | | | | Salable Domestic Energy (GWh/Yr) | Salable Export Energy (GWh/Yr) | Surplus Energy (GWh/Yr) | Useful Capacity (MW) | Salable Domestic Energy | Salable Export Energy | Surplus Energy | Useful Capacity | |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 24.69 | 15.69 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 52.25 | 29.64 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 77.05 | 39.03 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 116.30 | 52.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 63.76 | 25.75 | 179.00 | 0.00 | 799.80 | 52.00 | 4.55 | 0.00 | 1.61 | 1.42 | 7.59 |
| 1995 | 9 | 17.04 | 6.14 | 256.00 | 0.00 | 722.80 | 69.00 | 5.81 | 0.00 | 1.30 | 1.69 | 8.81 |
| 1996 | 10 | 23.70 | 7.63 | 333.00 | 0.00 | 645.80 | 86.10 | 6.75 | 0.00 | 1.03 | 1.88 | 9.67 |
| 1997 | 11 | 71.41 | 20.52 | 415.00 | 0.00 | 1047.10 | 104.20 | 7.51 | 0.00 | 1.50 | 2.03 | 11.05 |
| 1998 | 12 | 53.21 | 13.65 | 500.00 | 0.00 | 962.10 | 123.20 | 8.08 | 0.00 | 1.23 | 2.15 | 11.47 |
| 1999 | 13 | 11.80 | 2.70 | 588.00 | 0.00 | 874.10 | 143.00 | 8.48 | 0.00 | 1.00 | 2.22 | 11.71 |
| 2000 | 14 | 7.40 | 1.51 | 680.00 | 2506.90 | 0.00 | 163.70 | 8.76 | 24.62 | 0.00 | 2.27 | 35.66 |
| 2001 | 15 | 6.06 | 1.10 | 776.00 | 2410.90 | 0.00 | 185.40 | 8.99 | 21.14 | 0.00 | 2.30 | 32.37 |
| 2002 | 16 | 6.06 | 0.98 | 876.00 | 2310.90 | 0.00 | 208.30 | 9.60 | 18.09 | 0.00 | 2.31 | 29.40 |
| 2003 | 17 | 6.06 | 0.88 | 980.00 | 2206.90 | 0.00 | 232.30 | 8.99 | 15.42 | 0.00 | 2.30 | 26.72 |
| 2004 | 18 | 6.06 | 0.78 | 1089.00 | 2097.90 | 0.00 | 257.50 | 8.92 | 13.09 | 0.00 | 2.27 | 24.29 |
| 2005 | 19 | 6.06 | 0.70 | 1201.00 | 1985.90 | 0.00 | 283.80 | 8.78 | 11.06 | 0.00 | 2.24 | 22.09 |
| 2006 | 20 | 6.06 | 0.62 | 1318.00 | 1868.90 | 0.00 | 311.30 | 8.60 | 9.29 | 0.00 | 2.19 | 20.10 |
| 2007 | 21 | 6.06 | 0.56 | 1440.00 | 1746.90 | 0.00 | 340.10 | 8.39 | 7.76 | 0.00 | 2.14 | 18.29 |
| 2008 | 22 | 6.06 | 0.50 | 1567.00 | 1619.90 | 0.00 | 354.00 | 8.15 | 6.42 | 0.00 | 1.98 | 16.57 |
| 2009 | 23 | 6.06 | 0.44 | 1699.00 | 1487.90 | 0.00 | 354.00 | 7.89 | 5.26 | 0.00 | 1.77 | 14.94 |
| 2010 | 24 | 6.06 | 0.39 | 1837.00 | 1349.90 | 0.00 | 354.00 | 7.62 | 4.26 | 0.00 | 1.58 | 13.47 |
| 2011 | 25 | 6.06 | 0.35 | 1863.20 | 1323.70 | 0.00 | 354.00 | 6.90 | 3.73 | 0.00 | 1.41 | 12.05 |
| 2012 | 26 | 6.06 | 0.31 | 1863.20 | 1323.70 | 0.00 | 354.00 | 6.16 | 3.33 | 0.00 | 1.26 | 10.76 |
| 2013 | 27 | 6.06 | 0.28 | 1863.20 | 1323.70 | 0.00 | 354.00 | 5.50 | 2.97 | 0.00 | 1.12 | 9.61 |
| 2014 | 28 | 6.06 | 0.25 | 1863.20 | 1323.70 | 0.00 | 354.00 | 4.91 | 2.66 | 0.00 | 1.00 | 8.58 |
| 2015 | 29 | 6.06 | 0.22 | 1863.20 | 1323.70 | 0.00 | 354.00 | 4.38 | 2.37 | 0.00 | 0.89 | 7.66 |
| 2016 | 30 | 6.06 | 0.20 | 1863.20 | 1323.70 | 0.00 | 354.00 | 3.91 | 2.12 | 0.00 | 0.80 | 6.84 |
| 2017 | 31 | 6.06 | 0.18 | 1863.20 | 1323.70 | 0.00 | 354.00 | 3.49 | 1.89 | 0.00 | 0.71 | 6.10 |
| 2018 | 32 | 6.06 | 0.16 | 1863.20 | 1323.70 | 0.00 | 354.00 | 3.12 | 1.69 | 0.00 | 0.64 | 5.45 |
| 2019 | 33 | 6.06 | 0.14 | 1863.20 | 1323.70 | 0.00 | 354.00 | 2.78 | 1.50 | 0.00 | 0.57 | 4.87 |
| 2020 | 34 | 6.06 | 0.12 | 1863.20 | 1323.70 | 0.00 | 354.00 | 2.48 | 1.34 | 0.00 | 0.51 | 4.34 |
| 2021 | 35 | 6.06 | 0.11 | 1863.20 | 1323.70 | 0.00 | 354.00 | 2.22 | 1.20 | 0.00 | 0.45 | 3.88 |
| 2022 | 36 | 6.06 | 0.10 | 1863.20 | 1323.70 | 0.00 | 354.00 | 1.98 | 1.07 | 0.00 | 0.40 | 3.46 |
| 2023 | 37 | 6.06 | 0.09 | 1863.20 | 1323.70 | 0.00 | 354.00 | 1.77 | 0.95 | 0.00 | 0.36 | 3.09 |
| 2024 | 38 | 6.06 | 0.08 | 1863.20 | 1323.70 | 0.00 | 354.00 | 1.58 | 0.85 | 0.00 | 0.32 | 2.76 |
| 2025 | 39 | 6.06 | 0.07 | 1863.20 | 1323.70 | 0.00 | 354.00 | 1.41 | 0.76 | 0.00 | 0.28 | 2.46 |
| 2026 | 40 | 6.06 | 0.06 | 1863.20 | 1323.70 | 0.00 | 354.00 | 1.29 | 0.68 | 0.00 | 0.25 | 2.20 |
| 2027 | 41 | 6.06 | 0.05 | 1863.20 | 1323.70 | 0.00 | 354.00 | 1.12 | 0.60 | 0.00 | 0.23 | 1.96 |
| 2028 | 42 | 6.06 | 0.05 | 1863.20 | 1323.70 | 0.00 | 354.00 | 1.00 | 0.54 | 0.00 | 0.20 | 1.75 |
| 2029 | 43 | 6.06 | 0.04 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.89 | 0.48 | 0.00 | 0.18 | 1.56 |
| 2030 | 44 | 6.06 | 0.04 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.81 | 0.43 | 0.00 | 0.16 | 1.40 |
| 2031 | 45 | 6.06 | 0.03 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.71 | 0.38 | 0.00 | 0.14 | 1.25 |
| 2032 | 46 | 6.06 | 0.03 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.63 | 0.34 | 0.00 | 0.13 | 1.11 |
| 2033 | 47 | 6.06 | 0.02 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.57 | 0.30 | 0.00 | 0.11 | 0.99 |
| 2034 | 48 | 6.06 | 0.02 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.50 | 0.27 | 0.00 | 0.10 | 0.88 |
| 2035 | 49 | 6.06 | 0.02 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.45 | 0.24 | 0.00 | 0.09 | 0.79 |
| 2036 | 50 | 6.06 | 0.02 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.40 | 0.21 | 0.00 | 0.08 | 0.70 |
| 2037 | 51 | 6.06 | 0.01 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.36 | 0.19 | 0.00 | 0.07 | 0.63 |
| 2038 | 52 | 6.06 | 0.01 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.32 | 0.17 | 0.00 | 0.06 | 0.56 |
| 2039 | 53 | 6.06 | 0.01 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.28 | 0.15 | 0.00 | 0.05 | 0.50 |
| 2040 | 54 | 6.06 | 0.01 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.25 | 0.13 | 0.00 | 0.05 | 0.45 |
| 2041 | 55 | 6.06 | 0.01 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.23 | 0.12 | 0.00 | 0.04 | 0.40 |
| 2042 | 56 | 6.06 | 0.01 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.20 | 0.11 | 0.00 | 0.04 | 0.35 |
| 2043 | 57 | 6.06 | 0.00 | 1863.20 | 1323.70 | 0.00 | 354.00 | 0.18 | 0.09 | 0.00 | 0.03 | 0.32 |
| Total | | 825.14 | 260.41 | | | | | 198.21 | 170.52 | 7.69 | 47.71 | 424.16 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

Discounted Cash Flow Method

Case- III - 200

Discount rate= 12 (%)
 B = 443.66
 C = 269.03
 B/C = 1.649
 B-C = 174.63

S = 1
 kW Value B1= 68 US\$/kW
 kWh Value B2= 0.063 US\$/kWh
 kWh Value B3= 0.048 US\$/kWh
 kWh Value B4= 0.005 US\$/kWh

C1= 0.036765376
 C2= 0.030040847
 C3= 0.030242876

UNIT= Million US\$

| Year | Serial Number | Cost Flow | Discounted Cost Flow | Project Sales | | | | Discounted Benefit Flow | | | | Total |
|-------|---------------|-----------|----------------------|----------------------------------|--------------------------------|-------------------------|----------------------|-------------------------|-----------------------|----------------|-----------------|--------|
| | | | | Salable Domestic Energy (GWh/Yr) | Salable Export Energy (GWh/Yr) | Surplus Energy (GWh/Yr) | Useful Capacity (MW) | Salable Domestic Energy | Salable Export Energy | Surplus Energy | Useful Capacity | |
| 1987 | 1 | 4.81 | 4.29 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1988 | 2 | 19.57 | 15.60 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1989 | 3 | 21.57 | 15.35 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1990 | 4 | 25.28 | 16.06 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1991 | 5 | 54.56 | 30.95 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1992 | 6 | 80.90 | 40.98 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1993 | 7 | 120.14 | 54.34 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 1994 | 8 | 66.11 | 26.70 | 179.00 | 0.00 | 908.50 | 52.00 | 4.55 | 0.00 | 1.83 | 1.42 | 7.81 |
| 1995 | 9 | 12.91 | 4.65 | 256.00 | 0.00 | 831.50 | 69.00 | 5.81 | 0.00 | 1.49 | 1.69 | 9.00 |
| 1996 | 10 | 24.98 | 8.04 | 333.00 | 0.00 | 754.50 | 86.10 | 6.75 | 0.00 | 1.21 | 1.88 | 9.85 |
| 1997 | 11 | 77.73 | 22.34 | 415.00 | 0.00 | 672.50 | 104.20 | 7.51 | 0.00 | 0.96 | 2.03 | 10.51 |
| 1998 | 12 | 57.01 | 14.63 | 500.00 | 0.00 | 1118.50 | 123.20 | 8.08 | 0.00 | 1.43 | 2.15 | 11.67 |
| 1999 | 13 | 12.35 | 2.83 | 588.00 | 0.00 | 1030.50 | 143.00 | 8.48 | 0.00 | 1.18 | 2.22 | 11.89 |
| 2000 | 14 | 7.69 | 1.57 | 680.00 | 2716.40 | 0.00 | 163.70 | 8.76 | 26.67 | 0.00 | 2.27 | 37.72 |
| 2001 | 15 | 6.29 | 1.14 | 776.00 | 2620.40 | 0.00 | 185.40 | 8.93 | 22.97 | 0.00 | 2.30 | 34.21 |
| 2002 | 16 | 6.29 | 1.02 | 876.00 | 2520.40 | 0.00 | 208.30 | 9.00 | 19.73 | 0.00 | 2.31 | 31.04 |
| 2003 | 17 | 6.29 | 0.91 | 980.00 | 2416.40 | 0.00 | 232.30 | 8.99 | 16.89 | 0.00 | 2.30 | 28.18 |
| 2004 | 18 | 6.29 | 0.81 | 1089.00 | 2307.40 | 0.00 | 257.50 | 8.92 | 14.40 | 0.00 | 2.27 | 25.60 |
| 2005 | 19 | 6.29 | 0.73 | 1201.00 | 2195.40 | 0.00 | 283.80 | 8.78 | 12.23 | 0.00 | 2.24 | 23.26 |
| 2006 | 20 | 6.29 | 0.65 | 1318.00 | 2078.40 | 0.00 | 311.30 | 8.60 | 10.34 | 0.00 | 2.19 | 21.14 |
| 2007 | 21 | 6.29 | 0.58 | 1440.00 | 1956.40 | 0.00 | 340.10 | 8.39 | 8.69 | 0.00 | 2.14 | 19.22 |
| 2008 | 22 | 6.29 | 0.51 | 1567.00 | 1829.40 | 0.00 | 354.00 | 8.15 | 7.25 | 0.00 | 1.98 | 17.40 |
| 2009 | 23 | 6.29 | 0.46 | 1699.00 | 1697.40 | 0.00 | 354.00 | 7.89 | 6.01 | 0.00 | 1.77 | 15.68 |
| 2010 | 24 | 6.29 | 0.41 | 1837.00 | 1559.40 | 0.00 | 354.00 | 7.62 | 4.93 | 0.00 | 1.58 | 14.14 |
| 2011 | 25 | 6.29 | 0.36 | 1863.20 | 1533.20 | 0.00 | 354.00 | 6.90 | 4.32 | 0.00 | 1.41 | 12.64 |
| 2012 | 26 | 6.29 | 0.33 | 1863.20 | 1533.20 | 0.00 | 354.00 | 6.16 | 3.86 | 0.00 | 1.26 | 11.29 |
| 2013 | 27 | 6.29 | 0.29 | 1863.20 | 1533.20 | 0.00 | 354.00 | 5.50 | 3.45 | 0.00 | 1.12 | 10.08 |
| 2014 | 28 | 6.29 | 0.26 | 1863.20 | 1533.20 | 0.00 | 354.00 | 4.91 | 3.08 | 0.00 | 1.00 | 9.00 |
| 2015 | 29 | 6.29 | 0.23 | 1863.20 | 1533.20 | 0.00 | 354.00 | 4.38 | 2.75 | 0.00 | 0.89 | 8.03 |
| 2016 | 30 | 6.29 | 0.20 | 1863.20 | 1533.20 | 0.00 | 354.00 | 3.91 | 2.45 | 0.00 | 0.80 | 7.17 |
| 2017 | 31 | 6.29 | 0.18 | 1863.20 | 1533.20 | 0.00 | 354.00 | 3.49 | 2.19 | 0.00 | 0.71 | 6.40 |
| 2018 | 32 | 6.29 | 0.16 | 1863.20 | 1533.20 | 0.00 | 354.00 | 3.12 | 1.95 | 0.00 | 0.64 | 5.72 |
| 2019 | 33 | 6.29 | 0.14 | 1863.20 | 1533.20 | 0.00 | 354.00 | 2.78 | 1.74 | 0.00 | 0.57 | 5.10 |
| 2020 | 34 | 6.29 | 0.13 | 1863.20 | 1533.20 | 0.00 | 354.00 | 2.48 | 1.56 | 0.00 | 0.51 | 4.56 |
| 2021 | 35 | 6.29 | 0.11 | 1863.20 | 1533.20 | 0.00 | 354.00 | 2.22 | 1.39 | 0.00 | 0.45 | 4.07 |
| 2022 | 36 | 6.29 | 0.10 | 1863.20 | 1533.20 | 0.00 | 354.00 | 1.98 | 1.24 | 0.00 | 0.40 | 3.63 |
| 2023 | 37 | 6.29 | 0.09 | 1863.20 | 1533.20 | 0.00 | 354.00 | 1.77 | 1.11 | 0.00 | 0.36 | 3.24 |
| 2024 | 38 | 6.29 | 0.08 | 1863.20 | 1533.20 | 0.00 | 354.00 | 1.58 | 0.93 | 0.00 | 0.32 | 2.89 |
| 2025 | 39 | 6.29 | 0.07 | 1863.20 | 1533.20 | 0.00 | 354.00 | 1.41 | 0.88 | 0.00 | 0.28 | 2.58 |
| 2026 | 40 | 6.29 | 0.06 | 1863.20 | 1533.20 | 0.00 | 354.00 | 1.26 | 0.79 | 0.00 | 0.25 | 2.31 |
| 2027 | 41 | 6.29 | 0.06 | 1863.20 | 1533.20 | 0.00 | 354.00 | 1.12 | 0.70 | 0.00 | 0.23 | 2.06 |
| 2028 | 42 | 6.29 | 0.05 | 1863.20 | 1533.20 | 0.00 | 354.00 | 1.00 | 0.63 | 0.00 | 0.20 | 1.84 |
| 2029 | 43 | 6.29 | 0.04 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.89 | 0.56 | 0.00 | 0.18 | 1.64 |
| 2030 | 44 | 6.29 | 0.04 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.80 | 0.50 | 0.00 | 0.16 | 1.46 |
| 2031 | 45 | 6.29 | 0.03 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.71 | 0.44 | 0.00 | 0.14 | 1.31 |
| 2032 | 46 | 6.29 | 0.03 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.63 | 0.40 | 0.00 | 0.13 | 1.17 |
| 2033 | 47 | 6.29 | 0.03 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.57 | 0.35 | 0.00 | 0.11 | 1.04 |
| 2034 | 48 | 6.29 | 0.02 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.50 | 0.31 | 0.00 | 0.10 | 0.93 |
| 2035 | 49 | 6.29 | 0.02 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.45 | 0.28 | 0.00 | 0.09 | 0.83 |
| 2036 | 50 | 6.29 | 0.02 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.40 | 0.25 | 0.00 | 0.08 | 0.74 |
| 2037 | 51 | 6.29 | 0.01 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.36 | 0.22 | 0.00 | 0.07 | 0.66 |
| 2038 | 52 | 6.29 | 0.01 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.32 | 0.20 | 0.00 | 0.06 | 0.59 |
| 2039 | 53 | 6.29 | 0.01 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.28 | 0.18 | 0.00 | 0.05 | 0.52 |
| 2040 | 54 | 6.29 | 0.01 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.25 | 0.16 | 0.00 | 0.05 | 0.47 |
| 2041 | 55 | 6.29 | 0.01 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.23 | 0.14 | 0.00 | 0.04 | 0.42 |
| 2042 | 56 | 6.29 | 0.01 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.20 | 0.12 | 0.00 | 0.04 | 0.37 |
| 2043 | 57 | 6.29 | 0.00 | 1863.20 | 1533.20 | 0.00 | 354.00 | 0.18 | 0.11 | 0.00 | 0.03 | 0.33 |
| Total | | 856.08 | 269.03 | | | | | 198.21 | 189.60 | 8.13 | 47.71 | 443.66 |

C1: average net cost of useful salable energy and capacity
 C2: average net cost of useful salable energy
 C3: average net cost of total energy and capacity

D. DESIGN DATA

D. DESIGN DATA

| | Page |
|--|------|
| D.1 Rating Curve at Dam Site | D-1 |
| D.2 Discharge Capacity of Diversion Tunnel | D-4 |
| D.3 Stability Analysis of Dam | D-8 |
| D.4 Spillway Discharge Capacity | D-28 |
| D.5 Oscillation Analysis of Surging Water Level | D-32 |
| D.6 Water Hammer at Penstock | D-40 |
| D.7 Rating Curve at Tailrace Outlet | D-46 |
| D.8 Calculation of Head Loss | D-49 |
| D.9 Probability Analysis on Seismic Hazard at the ARUN-3 Project Site | D-54 |

D.1 Rating Curve at Dam Site

(1) Formula

$$Q = AV = A \frac{1}{n} I^{\frac{1}{2}} R^{\frac{2}{3}}$$

where

- Q: Discharge (m³/s)
- A: Cross Sectional Area (m²)
- V: Flow Velocity (m/s)
- n: Coefficient of Roughness 0.045, 0.035.
- I: Hydraulic Gradient 1/100
- R: Hydraulic Radius

(2) Rating Curve

Results are shown in Table - D-1, - D-2 and Fig. D-1. The symbols in the Tables are as following

- F : Froude Number
- SQ : Discharge = Q (m³/s)

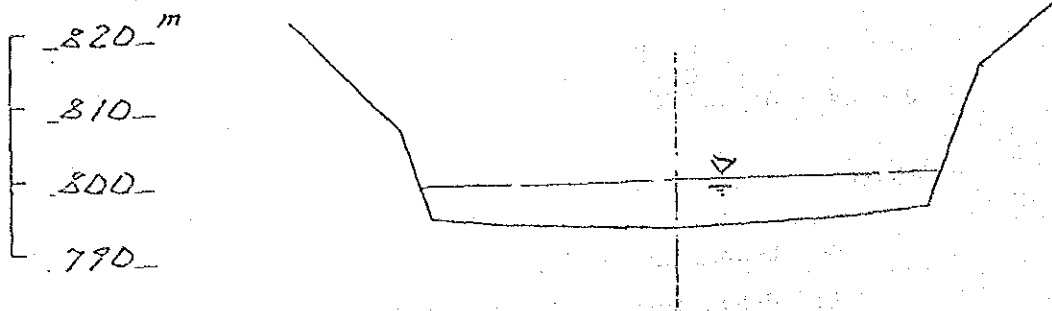


Table D-1

$n = 0.045$

1 / 100

| EL. (m) | D (m) | A (m ²) | P (m) | R (m) | n | V (m/s) | F | SQ (m ³ /s) | Q (m ³ /s) |
|------------|----------|------------------------|----------|----------|-------|------------|-------|---------------------------|--------------------------|
| 792.000 | 0.500 | 23.500 | 47.043 | 0.500 | 0.045 | 1.399 | 0.663 | 32.878 | 32.878 |
| 793.000 | 1.201 | 80.500 | 67.142 | 1.199 | 0.045 | 2.508 | 0.767 | 201.891 | 201.891 |
| 794.000 | 2.184 | 147.851 | 69.262 | 2.135 | 0.045 | 3.684 | 0.835 | 544.708 | 544.708 |
| 795.000 | 3.156 | 215.904 | 71.382 | 3.025 | 0.045 | 4.648 | 0.876 | 1003.450 | 1003.450 |
| 796.000 | 4.119 | 284.658 | 73.502 | 3.873 | 0.045 | 5.480 | 0.905 | 1560.010 | 1560.010 |
| 797.000 | 5.073 | 354.114 | 75.622 | 4.683 | 0.045 | 6.220 | 0.925 | 2202.570 | 2202.570 |
| 798.000 | 6.017 | 424.272 | 77.741 | 5.457 | 0.045 | 6.888 | 0.941 | 2922.540 | 2922.540 |
| 799.000 | 6.953 | 495.132 | 79.861 | 6.200 | 0.045 | 7.500 | 0.953 | 3713.340 | 3713.340 |
| 800.000 | 7.880 | 566.693 | 81.981 | 6.913 | 0.045 | 8.064 | 0.962 | 4569.750 | 4569.750 |
| 801.000 | 8.799 | 638.956 | 84.101 | 7.598 | 0.045 | 8.588 | 0.970 | 5487.480 | 5487.480 |
| 802.000 | 9.710 | 711.921 | 86.221 | 8.257 | 0.045 | 9.078 | 0.976 | 6462.990 | 6462.990 |
| 803.000 | 10.614 | 785.588 | 88.340 | 8.893 | 0.045 | 9.538 | 0.981 | 7493.290 | 7493.290 |
| 804.000 | 11.509 | 859.956 | 90.460 | 9.506 | 0.045 | 9.972 | 0.985 | 8575.840 | 8575.840 |
| 805.000 | 12.397 | 935.026 | 92.580 | 10.100 | 0.045 | 10.383 | 0.988 | 9708.440 | 9708.440 |

Table D-2

$n = 0.035$

1 / 100

| EL. (m) | D (m) | A (m ²) | P (m) | R (m) | n | V (m/s) | F | SQ (m ³ /s) | Q (m ³ /s) |
|------------|----------|------------------------|----------|----------|-------|------------|-------|---------------------------|--------------------------|
| 792.000 | 0.500 | 23.500 | 47.043 | 0.500 | 0.035 | 1.799 | 0.852 | 42.272 | 42.272 |
| 793.000 | 1.201 | 80.500 | 67.142 | 1.199 | 0.035 | 3.225 | 0.986 | 259.574 | 259.574 |
| 794.000 | 2.184 | 147.851 | 69.262 | 2.135 | 0.035 | 4.737 | 1.074 | 700.339 | 700.339 |
| 795.000 | 3.156 | 215.904 | 71.382 | 3.025 | 0.035 | 5.976 | 1.127 | 1290.150 | 1290.150 |
| 796.000 | 4.119 | 284.658 | 73.502 | 3.873 | 0.035 | 7.046 | 1.163 | 2005.730 | 2005.730 |
| 797.000 | 5.073 | 354.114 | 75.622 | 4.683 | 0.035 | 7.997 | 1.190 | 2831.870 | 2831.870 |
| 798.000 | 6.017 | 424.272 | 77.741 | 5.457 | 0.035 | 8.856 | 1.210 | 3757.550 | 3757.550 |
| 799.000 | 6.953 | 495.132 | 79.861 | 6.200 | 0.035 | 9.642 | 1.225 | 4774.300 | 4774.300 |
| 800.000 | 7.880 | 566.693 | 81.981 | 6.913 | 0.035 | 10.368 | 1.237 | 5875.390 | 5875.390 |
| 801.000 | 8.799 | 638.956 | 84.101 | 7.598 | 0.035 | 11.042 | 1.247 | 7055.330 | 7055.330 |
| 802.000 | 9.710 | 711.921 | 86.221 | 8.257 | 0.035 | 11.672 | 1.255 | 8309.560 | 8309.560 |
| 803.000 | 10.614 | 785.588 | 88.340 | 8.893 | 0.035 | 12.264 | 1.261 | 9634.240 | 9634.240 |
| 804.000 | 11.509 | 859.956 | 90.460 | 9.506 | 0.035 | 12.822 | 1.266 | 11026.100 | 11026.100 |
| 100 | | | | | | | | | |
| 805.000 | 12.397 | 935.026 | 92.580 | 10.100 | 0.035 | 13.350 | 1.270 | 12482.300 | 12482.300 |
| 300 | | | | | | | | | |

Rating Curve at Dam Site

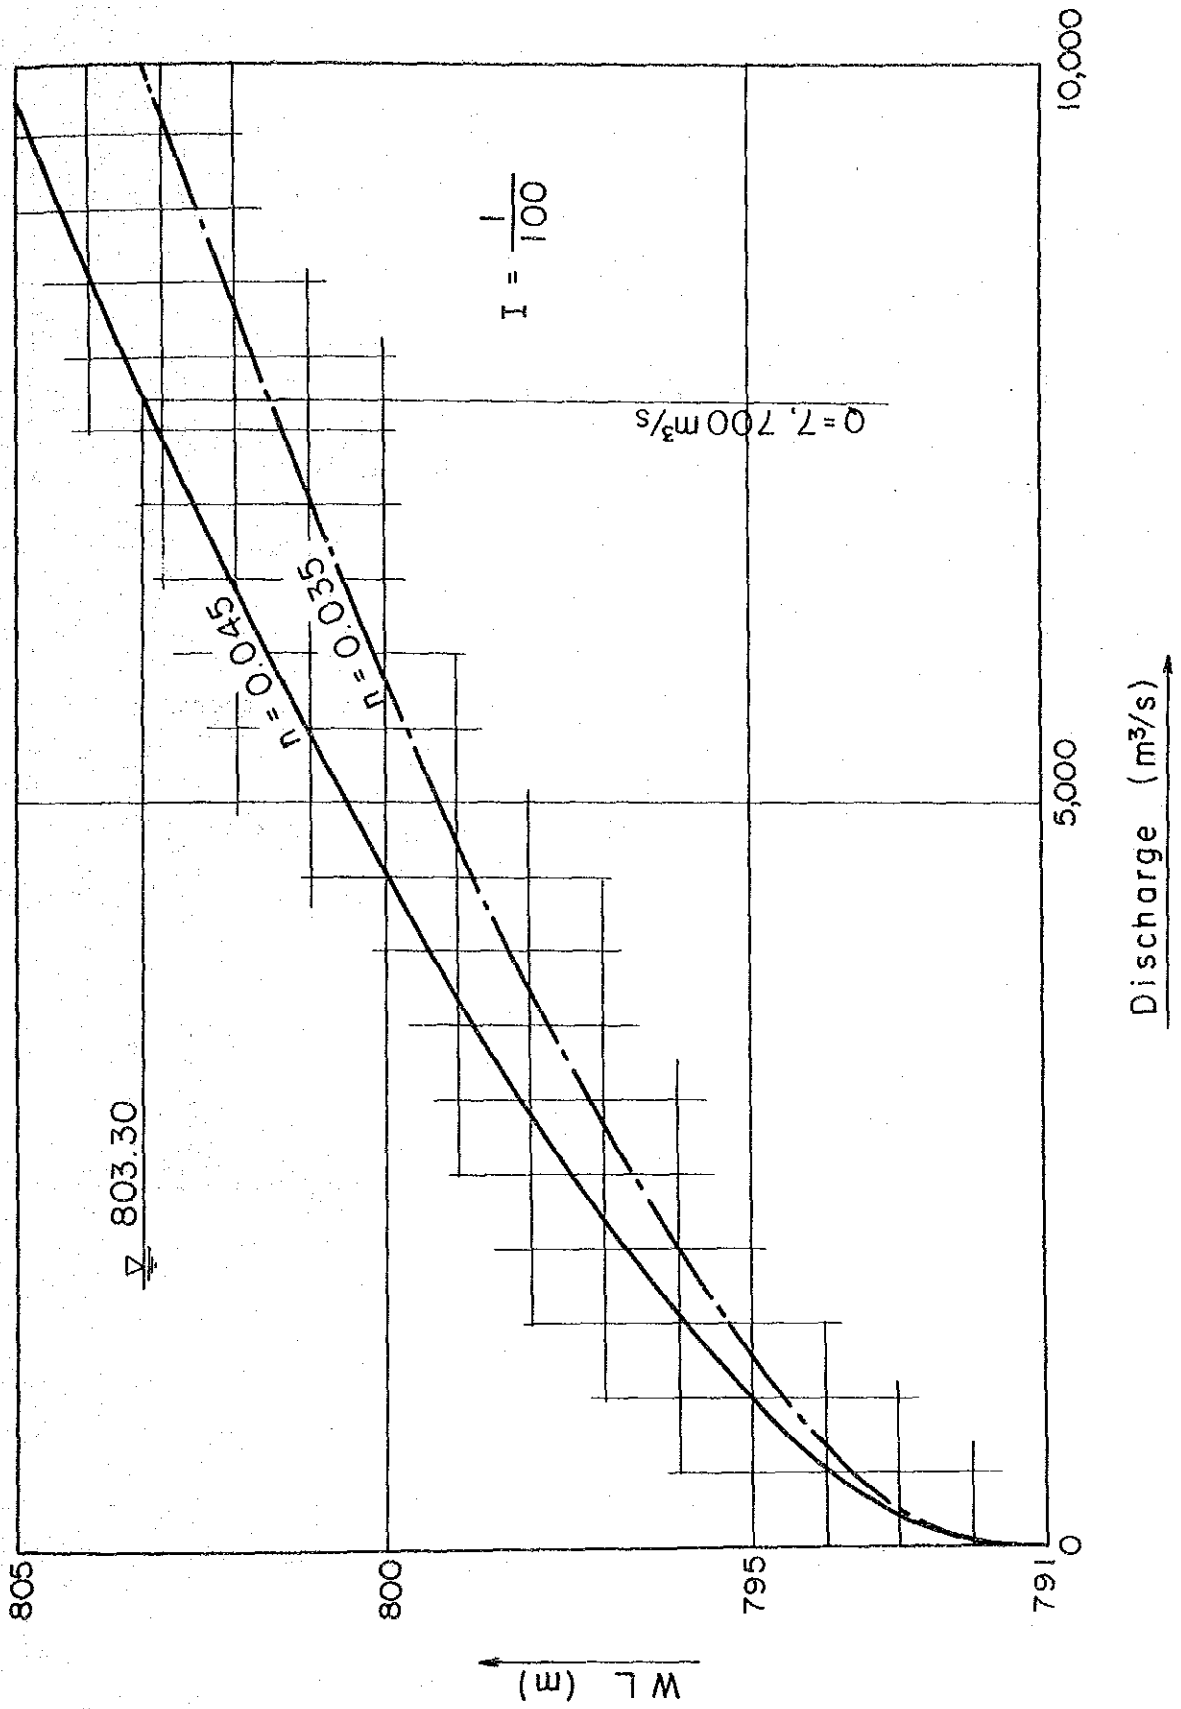


Fig. D-1

D.2 Discharge Capacity of Diversion Tunnel

(1) Open flow condition

Formula

$$H = h_c + \frac{v_c^2}{2g} (1+fe) + H_c$$

where

H: Water Surface EL.


h_c : Critical depth of flow at Inlet

H_c : EL. of Inlet invert (EL. 800.0m)

v_c : Critical Velocity

fe : Coefficient of Head Loss due to Entrance
($fe = 0.20$)

g : Acceleration of Gravity ($g = 9.8 \text{ m/s}^2$)

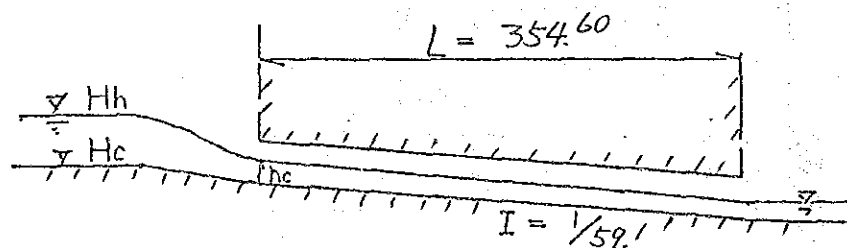


Calculations

Table D-3

| Q (m ³ /s) | h _c (m) | V _c (m/s) | $\frac{V_c^2}{2g}(1+f_e)$ | H (m) |
|-----------------------|--------------------|----------------------|---------------------------|--------|
| 50 | 1.79 | 3.99 | 0.89 | 802.68 |
| 100 | 3.00 | 4.76 | 1.27 | 804.27 |
| 150 | 3.61 | 5.94 | 1.98 | 805.59 |
| 200 | 4.51 | 6.34 | 2.26 | 806.77 |
| 250 | 5.23 | 6.83 | 2.62 | 807.85 |
| 300 | 5.91 | 7.25 | 2.95 | 808.86 |
| 350 | 6.55 | 7.63 | 3.27 | 809.82 |
| 400 | 7.16 | 7.98 | 3.57 | 810.73 |
| 450 | 7.74 | 8.31 | 3.88 | 811.62 |

(2) Pipe flow condition

Formula

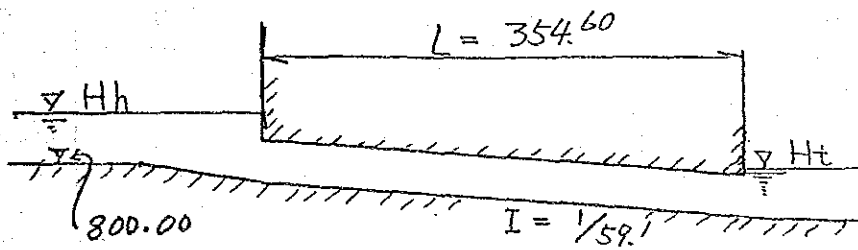

$$H_h = \frac{v^2}{2g} (1+f_e+f_L+f_b) + H_t$$

where

H_h: Water level at Inlet (EL.)

H_t: Water level at Outlet (EL.) (= 800.00m)

f_e : Coefficient of head loss due to entrance

$$f_e = 0.1$$

f_f : Coefficient of head loss due to friction

$$f_f = \frac{122.0 \times n^2 \times L}{D^{4/3}}$$

$$n = 0.015$$

f_b : Coefficient of head loss due to bend

$$f_b = 0.064$$

$$H_h = \frac{v^2}{2g} (1 + 0.1 + 0.727 + 0.064) + 800$$

$$= 0.096 v^2 + 800$$


$$v = Q/A = Q/40.633$$

Calculations

Table D-4

| Q (m ³ /s) | v (m/s) | $(1+f_e+f_f+f_b)\frac{v^2}{2g}$ | Ht (m) | Hb (m) |
|-----------------------|---------|---------------------------------|--------|--------|
| 300 | 7.383 | 5.233 | 800.00 | 805.23 |
| 350 | 8.614 | 7.123 | " | 807.12 |
| 400 | 9.844 | 9.303 | " | 809.30 |
| 450 | 11.075 | 11.775 | " | 811.78 |
| 500 | 12.305 | 14.536 | " | 814.54 |
| 550 | 13.536 | 17.589 | " | 817.59 |
| 600 | 14.766 | 20.931 | " | 820.93 |
| 650 | 15.997 | 24.567 | " | 824.57 |
| 700 | 17.227 | 28.490 | " | 828.49 |

Fig. D-2 DISCHARGE CURVE OF DIVERSION TUNNEL

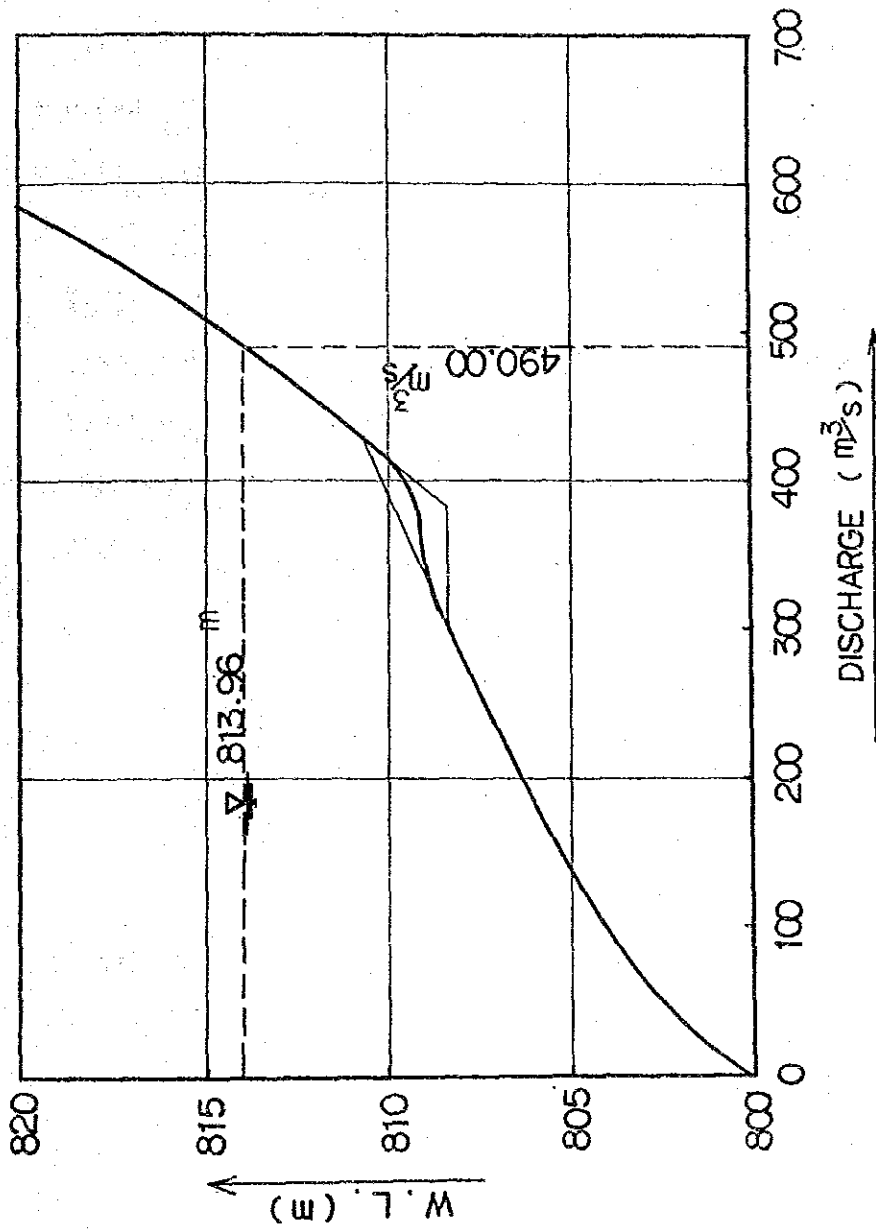

D.3 Stability Analysis of Dam

1. Design Conditions

| | |
|-------------------------------------|------------------------------|
| Unit Weight of Water | $W_o = 1.0 \text{ t/m}^3$ |
| Unit Weight of Concrete | $W_c = 2.30 \text{ t/m}^3$ |
| Unit Weight of Sediment (Submerged) | $W_l = 1.1 \text{ t/m}^3$ |
| Coefficient of Sediment Pressure | $C_e = 0.5$ |
| Seismic Coefficient | $K = 0.12$ |
| Crest EL. | EL. 846.0 m |
| Foundation Rock EL. | EL. 781.0 m |
| Sediment EL. | EL. 828.0 m |
| Slope (D/S) | $m = 1:0.9$ |
| Slope (U/S) EL. 846.0 - EL. 806.0 | Vertical |
| EL. 806.0 - EL. 781.0 | $n = 1:0.3$ |
| Shear Strength | $\tau_o = 150 \text{ t/m}^2$ |
| Coefficient of Internal Friction | $f = 0.75$ |

2. Load and Calculations

(1) Body Weight

$$W_c = w_c \cdot V$$

where

W_c : Body Weight (t)

w_c : Unit Weight of Concrete = $2.30 \text{ (t/m}^3\text{)}$

V : Volume (m^3)

(2) Seismic Force

$$H_c = W_c \cdot K$$

where

H_c : Seismic Force (t)

K : Seismic Coefficient

(3) Hydrostatic Pressure

$$P = w_o \cdot h$$

where

P: Hydrostatic Pressure (t/m²)

w_o: Unit Weight of Water = 1.00 (t/m³)

h: Water Depth (m)

1) Upstream

$$\text{Normal High W.L} = 842.00 + 1.50^{1)} + 0.50^{2)} = 844.0 \text{ m}$$

2) Downstream W.L

$$\text{Downstream Bed EL} + 2.0 \text{ m} = 795.0 \text{ m}$$

(4) Sediment Pressure

$$P_e = C_e \cdot w_l \cdot d$$

where

P_e: Sediment Pressure in Horizontal Direction (t/m²)

C_e: Coefficient of Sediment Pressure = 0.50

w_l: Unit Weight of Sediment (Submerged) (t/m³)

$$w_l = w - (1 - v) \cdot w_o$$

w: Apparent Unit Weight of Sediment
= 1.80 (t/m³)

v: Porosity of Sediment = 0.30

$$w_l = 1.80 - (1 - 0.3) \times 1.00 = 1.1 \text{ (t/m}^3\text{)}$$

d: Sediment Depth (m)

-
- Note 1) Wave height induced by wind
2) Wave height induced by earthquake

(5) Uplift pressure

Heel : Upstream Water Pressure

Drainage: Downstream water pressure plus over 1/5 of the difference between upstream and downstream ends

Toe : Downstream Water Pressure

Waves and effects of instantaneous change of reservoir W.L are not considered in the water pressures above mentioned.

(6) Hydrodynamic Pressure

$$P_d = \frac{7}{8} \cdot w_o \cdot K \cdot H \cdot h$$

where

P_d : Hydrodynamic Pressure (t/m^3)

w_o : Unit Weight of Water = 1.00 (t/m^3)

K : Seismic Coefficient

H : Water depth measured from water surface of reservoir to foundation

h : Water depth measured from water surface down to a given point

(7) Miscellaneous

In addition to the aboves, the weight of water, sediment, and weight due to auxiliary structures are considered.

3. Stability Analyses

Stability Analyses are carried out by personal computer, on condition that the reservoir is H.W.L and earthquake takes place.

Working Point of Load

$$X_o = \frac{M}{V} \text{ (m)}$$

Distance of Eccentricity

$$e = X_o - \frac{L}{2} \text{ (m)}$$

L : Bottom Length

Moment around the center of Bottom Section

$$M_o = e \cdot V \text{ (t.m)}$$

Normal Stress Heel

$$\sigma_u = \frac{\Sigma V}{L} \left(1 - \frac{6 \cdot e}{L}\right) \text{ (t/m}^2\text{)}$$

Toe


$$\sigma_d = \frac{\Sigma V}{L} \left(1 + \frac{6 \cdot e}{L}\right) \text{ (t/m}^2\text{)}$$

Safety Factor for Shear
Friction


$$n = \frac{V \cdot f + \tau_o L}{H}$$

Fig. D-3 Load Diagram for Stability Analysis

● Non-overflow Section

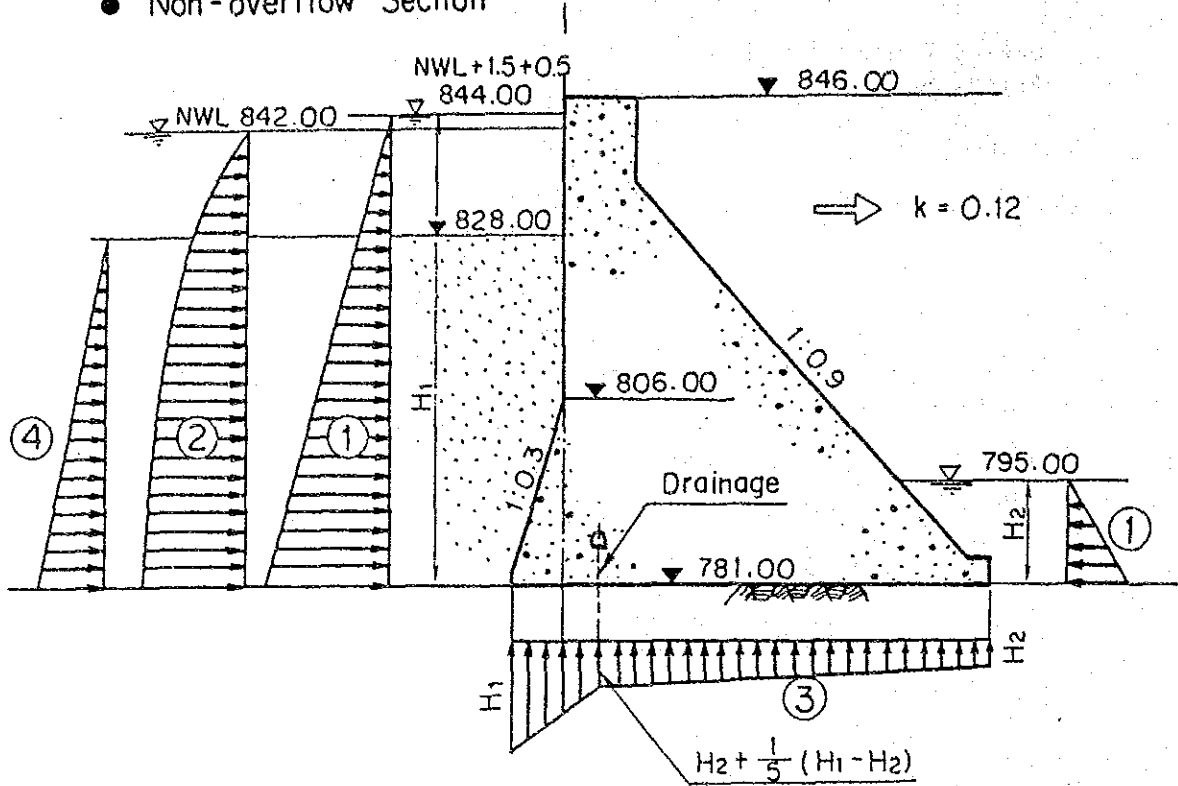

● Overflow Section

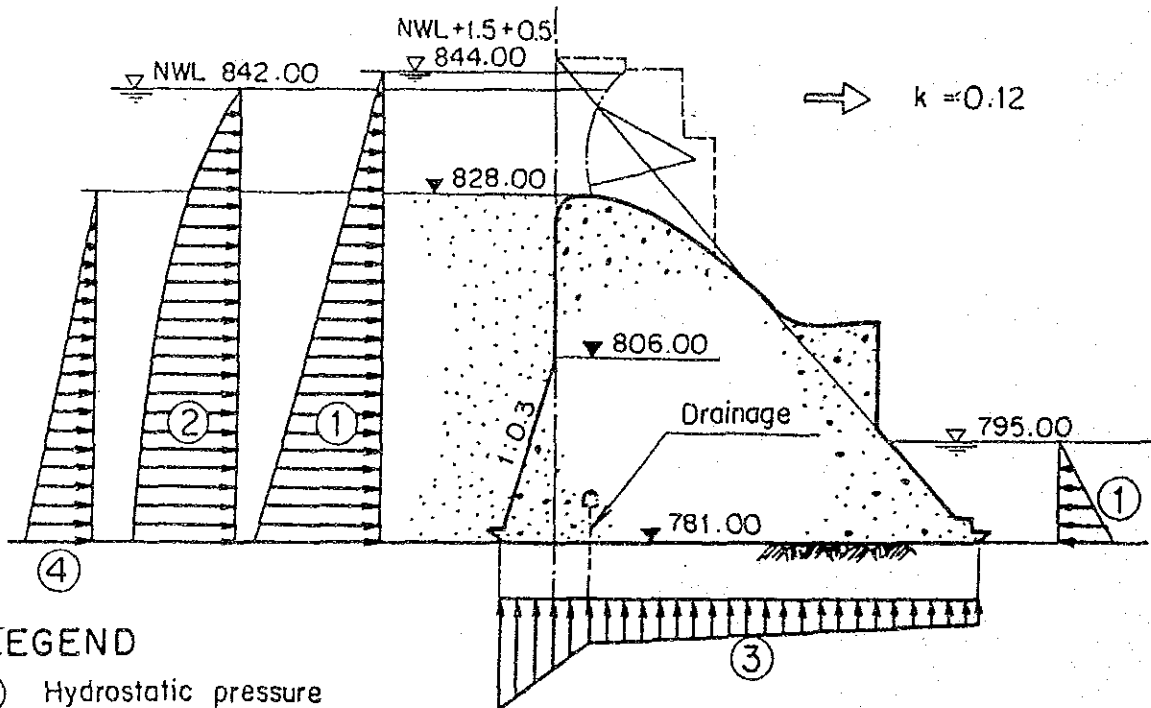

LEGEND

- ① Hydrostatic pressure
- ② Hydrodynamic pressure
- ③ Uplift
- ④ Sediment pressure

4. Calculation Results

4.1 Crest gate type (Non-overflow section)

(1) Dam shape

| Point | Y (m) | EL (m) |
|-------|--------|---------|
| 1 | 58.500 | 846.000 |
| 2 | 48.500 | 846.000 |
| 3 | 48.500 | 834.889 |
| 4 | 58.500 | 806.000 |
| 5 | 66.000 | 781.000 |
| 6 | 0.000 | 781.000 |

| | |
|--------------------------|-------------------------|
| Note: Foundation Rock EL | 781.000 |
| Width of Crest Road | 10.000 |
| Slope Upstream | 1:0.000 |
| Downstream | 1:0.300 below EL 806.00 |
| | 1:0.900 |

(2) Conditions related w.l etc.

| | |
|----------------------|---------------|
| Design Discharge W.L | EL = 844.20 m |
| Surcharge W.L | = 844.20 m |
| Normal H.W.L | = 842.00 m |
| Sediment EL | = 828.00 m |
| Downstream W.L | |
| Design Discharge | = 803.30 m |
| Surcharge W.L | = 795.00 m |
| Normal H.W.L | = 795.00 m |
| Empty | = 781.00 m |
| Wave Height | |
| Wind Induced | H = 1.50 m |
| Earthquake Induced | = 0.50 m |


Uplift Pressure: considered

Hydrodynamic Pressure at Downstream: non

| | | |
|---------------|--------|---------|
| Drainage Hole | Y | EL |
| | 53.000 | 813.000 |

Seismic Coefficient = 0.120

Fig. D-4 Non - Over Flow Section (Crest Gate Type)

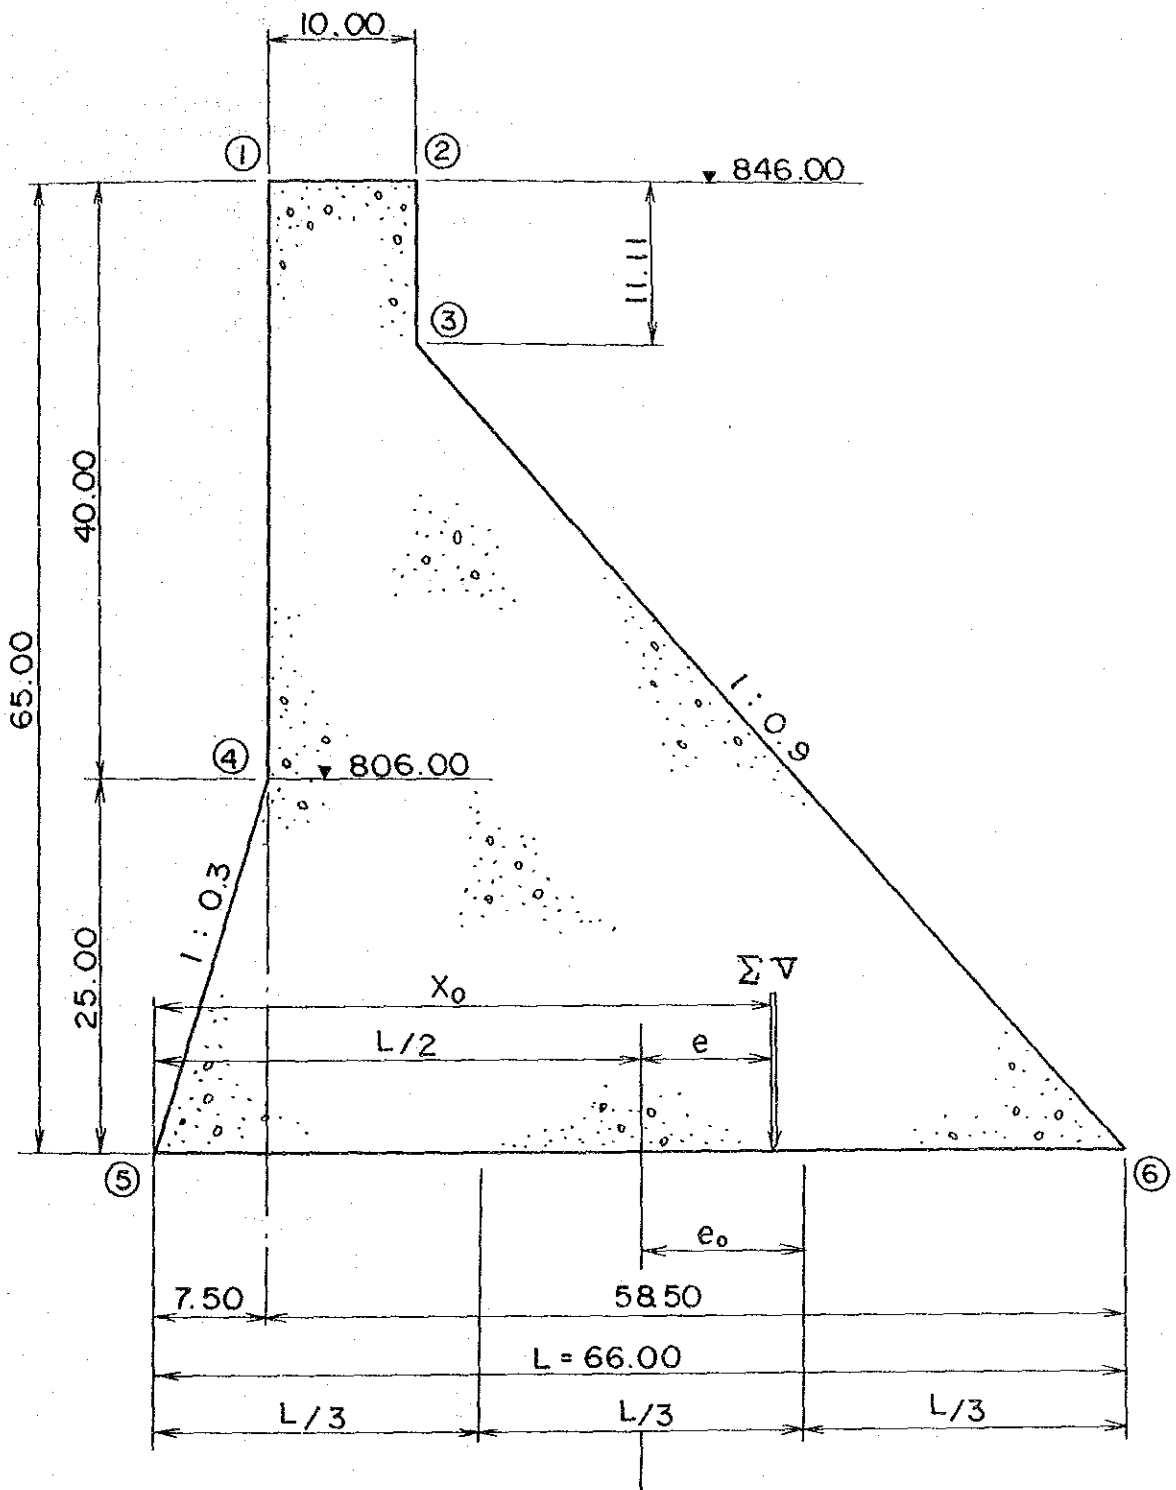

(3) Calculation and Results (Elevation 781.00)

| | Working Point Xg (m) | Vertical Force V (t) | Working Point yg (m) | Horizontal Force H (t) | Moment around the Heel M (t.m) |
|-------------------------------------|-------------------------|-------------------------|-------------------------|---------------------------|--------------------------------------|
| Body weight, seismic force | 25.646 | 4,716.277 | 22.131 | 565.953 | 133,480.885 |
| U/s hydrostatic pressure | 3.441 | 378.750 | 21.000 | 1,984.500 | 42,977.625 |
| U/s hydrodynamic pressure | 0.000 | 0.000 | 24.400 | 260.470 | 6,355.468 |
| Sediment pressure | 3.297 | 284.625 | 15.667 | 607.475 | 10,455.546 |
| D/s hydrostatic pressure | 61.800 | 88.200 | 4.667 | - 98.000 | 4,993.427 |
| D/s hydrodynamic pressure | 0.000 | 0.000 | 5.600 | 0.000 | 0.000 |
| Uplift | 26.069 | - 1,527.950 | 0.000 | 0.000 | - 39,832.858 |
| Adjustment due to irregure shape | | 0.000 | | 0.000 | 0.000 |
| Sum | | 3,939.901 | | 3,320.398 | 158,430.092 |

| | |
|--|-----------------------------------|
| Bottom Length | $L(m) = 66.000$ |
| Working Point of Load | $X_o(m) = 40.212$ |
| Middle Third | $e_o(m) = 11.000$ |
| Distance of Eccentricity | $e(m) = 7.212$ |
| Moment arround the center of Bottom Section | $M_o(t.m) = 28,413.343$ |
| Coefficient of Internal Friction | $f = 0.750$ |
| Shear Strength | $\tau_o = 150.000$ |
| Normal Stress | |
| Heel | $\sigma_u = 20,559 \text{ t/m}^2$ |
| Toe | $\sigma_d = 98,832 \text{ t/m}^2$ |
| Safety Factor for Shear Friction | $n = 3.872$ |

(4) Calculation and Results (Elevation 806.00)

| | Working Point Xg (m) | Vertical Force V (t) | Working Point yg (m) | Horizontal Force H (t) | Moment around the Heel M (t.m) |
|-------------------------------------|-------------------------|-------------------------|-------------------------|---------------------------|--------------------------------------|
| Body weight, seismic force | 11.618 | 1,783.777 | 14.978 | 214.053 | 23,929.982 |
| U/s hydrostatic pressure | 0.000 | 0.000 | 12.667 | 722.000 | 9,145.333 |
| U/s hydrodynamic pressure | 0.000 | 0.000 | 14.400 | 118.091 | 1,700.510 |
| Sediment pressure | 0.000 | 0.000 | 7.333 | 133.100 | 976.067 |
| D/s hydrostatic pressure | 0.000 | 0.000 | 0.000 | - 98.000 | 0.000 |
| D/s hydrodynamic pressure | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 |
| Uplift | 8.749 | - 219.600 | 0.000 | 0.000 | - 1,921.200 |
| Adjustment due to irregure shape | | 0.000 | | 0.000 | 0.000 |
| Sum | | 1,564.176 | | 1,187.244 | 33,830.692 |

| | |
|--|-----------------------------------|
| Bottom Length | $L(m) = 36.000$ |
| Working Point of Load | $X_o(m) = 21.628$ |
| Middle Third | $e_o(m) = 6.000$ |
| Distance of Eccentricity | $e(m) = 3.628$ |
| Moment around the center of Bottom Section | $M_o(t.m) = 5,675.515$ |
| Coefficient of Internal Friction | $f = 0.750$ |
| Shear Strength | $\tau_o = 150.000$ |
| Normal Stress | |
| Heel | $\sigma_u = 17.174 \text{ t/m}^2$ |
| Toe | $\sigma_d = 69.725 \text{ t/m}^2$ |
| Safety Factor for Shear Friction | $n = 5.536$ |

4.2 Crest Gate Type (Overflow section)

(1) Dam shape

| Point | Y (m) | EL (m) |
|-------|--------|---------|
| 1 | 58.500 | 846.000 |
| 2 | 48.500 | 846.000 |
| 3 | 48.500 | 834.889 |
| 4 | 58.500 | 806.000 |
| 5 | 66.000 | 781.000 |
| 6 | 0.000 | 781.000 |

| | |
|--------------------------|----------------------|
| Note: Foundation Rock EL | 781.000 |
| Width of Crest Road | 10.000 |
| Slope Upperstream | 1:0.000 |
| | 1:0.300 below 806.00 |
| Downstream | 1:0.900 |

(2) Conditions related w.l etc.

Design Discharge W.L. EL = 844.20 m
Surcharge W.L. = 844.20 m
Normal H.W.L. = 842.00 m
Sediment EL = 828.00 m
Downstream W.L.

Design Discharge = 803.30 m
Surcharge W.L. = 795.00 m
Normal H.W.L. = 795.00 m
Empty = 781.00 m

Wave Height

Wind Induced H = 1.50 m

Earthquake Induced = 0.50 m


Uplift Pressure: considered

Hydrodynamic Pressure at Downstream: non

Drainage Hole Y EL
53.000 813.000

Seismic Coefficient = 0.120

Fig. D-5 Over Flow Section (Crest Gate Type)

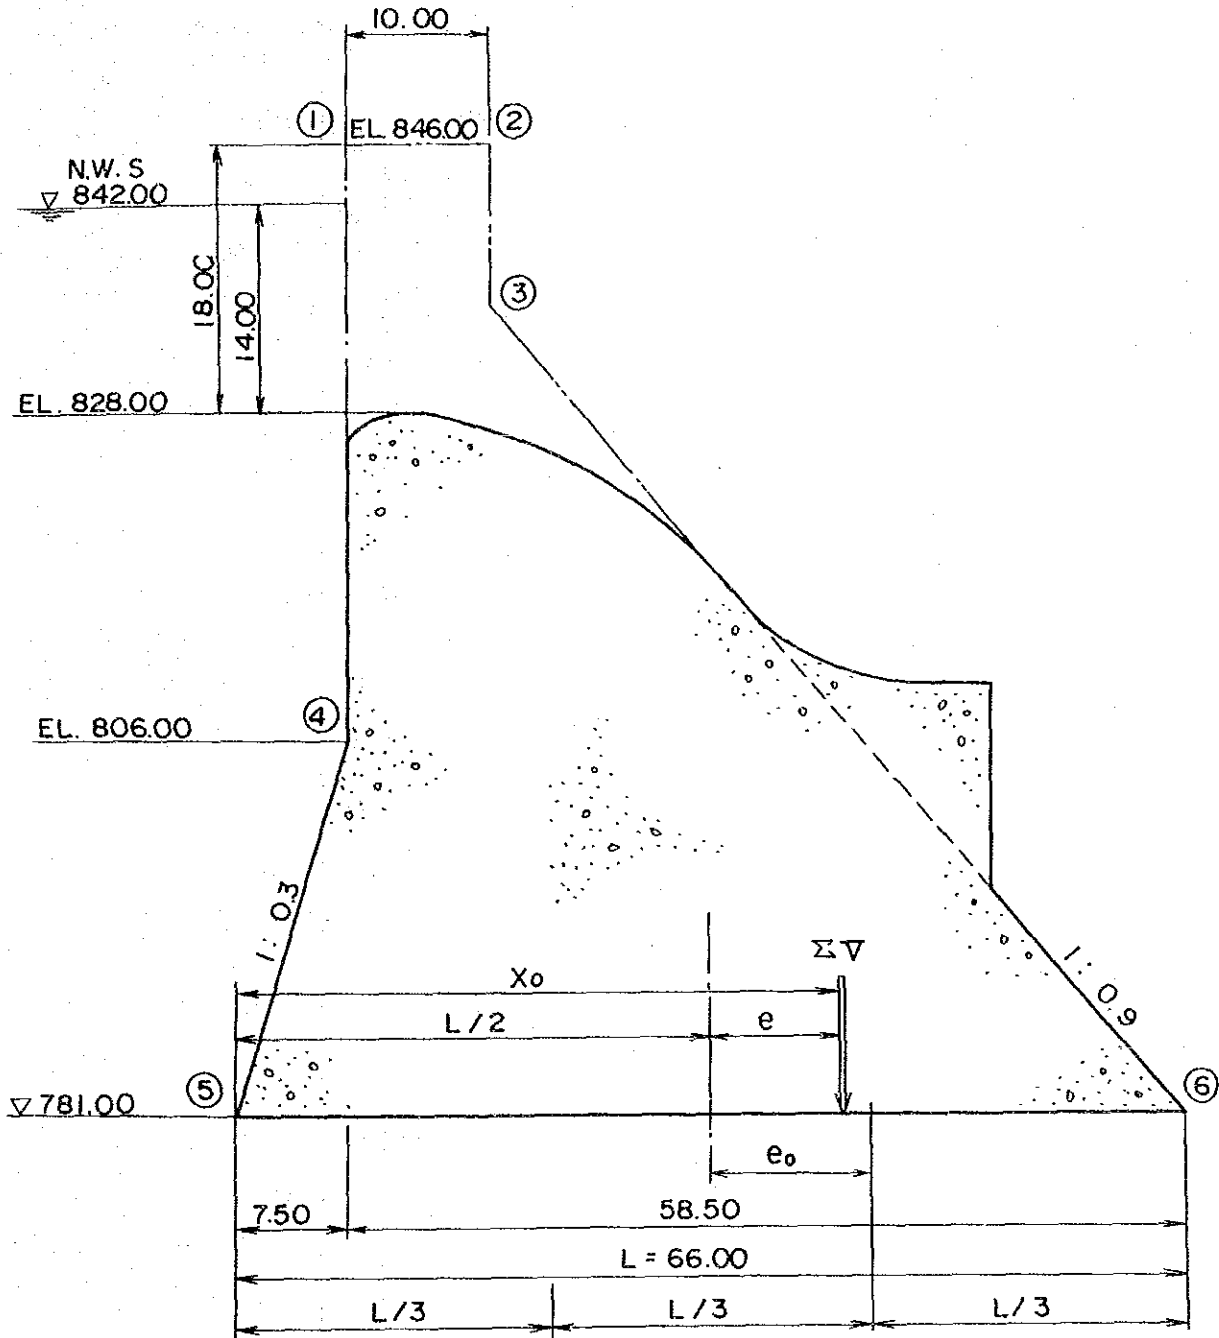

(3) Calculation and Results (Elevation 781.00)

| | Working Point Xg (m) | Vertical Force V (t) | Working Point yg (m) | Horizontal Force H (t) | Moment around the Heel M (t.m) |
|-------------------------------------|-------------------------|-------------------------|-------------------------|---------------------------|--------------------------------------|
| Body weight, seismic force | 25.646 | 4,716.277 | 22.131 | 565.953 | 133,480.885 |
| U/s hydrostatic pressure | 3.441 | 378.750 | 21.000 | 1,984.500 | 42,977.625 |
| U/s hydrodynamic pressure | 0.000 | 0.000 | 24.400 | 260.470 | 6,355.468 |
| Sediment pressure | 3.297 | 284.625 | 15.667 | 607.475 | 10,455.546 |
| D/s hydrostatic pressure | 61.800 | 88.200 | 4.667 | - 98.000 | 4,993.427 |
| D/s hydrodynamic pressure | 0.000 | 0.000 | 5.600 | 0.000 | 0.000 |
| Uplift | 26.069 | - 1,527.950 | 0.000 | 0.000 | - 39,832.858 |
| Adjustment due to irregure shape | | - 210.968 | | - 33.717 | 1,033.940 |
| Sum | | 3,728.933 | | 3,286.681 | 159,464.032 |

Bottom Length $L(m) = 66.000$
 Working Point of Load $X_o(m) = 42.764$
 Middle Third $e_o(m) = 11.000$
 Distance of Eccentricity $e(m) = 9.764$
 Moment around the center of Bottom Section $M_o(t.m) = 36,409.227$
 Coefficient of Internal Friction $f = 0.750$
 Shear Strength $\tau_o = 150.000$
 Normal Stress
 Heel $\sigma_u = 6.349 \text{ t/m}^2$
 Toe $\sigma_d = 106.649 \text{ t/m}^2$
 Safety Factor for Shear Friction $n = 3.863$

4.3 Bottom Flushing Type (Non-overflow section)

(1) Dam shape

| Point | Y (m) | EL (m) |
|-------|-------|---------|
| 1 | 58.50 | 846.000 |
| 2 | 48.50 | 846.000 |
| 3 | 48.50 | 834.889 |
| 4 | 58.50 | 805.000 |
| 5 | 65.70 | 781.000 |
| 6 | 0.00 | 781.000 |

Note: Foundation Rock EL 781.000m
 Width of Crest Road 10.000m
 Slope Upstream 1:0.00
 1:0.30 below EL 805.00
 Downstream 1:0.90

(2) Conditions related w.l etc.

Design Discharge W.L. EL = 844.20 m

Surcharge W.L. = 844.20 m

Normal H.W.L. = 842.00 m

Sediment EL = 805.00 m

Downstream W.L.

Design Discharge = 803.30 m

Surcharge W.L. = 795.00 m

Normal H.W.L. = 795.00 m

Empty = 781.00 m

Wave Height

Wind Induced H = 1.50 m

Earthquake Induced = 0.50 m


Uplift Pressure: Considered

Hydrodynamic Pressure at Downstream: non

Drainage Hole: Considered

Seismic Coefficient = 0.15

Fig. D-6 Non-Over Flow Section (Bottom Flushing Type)

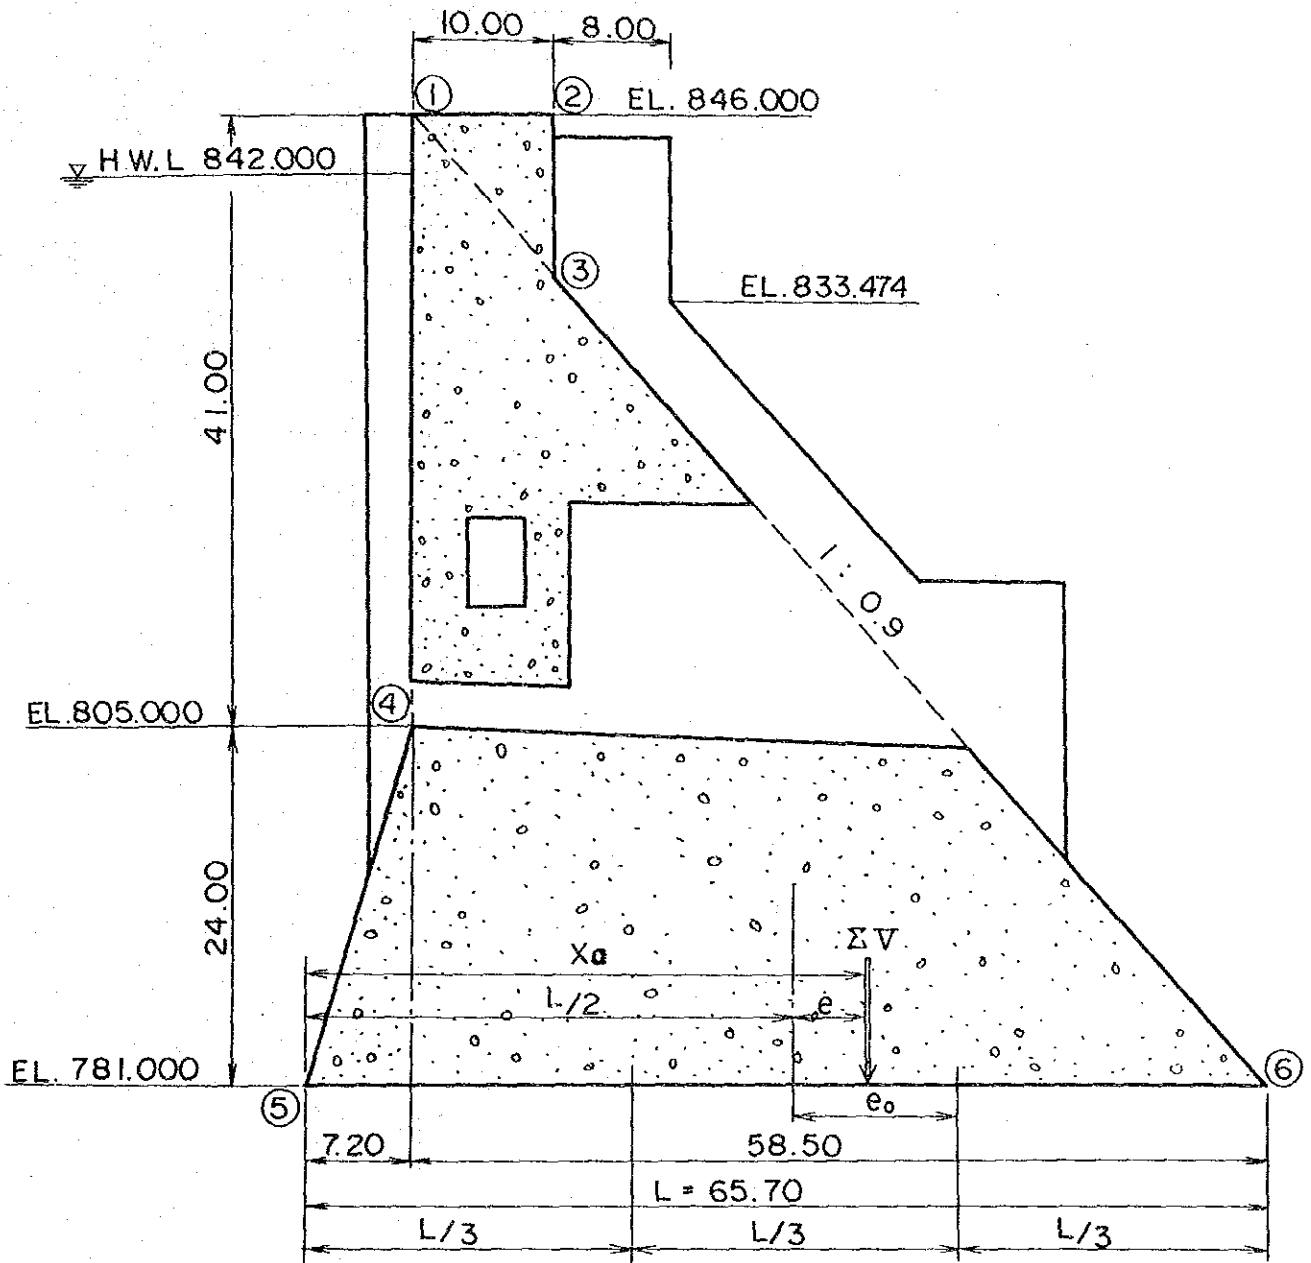

(3) Calculation and Results (Elevation 781.000)

| | Working Point Xg (m) | Vertical Force V (t) | Working Point yg (m) | Horizontal Force H (t) | Moment around the Heel M (t.m) |
|-------------------------------------|-------------------------|-------------------------|-------------------------|---------------------------|--------------------------------------|
| Body weight, seismic force | 25.425 | 4,699.372 | 22.166 | 704.906 | 135,106.595 |
| U/s hydrostatic pressure | 3.318 | 367.200 | 21.000 | 1,984.500 | 42,892.740 |
| U/s hydrodynamic pressure | 0.000 | 0.000 | 24.400 | 325.588 | 7,944.335 |
| Sediment pressure | 2.400 | 95.040 | 8.000 | 158.400 | 1,495.296 |
| D/s hydrostatic pressure | 61.500 | 88.200 | 4.667 | - 98.000 | 4,966.967 |
| D/s hydrodynamic pressure | 0.000 | 0.000 | 5.600 | 0.000 | 0.000 |
| Uplift | 26.001 | - 1,515.290 | 0.000 | 0.000 | - 39,399.590 |
| Adjustment due to irregure shape | | - 210.968 | | - 42.146 | 454.747 |
| Sum | | 3,523.553 | | 3,033.247 | 153,461.090 |

| | |
|---|------------------------------------|
| Bottom Length | $L(m) = 65.700$ |
| Working Point of Load | $X_o(m) = 43.553$ |
| Middle Third | $e_o(m) = 10.950$ |
| Distance of Eccentricity | $e(m) = 10.703$ |
| Moment around the center of Bottom Section | $M_o(t.m) = 37,712.358$ |
| Coefficient of Internal Friction | $f = 0.750$ |
| Shear Strength | $\tau_o = 150.000$ |
| Normal Stress | |
| Heel | $\sigma_u = 1.210 \text{ t/m}^2$ |
| Toe | $\sigma_d = 106.052 \text{ t/m}^2$ |
| Safety Factor for Shear Friction | $n = 4.120$ |

D.4 Spillway Discharge Capacity

1. General

Five (5) overflow sections (12.00 m wide each) are arranged as spillway section with crest top of EL 828.00.

The shape of overflow crest consists of a combined curve of Harold's standard crest and circles. This curve is inscribed with the principal triangle of dam body.

2. Calculation Formula

Ishii-Fujimoto's formula is applied.

$$Q = n \cdot c' \cdot B \cdot H^{\frac{3}{2}}$$

$$c' = c \cdot \left\{ 1 - Md \left(\frac{H}{Hd} \right)^{1.5} \right\}$$

$$Md = 0.0756 \left(\frac{Hd}{B} \right)^{0.5}$$

when $n=1$ or $n \geq 2$ and $B/S \geq 0.8$

$$Md = 0.0756 \left(\frac{Hd}{B} \right)^{0.5} \left\{ \frac{1}{n} + 1.465 \left(\frac{n-1}{n} \right) \left(\frac{b}{s} \right)^{1.7} \right\}$$

..... when $n \geq 2$ and $B/S < 0.8$

$$c = 1.60 \frac{1 + 2a \left(\frac{H}{Hd} \right)}{1 + a \left(\frac{H}{Hd} \right)}$$

$$cd = 2,200 - 0.0416 \left(\frac{Hd}{W} \right)^{0.99}$$

where, Q : Overflow Discharge (m^3/s)

n : Numbers of overflow section (5)

c' : Coefficient of discharge, taking effects due to pier and abutment

B : Width of overflow section per one span (m)

H : Overflow head at crest (m)

Md : Adjustment factor

c : Coefficient of discharge without effects due to pier and abutment

Hd : Design head 16 m

: Constant

W : Height of weir

b : Width of pier

s : Surplus length of pier from U/S face of dam body

3. Results

Calculated results are shown in Table D-5 and Fig. D-7.


Table D-5 Discharge Calculation

B = 12.000 N = 5 CRELV = 828.000 b = 3.000 S = 3.000

Hd = 16.000 W = 23.000 Cd = 2.171 A1 = 0.55484 Ma = 0.08730

| WL | H | C | C' | Q |
|---------|--------|-------|-------|---------|
| 828.000 | 0.000 | 0.000 | 0.000 | 0.00 |
| 828.100 | 0.100 | 1.606 | 1.605 | 3.05 |
| 828.200 | 0.200 | 1.611 | 1.611 | 8.64 |
| 828.300 | 0.300 | 1.616 | 1.616 | 15.93 |
| 828.400 | 0.400 | 1.622 | 1.621 | 24.61 |
| 828.500 | 0.500 | 1.627 | 1.626 | 34.50 |
| 828.600 | 0.600 | 1.633 | 1.632 | 45.50 |
| 828.700 | 0.700 | 1.638 | 1.637 | 57.51 |
| 828.800 | 0.800 | 1.643 | 1.642 | 70.48 |
| 828.900 | 0.900 | 1.648 | 1.647 | 84.35 |
| 829.000 | 1.000 | 1.654 | 1.651 | 99.08 |
| 829.100 | 1.100 | 1.659 | 1.656 | 114.64 |
| 829.200 | 1.200 | 1.664 | 1.661 | 131.00 |
| 829.300 | 1.300 | 1.669 | 1.666 | 148.13 |
| 829.400 | 1.400 | 1.674 | 1.670 | 166.01 |
| 829.500 | 1.500 | 1.679 | 1.675 | 184.62 |
| 829.600 | 1.600 | 1.684 | 1.679 | 203.94 |
| 829.700 | 1.700 | 1.689 | 1.684 | 223.95 |
| 829.800 | 1.800 | 1.694 | 1.688 | 244.65 |
| 829.900 | 1.900 | 1.699 | 1.693 | 266.01 |
| 830.000 | 2.000 | 1.704 | 1.697 | 288.02 |
| 842.000 | 14.000 | 2.123 | 1.971 | 6195.56 |
| 842.100 | 14.100 | 2.125 | 1.972 | 6264.28 |
| 842.200 | 14.200 | 2.128 | 1.973 | 6333.22 |
| 842.300 | 14.300 | 2.130 | 1.973 | 6402.37 |
| 842.400 | 14.400 | 2.133 | 1.974 | 6471.74 |
| 842.500 | 14.500 | 2.135 | 1.975 | 6541.32 |
| 842.600 | 14.600 | 2.138 | 1.975 | 6611.10 |
| 842.700 | 14.700 | 2.140 | 1.976 | 6681.10 |
| 842.800 | 14.800 | 2.143 | 1.976 | 6751.29 |
| 842.900 | 14.900 | 2.145 | 1.977 | 6821.69 |
| 843.000 | 15.000 | 2.147 | 1.977 | 6892.29 |
| 843.100 | 15.100 | 2.150 | 1.978 | 6963.09 |
| 843.200 | 15.200 | 2.152 | 1.978 | 7034.08 |
| 843.300 | 15.300 | 2.155 | 1.979 | 7105.26 |
| 843.400 | 15.400 | 2.157 | 1.979 | 7176.63 |
| 843.500 | 15.500 | 2.159 | 1.980 | 7248.19 |
| 843.600 | 15.600 | 2.162 | 1.980 | 7319.94 |
| 843.700 | 15.700 | 2.164 | 1.980 | 7391.87 |
| 843.800 | 15.800 | 2.166 | 1.981 | 7463.98 |
| 843.900 | 15.900 | 2.169 | 1.981 | 7536.27 |
| 844.000 | 16.000 | 2.171 | 1.981 | 7608.73 |
| 844.100 | 16.100 | 2.173 | 1.982 | 7681.37 |
| 844.200 | 16.200 | 2.176 | 1.982 | 7754.19 |
| 844.300 | 16.300 | 2.178 | 1.982 | 7827.17 |
| 844.400 | 16.400 | 2.180 | 1.983 | 7900.32 |
| 844.500 | 16.500 | 2.182 | 1.983 | 7973.63 |
| 844.600 | 16.600 | 2.185 | 1.983 | 8047.11 |
| 844.700 | 16.700 | 2.187 | 1.983 | 8120.74 |
| 844.800 | 16.800 | 2.189 | 1.983 | 8194.54 |
| 844.900 | 16.900 | 2.191 | 1.984 | 8268.49 |
| 845.000 | 17.000 | 2.193 | 1.984 | 8342.50 |
| 845.000 | 17.000 | 2.193 | 1.984 | 8342.50 |

Fig. D-7 Spillway Discharge Capacity Curve

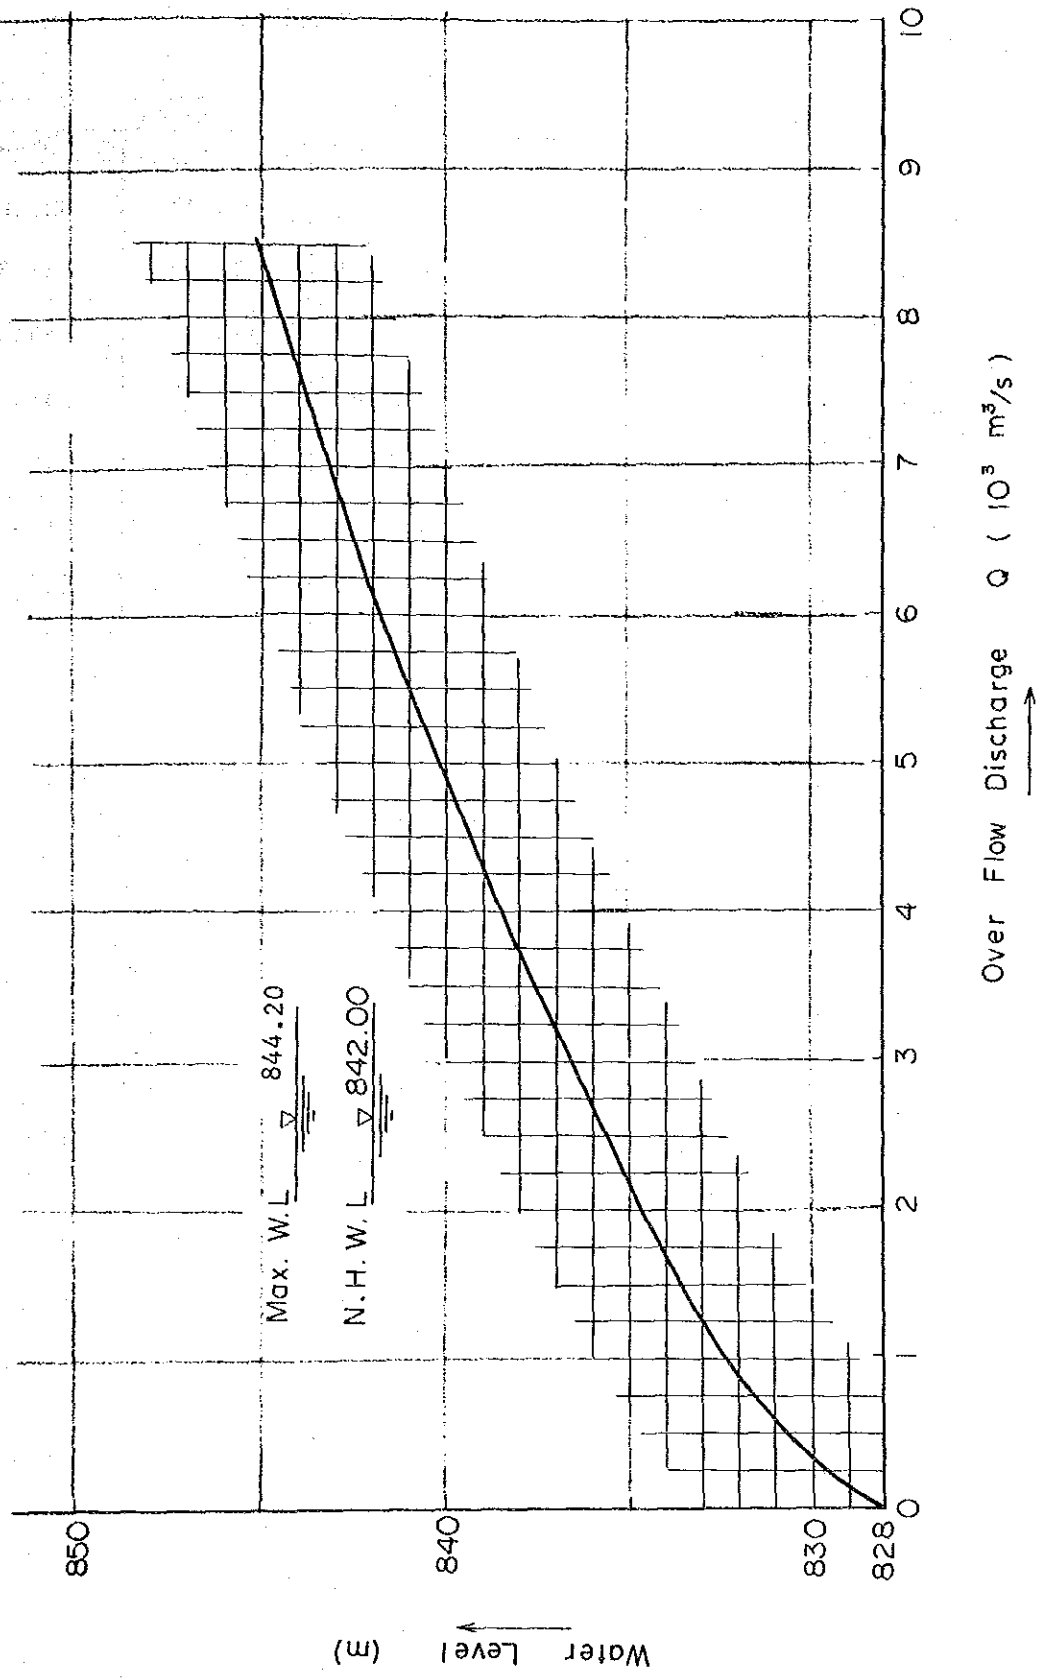

D.5 Oscillation Analysis of Surging Water Level

Table D-6 Surging WL Analysis

| Case Name | Port Dia | Qm ³ /s, t(s) | HW at Reservoir | Surging WL | |
|-----------|----------|--------------------------|-----------------|------------|--------|
| | | | | Up | Down |
| U-1 | 3.00 | 80 → 0, 5.5 | 842.00 | 865.02 | 825.84 |
| U-2 | 2.40 | 80 → 0, 5.5 | 842.00 | 859.00 | 831.30 |
| U-3 | 2.40 | 80 → 57, 0 | 842.00 | 844.46 | 835.00 |
| U-4 | 2.40 | 80 → 0, 0 | 842.00 | 858.99 | 831.30 |
| D-1 | 3.00 | 40 → 80, 5.5 | 837.00 | - | 816.24 |
| D-2 | 2.40 | 40 → 80, 5.5 | 837.00 | - | 817.71 |
| D-3 | 2.40 | 40 → 80, 0 | 837.00 | - | 817.72 |

Fig. D-8 CASE U-1 Port Diameter 3.00 m

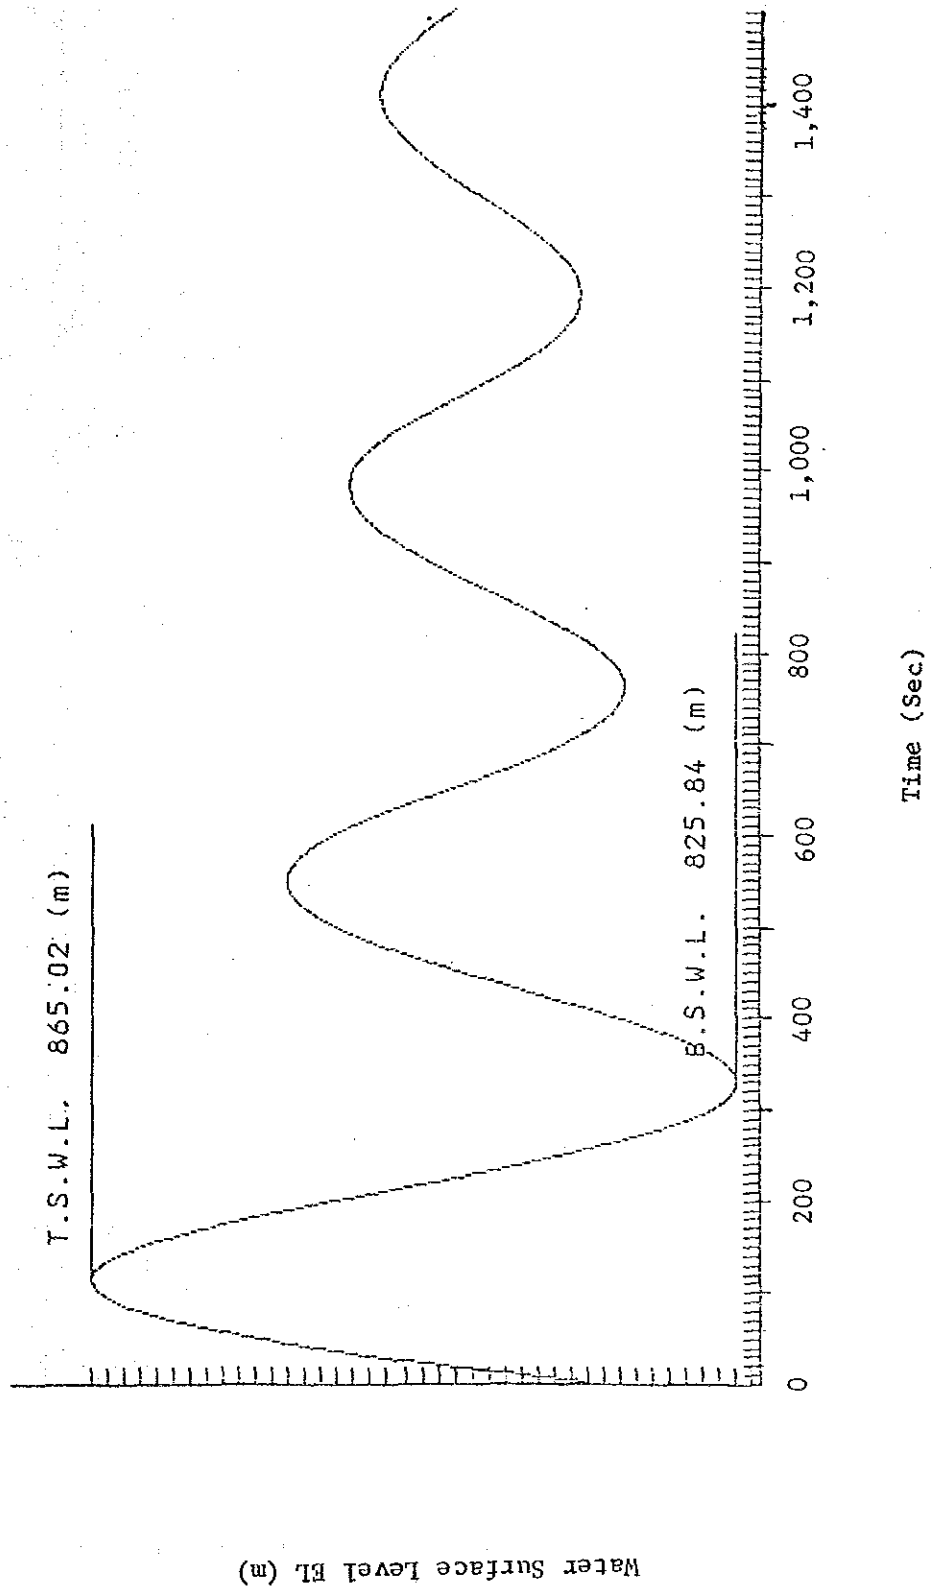


FIG. D-9 CASE U-2 Port Diameter 2.40 m

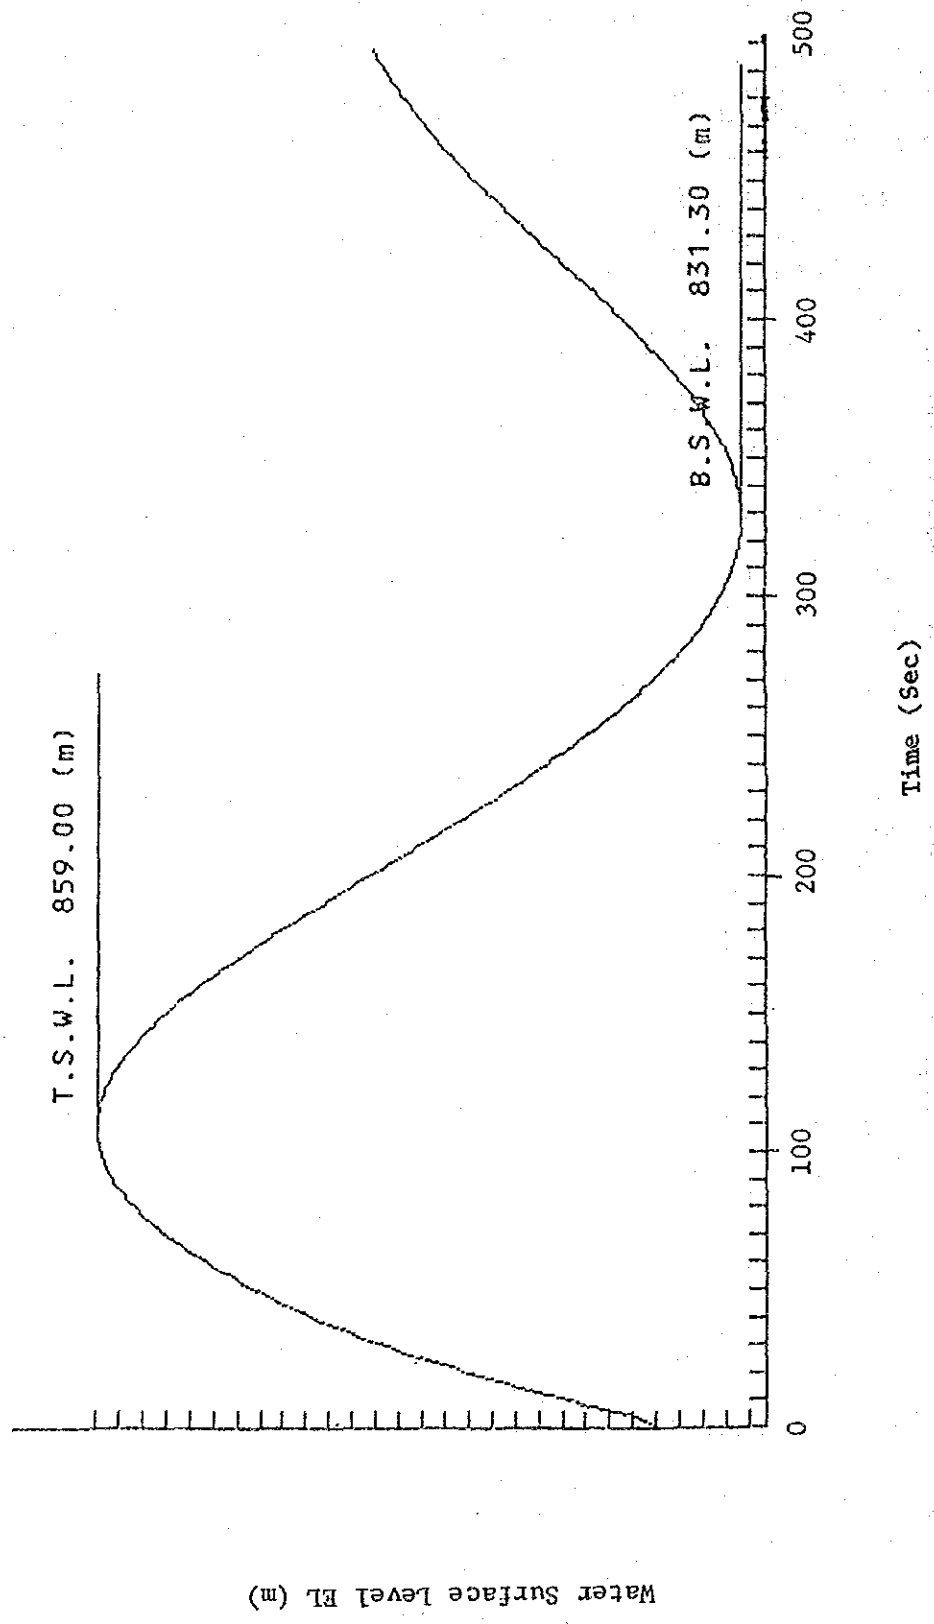


Fig. D-10 CASE U-3 Port Diameter 2.40 m

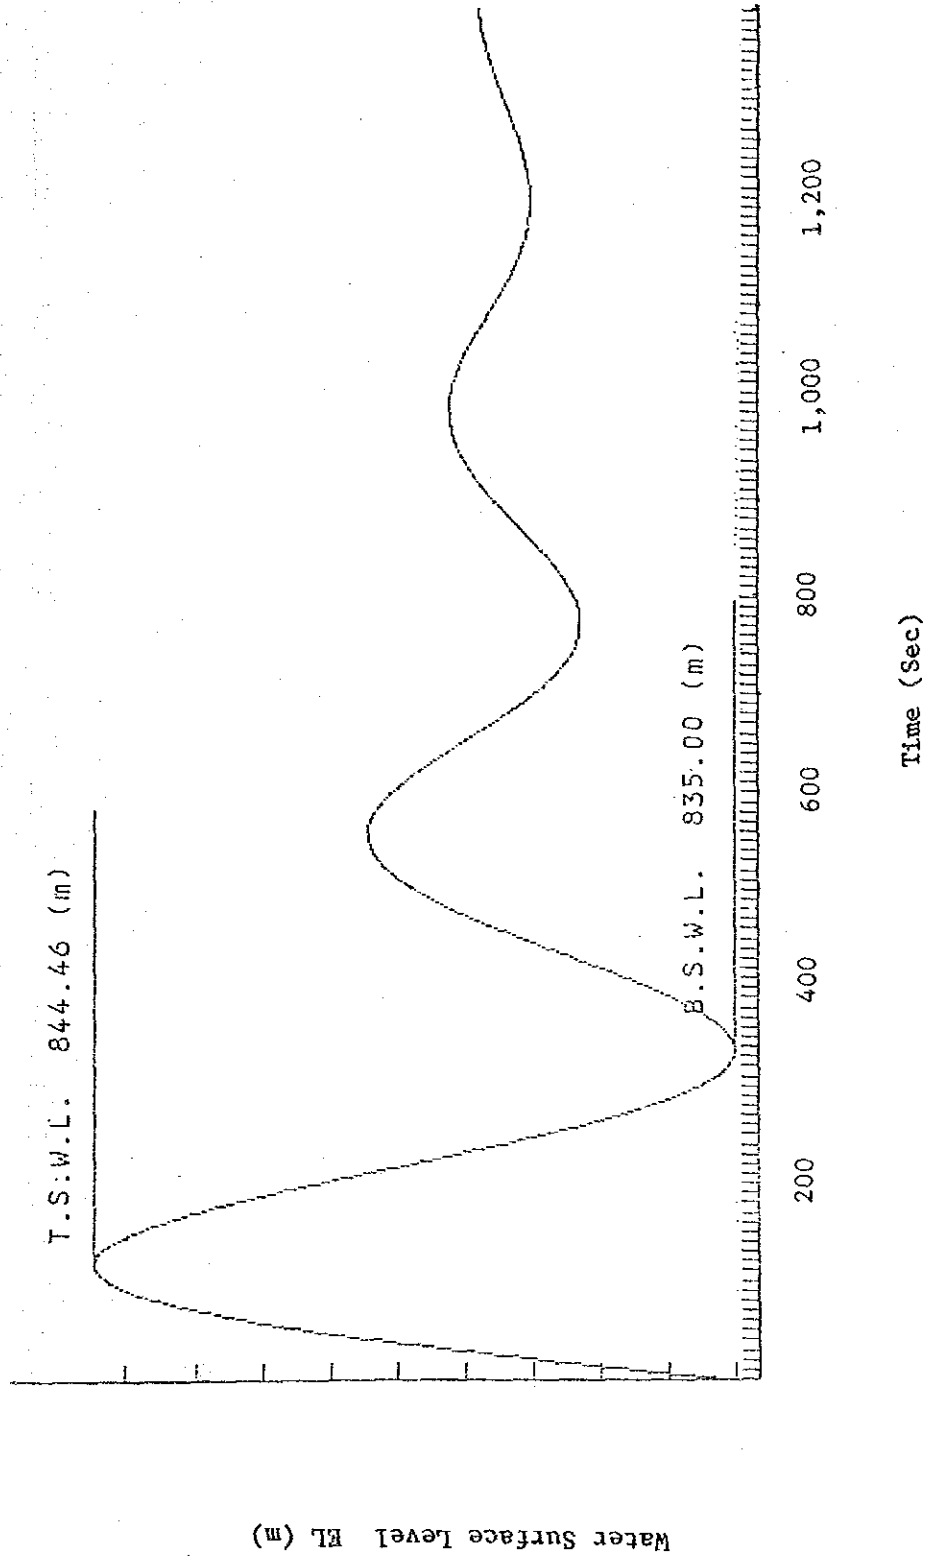


Fig. D-11 CASE U-4 Port Diameter 2.40 m

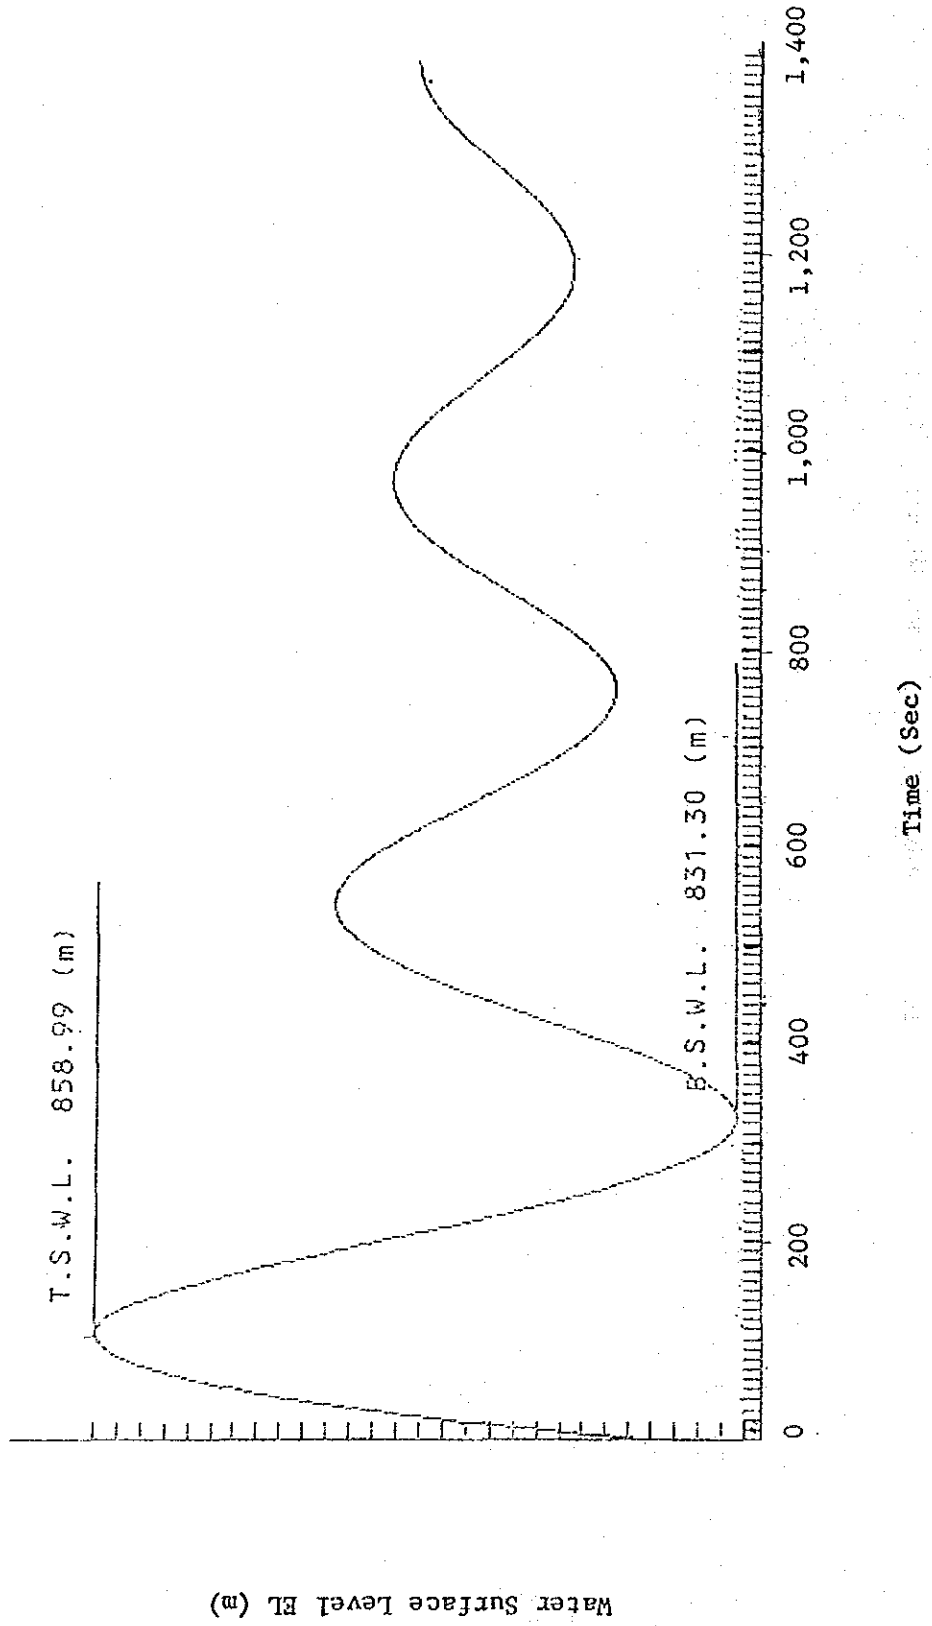


Fig. D-12 CASE D-1 Port Diameter 3.00 m

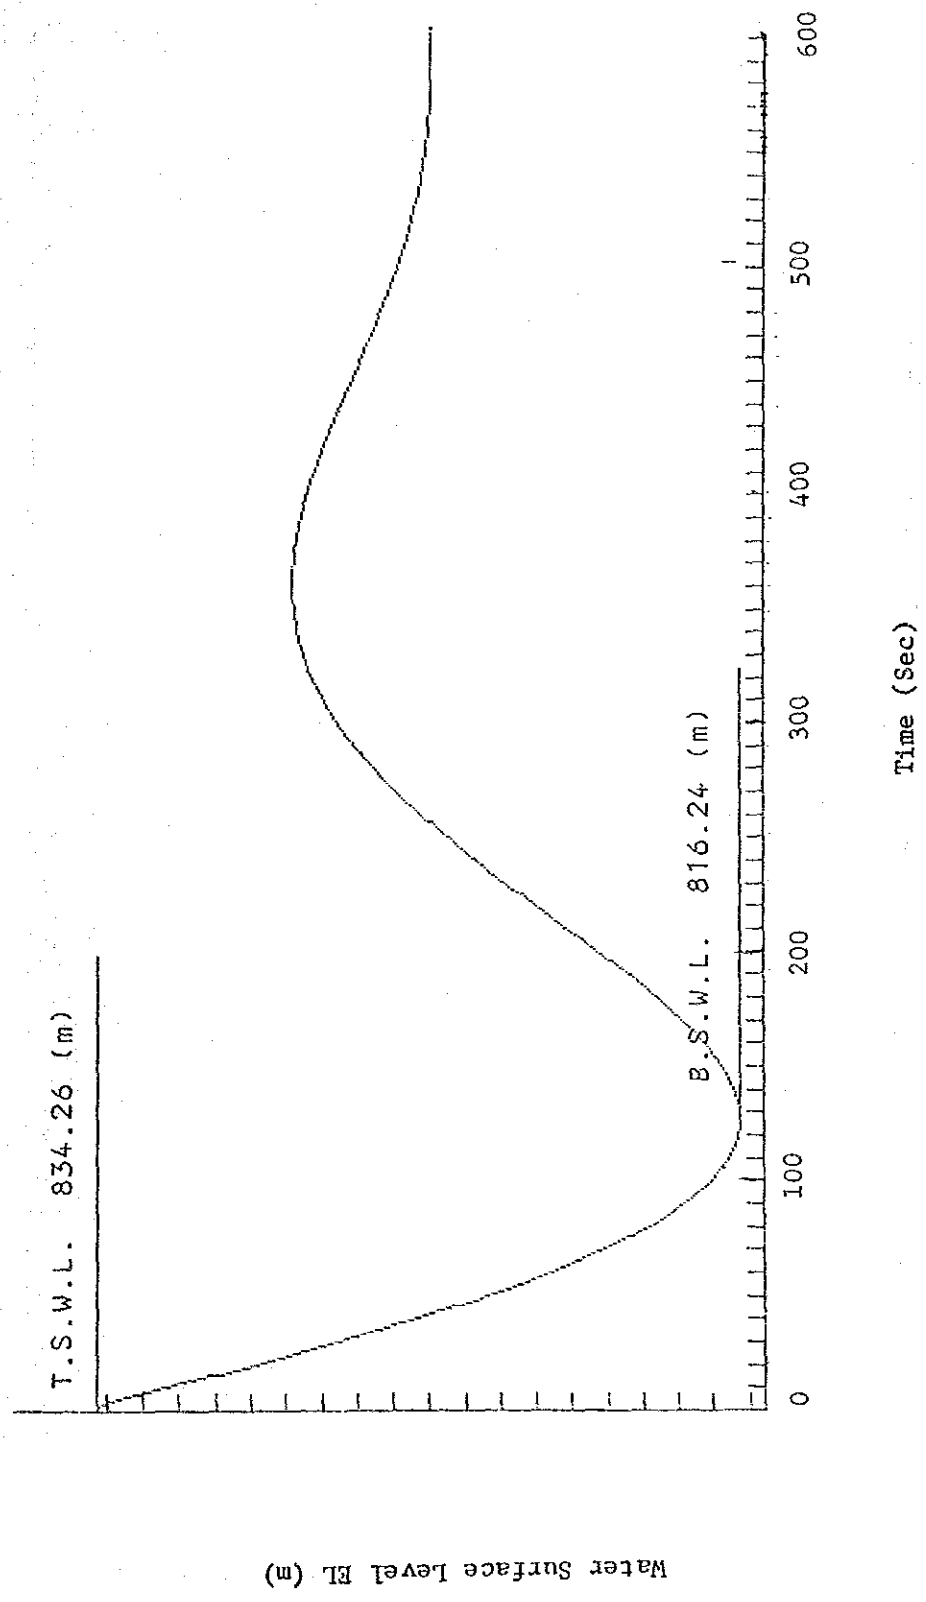


Fig. D-13 CASE D-2 Port Diameter 2.40 m


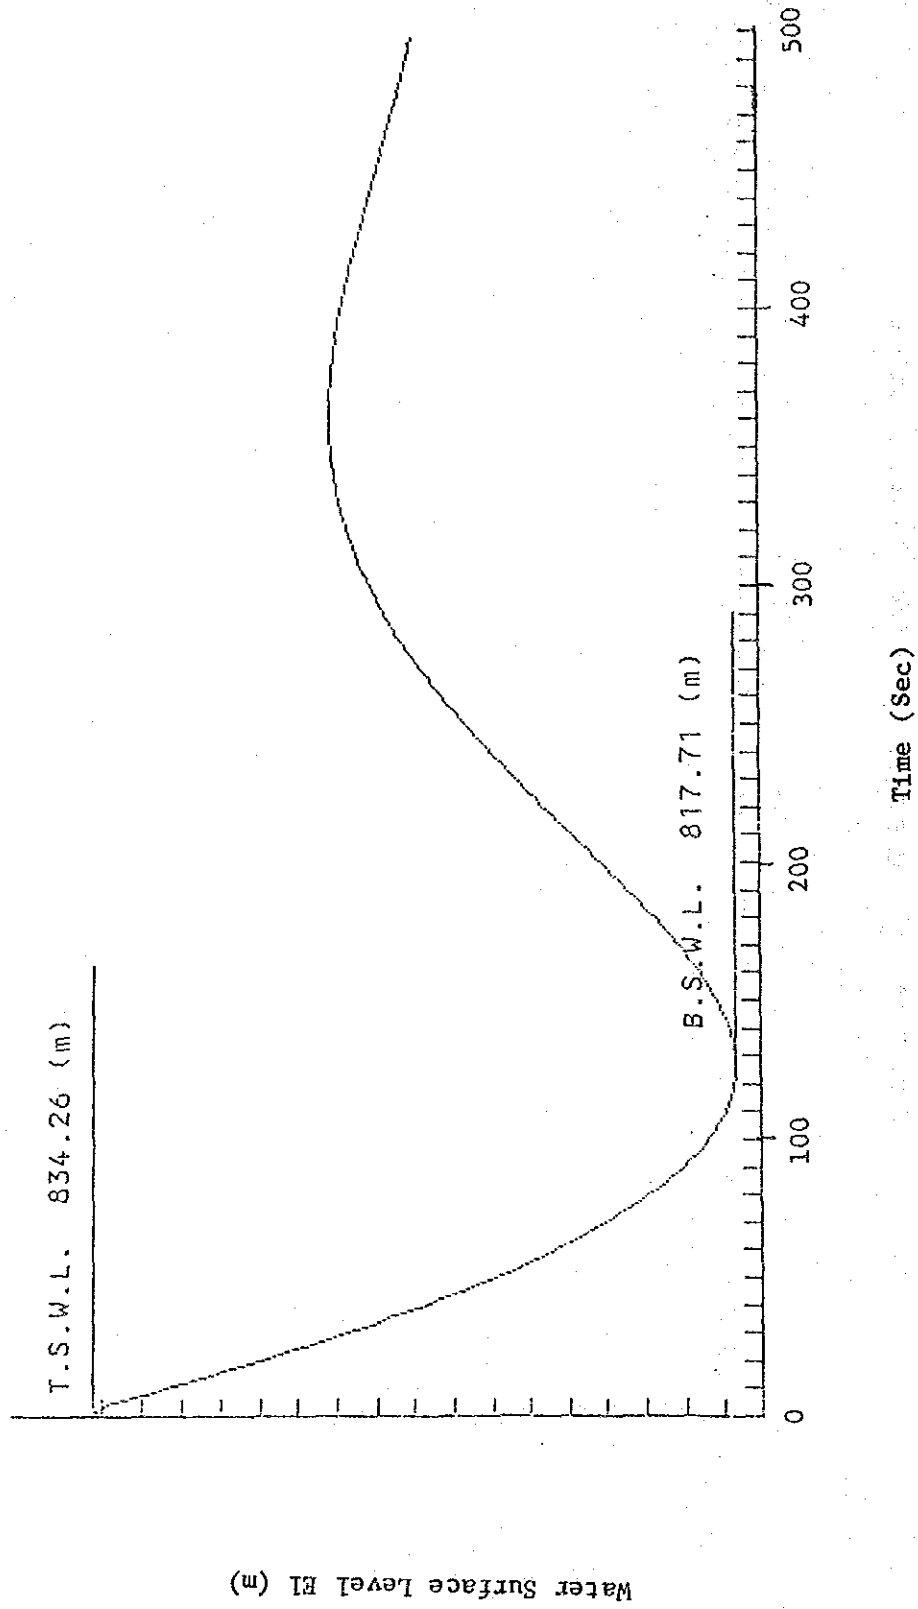


Fig. D-14 CASE D-3 Port Diameter 2.40 m

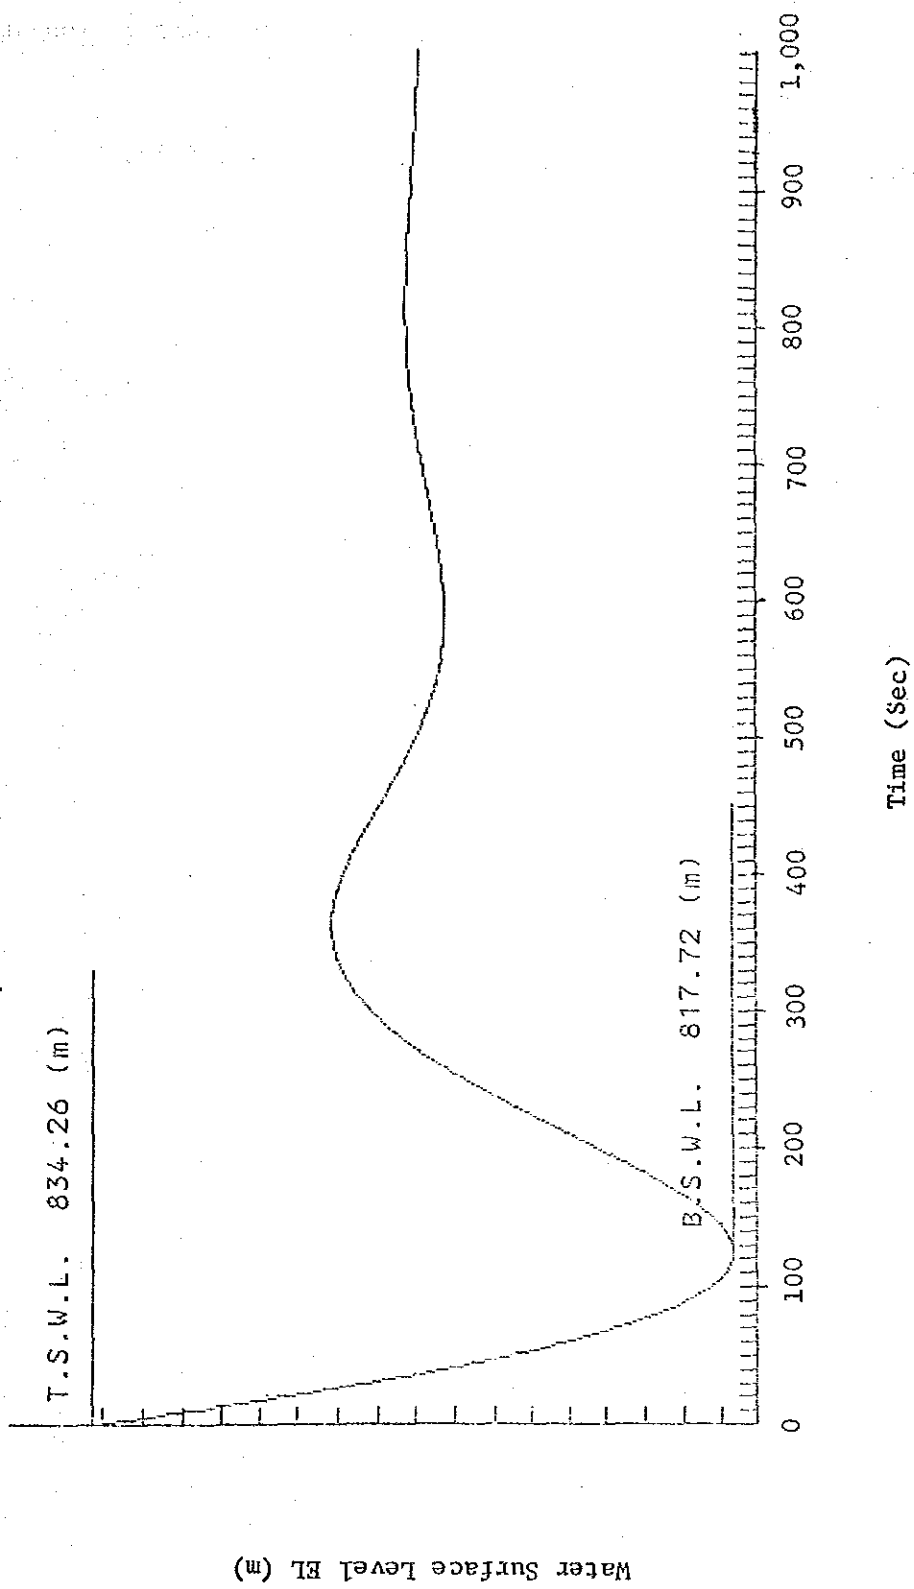

D.6 Water Hammer at Penstock

General features of a net work of waterway is shown in Fig. D-15. The net work consists of elements of waterway (pipe), pondages, a surge tank and turbines.

Results computed are shown in Fig. D-16 - Fig. D-19.

Fig. D-15 Waterway System

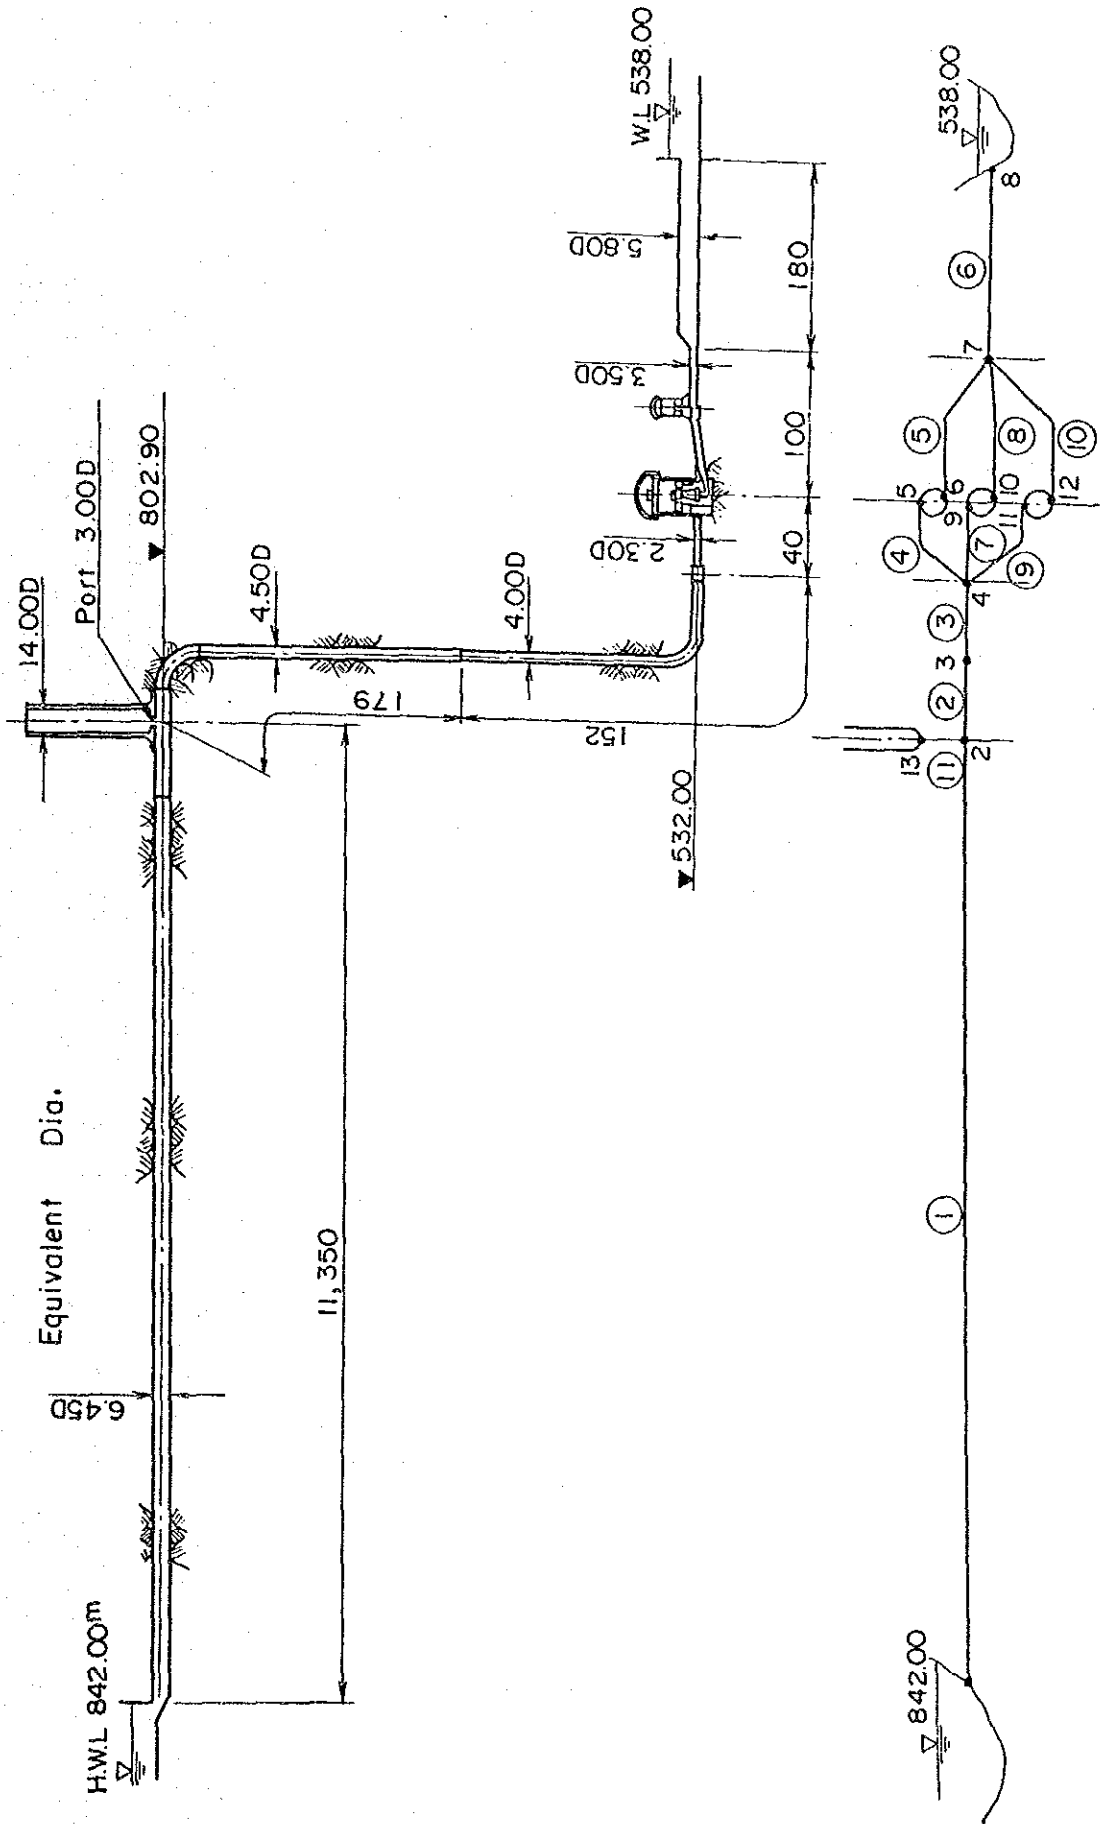


Fig. D-16 Pipe No. 5 (Upstream)

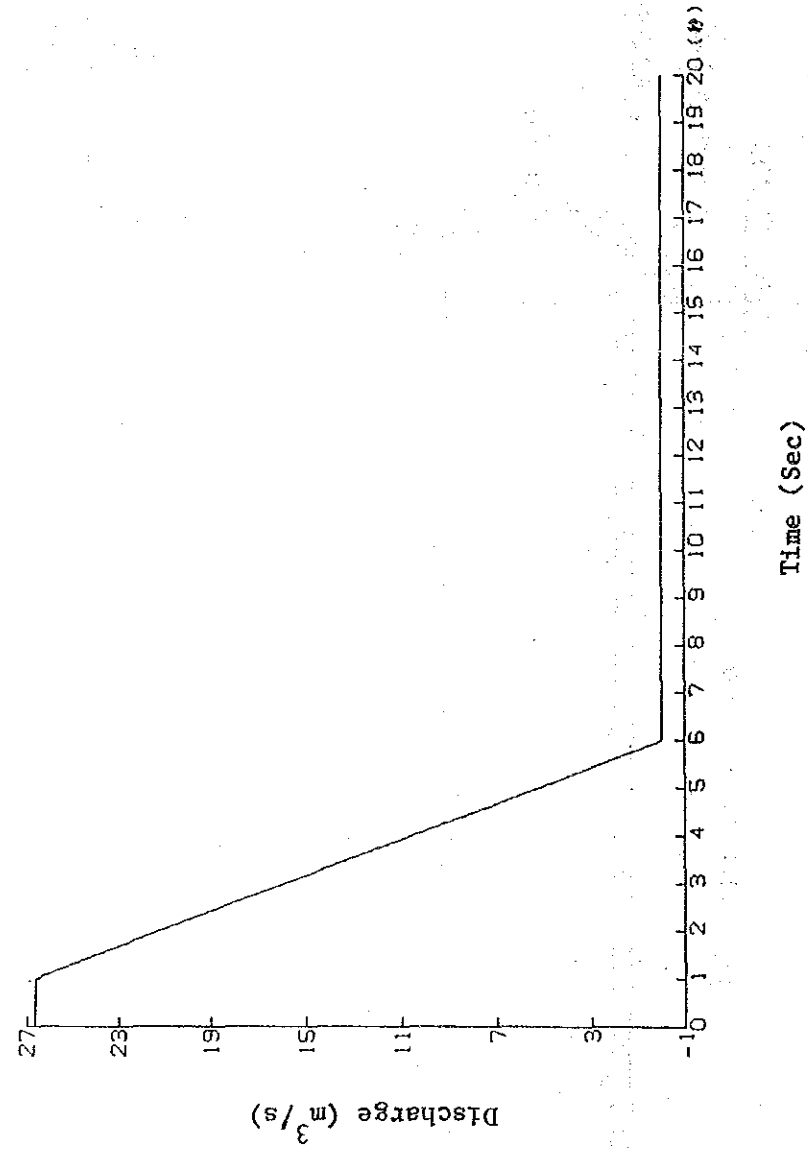


Fig. D-17 Point No. 3

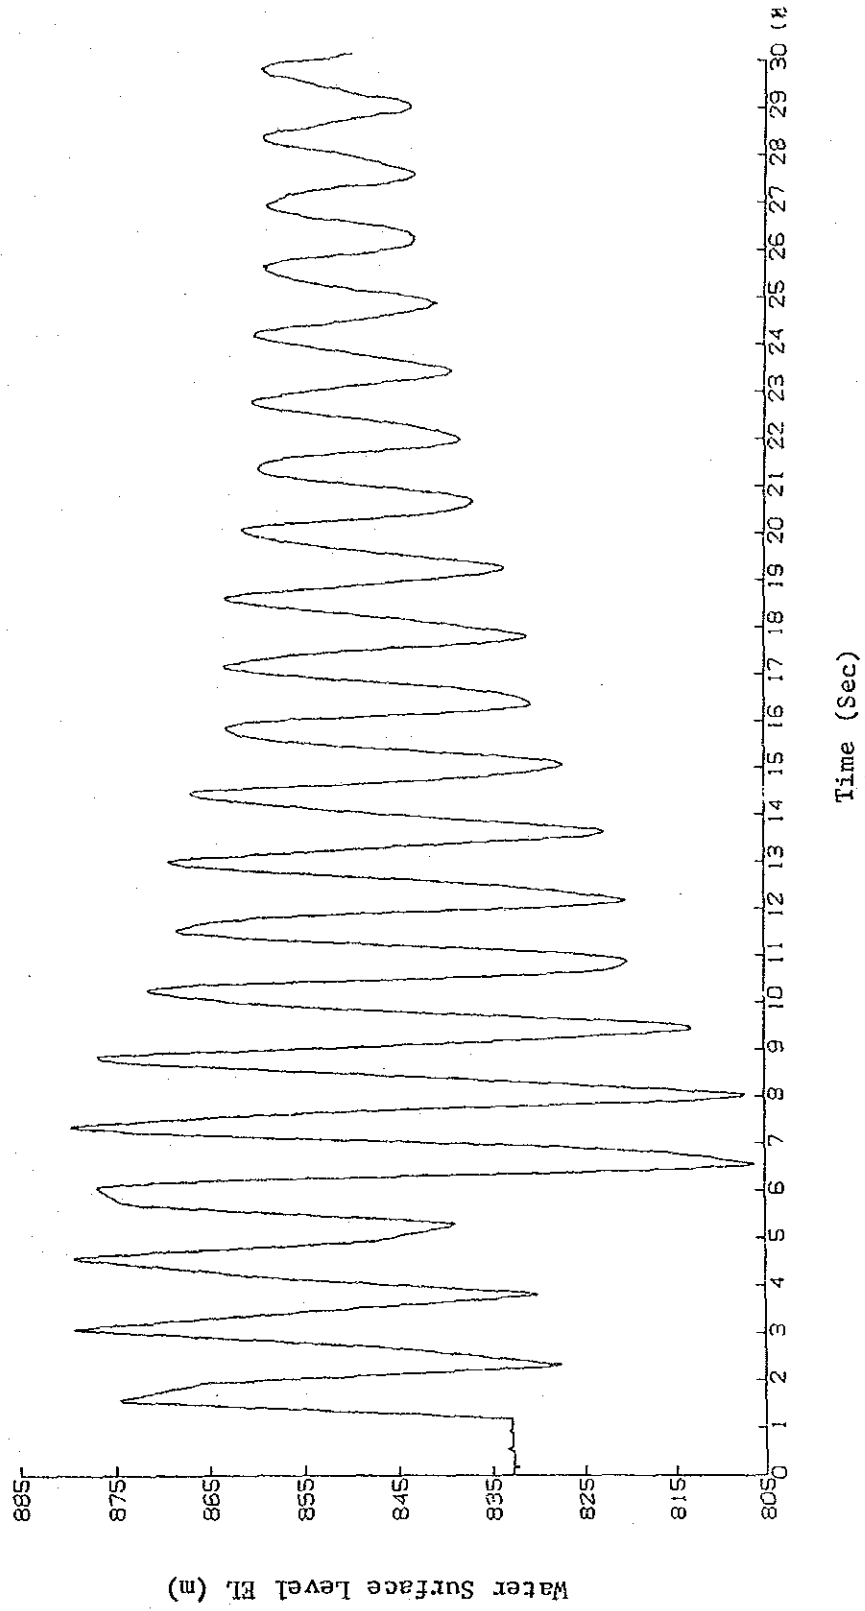


Fig. D-18 Point No. 4


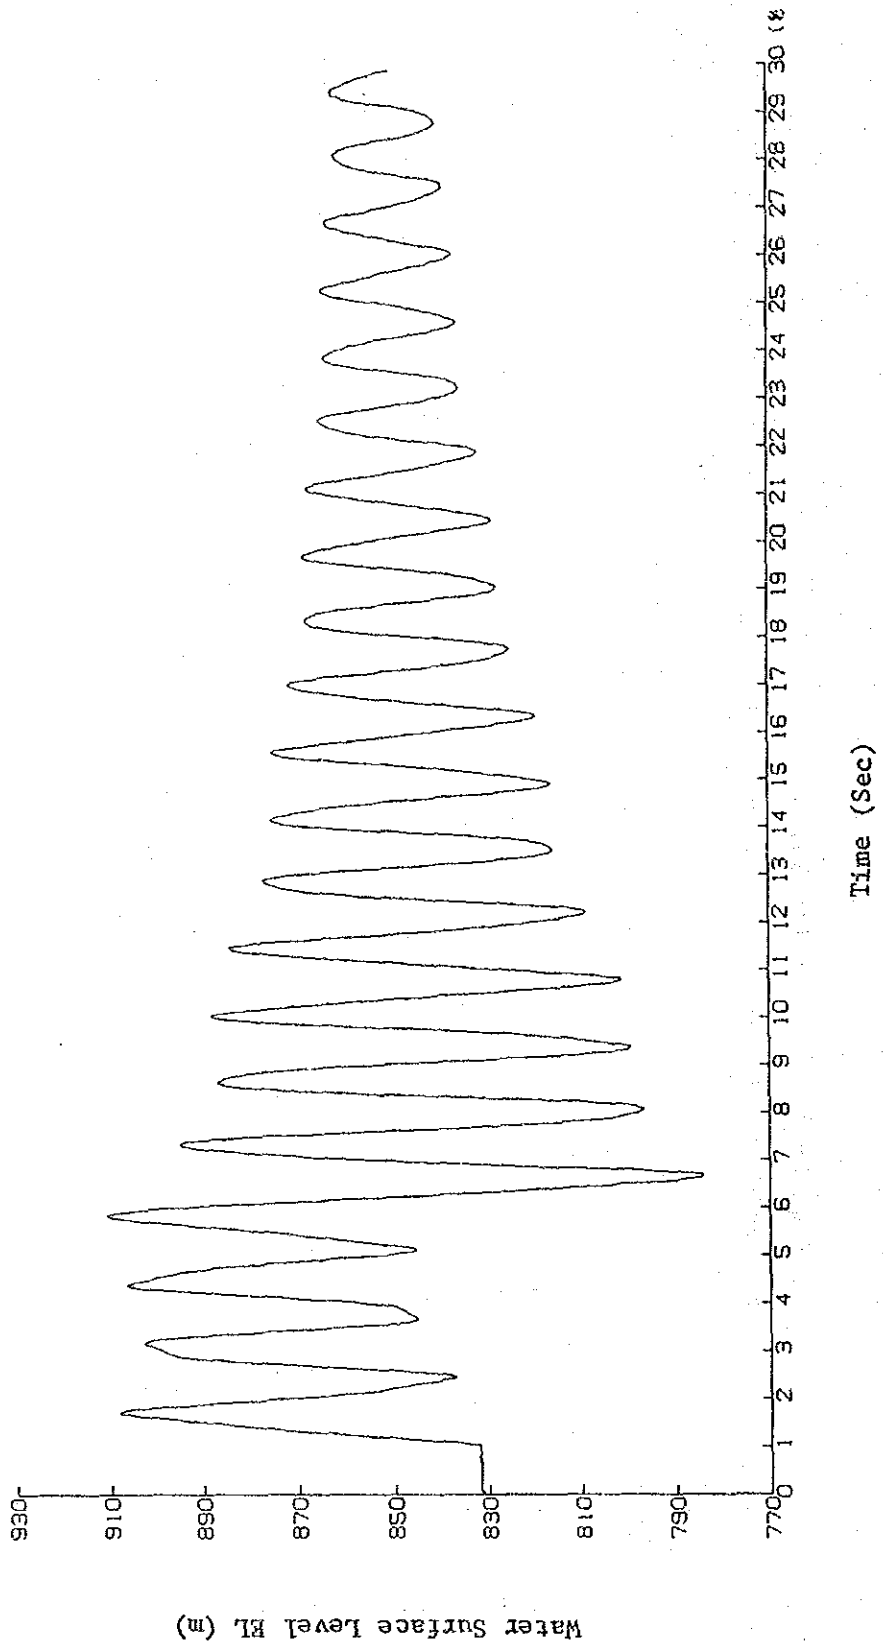


Fig. D-19 Point No. 5

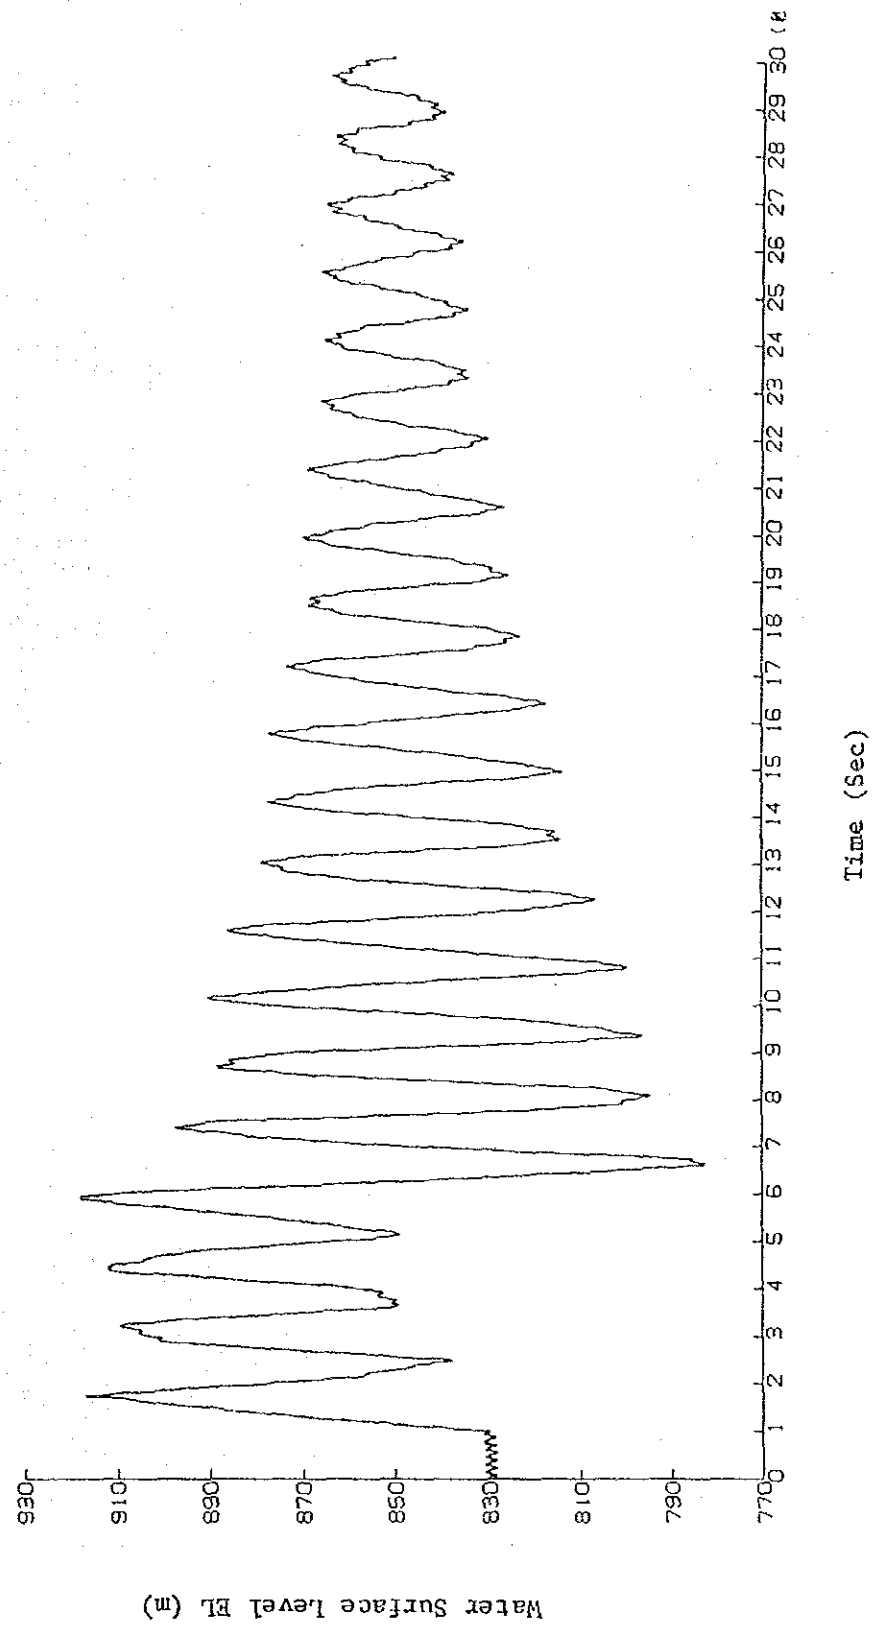

D.7 Rating Curve at Tailrace Outlet

** n=0.035 **

SH= 535
 OH= 2
 (1 / I) I = 60

RH= 555
 n= .035

| | | |
|----|---------|--------|
| 1 | X= 9 | Y= 558 |
| 2 | X= 13.5 | Y= 539 |
| 3 | X= 20 | Y= 537 |
| 4 | X= 20 | Y= 535 |
| 5 | X= 50 | Y= 535 |
| 6 | X= 50 | Y= 537 |
| 7 | X= 58.5 | Y= 539 |
| 8 | X= 64 | Y= 541 |
| 9 | X= 66 | Y= 543 |
| 10 | X= 75.5 | Y= 551 |
| 11 | X= 86.5 | Y= 560 |

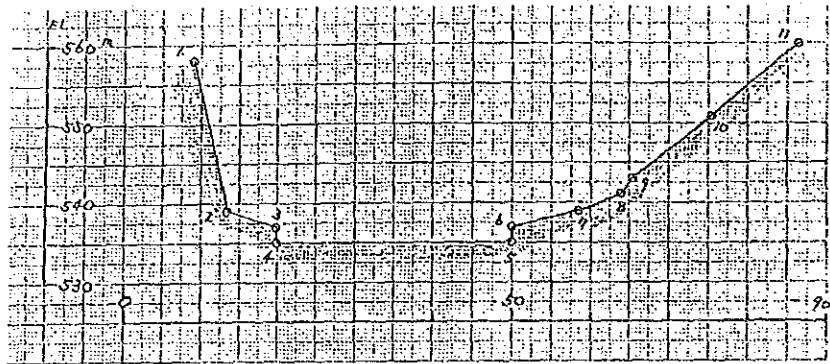


Table D-7

1 / 60

| EL. (m) | D (m) | A (m ²) | P (m) | R (m) | n | V (m/s) | F | SQ (m ³ /s) | Q (m ³ /s) |
|------------|----------|------------------------|----------|----------|-------|------------|-------|---------------------------|--------------------------|
| 535.000 | 0.000 | 0.00 | 0.000 | 0.000 | 0.035 | 0.000 | 0.000 | 0.00 | 0.00 |
| 537.000 | 2.000 | 60.00 | 34.000 | 1.765 | 0.035 | 5.386 | 1.276 | 323.19 | 323.19 |
| 539.000 | 3.000 | 135.00 | 49.533 | 2.725 | 0.035 | 7.197 | 1.392 | 971.59 | 971.59 |
| 541.000 | 4.531 | 230.97 | 57.441 | 4.021 | 0.035 | 9.327 | 1.468 | 2154.34 | 2154.34 |
| 543.000 | 6.275 | 335.40 | 62.324 | 5.381 | 0.035 | 11.327 | 1.515 | 3799.08 | 3799.08 |
| 545.000 | 7.907 | 445.14 | 67.485 | 6.596 | 0.035 | 12.973 | 1.546 | 5774.90 | 5774.90 |
| 547.000 | 9.478 | 560.58 | 72.645 | 7.717 | 0.035 | 14.404 | 1.568 | 8074.48 | 8074.48 |
| 549.000 | 10.997 | 681.72 | 77.805 | 8.762 | 0.035 | 15.677 | 1.584 | 10687.10 | 10687.10 |
| 551.000 | 12.470 | 808.55 | 82.965 | 9.746 | 0.035 | 16.829 | 1.597 | 13607.30 | 13607.30 |
| 553.000 | 13.890 | 941.16 | 88.179 | 10.673 | 0.035 | 17.881 | 1.608 | 16828.60 | 16828.60 |
| 555.000 | 15.275 | 1079.59 | 93.393 | 11.560 | 0.035 | 18.858 | 1.617 | 20358.60 | 20358.60 |

** n=0.045 **

SH= 535
DH= 2
(1 / I) I = 60

RH= 555
n= .045

| | | |
|----|---------|--------|
| 1 | X= 9 | Y= 558 |
| 2 | X= 13.5 | Y= 539 |
| 3 | X= 20 | Y= 537 |
| 4 | X= 20 | Y= 535 |
| 5 | X= 50 | Y= 535 |
| 6 | X= 50 | Y= 537 |
| 7 | X= 58.5 | Y= 539 |
| 8 | X= 64 | Y= 541 |
| 9 | X= 66 | Y= 543 |
| 10 | X= 75.5 | Y= 551 |
| 11 | X= 86.5 | Y= 560 |

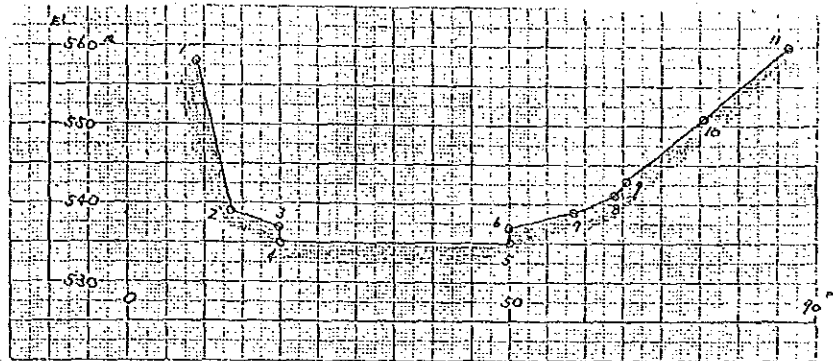



Table D-8

1 / 60

| EL. (m) | D (m) | A (m ²) | P (m) | R (m) | n | V (m/s) | F | SQ (m ³ /s) | Q (m ³ /s) |
|------------|----------|------------------------|----------|----------|-------|------------|-------|---------------------------|--------------------------|
| 535.000 | 0.000 | 0.00 | 0.000 | 0.000 | 0.045 | 0.000 | 0.000 | 0.00 | 0.00 |
| 537.000 | 2.000 | 60.00 | 34.000 | 1.765 | 0.045 | 4.189 | 0.993 | 251.37 | 251.37 |
| 539.000 | 3.000 | 135.00 | 49.533 | 2.725 | 0.045 | 5.598 | 1.083 | 755.68 | 755.68 |
| 541.000 | 4.531 | 230.97 | 57.441 | 4.021 | 0.045 | 7.255 | 1.142 | 1675.60 | 1675.60 |
| 543.000 | 6.275 | 335.40 | 62.324 | 5.381 | 0.045 | 8.810 | 1.178 | 2954.84 | 2954.84 |
| 545.000 | 7.907 | 445.14 | 67.485 | 6.596 | 0.045 | 10.090 | 1.202 | 4491.59 | 4491.59 |
| 547.000 | 9.478 | 560.58 | 72.645 | 7.717 | 0.045 | 11.203 | 1.219 | 6280.15 | 6280.15 |
| 549.000 | 10.997 | 681.72 | 77.805 | 8.762 | 0.045 | 12.193 | 1.232 | 8312.15 | 8312.15 |
| 551.000 | 12.470 | 808.55 | 82.965 | 9.746 | 0.045 | 13.089 | 1.242 | 10583.50 | 10583.50 |
| 553.000 | 13.890 | 941.16 | 88.179 | 10.673 | 0.045 | 13.907 | 1.250 | 13088.90 | 13088.90 |
| 555.000 | 15.275 | 1079.59 | 93.393 | 11.560 | 0.045 | 14.667 | 1.257 | 15834.50 | 15834.50 |

Rating Curve at Tailrace Outlet

Fig. D-20

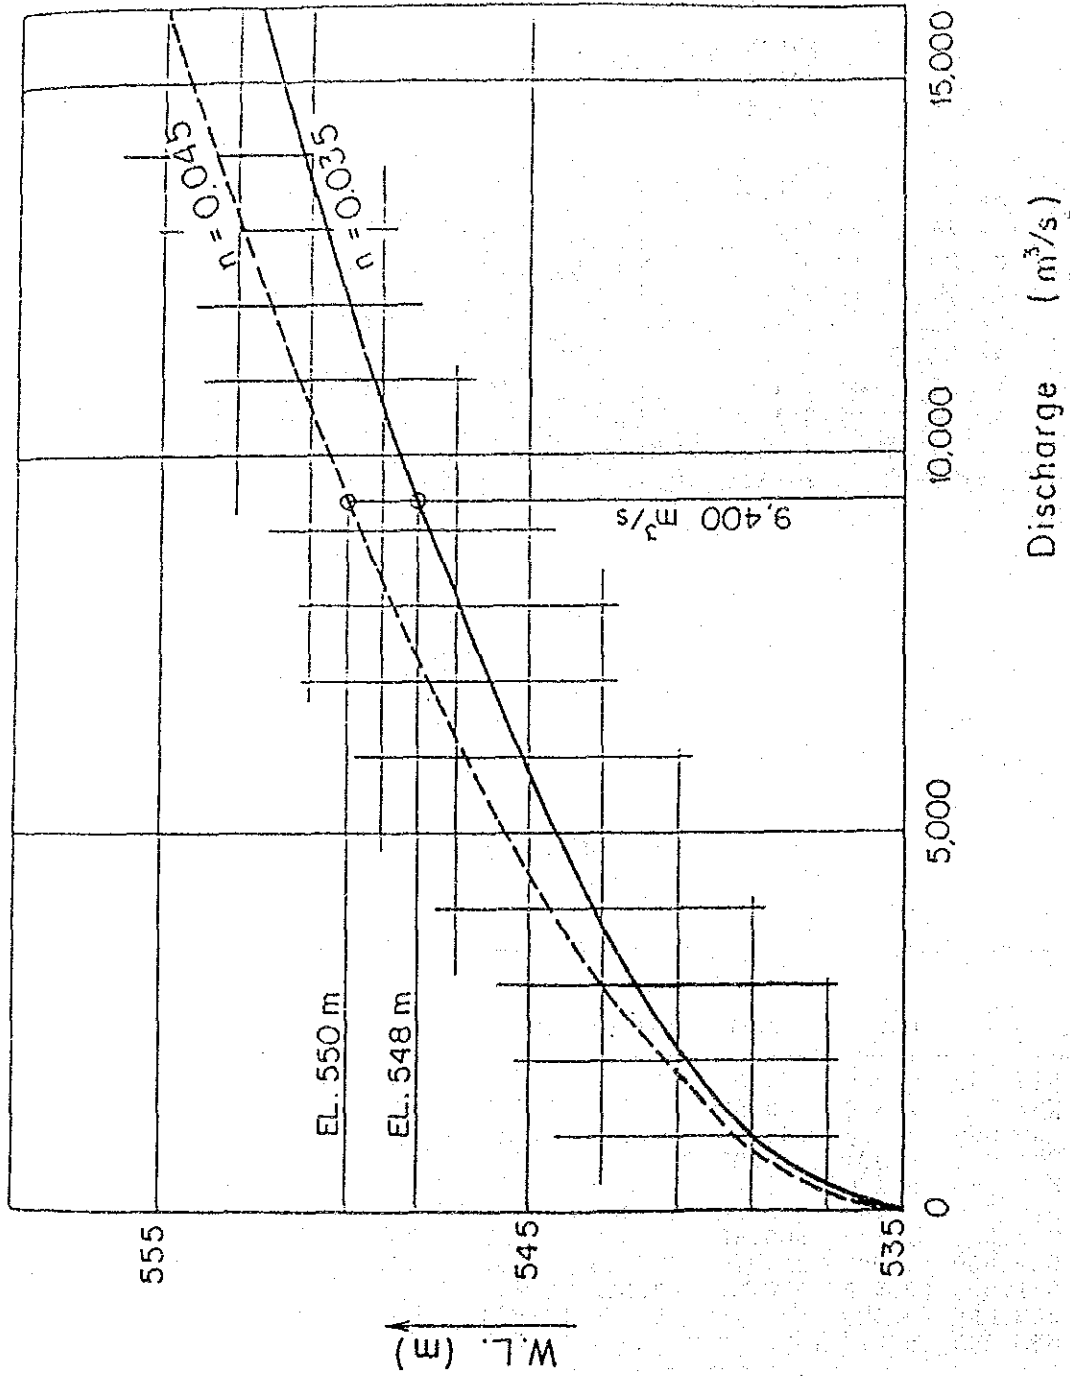

D.8 Calculation of Head Loss

1. General

Dimensions of waterway, such as diameter, length, etc. are shown in Fig. D-21, 22 and 23.

Coefficients of roughness are as shown below:

| | |
|-----------------|-------|
| Unlined, (TBM) | 0.020 |
| Shotcrete (TBM) | 0.018 |
| Shotcrete (CBM) | 0.020 |
| Concrete lined | 0.013 |
| Steel lined | 0.012 |

2. Results

The summary table (Table D-9) shows calculation results.


Table D-9 Summary Tabel of Head Losses

Q=80m³/s

| Unit | | Loss of Head (m) |
|------|----------|---|
| 1 | Intake | $3.1250 \times 10^{-5} \times Q^2 = 0.20$ |
| | Tunnel | 142.8658 " = 9.14 |
| | Penstock | 55.5827 " = 3.55 |
| | Tailrace | 12.9728 " = 0.83 |
| | Outlet | |
| | Total | 13.72 |
| 2 | Intake | $3.1250 \times 10^{-5} \times Q^2 = 0.20$ |
| | Tunnel | 142.8658 " = 9.14 |
| | Penstock | 51.7560 " = 3.31 |
| | Tailrace | 12.4848 " = 0.80 |
| | Outlet | |
| | Total | 13.45 |
| 3 | Intake | $3.1250 \times 10^{-5} \times Q^2 = 0.20$ |
| | Tunnel | 142.8658 " = 9.14 |
| | Penstock | 55.5843 " = 3.56 |
| | Tailrace | 10.5949 " = 0.68 |
| | Outlet | |
| | Total | 13.58 |

A design head loss of 14.00 m is applied for the optimum studies and the planning, taking some miscellaneous losses into consideration.

Fig. D-21 Headrace Tunnel Profile

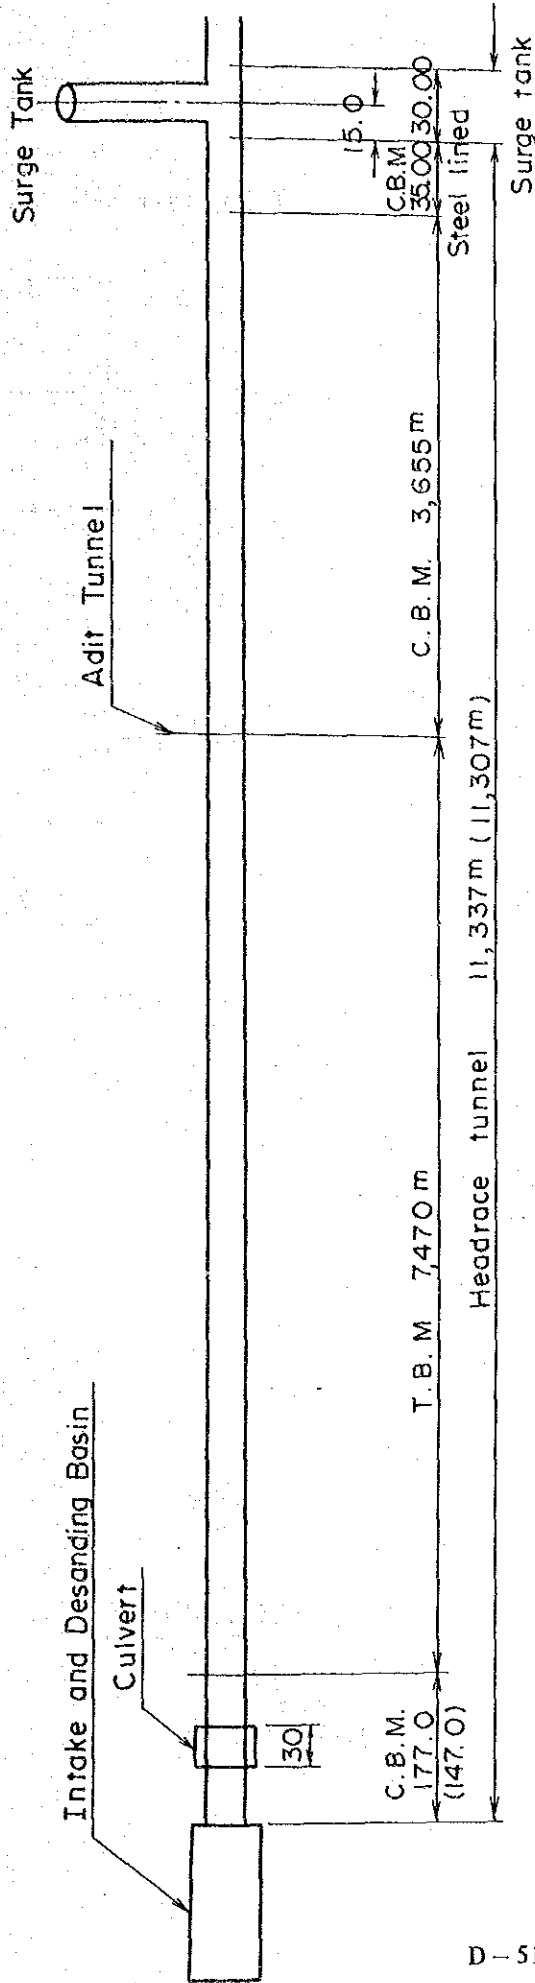

| T. B. M | C. B. M | Note |
|------------------------------|--------------------|-----------------------------------|
| Unliend | 2,000 ^m | 1,300 |
| Shotcrete | 3,370 | Concret (I), with Shotcrete 400 |
| Concrete (I), with Shotcrete | 600 | Concrete (II) 2,102 Including 147 |
| Concrete (II) | 1,500 | Stell lined 35 |
| Total | 7,470 | Total 3,837 |

Fig. D-22 Penstock


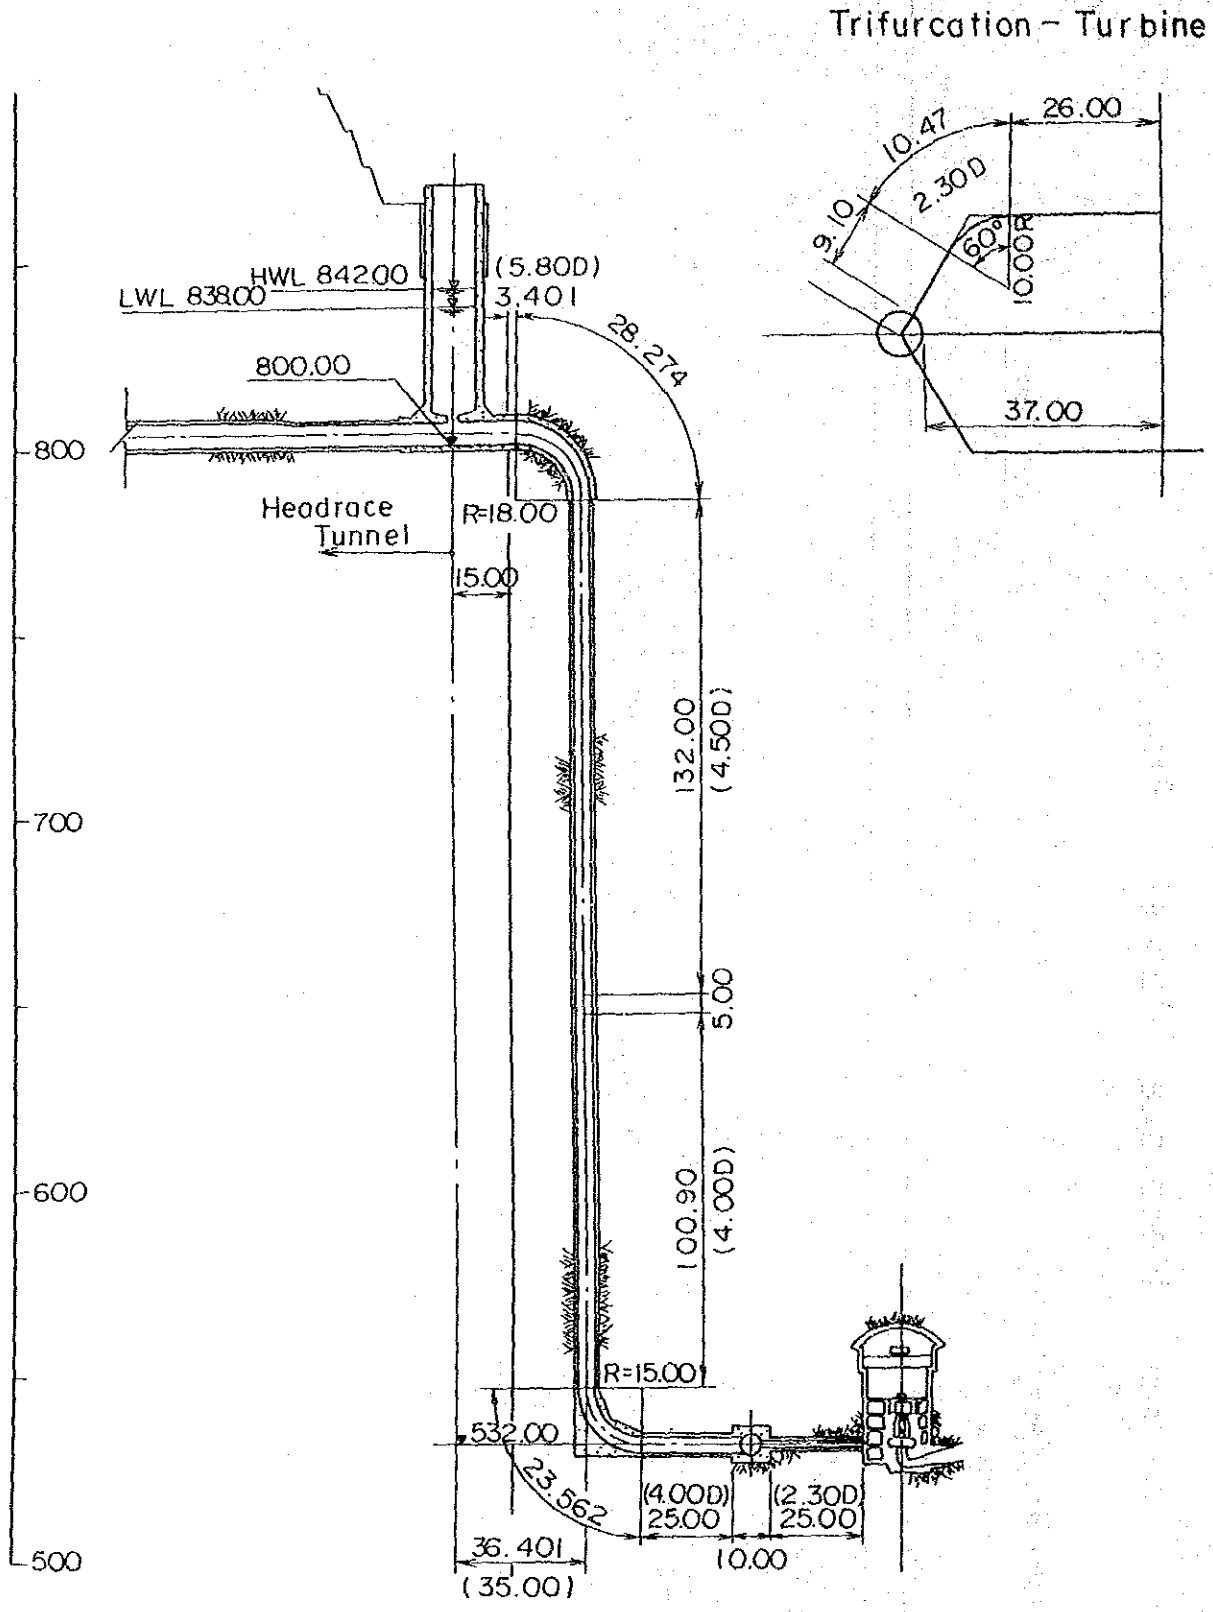


Fig. D-23 Tailrace Tunnel

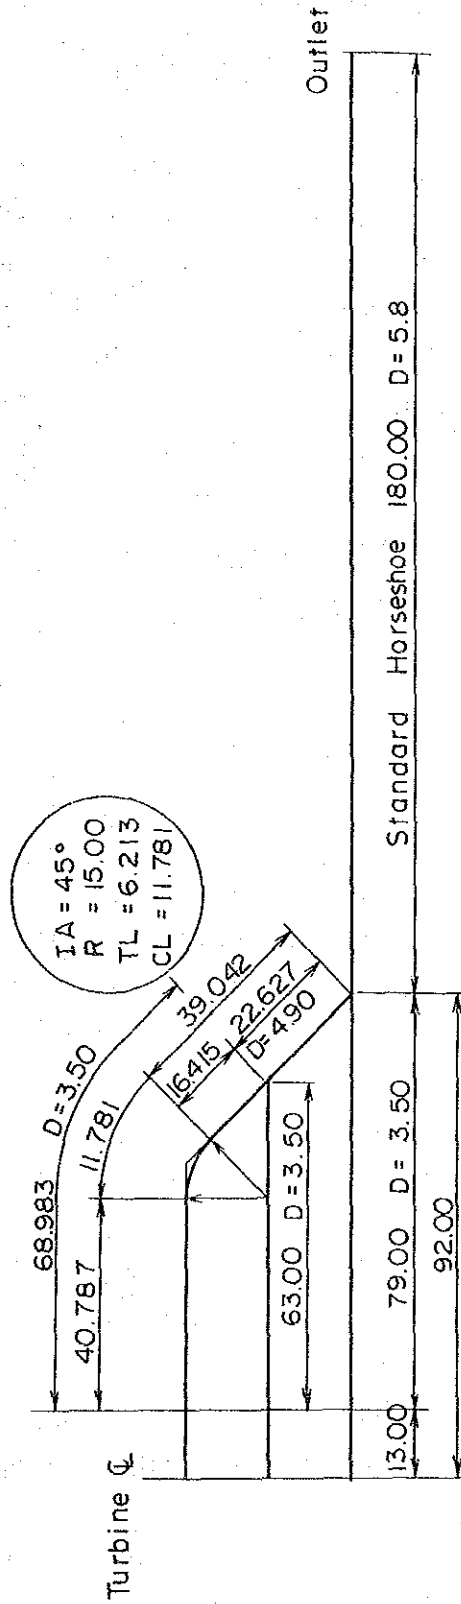

D.9 Probability Analysis on Seismic Hazard
at the ARUN-3 PROJECT site

1. Seismicity Data

Seismicity data used in this study are based on those retrieved from 'The Earthquake Data File' compiled by NOAA (National Oceanic and Atmospheric Administration Environmental Data Service). Total number of the data amounts to 964, covering a period from 1963 to 1985. Location of all the data is plotted in Fig. 1 in which the ARUN-3 project site (27°33'40"N, 87°18'25"E) is shown by a cross. Numbers of the data in each year during the period are shown in Table 1, together with accumulative numbers from 1963. General aspects of the data such as magnitude and epicentral distance can be seen in Table 2 and also in Figs. 2-12.

2. Attenuation Models

Of previously proposed attenuation models which express peak acceleration, A (gal), in terms of earthquake magnitude, M, and hypocentral distance, R (km), or epicentral distance, D (km), five models shown below are used in this study.

$$\log A = 3.090 + 0.347M - 2 \log (R+25) \quad (1)$$

proposed by C. Oliveira¹⁾.

$$\log A = 2.674 + 0.278M - 1.301 \log (R+25) \quad (2)$$

proposed by R. K. McGuire²⁾.

$$\log A = 2.041 + 1.842M - 1.6 \log D \quad (3)$$

proposed by L. Esteva and E. Rosenblueth³⁾.

$$\log A = 2.308 + 0.411M - 1.637 \log (R+30) \quad (4)$$

proposed by T. Katayama⁴⁾.

$$\log (A/640) = (D+40)(-7.6+1.724M-0.1036M^2)/100 \quad (5)$$

proposed by S. Okamoto⁵⁾.

For all the data described earlier, peak accelerations were calculated by using the above attenuation models, and maximum accelerations in each year-long interval were found to be as shown in Table 3.

3. Statistical Analysis of Maximum Accelerations

The seismicity data are available for successive 23 years from 1963 to 1985. Hence, a probabilistic model based on the "Theory of Extreme Values" can be established by setting an equal time interval to one year.

Although a probability function of the maximum acceleration expected at the project site is not known, it is reasonable to suppose that the function should be associated with the third type asymptotic distribution defined by

$$P(x) = \exp[-\{(w-x)/(w-u)\}^k] \quad (6)$$

where w is an upper limit of a variable, k is a shape parameter, u is a characteristic value, and x is a random variable taken as logarithm of the maximum acceleration during a year-long interval, expressed as

$$x = \log A_{\max} \quad (7)$$

The previously mentioned maximum acceleration values are plotted in Figs. 13-17. Plotting position of each maximum value was calculated by

$$p(m) = (N-m+1)/(N+1) \quad (8)$$

where N ($=23$) is the total number of the time interval and m is the order of the value from the largest one. In these figures, regression curves estimated for the third asymptotic distribution function are also shown by solid lines, from which the maximum acceleration for any return period can be evaluated. Table 4 shows the maximum accelerations expected at the site for five different return periods of 50, 100, 200, 500 and 1000 years.

4. References

- 1) Oliveira, C.; Seismic Risk Analysis, EERC 74-1, Earthquake Engineering Research Center, University of California, Berkeley (1974), 1-102.
- 2) McGuire, R. K.; Seismic Structural Response Risk Analysis incorporating Peak Response Regressions on Earthquake Magnitude and Distance, Mass. Inst. Tech. Dep. Civ. Eng., R74-51 (1974).
- 3) Esteva, L. and Rosenblueth, E.; Espectos de Temblores a Distancias Moderadas y Grandes, Proc. Chilean Conference on Seismology and Earthquake Engineering, vol. 1, University of Chile (1963).
- 4) Katayama, T.; Fundamentals of Probabilistic Evaluation of Seismic Activity and Seismic Risk (in Japanese), SEISAN-KENKYU (Monthly Journal of Institute of Industrial Science, University of Tokyo), 27-5 (1975), 1-11.
- 5) Okamoto, S.; Introduction to Earthquake Engineering 2nd ed., University of Tokyo Press (1984), 152-154.

Table-1

Number of Earthquakes in a year during the period from 1906 to 1985

| Year | N | Sum of N | Year | N | Sum of N |
|------|----|----------|------|-----|----------|
| 1906 | 1 | | 1946 | 4 | |
| 1907 | 0 | | 1947 | 3 | |
| 1908 | 1 | | 1948 | 0 | |
| 1909 | 0 | | 1949 | 1 | |
| 1910 | 0 | | 1950 | 101 | |
| 1911 | 1 | | 1951 | 44 | |
| 1912 | 0 | | 1952 | 29 | |
| 1913 | 3 | | 1953 | 15 | |
| 1914 | 0 | | 1954 | 13 | |
| 1915 | 1 | | 1955 | 26 | |
| 1916 | 1 | | 1956 | 17 | |
| 1917 | 0 | | 1957 | 17 | |
| 1918 | 3 | | 1958 | 21 | |
| 1919 | 1 | | 1959 | 30 | |
| 1920 | 3 | | 1960 | 22 | |
| 1921 | 2 | | 1961 | 27 | |
| 1922 | 0 | | 1962 | 21 | |
| 1923 | 4 | | 1963 | 22 | 22 |
| 1924 | 11 | | 1964 | 32 | 54 |
| 1925 | 4 | | 1965 | 37 | 91 |
| 1926 | 14 | | 1966 | 45 | 136 |
| 1927 | 13 | | 1967 | 32 | 168 |
| 1928 | 5 | | 1968 | 35 | 203 |
| 1929 | 3 | | 1969 | 23 | 226 |
| 1930 | 14 | | 1970 | 22 | 248 |
| 1931 | 13 | | 1971 | 30 | 278 |
| 1932 | 18 | | 1972 | 26 | 304 |
| 1933 | 4 | | 1973 | 32 | 336 |
| 1934 | 18 | | 1974 | 32 | 368 |
| 1935 | 16 | | 1975 | 67 | 435 |
| 1936 | 14 | | 1976 | 36 | 471 |
| 1937 | 13 | | 1977 | 53 | 524 |
| 1938 | 15 | | 1978 | 56 | 580 |
| 1939 | 5 | | 1979 | 55 | 635 |
| 1940 | 11 | | 1980 | 83 | 718 |
| 1941 | 12 | | 1981 | 56 | 774 |
| 1942 | 3 | | 1982 | 70 | 844 |
| 1943 | 1 | | 1983 | 38 | 882 |
| 1944 | 5 | | 1984 | 68 | 950 |
| 1945 | 1 | | 1985 | 14 | 964 |

Note : Magnitude is not described in the Files before 1962.

Table 2

Distribution of Magnitude and Epicentral Distance of the Seismicity Data

Δ : Epicentral Distance [km]
M : Magnitude

| | $0 \leq \Delta < 50$ | < 100 | < 200 | < 300 | < 400 | < 500 | < 600 | < 700 | < 800 | < 900 | ≤ 1000 | Total |
|--------------------|----------------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|-------------|-------|
| $3.5 \leq M < 4.0$ | 0 | 0 | 0 | 0 | 1 | 1 | 0 | 2 | 3 | 2 | 3 | 12 |
| < 4.5 | 1 | 0 | 4 | 4 | 5 | 10 | 10 | 17 | 21 | 30 | 33 | 135 |
| < 5.0 | 0 | 5 | 11 | 10 | 22 | 26 | 49 | 49 | 90 | 122 | 112 | 496 |
| < 5.5 | 2 | 8 | 4 | 6 | 7 | 16 | 22 | 33 | 30 | 64 | 58 | 250 |
| < 6.0 | 0 | 0 | 1 | 1 | 3 | 4 | 6 | 10 | 9 | 12 | 7 | 53 |
| < 6.5 | 0 | 1 | 1 | 1 | 0 | 0 | 0 | 4 | 2 | 3 | 3 | 15 |
| < 7.0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 3 | 0 | 3 |
| Total | 3 | 14 | 21 | 22 | 38 | 57 | 87 | 115 | 155 | 236 | 216 | 964 |

Table 3

Maximum Accelerations during a year from 1963 to 1985

unit : gal


| year | C.Oliveira Eq.(1) | R.k.McGuire Eq.(2) | L.Esteva & E.Rosenblueth Eq.(3) | T.katayama Eq.(4) | S.Okamoto Eq.(5) |
|------|----------------------|-----------------------|---------------------------------------|----------------------|---------------------|
| 1963 | 7.1 | 27.3 | 7.0 | 9.1 | 10.3 |
| 1964 | 7.6 | 30.8 | 7.0 | 11.7 | 17.0 |
| 1965 | 17.3 | 61.2 | 15.5 | 33.8 | 61.8 |
| 1966 | 1.6 | 10.8 | 1.4 | 3.1 | 0.2 |
| 1967 | 1.8 | 12.3 | 1.7 | 3.9 | 0.4 |
| 1968 | 2.5 | 15.1 | 2.3 | 5.0 | 1.2 |
| 1969 | 0.7 | 6.6 | 0.7 | 1.8 | 0.0 |
| 1970 | 2.9 | 17.1 | 2.6 | 6.2 | 1.8 |
| 1971 | 6.8 | 29.3 | 6.1 | 11.5 | 13.3 |
| 1972 | 5.9 | 27.1 | 5.3 | 10.6 | 10.4 |
| 1973 | 7.4 | 31.6 | 6.6 | 13.0 | 16.2 |
| 1974 | 5.3 | 27.1 | 4.7 | 11.8 | 9.8 |
| 1975 | 22.3 | 64.8 | 24.4 | 30.4 | 122.2 |
| 1976 | 1.8 | 12.6 | 1.7 | 4.2 | 0.6 |
| 1977 | 1.3 | 9.9 | 1.2 | 3.0 | 0.1 |
| 1978 | 2.9 | 17.2 | 2.6 | 6.2 | 1.9 |
| 1979 | 5.0 | 24.1 | 4.4 | 9.2 | 6.4 |
| 1980 | 5.2 | 27.6 | 4.6 | 12.6 | 9.8 |
| 1981 | 1.0 | 8.3 | 0.9 | 2.5 | 0.0 |
| 1982 | 2.2 | 14.0 | 2.0 | 4.8 | 0.7 |
| 1983 | 0.5 | 5.1 | 0.5 | 1.2 | 0.0 |
| 1984 | 2.1 | 13.2 | 1.9 | 4.1 | 0.6 |
| 1985 | 0.4 | 5.4 | 0.5 | 1.6 | 0.0 |

Table 4

Maximum Accelerations for Five Return Periods


unit : gal

| Model (Eq.No.) | Proposer(s) | Return Period , Tr (year) | | | | |
|-------------------|-----------------------------|---------------------------|-----|-----|-----|------|
| | | 50 | 100 | 200 | 500 | 1000 |
| (1) | C.Oliveira | 26 | 34 | 42 | 55 | 65 |
| (2) | R.K.McGuire | 71 | 84 | 97 | 113 | 125 |
| (3) | L.Esteva & E.Rosenblueth | 28 | 41 | 57 | 85 | 113 |
| (4) | T.Katayama | 38 | 48 | 59 | 75 | 87 |
| (5) | S.Okamoto | 164 | 231 | 298 | 381 | 436 |

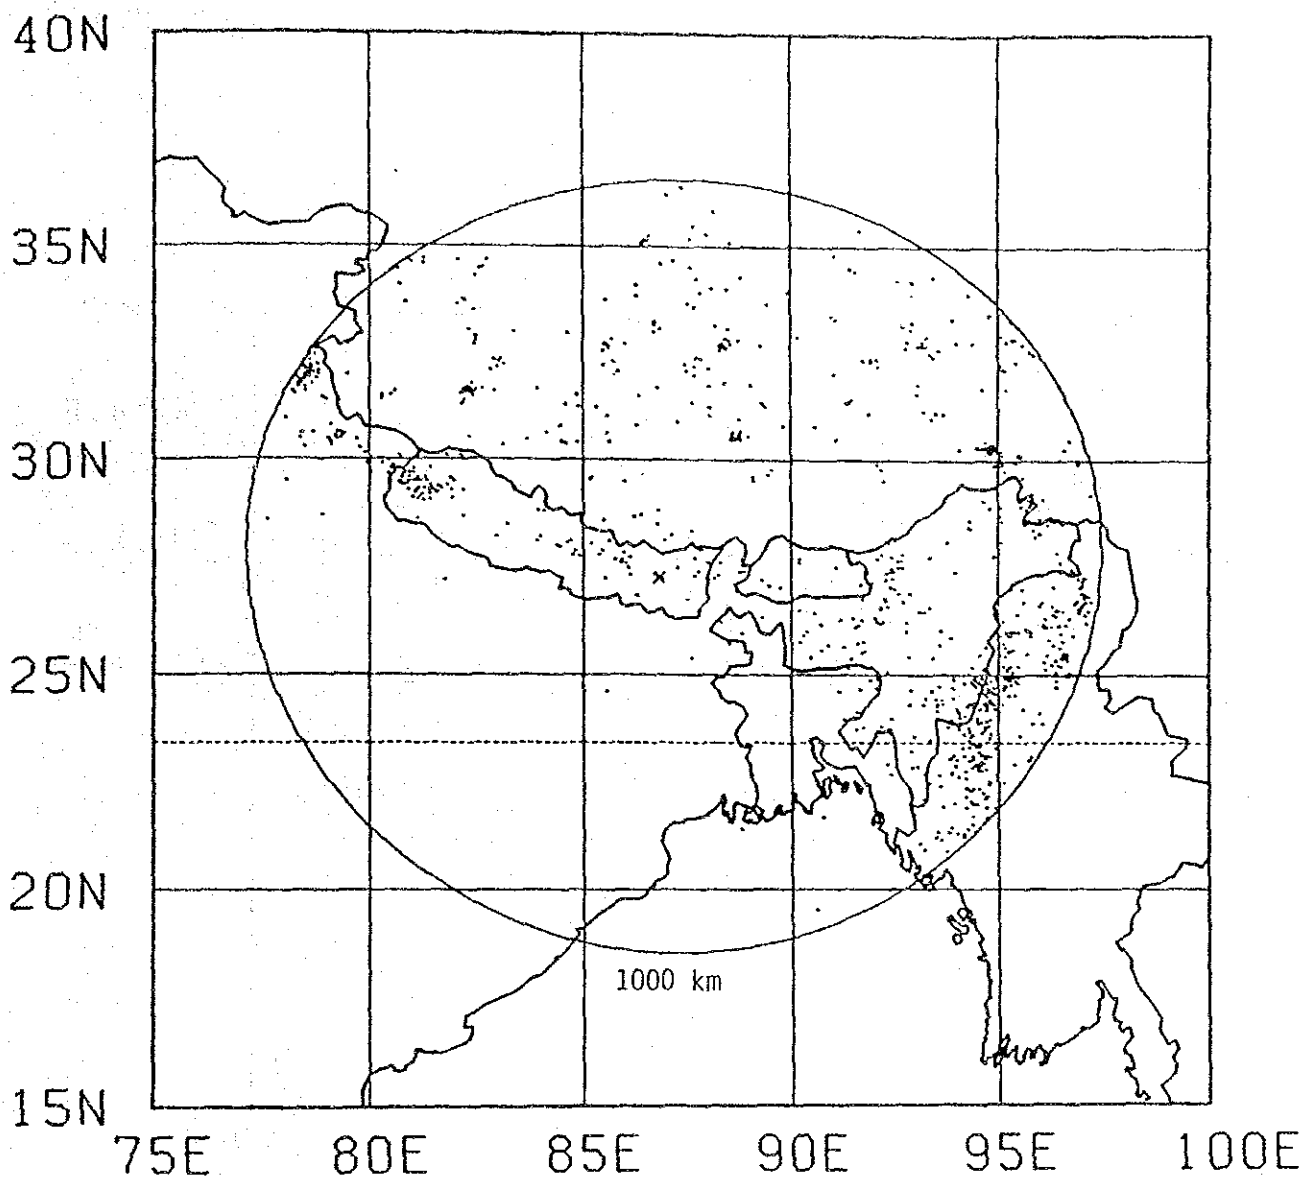


Seismicity of all data in 1963-1985,
 Total Number of Plots in the area of $\Delta \leq 1000.0$ (km) is 964.

Fig. 1

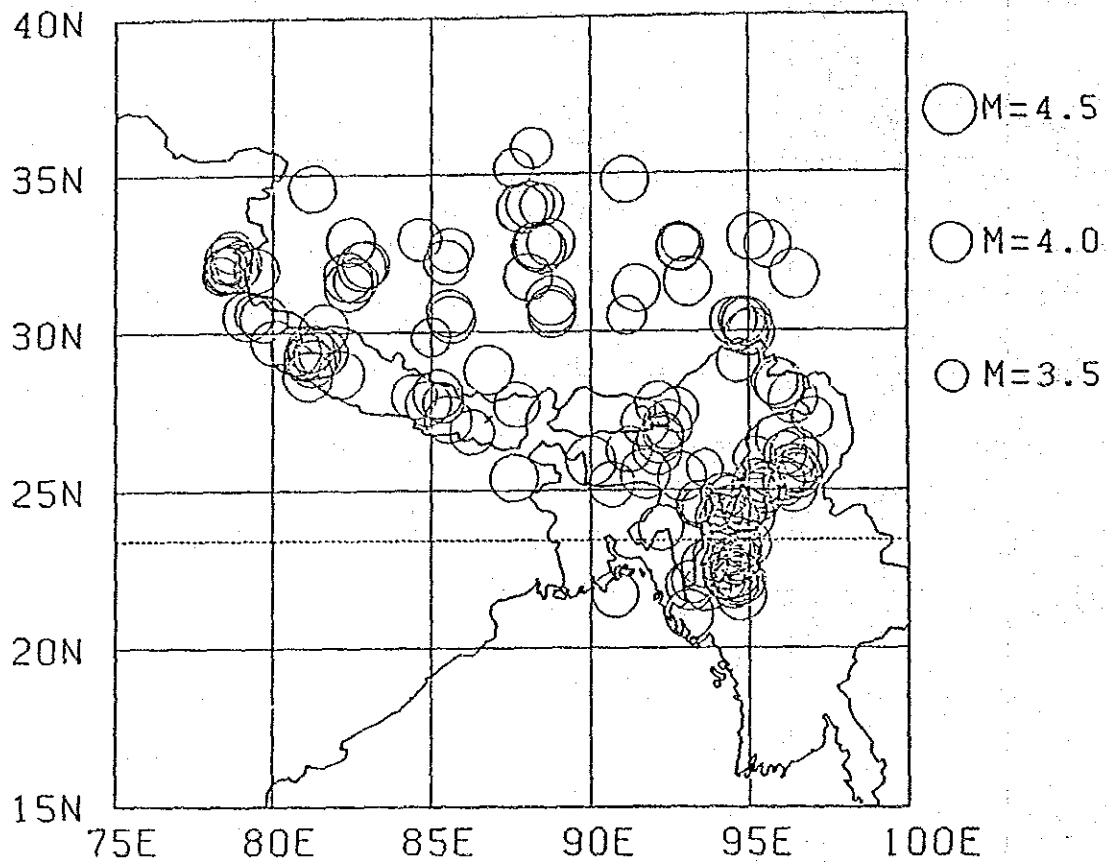


Seismicity of Magnitude $3.5 \leq M < 4.5$ in 1963-1985,
 Total Number of Plots is 147.

Fig. 2

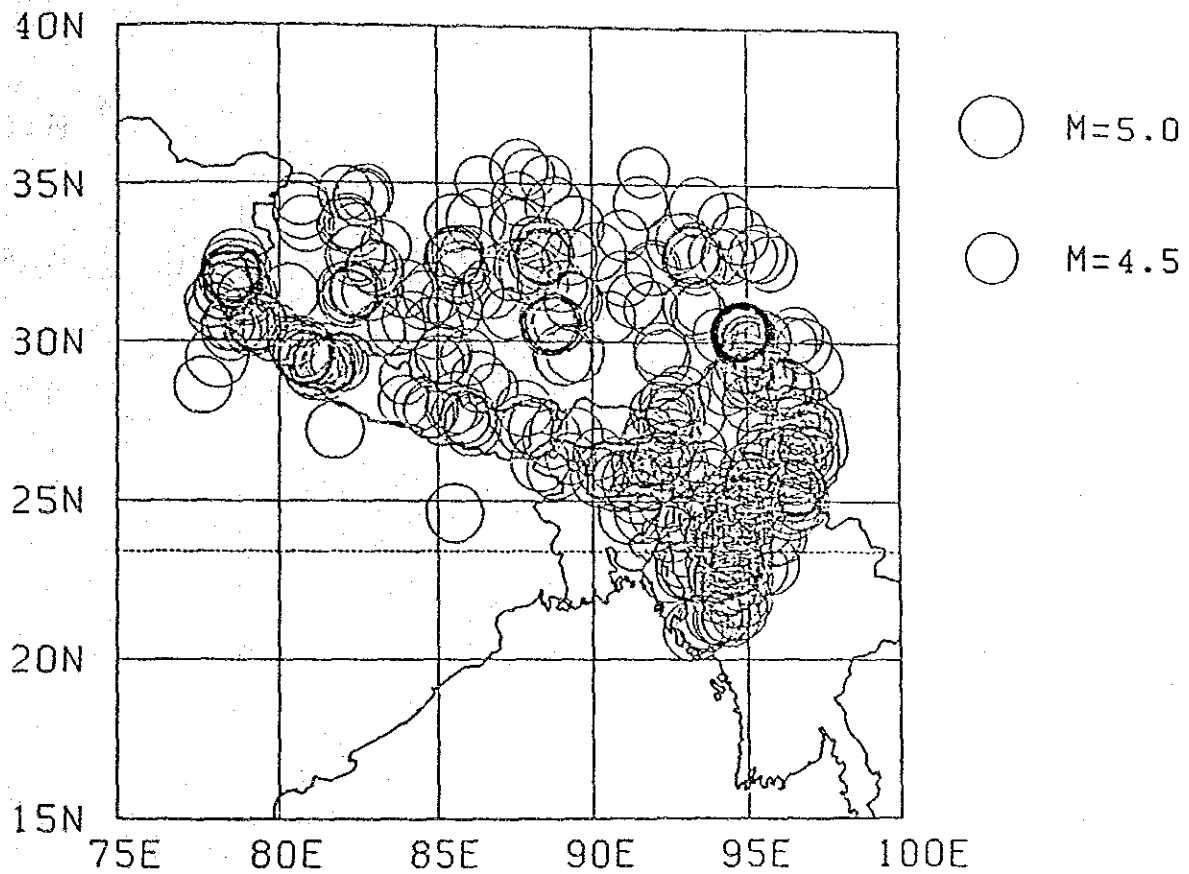


Seismicity of Magnitude $4.5 \leq M < 5.0$ in 1963-1985,
Total Number of Plots is 496.

Fig. 3

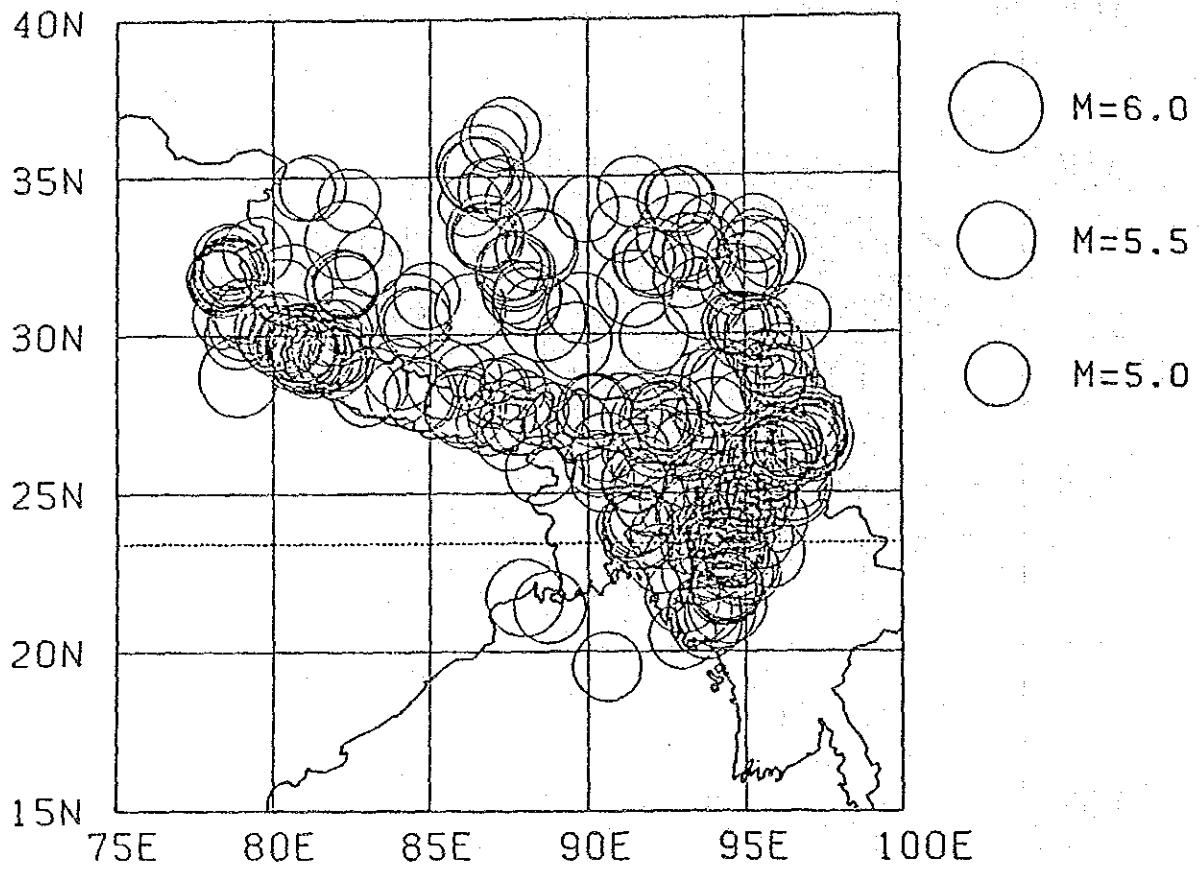


Seismicity of Magnitude $5.0 \leq M < 6.0$ in 1963-1985,
Total Number of Plots is 303.

Fig. 4

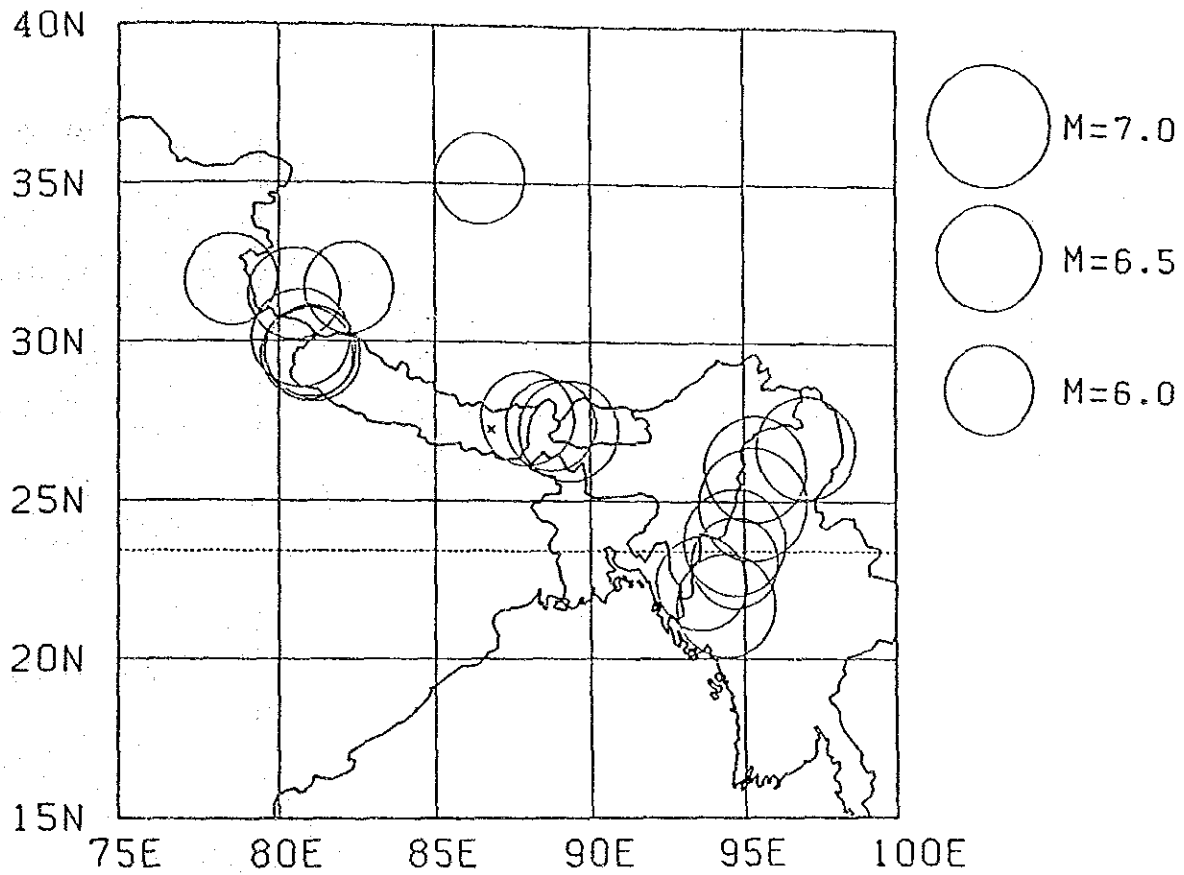


Seismicity of Magnitude $6.0 \leq M < 7.0$ in 1963-1985.
 Total Number of Plots is 18.

Fig. 5

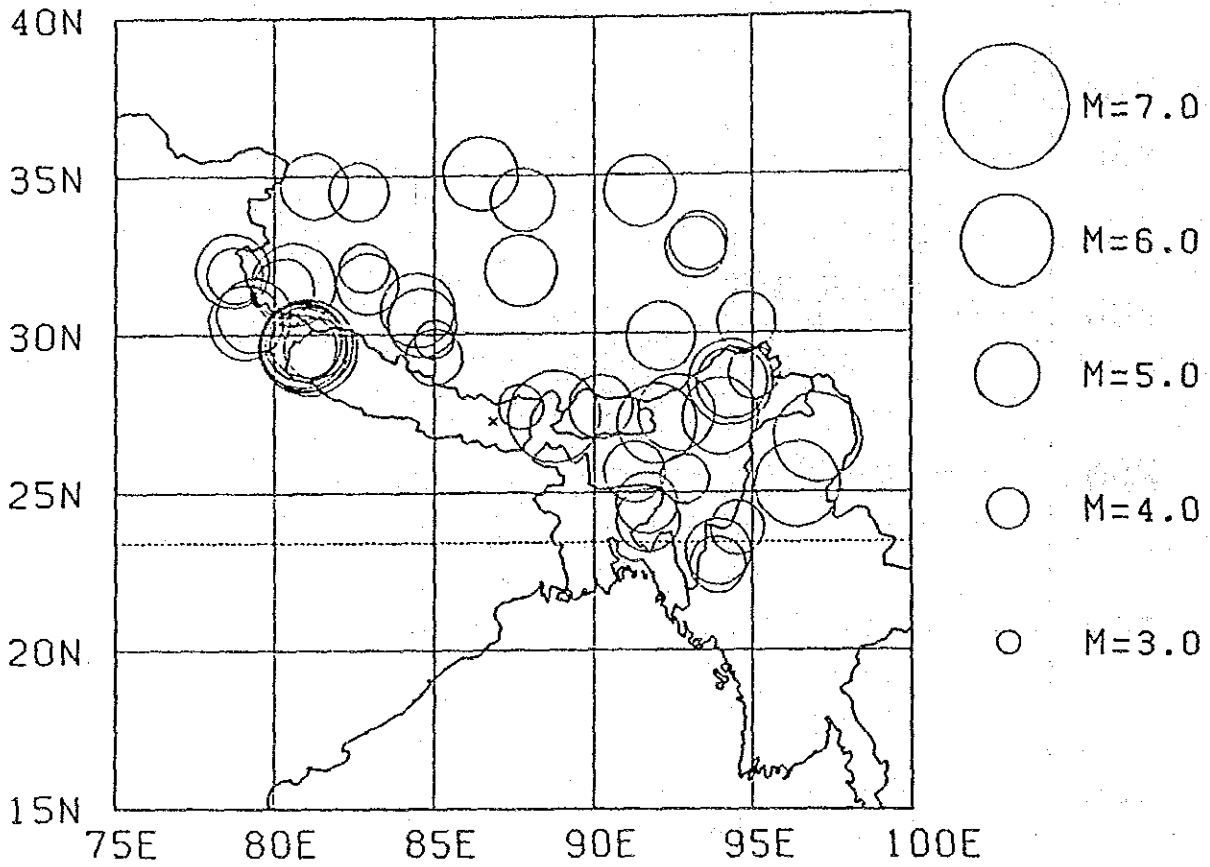


Distribution of Focal Depth $0 \leq D < 20$ km in 1963-1985,
 Total Number of Plots is 48.

Fig. 6

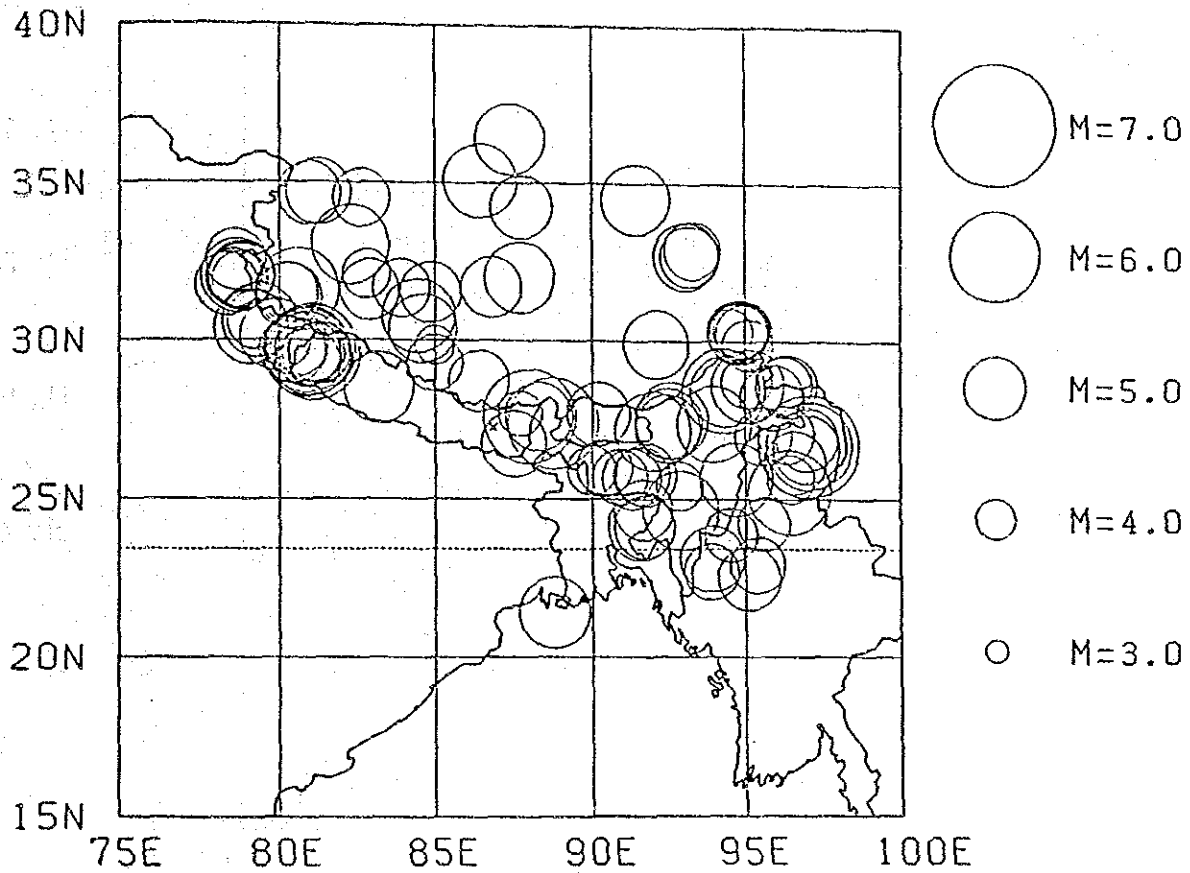


Distribution of Focal Depth $0 \leq D < 30$ km in 1963-1985.
Total Number of Plots is 105.

Fig. 7

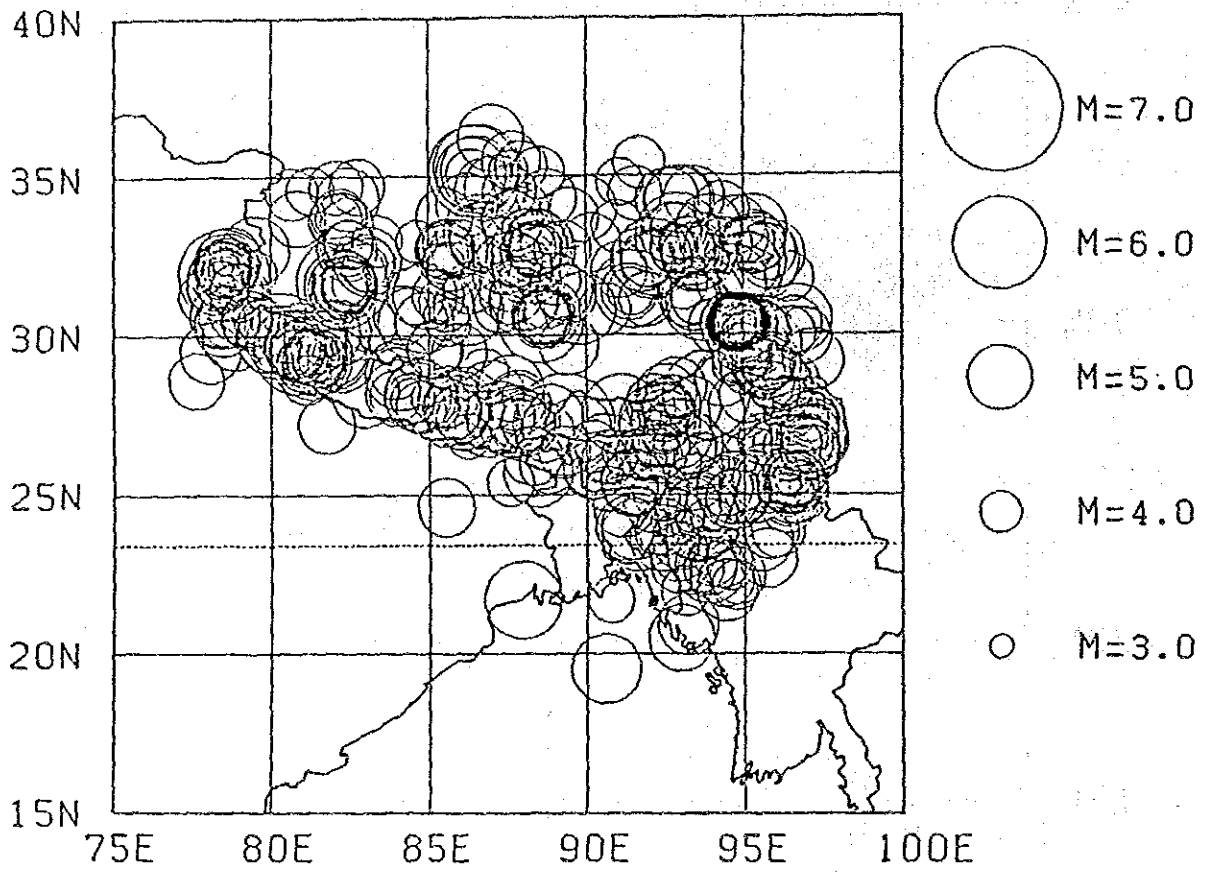


Distribution of Focal Depth $30 \leq D < 40$ km in 1963-1985,
 Total Number of Plots is 534.

Fig. 8

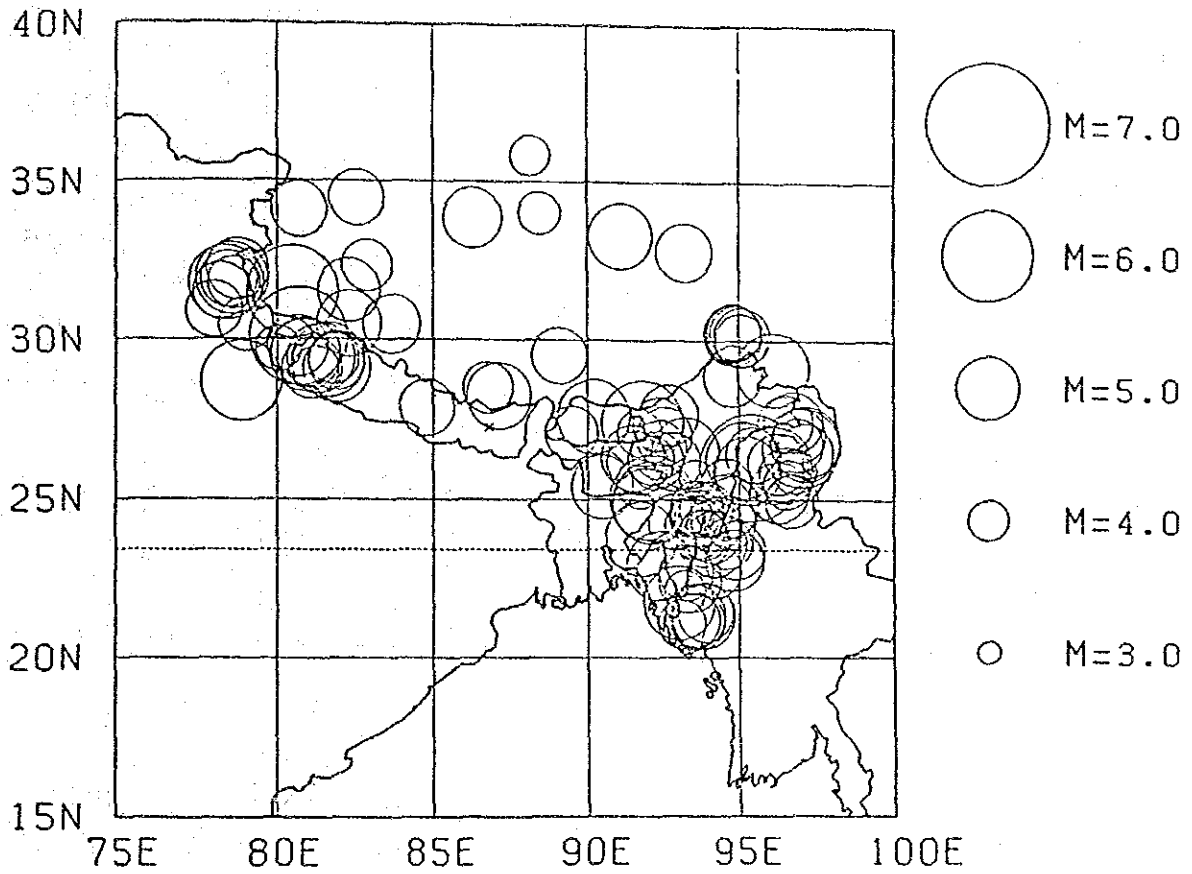


Distribution of Focal Depth $40 \leq D < 60$ km in 1963-1985,
 Total Number of Plots is 118.

Fig. 9

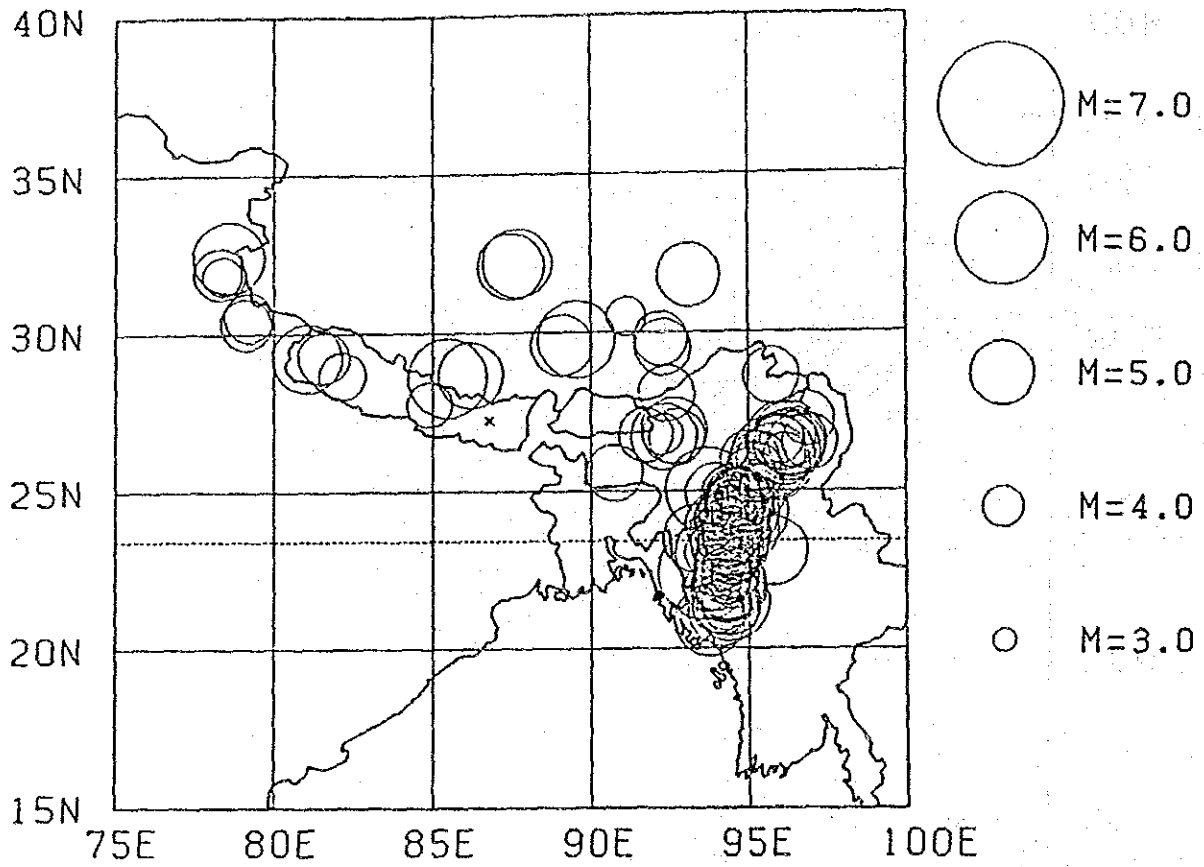


Distribution of Focal Depth $60 \leq D < 100$ km in 1963-1985.
 Total Number of Plots is 129.

Fig. 10

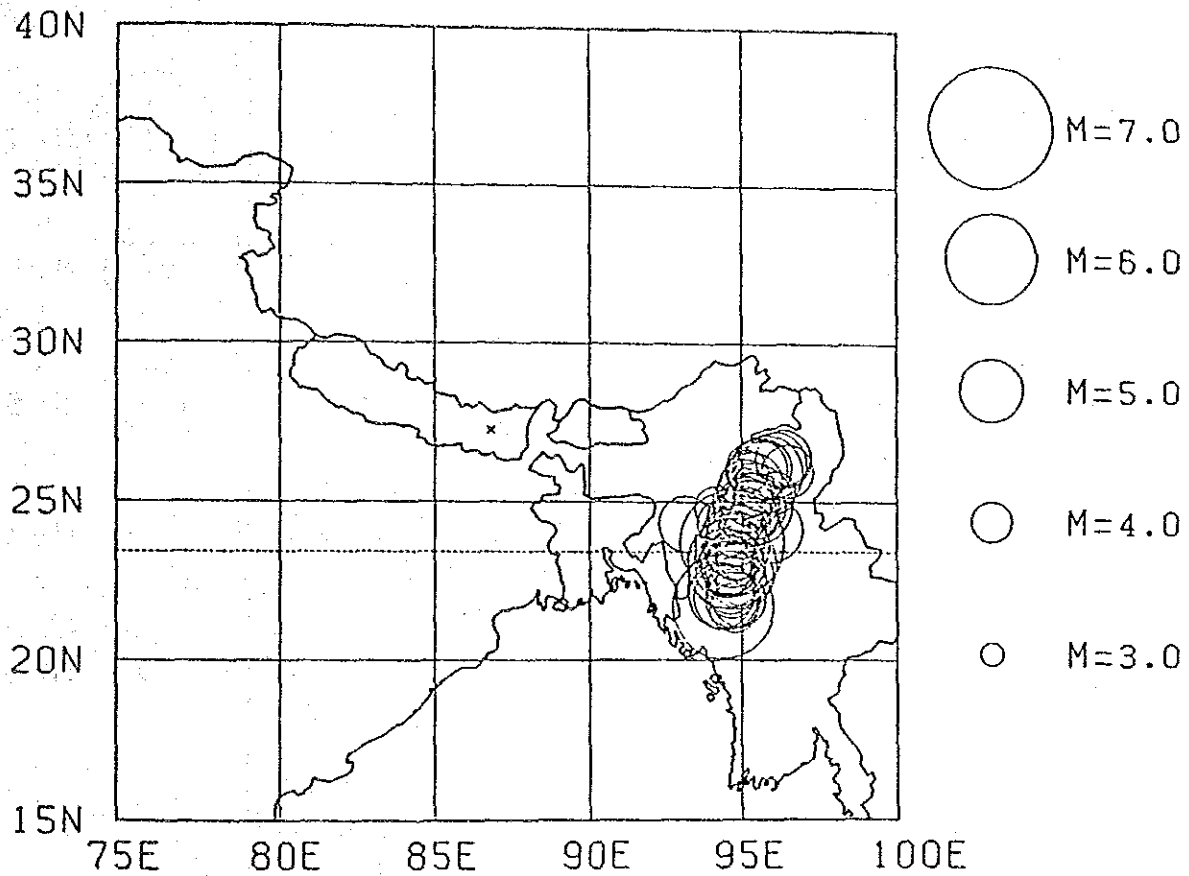


Distribution of Focal Depth $100 \leq D < 150$ km in 1963-1985,
 Total Number of Plots is 65.

Fig. 11

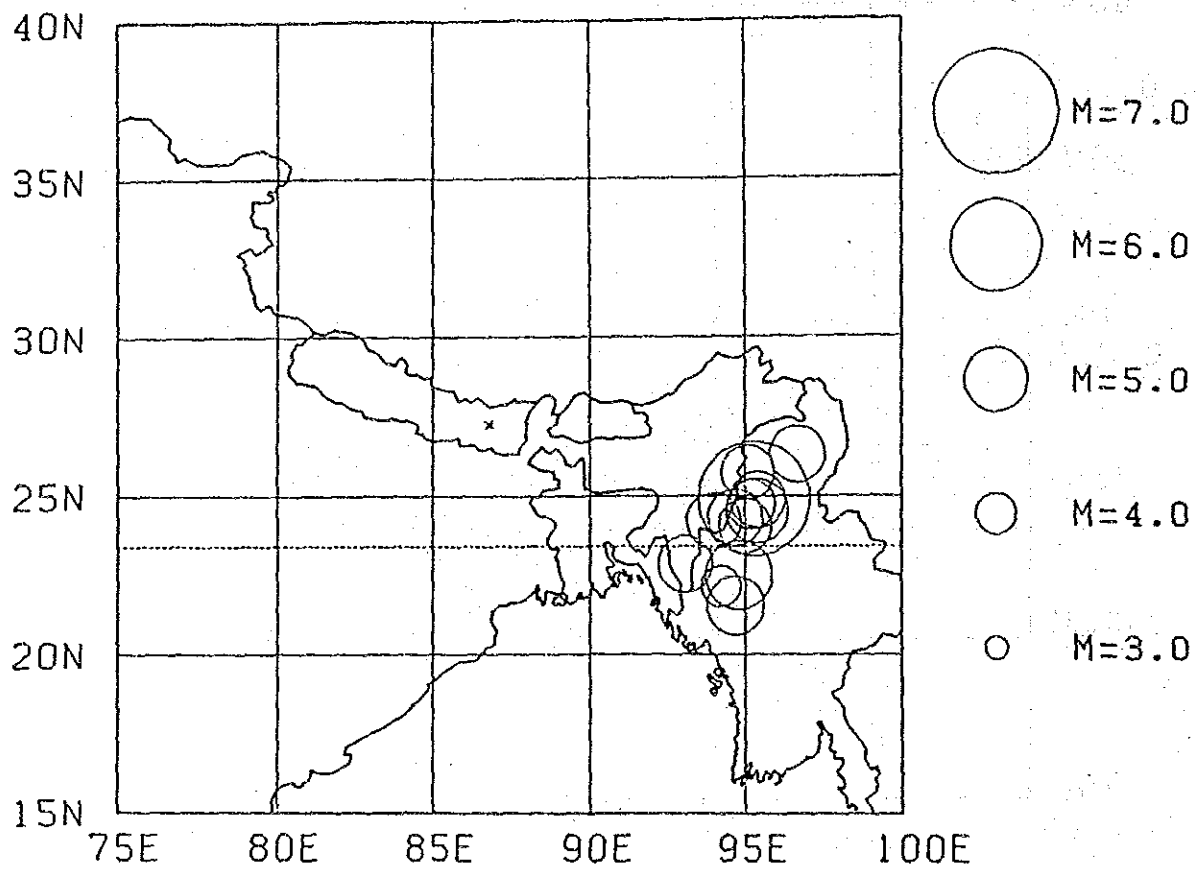


Distribution of Focal Depth $150 \leq D < 200$ km in 1963-1985,
Total Number of Plots is 13.

Fig. 12

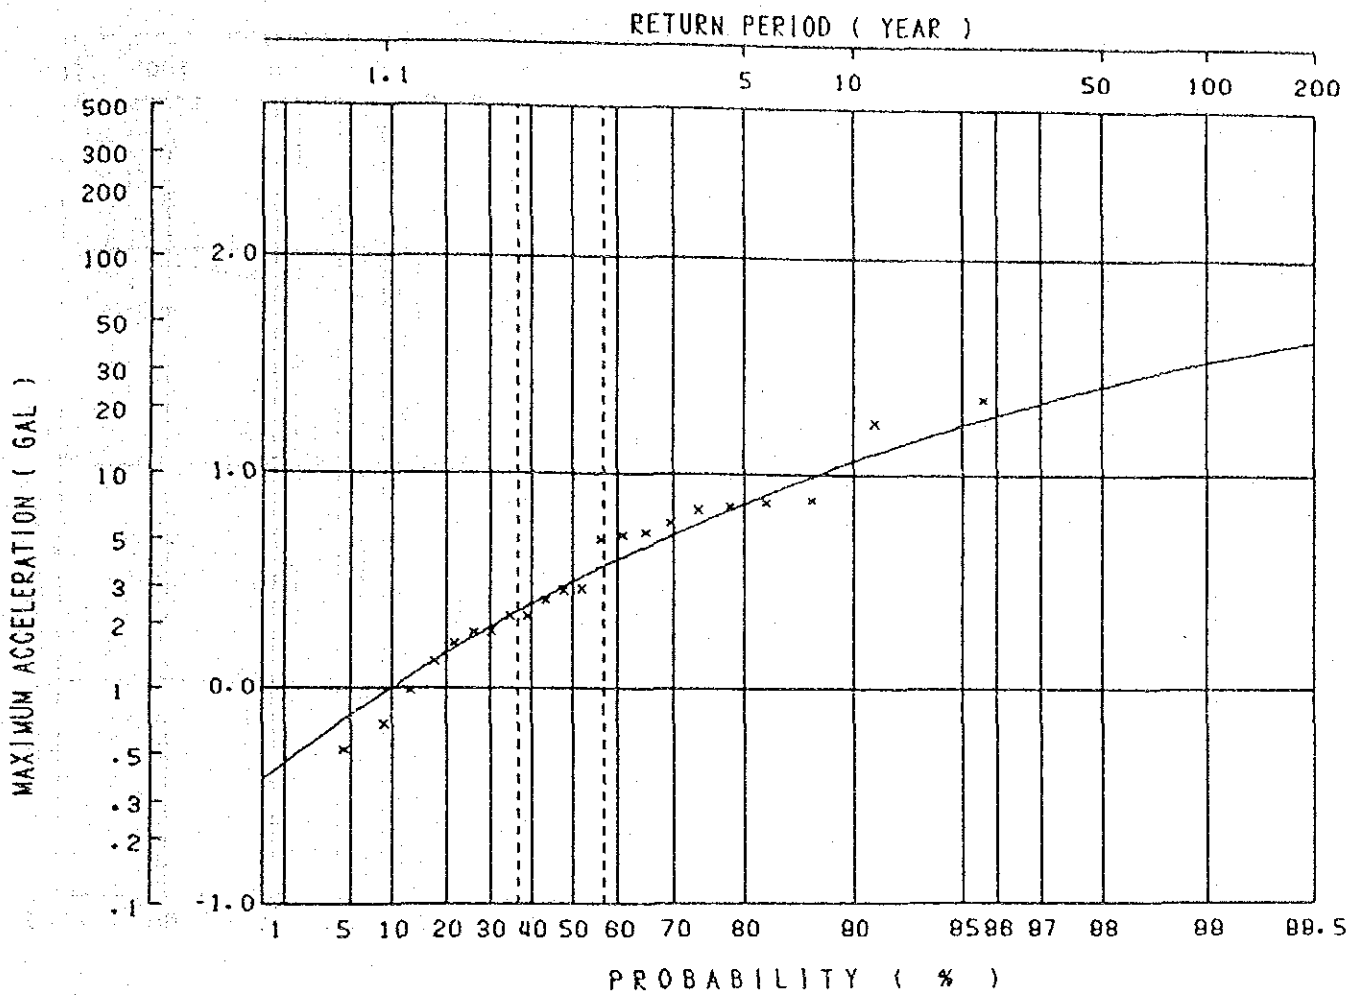


Return Period for Maximum Accelerations calculated by Eq.(1)

Fig. 13

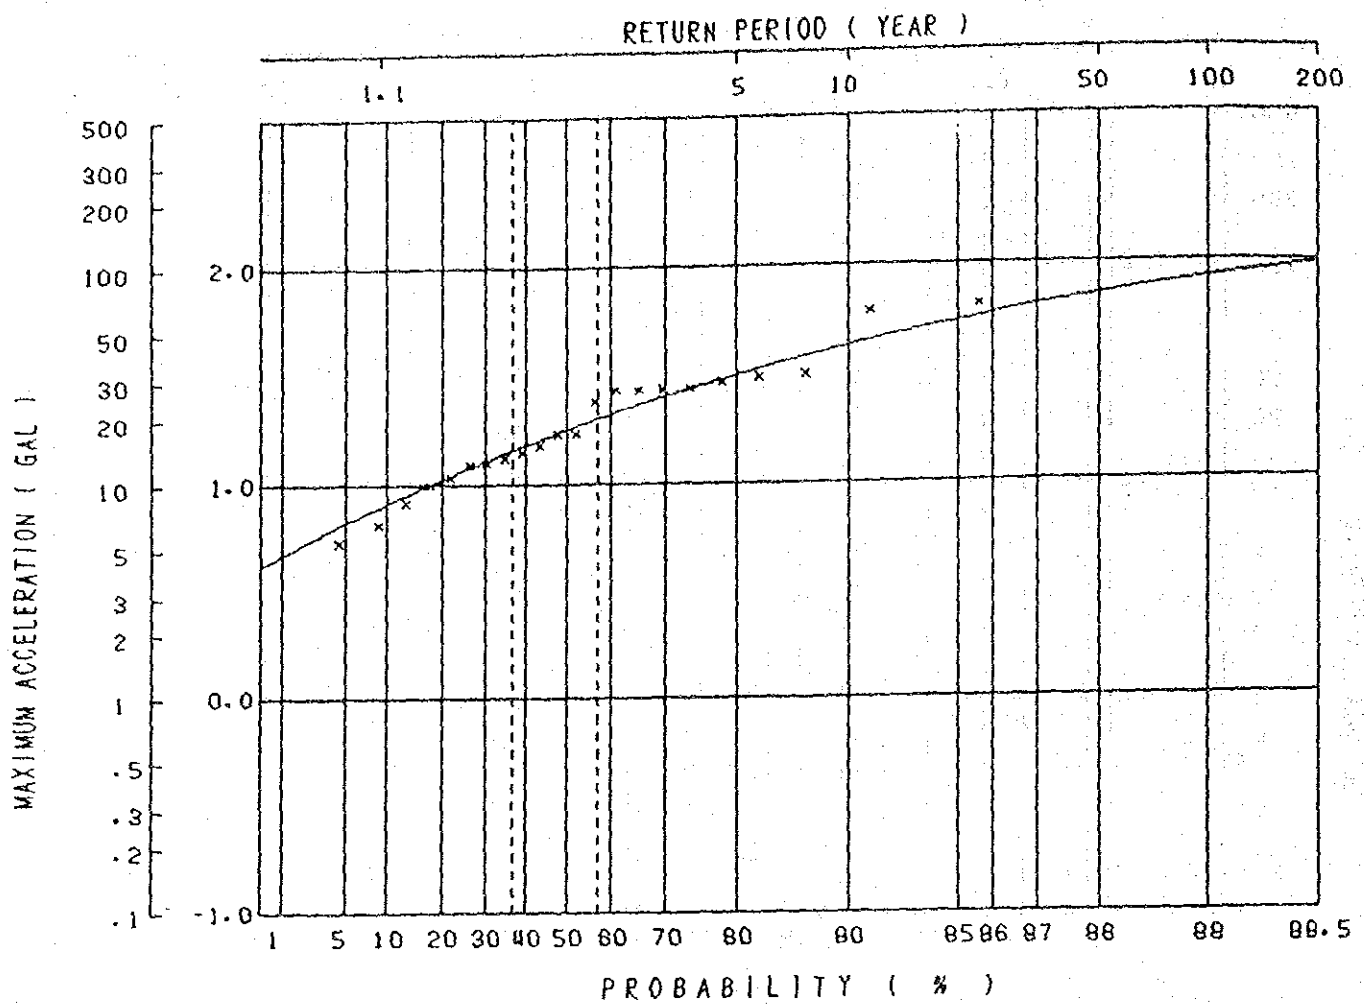


Return Period for Maximum Accelerations calculated by Eq.(2)

Fig. 14

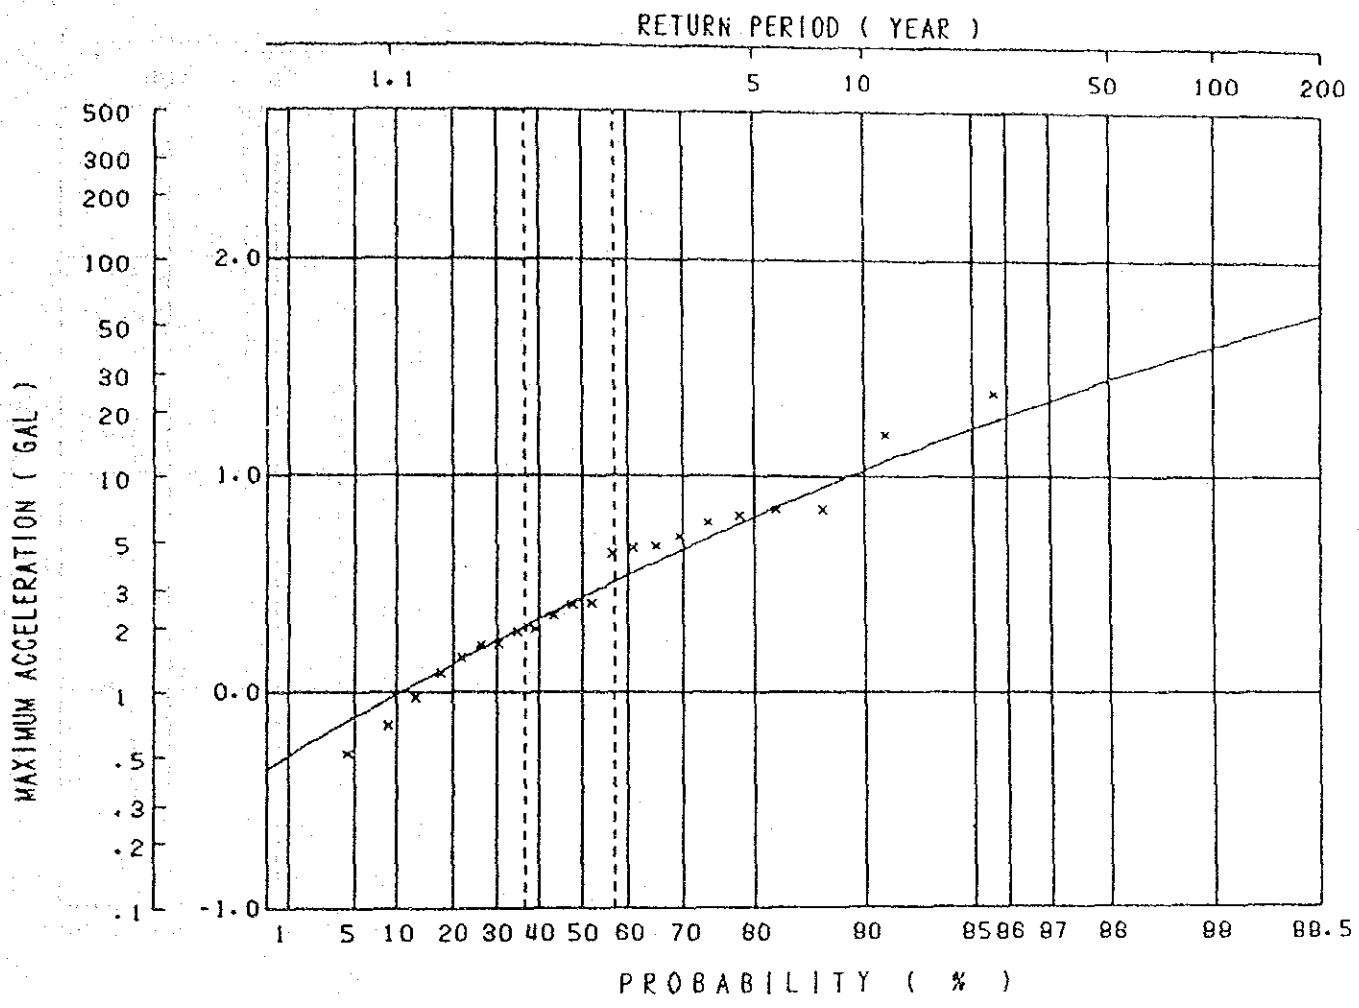


Return Period for Maximum Accelerations calculated by Eq.(3)

Fig. 15

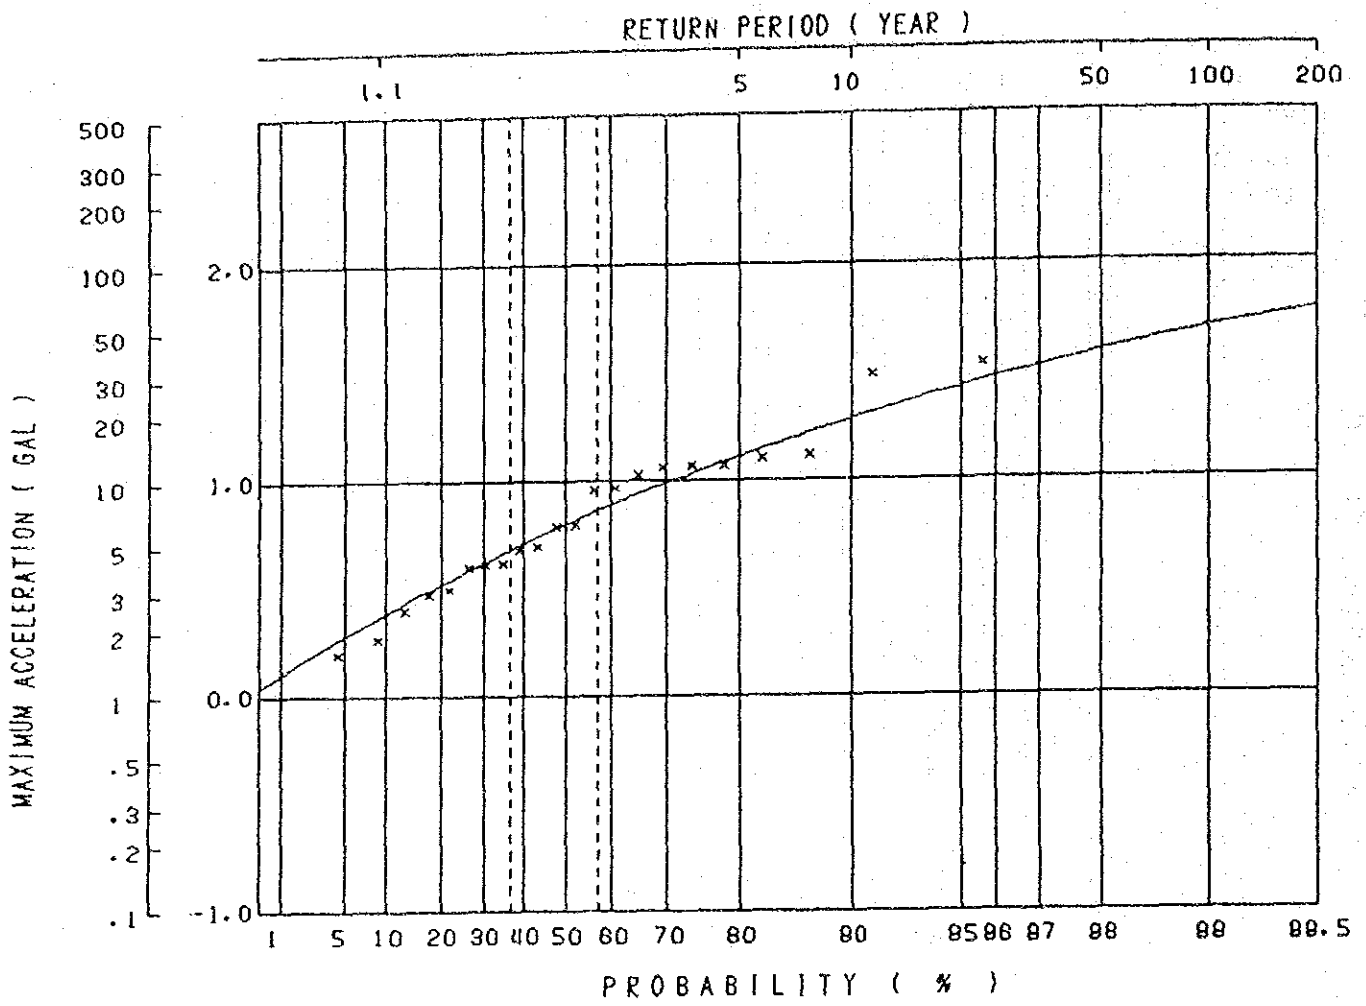

Return Period for Maximum Accelerations calculated by Eq.(4)

Fig. 16

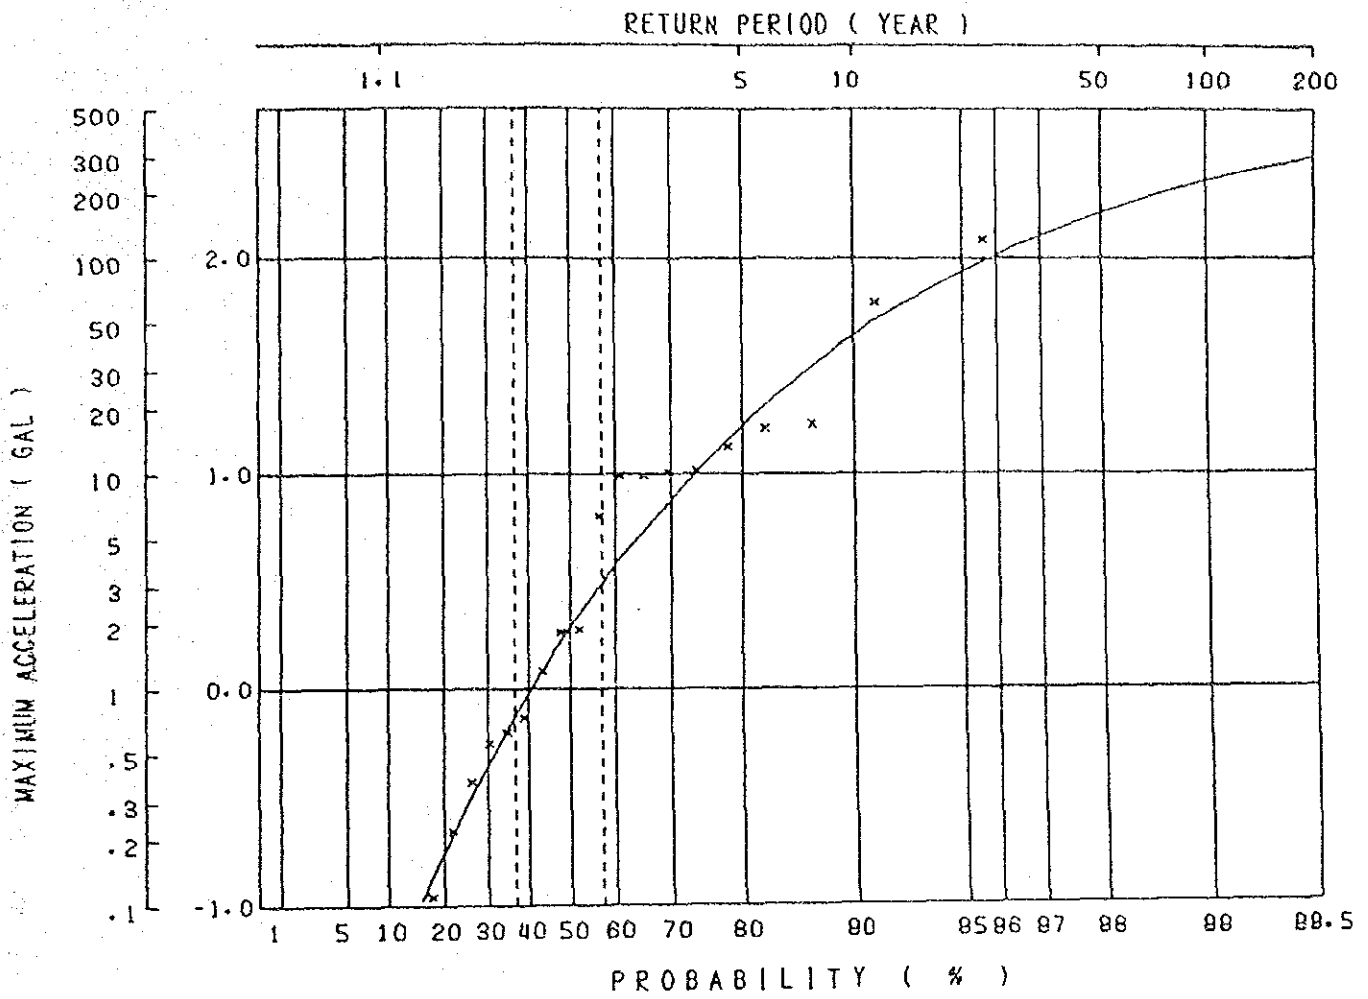

Return Period for Maximum Accelerations calculated by Eq.(5)

Fig. 17

JICA