

Factor No.	No. of Sample	Mean Value	Inverted Value	Anomaly		
				Probable	Possible	Highly
1st Factor	5192	0	1.5	1.0~14	15~19	20~

Concerned Element : Mn, Co, Zn.

Factor No.	No. of Sample	Mean Value	Inverted Value	Anomaly		
				Probable	Possible	Highly
2nd Factor	5192	0	1.5	1.0~14	15~19	20~


Concerned Element : Hg, Pb, As


Factor No.	No. of Sample	Mean Value	Standard Deviation	Anomaly		
				Possible	Probably	Highly
2nd Factor	5,192	0	1.5	1.0~1.4	1.5~1.9	2.0~

Concerned Element : Hg, Pb, As

Factor No.	No. of Sample	Mean Value	Standard Deviation	Anomaly		
				Possible	Probably	Highly
3rd Factor	5,192	0	1.5	1.0~1.4	1.5~1.9	2.0~

Concerned Element : Mo, As

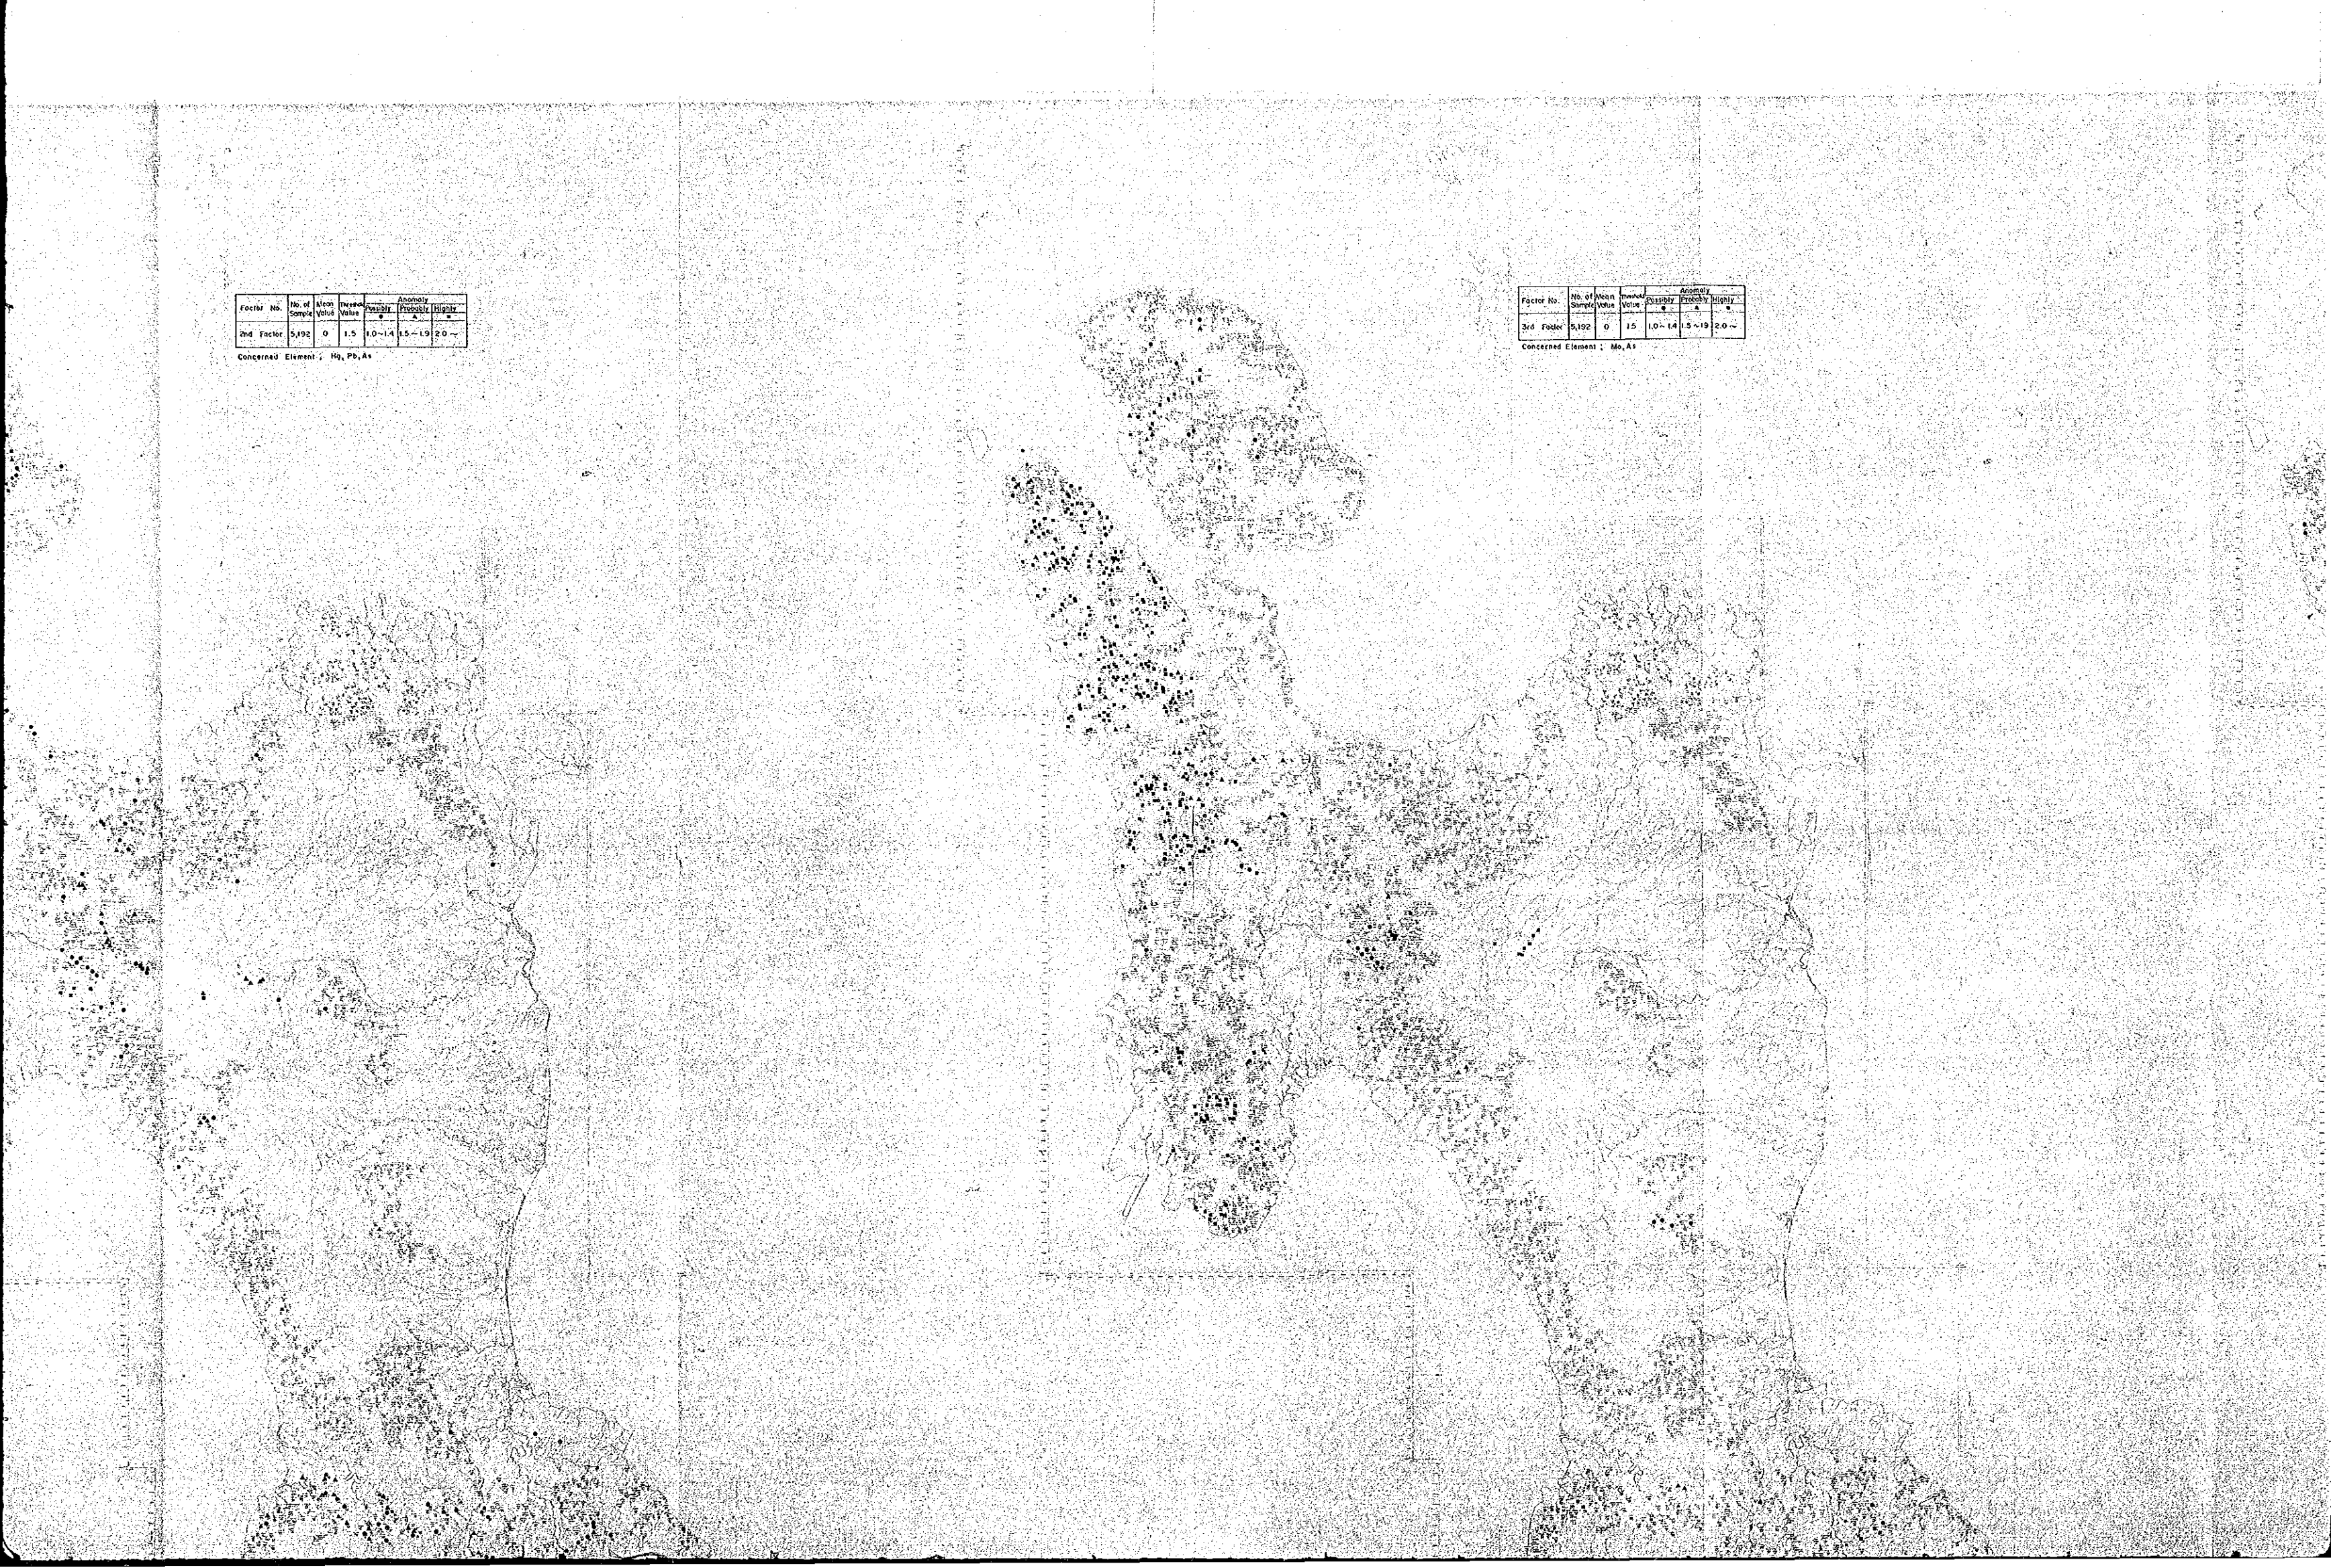

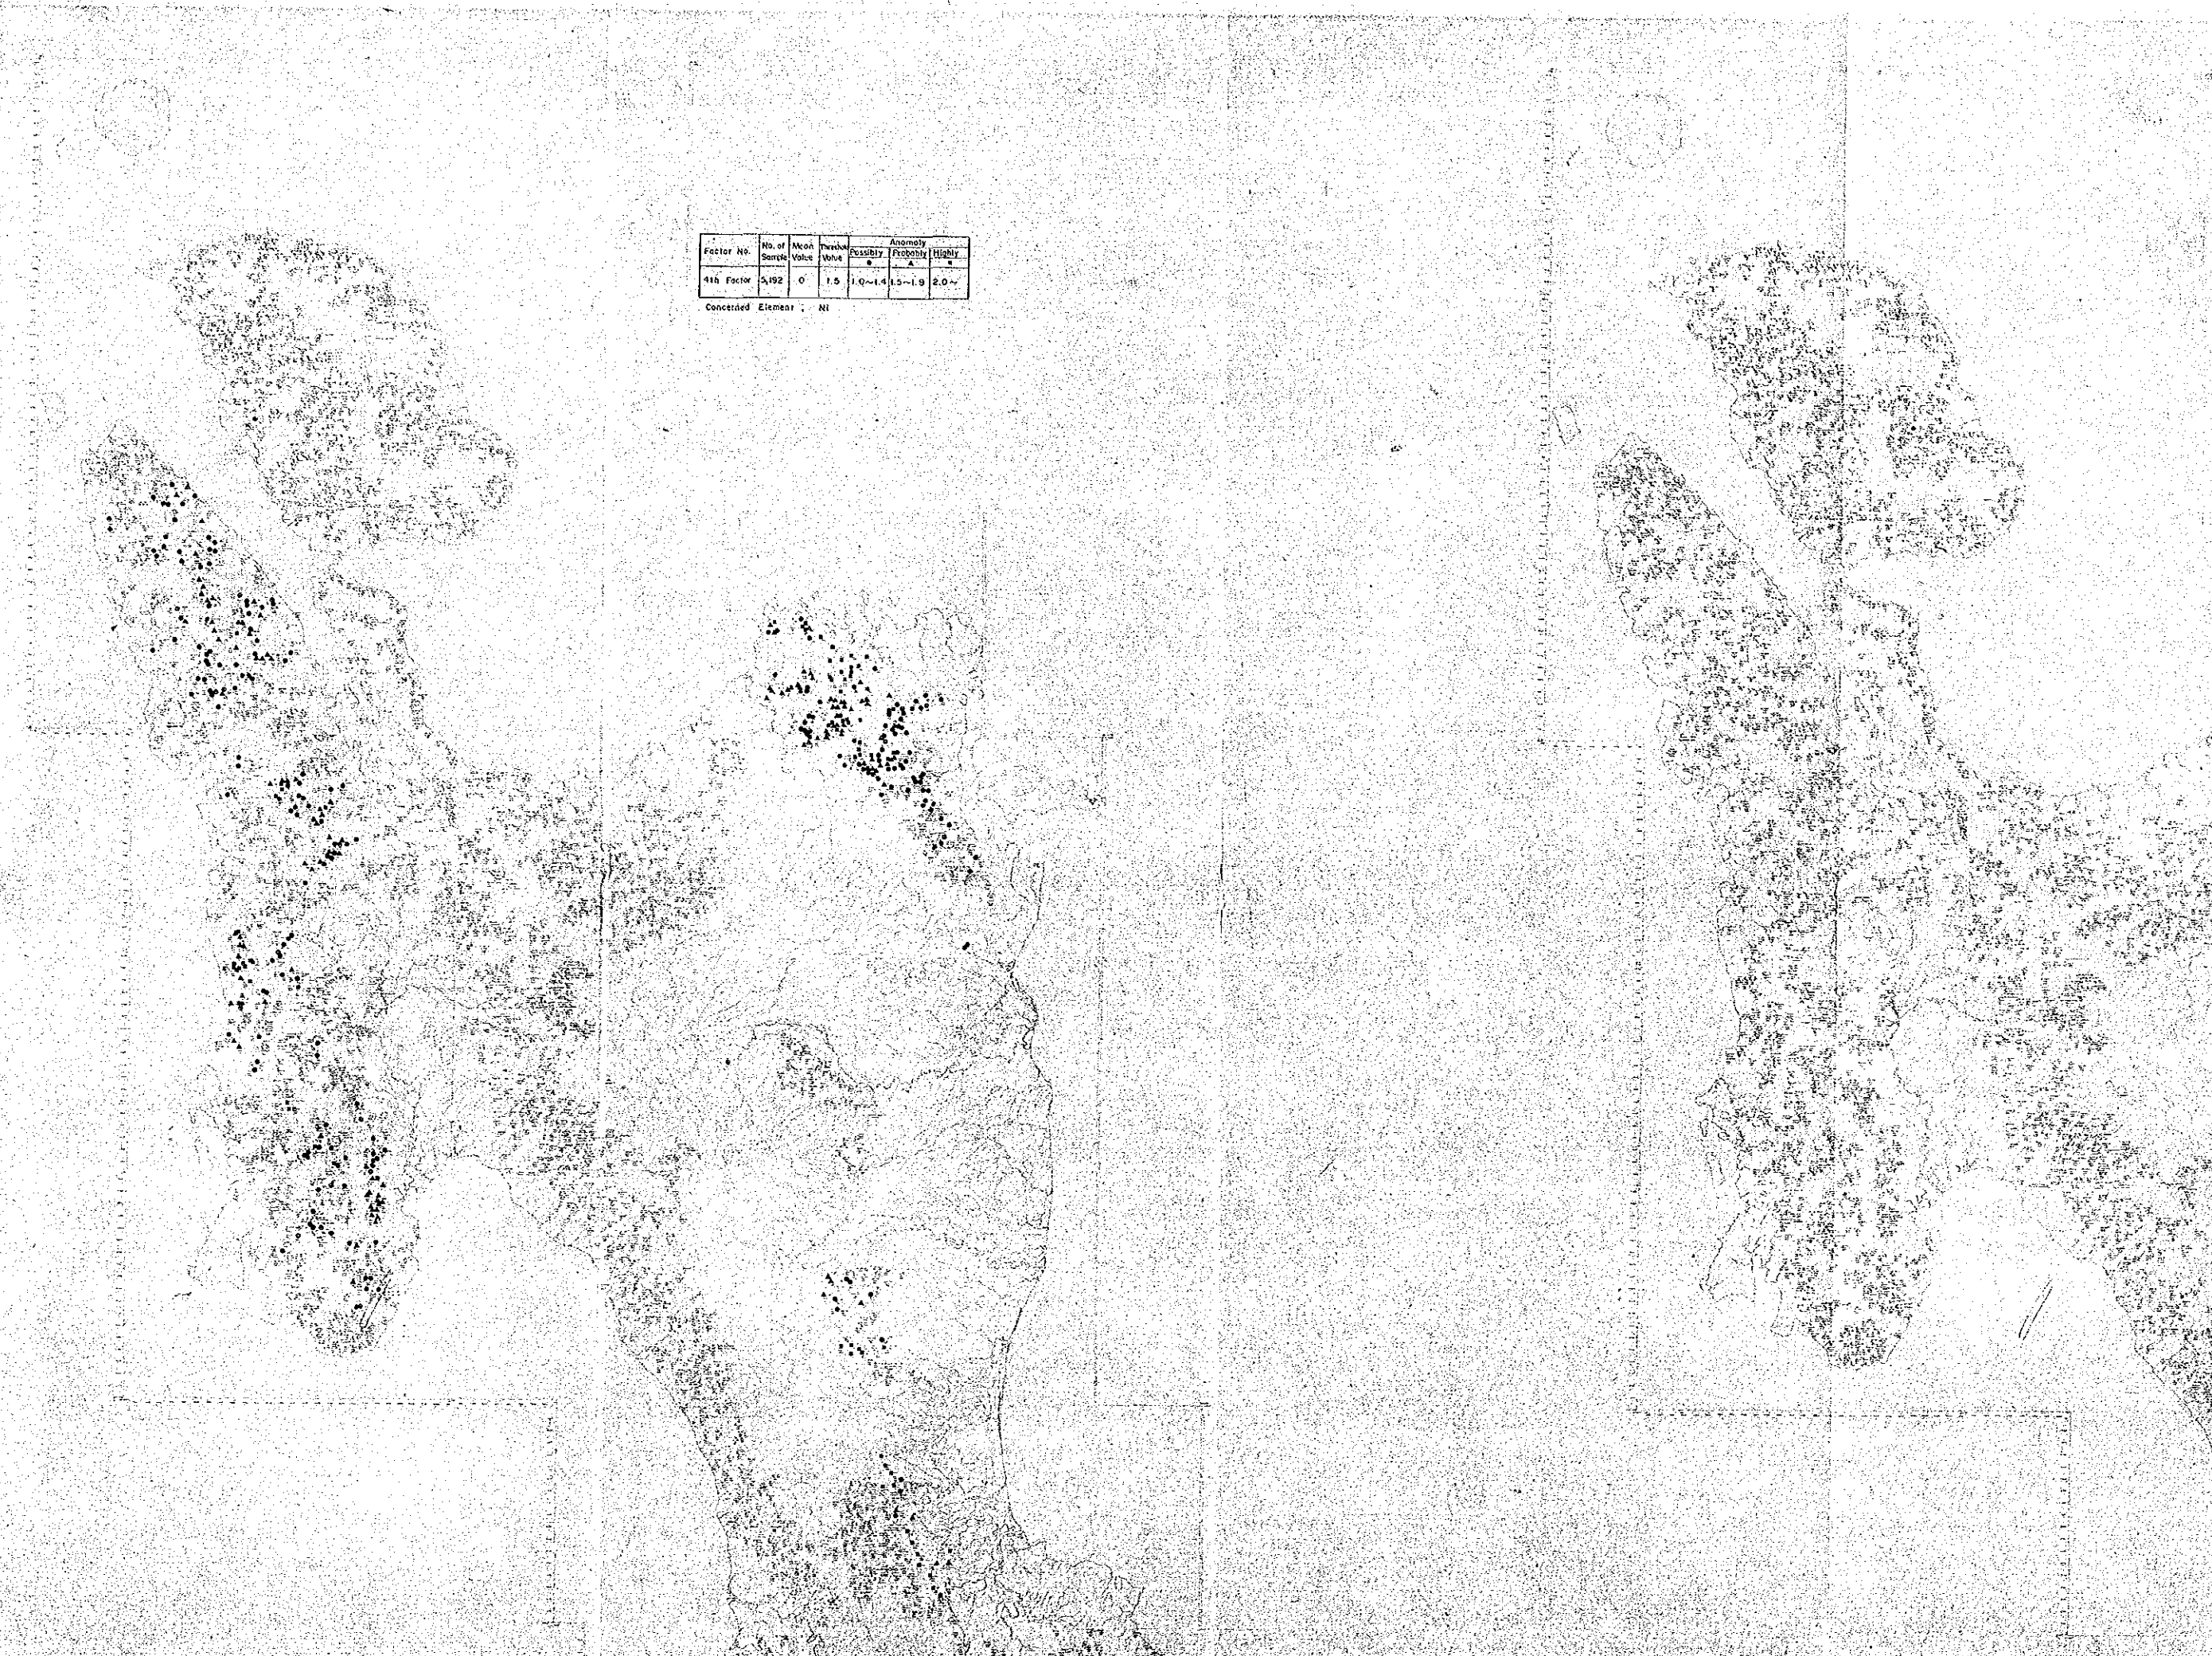

Factor No.	No. of Sample	Mean Value	Deviation Value	Anomaly		
				Possibility %	Probability %	Highly %
4th Factor	5,192	0	1.5	1.0~1.4	1.5~1.9	2.0~

Concerned Element : Ni

Factor No.	No. of Sample	Mean Value	Anomaly		
			Possibility %	Probability %	Highly %
5th Factor	5,192	0			

Concerned Element : Ag, C