

APPENDIX 8.2.1.B PROJECT COST WITH FOREIGN AND LOCAL CURRENCY  
 BREAKDOWN (1986 Price Level, Angeles City)

SUMMARY

Phase I, Stage 1

	(Unit: thousand ₱)		
	<u>F.E.C</u>	<u>Local</u>	<u>Total</u>
Direct Construction Cost	23,052	18,292	41,344
Physical Cont. (8% of D.C.C.)	1,844	1,464	3,308
Sub Total	24,896	19,756	44,652
Leakage Detection	-	990	990
Detailed Design (10% of S.T. in Stage 1 & Stage 2)	4,397	4,397	8,794
Construction Supervision (4% of S.T.)	893	893	1,786
Total	30,186	26,036	56,222

Phase I, Stage 2

	(Unit: thousand ₱)		
	<u>F.E.C</u>	<u>Local</u>	<u>Total</u>
Direct Construction Cost	25,221	14,858	40,079
Physical Cont. (8% of D.C.C.)	2,018	1,188	3,206
Sub Total	27,239	16,046	43,285
Construction Supervision (4% of S.T.)	228	1,503	1,731
Total	27,467	17,549	45,016

Phase II

	(Unit: thousand ₱)		
	<u>F.E.C</u>	<u>Local</u>	<u>Total</u>
Direct Construction Cost	71,592	45,496	117,088
Physical Cont. (8% of D.C.C.)	5,727	3,640	9,367
Sub Total	77,319	49,136	126,455
Detailed Design (10% of S.T.)	6,323	6,323	12,646
Construction Supervision (4% of S.T.)	-	5,058	5,058
Total	83,642	60,517	144,159

The following tables show the breakdown of the project cost in each design year. The unit of all figures is thousand pesos. Project cost is further broken down into the Foreign Exchange Component and the Local Currency Component. Abbreviations in the tables are as follows:

COST	---	Construction Cost
C.FEC	---	Cost for Civil Work in the Foreign Exchange Component
C.DOM	---	Cost for Civil Work in the Local Currency Component
C.D.UNSKL	---	Cost for Unskilled Laborer of Civil Works in the Local Currency Component.
E.FEC	---	Cost for Equipments in the Foreign Exchange Component
E.DOM	---	Cost for Equipments in the Local Currency Component

$$\text{COST} = \text{C.FEC} + \text{C.DOM} + \text{E.FEC} + \text{E.DOM}$$

The exchange rates used in the cost estimates are as follows:

$$\text{₱20} = \$1$$

$$\$1 = \text{₱155}$$

No.	ANGELES ITEM	1988				1989				1990				
		CUST	C-FEC	C-DOM	C-D-UNSKD	E-FEC	E-DOM	E-FEC	E-DOM	CUST	C-FEC	C-DOM	C-D-UNSKD	E-FEC
1.0	SOURCE FACILITY													
	(1) DEEP WELL	0.0	0.0	0.0	0.0	0.0	0.0	422.4	47.0	188.0	0.0	0.0	0.0	0.0
	(2) PUMPING FACILITY	0.0	0.0	0.0	0.0	0.0	0.0	448.0	64.0	601.6	0.0	0.0	0.0	0.0
	1) Pumping Station	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	124.0	0.0	0.0	0.0	0.0
	2) Flow Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	310.0	0.0	0.0	0.0	0.0
	(3) PUMP REPLACEMENT	0.0	0.0	0.0	0.0	0.0	0.0	880.4	111.0	913.6	0.0	0.0	0.0	0.0
	SUB-TOTAL	0.0	0.0	0.0	0.0	0.0	0.0	2344.0	275.0	275.0	0.0	0.0	0.0	0.0
2.0	TRANSMISSION FACILITIES													
	(1) Line Lines	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	SUB-TOTAL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3.0	DISTRIBUTION FACILITIES													
	(1) Reservoir	0.0	0.0	0.0	0.0	0.0	0.0	2731.3	294.1	210.1	168.1	0.0	0.0	0.0
	(2) Pump Facility (Equip)	0.0	0.0	0.0	0.0	0.0	0.0	651.0	0.0	540.3	110.7	0.0	539.5	110.5
	Pump Facility (Civil)	0.0	0.0	0.0	0.0	0.0	0.0	2228.0	401.0	0.0	0.0	0.0	0.0	0.0
	(3) Chlorination Facility	0.0	0.0	0.0	0.0	0.0	0.0	196.0	9.8	30.2	29.4	0.0	223.8	73.7
	(4) Electric Sub-station	0.0	0.0	0.0	0.0	0.0	0.0	2757.0	55.1	1417.5	275.7	0.0	0.0	0.0
	(5) Distribution pipes	0.0	0.0	0.0	0.0	0.0	0.0	7127.0	1995.6	2209.3	1839.2	0.0	1114.2	826.6
	1) Main Pipes	0.0	0.0	0.0	0.0	0.0	0.0	2188.0	42.8	1433.8	192.4	0.0	531.1	70.3
	2) Valves	0.0	0.0	0.0	0.0	0.0	0.0	1389.0	209.4	445.1	288.0	0.0	445.1	288.0
	3) Internal Network	0.0	0.0	0.0	0.0	0.0	0.0	1609.0	16.1	1367.6	64.4	0.0	1367.6	64.4
	4) Service Connections	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	5) Water Meter	1151.0	5.8	59.8	13.8	143.7	20.7	230.0	5.8	143.7	20.7	5.8	143.7	20.7
	6) Srvc Concn Rbltn w/H	230.0	1.8	18.4	5.5	156.4	7.4	183.0	5.5	155.6	7.3	18.3	155.6	7.3
	7) Srvc Concn Rbltn w/H	184.0	0.0	0.0	0.0	0.0	0.0	429.0	68.6	145.9	94.4	428.0	152.8	98.4
	8) Lateral Rehabilitation	0.0	0.0	0.0	0.0	0.0	0.0	215.0	0.0	215.0	0.0	0.0	0.0	0.0
	9) Flow Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(10) Fire Protection	0.0	0.0	0.0	0.0	0.0	0.0	22274.0	3290.7	8424.1	2890.3	0.0	4658.4	1559.9
	SUB-TOTAL	1565.0	7.6	78.2	19.3	143.1	28.1	22274.0	1306.7	2209.3	1839.2	0.0	6458.4	1559.9
4.0	ADMINISTRATION BIDS													
	1) Administration Bids	0.0	0.0	0.0	0.0	0.0	0.0	1590.0	143.1	572.4	222.6	0.0	0.0	0.0
	2) Operation Center	0.0	0.0	0.0	0.0	0.0	0.0	1590.0	79.5	572.4	222.6	0.0	0.0	0.0
	SUB-TOTAL	0.0	0.0	0.0	0.0	0.0	0.0	27208.0	143.1	572.4	222.6	0.0	0.0	0.0
	TOTAL	1565.0	7.6	78.2	19.3	143.1	28.1	27208.0	143.1	572.4	222.6	0.0	0.0	0.0
5.0	LAND ACQUISITION													
	Vehicle	348.0	0.0	348.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	Stored Material & Equip.	600.0	0.0	600.0	0.0	0.0	0.0	216.0	0.0	206.6	39.4	0.0	136.1	25.9
	SUB-TOTAL	948.0	0.0	948.0	0.0	0.0	0.0	216.0	0.0	206.6	39.4	0.0	136.1	25.9
6.0	REPLACEMENT OF EQUIPMENT													
	1) Deep Well Pump	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	2) Booster Pump	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	3) Flow Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	4) Chlorinator	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	5) Water Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	6) Operation Center	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	7) Vehicle	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	8) Stored Material & Equip.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	SUB-TOTAL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	Leakage Detection	330.0	7.6	756.2	19.3	1776.3	332.9	330.0	1497.2	10116.7	3427.3	0.0	6445.5	1841.8
	SUB-TOTAL	330.0	7.6	756.2	19.3	1776.3	332.9	330.0	1497.2	10116.7	3427.3	0.0	6445.5	1841.8
	GRAND TOTAL	2873.0	15.2	1504.2	38.6	1953.1	332.9	27784.0	3708.8	3708.8	3708.8	0.0	11677.0	3329.5

No.	ANGELES ITEM	1988				1989				1990					
		CUST	C-FEC	C-DOM	C-D-UNSKD	E-FEC	E-DOM	E-FEC	E-DOM	CUST	C-FEC	C-DOM	C-D-UNSKD	E-FEC	E-DOM
1	Deep Well Facilities	0.0	0.0	0.0	0.0	0.0	0.0	860.4	111.0	913.6	275.0	0.0	0.0	0.0	0.0
2	Transmission Facilities	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	Purification Plant	0.0	0.0	0.0	0.0	0.0	0.0	2731.3	294.1	210.1	168.1	0.0	0.0	0.0	0.0
4	Reservoir	0.0	0.0	0.0	0.0	0.0	0.0	66.6	5.9	30.2	29.4	0.0	0.0	0.0	0.0
5	Disinfection Facilities	0.0	0.0	0.0	0.0	0.0	0.0	606.5	55.1	1417.5	275.7	0.0	0.0	0.0	0.0
6	Electric Sub-station	0.0	0.0	0.0	0.0	0.0	0.0	5025.5	884.0	5009.4	2324.7	0.0	0.0	0.0	0.0
7	Distribution Facilities	1565.0	7.6	78.2	19.3	1451.1	28.1	2022.0	67.6	1665.9	92.4	2022.0	67.6	1665.9	92.4
8	Service Connection	0.0	0.0	0.0	0.0	0.0	0.0	143.1	79.5	572.4	222.6	0.0	0.0	0.0	0.0
9	Admin. Bldg. & Ops. Ctr.	348.0	0.0	348.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10	Land Acquisition	630.0	0.0	630.0	0.0	0.0	0.0	246.0	0.0	206.6	39.4	0.0	136.1	25.9	
11	Replacement of Equip.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12	Leakage Detection	330.0	7.6	756.2	19.3	1776.3	332.9	330.0	1497.2	10116.7	3427.3	0.0	6445.5	1841.8	
13	Leakage Detection	330.0	7.6	756.2	19.3	1776.3	332.9	330.0	1497.2	10116.7	3427.3	0.0	6445.5	1841.8	
	TOTAL	2873.0	15.2	1504.2	38.6	1953.1	332.9	27784.0	3708.8	3708.8	3708.8	0.0	11677.0	3329.5	

No.	Item	Phase I (Stage I)				1991				1992					
		COST	C-FEC	C-DUM	C-D-UNSKU	E-FEC	E-DUM	E-FEC	E-DUM	COST	C-FEC	C-DUM	C-D-UNSKU	E-FEC	E-DUM
1.0	SOURCE FACILITY	940.0	159.8	432.4	47.0	188.0	159.8	864.8	94.0	376.0	319.6	432.4	47.0	188.0	159.8
	(1) DEEP WELL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(2) PUMPING FACILITY	1280.0	115.2	448.0	64.0	601.6	115.2	448.0	64.0	601.6	115.2	448.0	64.0	300.8	57.6
	1) Pumping Station	434.0	0.0	0.0	0.0	434.0	0.0	0.0	0.0	124.0	0.0	0.0	0.0	62.0	0.0
	2) Flow Meter	1600.0	0.0	0.0	0.0	1344.0	256.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(3) PUMP REPLACEMENT	4254.0	278.0	880.4	111.0	2567.6	531.0	3284.0	434.8	1312.8	434.8	656.4	79.0	550.8	217.4
	SUB-TOTAL	0.0	0.0	0.0	0.0	0.0	0.0	935.0	168.3	261.8	215.1	72.8	10.4	80.6	59.8
2.0	TRANSMISSION FACILITIES	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(1) Pipelines	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	SUB-TOTAL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3.0	DISTRIBUTION FACILITIES	4202.0	1092.5	2731.3	284.1	210.1	168.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(1) Reservoir	1301.0	0.0	0.0	0.0	1079.8	221.2	753.0	0.0	0.0	0.0	0.0	0.0	625.0	128.0
	(2) Pump Facility (EQUIP)	2228.0	238.7	2094.3	40.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(3) Chlorination Facility	987.0	34.4	233.5	20.6	316.0	103.1	98.0	4.9	33.3	45.1	4.7	0.0	0.0	0.0
	(4) Electric Sub-station	2157.0	427.3	606.5	55.1	1447.5	215.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(5) Distribution pipes	10721.0	1929.8	3001.9	428.9	3223.5	2065.8	1249.0	224.8	349.7	287.3	0.0	0.0	0.0	0.0
	1) Main Pipes	2819.0	58.4	613.0	175.2	1884.9	262.7	777.0	2.3	24.6	10.5	0.0	0.0	0.0	0.0
	2) Valves	2618.0	418.8	733.0	104.8	890.2	1958.0	313.3	548.2	78.3	430.8	541.0	77.3	656.9	425.0
	3) Internal Network	3218.0	32.2	321.8	96.6	2735.2	128.8	2336.0	23.4	233.6	93.4	233.6	70.1	1985.6	93.4
	4) Service Connections	1151.0	0.0	0.0	0.0	1151.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	5) Water Meter	690.0	17.4	179.4	41.4	431.1	62.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	6) Svc Cnctn Rhlblt w/H	550.0	5.4	55.0	16.5	467.6	22.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	7) Svc Cnctn Rhlblt w/H	857.0	145.6	239.9	34.3	278.7	192.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	8) Lateral Rehabilitation	215.0	0.0	0.0	0.0	215.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	9) Flow Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	10) Fire Protection	3411.4	428.5	2609.9	1668.5	14530.6	4478.2	551.0	508.7	1189.4	964.1	774.6	117.4	3267.5	616.4
	SUB-TOTAL	1590.0	143.1	651.9	79.5	572.4	222.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(1) Administration Bldg	1590.0	143.1	651.9	79.5	572.4	222.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(2) Operation Center	30958.0	4713.6	12311.9	1859.0	11670.6	5231.9	10730.0	1171.8	2164.0	1614.6	1503.8	236.8	3898.9	923.6
	SUB-TOTAL	348.0	0.0	348.0	0.0	348.0	0.0	240.0	0.0	240.0	150.0	0.0	0.0	150.0	0.0
	Land Acquisition	690.0	0.0	0.0	0.0	300.0	300.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	Vehicle	438.0	0.0	0.0	0.0	367.9	70.1	136.0	0.0	114.2	21.8	81.5	0.0	15.5	0.0
	Stored Material & Equip.	1386.0	0.0	348.0	0.0	667.9	370.1	676.0	0.0	264.2	171.8	397.0	0.0	231.5	165.5
5.0	Replacement of Equipment	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(1) Deep Well Pump	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(2) Booster Pump	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(3) Flow Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(4) Chlorinator	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(5) Water Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(6) Operation Center	20853.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(7) Vehicle	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(8) Stored Material & Equip.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	SUB-TOTAL	990.0	0.0	990.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	Leakage Detection	42334.0	4713.6	13679.9	1859.0	16338.5	5602.0	11406.0	1171.8	3004.0	1786.4	1503.8	236.8	4130.4	1089.1
	GRAND TOTAL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

No.	Item	Phase I (Stage I)				1991				1992					
		COST	C-FEC	C-DUM	C-D-UNSKU	E-FEC	E-DUM	E-FEC	E-DUM	COST	C-FEC	C-DUM	C-D-UNSKU	E-FEC	E-DUM
1	Deep Well Facilities	4254.0	275.0	880.4	111.0	2567.6	531.0	3284.0	434.8	1312.8	434.8	656.4	79.0	550.8	217.4
2	Transmission Facilities	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3	Purification Plant	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
4	Reservoir	4202.0	1092.5	2731.3	284.1	210.1	168.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	Disinfection Facilities	687.0	34.4	606.5	55.1	1447.5	215.7	98.0	4.9	33.3	45.1	4.7	0.0	0.0	0.0
6	Electric Sub-station	2157.0	427.3	606.5	55.1	1447.5	215.7	4077.0	540.4	922.5	866.6	541.0	77.3	1261.9	553.0
7	Distribution Facilities	20853.0	2686.3	6082.1	1144.2	7772.1	3718.5	1077.0	1171.8	233.6	93.4	233.6	70.1	1985.6	93.4
8	Service Connection	5609.0	55.0	556.2	154.5	4784.9	212.9	2336.0	23.4	233.6	93.4	233.6	70.1	1985.6	93.4
9	Admin. Bldg. & Oper. Ctr.	1590.0	143.1	651.9	79.5	572.4	222.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10	Land Acquisition	348.0	0.0	348.0	0.0	348.0	0.0	240.0	0.0	240.0	150.0	0.0	0.0	150.0	0.0
11	Vehicle & Stored Material	1038.0	0.0	0.0	0.0	667.9	370.1	436.0	0.0	264.2	171.8	397.0	0.0	231.5	165.5
12	Replacement of Equip.	4134.0	4713.6	13679.9	1859.0	16338.5	5602.0	11406.0	1171.8	3004.0	1786.4	1503.8	236.8	4130.4	1089.1
	SUB-TOTAL	990.0	0.0	990.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13	Leakage Detection	42334.0	4713.6	13679.9	1859.0	16338.5	5602.0	11406.0	1171.8	3004.0	1786.4	1503.8	236.8	4130.4	1089.1
	TOTAL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

No.	ITEM	1993				1994				1995					
		COST	C.FEC	C.DUR	C.D. UNSKI	E.FEC	E.DUR	C.DUR	C.D. UNSKI	E.FEC	E.DUR	C.DUR	C.D. UNSKI	E.FEC	E.DUR
1.0	SOURCE FACILITY														
	(1) DEEP WELL	940.0	159.8	432.4	47.0	188.0	159.8	432.4	47.0	188.0	159.8	432.4	47.0	188.0	
	(2) PUMPING FACILITY														
	1) Pumping Station	640.0	57.6	224.0	32.0	300.8	57.6	224.0	32.0	300.8	57.6	224.0	32.0	300.8	
	2) Flow Meter	62.0	0.0	0.0	0.0	62.0	0.0	0.0	0.0	62.0	0.0	0.0	0.0	62.0	
	(3) PUMP REPLACEMENT														
	SUB-TOTAL	1642.0	217.4	656.4	79.0	550.8	217.4	656.4	79.0	550.8	217.4	656.4	79.0	550.8	
2.0	TRANSMISSION FACILITIES														
	(1) Inlet Pipes	260.0	46.8	72.8	10.4	80.6	59.8	72.8	10.4	80.6	59.8	72.8	10.4	80.6	
	SUB-TOTAL	260.0	46.8	72.8	10.4	80.6	59.8	72.8	10.4	80.6	59.8	72.8	10.4	80.6	
3.0	DISTRIBUTION FACILITIES														
	(1) Reservoir	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(2) Pump Facility (Equip)	733.0	0.0	0.0	0.0	625.0	128.0	733.0	0.0	625.0	128.0	733.0	0.0	625.0	
	(3) Chlorination Facility	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(4) Electric Sub-station	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(5) Distribution pipes	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(6) Main Pipes	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(7) Valves	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(8) Internal Network	1932.0	308.1	541.0	77.3	656.9	425.0	1911.0	76.4	649.7	420.4	1911.0	76.4	649.7	
	(9) Service Connections	2336.0	23.4	233.6	70.1	1985.6	83.4	2336.0	70.1	1985.6	23.4	233.6	70.1	1985.6	
	(5) Water Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(6) Srvc Cnctn Rhlftn w/H	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(7) Srvc Cnctn Rhlftn w/H	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(8) Lateral Rehabilitation	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(9) Flow Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(10) Fire Protection	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	SUB-TOTAL	5021.0	332.5	773.6	147.4	3267.5	646.4	5000.0	146.5	3260.3	641.8	5000.0	146.5	3260.3	
4.0	ADMINISTRATION BLDG	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
5.0	OPERATION CENTER	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	SUB-TOTAL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	TOTAL	6923.0	596.7	1503.8	236.8	3808.9	923.6	6902.0	235.9	3897.7	919.0	6923.0	235.9	3897.7	
6.0	LAND ACQUISITION	300.0	0.0	0.0	0.0	150.0	150.0	300.0	0.0	150.0	150.0	300.0	0.0	150.0	
	Vehicle	97.6	0.0	0.0	0.0	97.6	0.0	97.6	0.0	97.6	0.0	97.6	0.0	97.6	
	Stored Material & Equip.	397.0	0.0	0.0	0.0	231.5	165.5	396.0	0.0	230.6	165.4	396.0	0.0	230.6	
	SUB-TOTAL	794.6	0.0	0.0	0.0	479.1	165.5	793.6	0.0	478.2	165.4	793.6	0.0	478.2	
7.0	REPLACEMENT OF EQUIPMENT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(1) Deep Well Pump	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(2) Booster Pump	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(3) Flow Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(4) Chlorinator	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(5) Water Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(6) Operation Center	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(7) Vehicle	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	(8) Stored Material & Equip.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	SUB-TOTAL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	GRAND TOTAL	7320.0	596.7	1503.8	236.8	4130.4	1089.1	7298.0	235.9	4122.3	1089.4	7320.0	235.9	4122.3	

No.	ITEM	1993				1994				1995				
		COST	C.FEC	C.DUR	C.D. UNSKI	E.FEC	E.DUR	C.DUR	C.D. UNSKI	E.FEC	E.DUR	C.DUR	C.D. UNSKI	E.FEC
1	Deep Well Facilities	1642.0	217.4	656.4	79.0	550.8	217.4	656.4	79.0	550.8	217.4	656.4	79.0	550.8
2	Transmission Facilities	260.0	46.8	72.8	10.4	80.6	59.8	72.8	10.4	80.6	59.8	72.8	10.4	80.6
3	Purification Plant	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
4	Reservoir	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	Disinfection Facilities	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
6	Electric Sub-station	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
7	Distribution Facilities	2685.0	309.1	541.0	77.3	1281.9	553.0	2684.0	76.4	1274.7	548.4	2684.0	76.4	1274.7
8	Service Connection	2336.0	23.4	233.6	70.1	1985.6	83.4	2336.0	70.1	1985.6	23.4	233.6	70.1	1985.6
9	Admin. Bldg. & Ops. Ctr.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10	Land Acquisition	397.0	0.0	0.0	0.0	231.5	165.5	396.0	0.0	230.6	165.4	396.0	0.0	230.6
11	Vehicle & Stored Material	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12	Replacement of Equip.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	SUB-TOTAL	7320.0	596.7	1503.8	236.8	4130.4	1089.1	7298.0	235.9	4122.3	1089.4	7320.0	235.9	4122.3
13	Leakage Detection	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	TOTAL	7320.0	596.7	1503.8	236.8	4130.4	1089.1	7298.0	235.9	4122.3	1089.4	7320.0	235.9	4122.3

No.	ITEM	Phase I (Stage 2)			Phase I Total			Phase II			E. DOM	E. DOM	
		C. DOM	C. D. UNSKI	E. FEC	C. DOM	C. D. UNSKI	E. FEC	C. DOM	C. D. UNSKI	E. FEC			
1.0	SOURCE FACILITY												
	(1) DEEP WELL	5640.0	958.8	2594.4	1118.6	3026.8	329.0	1316.0	1118.6	9400.0	4324.0	1598.0	1598.0
	(2) PUMPING FACILITY	3840.0	345.6	1344.0	460.8	1792.0	256.0	2406.4	460.8	6400.0	2240.0	3008.0	3008.0
	1) Pumping Station	372.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	620.0	0.0	0.0	0.0
	2) Flow Meter	372.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(3) PUMP REPLACEMENT	9852.0	1304.4	3938.4	1579.4	4818.8	585.0	5872.4	1835.4	16420.0	5584.0	5508.0	2174.0
	SUB-TOTAL	1715.0	308.7	480.2	308.7	480.2	68.6	531.6	394.5	6479.0	1814.1	2008.5	1490.2
	SUB-TOTAL	1715.0	308.7	480.2	308.7	480.2	68.6	531.6	394.5	6479.0	1814.1	2008.5	1490.2
2.0	TRANSMISSION FACILITIES												
	(1) Pipelines	3765.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4216.0	0.0	0.0	0.0
	(2) Reservoir	3765.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4216.0	0.0	0.0	0.0
	(3) Pump Facility (Equip)	3765.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4216.0	0.0	0.0	0.0
	(4) Pump Facility (Civil)	3765.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4216.0	0.0	0.0	0.0
	(5) Chlorination Facility	3765.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4216.0	0.0	0.0	0.0
	(6) Electric Sub-station	3765.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4216.0	0.0	0.0	0.0
	(7) Distribution Pipes	3765.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4216.0	0.0	0.0	0.0
	SUB-TOTAL	1249.0	224.8	349.7	2154.6	3351.6	478.9	3710.7	2753.1	6448.0	1805.4	1998.9	1483.0
	(1) Main Pipes	117.0	2.3	24.6	60.7	637.6	182.2	2064.5	273.2	315.0	65.2	214.2	28.4
	(2) Valves	9644.0	1543.1	2700.4	1961.9	3433.4	490.5	4189.1	2637.6	14239.0	4003.7	4861.7	3145.8
	(3) Internal Network	11680.0	117.0	1168.0	149.2	1488.8	447.1	12663.2	595.8	14245.0	1424.5	12108.2	568.8
	(4) Service Connections	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(5) Water Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(6) Serv. Cancin Rhlin w/H	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(7) Serv. Cancin Rhlin w/H	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(8) Lateral Rehabilitation	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(9) Flow Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(10) Fire Protection	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	SUB-TOTAL	26553.0	1892.1	4216.0	6187.5	15085.5	2403.0	31374.4	3019.4	61906.0	17910.2	20691.2	7312.5
	(1) Administration Bldg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(2) Operation Center	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	SUB-TOTAL	38120.0	3505.2	8094.6	8218.8	21036.5	3197.7	38350.8	10471.9	87715.0	27748.0	37891.3	11493.3
	SUB-TOTAL	240.0	0.0	240.0	0.0	0.0	0.0	0.0	0.0	0.0	1116.0	600.0	600.0
	(1) Land Acquisition	1200.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1200.0	0.0	0.0	0.0
	(2) Vehicle	519.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	519.0	0.0	0.0	0.0
	(3) Stored Material & Equip.	1959.0	0.0	240.0	0.0	0.0	0.0	0.0	0.0	3280.0	0.0	1409.8	754.2
	SUB-TOTAL	38120.0	3505.2	8094.6	8218.8	21036.5	3197.7	38350.8	10471.9	87715.0	27748.0	37891.3	11493.3
5.0	Land Acquisition	40079.0	3505.2	8094.6	8218.8	21036.5	3197.7	40054.6	11525.1	117088.0	28864.0	61009.2	16632.4
	SUB-TOTAL	40079.0	3505.2	8094.6	8218.8	21036.5	3197.7	40054.6	11525.1	117088.0	28864.0	61009.2	16632.4
6.0	Replacement of Equipment												
	(1) Deep Well Pump	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(2) Booster Pump	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(3) Flow Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(4) Chlorinator	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(5) Water Meter	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(6) Operation Center	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(7) Vehicle	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	(8) Stored Material & Equip.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	SUB-TOTAL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	SUB-TOTAL	40079.0	3505.2	8094.6	8218.8	21036.5	3197.7	40054.6	11525.1	117088.0	28864.0	61009.2	16632.4
7.0	Leakage Detection												
	SUB-TOTAL	40079.0	3505.2	8094.6	8218.8	21036.5	3197.7	40054.6	11525.1	117088.0	28864.0	61009.2	16632.4
	GRAND TOTAL	40079.0	3505.2	8094.6	8218.8	21036.5	3197.7	40054.6	11525.1	117088.0	28864.0	61009.2	16632.4

No.	ITEM	Phase I (Stage 2)			Phase I Total			Phase II			E. DOM	E. DOM	
		C. DOM	C. D. UNSKI	E. FEC	C. DOM	C. D. UNSKI	E. FEC	C. DOM	C. D. UNSKI	E. FEC			
1	Deep Well Facilities	9852.0	1304.4	3938.4	1579.4	4818.8	585.0	5872.4	1835.4	16420.0	5584.0	5508.0	2174.0
2	Transmission Facilities	1715.0	308.7	480.2	308.7	480.2	68.6	531.6	394.5	6479.0	1814.1	2008.5	1490.2
3	Purification Plant	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
4	Reservoir	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
5	Disinfection Facilities	98.0	4.9	33.3	39.3	266.8	291.1	210.1	168.1	888.8	577.2	444.4	355.5
6	Electric Sub-station	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
7	Distribution Facilities	14775.0	1770.2	3074.7	442.7	6906.5	55.1	1497.5	275.7	5131.0	1128.8	2693.8	513.1
8	Service Connection	11680.0	117.0	1168.0	149.2	1488.8	447.1	12663.2	595.8	14245.0	1424.5	12108.2	568.8
9	Admin. Bldg. & Ops. Ctr.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10	Land Acquisition	240.0	0.0	240.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11	Vehicle & Stored Material	1719.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12	Replacement of Equip.	40079.0	3505.2	8094.6	8218.8	21036.5	3197.7	40054.6	11525.1	117088.0	28864.0	61009.2	16632.4
13	Leakage Detection	40079.0	3505.2	8094.6	8218.8	21036.5	3197.7	40054.6	11525.1	117088.0	28864.0	61009.2	16632.4
	TOTAL	40079.0	3505.2	8094.6	8218.8	21036.5	3197.7	40054.6	11525.1	117088.0	28864.0	61009.2	16632.4

APPENDIX 8.2.1.C OPERATION AND MAINTENANCE COST (Angeles City)

(cost: thousand peso)

Item	Stage 1		Stage 2	Phase II
	Cost	Cost	Cost	Cost
<b>Operation &amp; Maintenance Cost</b>				
Salary	2,000 ₱/M.M	1,104	1,752	2,688
Power	0.3 ₱/kwh	323	986	2,016
Chemical	27 ₱/kg	95	246	471
Miscellaneous		838	2,207	3,877
Maintenance		629	1,725	3,063
<b>Total</b>		<b>2,989</b>	<b>6,916</b>	<b>12,115</b>

APPENDIX 9.3.1 MARKET SURVEY

The market survey was conducted by interviews to the residents in the study area using the LWUA's interview sheet as per attached in the end of this section.

The total number of respondents and its estimated coverage ratio to the total number of households in the study area are as follows:

<u>Total Number of Respondents</u>	<u>Estimated Total Household</u>	<u>Coverage Ratio to Total Household</u>
6,556	24,025	27%

The results of the market survey are obtained as shown in TABLE 9.3.1.

From the market survey, the income distribution of the respondents are shown as follows:

<u>Income Bracket<sup>1/</sup></u>	<u>Ave. Pesos</u>	<u>Number</u>
₱900 and below	722	903
₱901 to ₱1500	1,292	1,754
₱1,501 to ₱2,500	2,132	1,339
₱2,501 to ₱4,500	3,486	1,358
₱4,501 and above	8,256	945

The existing sources of water for the respondents and their willingness to connect to each source are indicated as follows :

---

1/ Residential, excluding no-income and no-answer



TABLE 9.3.1 MARKET SURVEY SUMMARY

Total Number of Respondents: 6556

1. Distribution According to Building Type

	No.	%
a. Residential	: 6359	97.00
b. Commercial	: 171	2.61
c. Industrial	: 26	0.40

2. Distribution According to Source of Water

	No.	%
a. Connected to System	: 1653	25.21
b. Neighbor's Connection	: 850	12.97
c. Public Faucet	: 239	3.65
d. Private System	: 3786	57.75
e. Water Vendor	: 3	0.05
f. Others	: 25	0.38

3. Average Persons Per Household

a. Residential / Number of Sample	: 6.55 /	6355
b. Commercial / Number of Sample	: 6.83 /	171
c. Industrial / Number of Sample	: 9.27 /	26

4. Willingness To Connect (%)

	Residential	Commercial	Industrial	Total
a. Yes	: 59.43	49.12	46.15	59.11
b. No	: 15.16	19.30	19.23	15.28
c. Undecided	: 0.39	0.00	3.85	0.40
d. W/ Own Conn.:	25.02	31.58	30.77	25.21

5. Average Monthly Water Needs

Type / Number of Sample	Residential	Commercial	Industrial
a. Kerosene Can / 1032	: 13.39	23.90	7.75
b. Drum / 5302	: 5.99	4.14	5.17
c. Gallon / 185	: 97.76	45.21	2.00
d. Others / 29	: 63.66	0.10	0.00

6. Ave. Monthly Electric Bills for Residential Users (PESO):148.18  
Number of Effective Respondents : 6163

7. Income Distribution

( Residential, Excluding No-Income and No-Answer )

	AVE. PESO	NUMBER
a. P900 and Below	: 722	903
b. P901 to P1500	: 1292	1754
c. P1501 to P2500	: 2132	1339
d. P2501 to P4500	: 3486	1358
e. P4501 and Above	: 8256	945

<u>Sources of Water</u>	<u>Distribution</u>	<u>Willingness to Connect</u>	
		<u>Yes</u>	<u>No</u>
Connected to System	25 %	- %	- %
Neighbor's Connection	13	79	21
Public Faucet	4	76	24
Private System	58	79	20

The private system is the major source of water for the respondents, followed by the system, neighbor's connection and public faucets.

In addition, only 0.4% of the respondents depend on water vendors and others for its water sources. The above table shows that majority of the respondents are willing to connect to the waterworks system.

The following are the distribution of water sources and the respondents' willingness to connect according to income bracket as obtained from the market survey.

TABLE 9.3.2 DISTRIBUTION OF WILLINGNESS TO CONNECT BY INCOME BRACKET

<u>Sources of Water</u>	<u>Income Bracket</u>				
	<u>₱900 &amp; below</u>	<u>₱901- ₱1,500</u>	<u>₱1,501- ₱2,500</u>	<u>₱2,501- ₱4,500</u>	<u>₱4,501- &amp; above</u>
Connected to System	12 %	20 %	27 %	31 %	37 %
Neighbor's Connection	29	19	11	5	2
Public Faucet	8	5	3	1	0
Private System	50	55	58	62	60
<u>Willingness to Connect</u>					
Yes	63	63	60	58	50
No	25	16	13	11	13
Undecided	1	1	0	0	0
With Own Connection	11	20	27	31	36

As the result of the market survey, the respondents' willingness to connect and the user's types are shown as follows :

<u>Answer</u>	<u>Residential</u>	<u>Commercial</u>	<u>Industrial</u>	<u>Total</u>
Yes	: 59.4 %	49.1 %	46.1 %	59.1 %
No	: 15.2	19.3	19.2	15.3
Undecided	: 0.4	0.0	3.3	0.4
With Own Conn.	: 25.0	31.6	30.8	25.2

Residential users account for 97% of the total respondents, so respondents' willingness to connect is approximately 60% of the total, while unwillingness to connect is 15%. It was observed from the results of the survey that the majority of the respondents in all income brackets are willing to connect to the waterworks system.

Judging from the above, it is safe to conclude that the majority of the residents in the study area are willing to connect to the new system when the water supply system is expanded.



In the calculation of Financial Internal Rate of Return (FIRR), the following two indicators are normally used to evaluate financial profitability of a project.

(1) Internal Rate of Return on Investment (IRROI)

The term IRROI indicates the internal rate of return on total capital investment, and assesses the profitability of the Project as a whole and the ability to recover funds invested in the Project.

The IRROI is calculated based on the assumption that the total capital investment is covered by its own capital. Therefore, the financial conditions such as the loan conditions on borrowed capital, changes on the ratio of equity to total capital requirement and others have no effect on the IRROI. Accordingly, the IRROI indicates the profitability of the Project itself.

(2) Internal Rate of Return on Equity (IRROE)

The term IRROE indicates the internal rate of return on equity, and assesses the profitability only with respect to equity and the ability to recover funds invested in the Project as equity. Here, the IRROE is calculated on the basis of such financial conditions proper to the Project as the loan conditions on borrowed capital and amount of capital owned.

In this study, the FIRR was calculated using the same method applied in the study report of the BACOLOD CITY WATER DISTRICT PHASE II WATER SUPPLY FEASIBILITY STUDY, DRAFT REPORT VOLUME 3 by LWUA.

APPENDIX 9.8.1 PROPOSED WATER RATE

The proposed water rates for 1/2 inch connections of commercial users, and 3/4 inch connections of domestic and commercial users to achieve financial self-sufficiency are as follows :

(1) Water rate for 1/2 inch connections of commercial users

Period	Rate/ Unit	First 10cu.m	11-20cu.m	21-35cu.m	Above 35cu.m
1988	₱1.0	₱ 50.0	₱ 6.2	₱ 8.0	₱ 10.6
1989	1.2	60.0	7.6	9.6	12.6
1990	1.2	60.0	7.6	9.6	12.6
1991	1.8	90.0	11.2	14.4	19.0
1992	2.7	135.0	16.8	21.6	28.4
1993	2.9	145.0	18.2	23.2	30.4
1994	3.1	155.0	19.4	24.8	32.6
1995	3.1	155.0	19.4	24.8	32.6
1996	3.3	165.0	20.6	26.4	34.6
1997	3.3	165.0	20.6	26.4	34.6

(2) Water rate for 3/4 inch connection of domestic users

Period	Rate/ Unit	First 10cu.m	11-20cu.m	21-35cu.m	Above 35cu.m
1988	₱1.0	₱ 40.0	₱ 5.0	₱ 6.4	₱ 8.5
1989	1.2	48.0	6.1	7.7	10.1
1990	1.2	48.0	6.1	7.7	10.1
1991	1.8	72.0	9.0	11.5	15.2
1992	2.7	108.0	13.4	17.3	22.7
1993	2.9	116.0	14.6	18.6	24.3
1994	3.1	124.0	15.5	19.8	26.1
1995	3.1	124.0	15.5	19.8	26.1
1996	3.3	132.0	16.5	21.1	27.7
1997	3.3	132.0	16.5	21.1	27.7

(3) Water rate for 3/4 inch connection of commercial users

---

<u>Period</u>	<u>Rate/ Unit</u>	<u>First 10cu.m</u>	<u>11-20cu.m</u>	<u>21-35cu.m</u>	<u>Above 35cu.m</u>
1988	₱1.0	₱ 80.0	₱10.0	₱12.8	₱17.0
1989	1.2	96.0	12.2	15.4	20.2
1990	1.2	96.0	12.2	15.4	20.2
1991	1.8	144.0	18.0	23.0	30.4
1992	2.7	216.0	26.8	34.6	45.4
1993	2.9	232.0	29.2	37.2	48.6
1994	3.1	248.0	31.0	39.6	52.2
1995	3.1	248.0	31.0	39.6	52.2
1996	3.3	264.0	33.0	42.2	55.4
1997	3.3	264.0	33.0	42.2	55.4

---





ダグパン市, パンガシナン県



APPENDIX 3.4.1 DECORP POWER RATES (AS OF FEB. 1986)

Residential

First 100 kwh	₱ 0.575 per kwh
Next 100 kwh	.585 per kwh
Excess kwh	.590 per kwh

Commercial

Classification

X-1	First 150 kwh	₱0.575 per kwh
(Conn. Load: 1-5,000 watts)	Next 150 kwh	.590 per kwh
	Next 300 kwh	.600 per kwh
	Excess kwh	.610 per kwh
X-2	First 600 kwh	₱0.575 per kwh
(Conn. load: over 5,000 watts)	Next 600 kwh	.590 per kwh
	Next 1200 kwh	.600 per kwh
	Excess kwh	.610 per kwh

Industrial

Demand charge		₱10.00 per kwh
Plus Energy charge	First 200 hrs.	.550 per kwh
	Next 200 hrs.	.530 per kwh
	Excess hrs.	.510 per kwh

Street light rates

125 watts Mercury lamp	₱24.00 per month
250 watts Mercury lamp	48.00 per month
400 watts Mercury lamp	73.80 per month

#### APPENDIX 4.2.1 DISCHARGE RATE OF THE EXISTING PUMP

The discharge rate of the pump was measured by means of potable flow meter covering fifteen existing pumping stations.

The time period for measurement was arranged in accordance with operation schedule for each pump since most pumps are being operated within the limited hours from the economical viewpoint. With regard to the situation of pump operation, measurement was conducted for a period of one hour for a majority of the pumps. However, the discharge rate at the four pumping stations (No. 2, No. 4, No. 5 and No.16) were measured through the day. Two of these pumping stations (No. 2 and No. 4) are being operated through the day. Other two pumping stations were considered for one day measurement to analyze the influence by the former two pumping stations, especially during the period when the pumps stop operating.

##### Implementation Schedule

The implementation schedule was made in consideration of the available set of potable flow meter (3 sets) and associated with other surveys. TABLE 4.2.1. 1 shows overall schedule for this survey.

TABLE 4.2.1.1 IMPLEMENTATION SCHEDULE

<u>Date</u>	<u>No. of P.S.</u>	<u>Measurement Time</u>		<u>R.M.</u>
June 18	No. 12	9:30	10:30	
	15	9:40	10:40	
	11	11:25	12:25	
	7	11:35	12:35	
	8	14:05	15:05	
	14	14:10	15:10	


<u>Date</u>	<u>No. of P.S.</u>	<u>Measurement Time</u>		<u>R.M.</u>
June 19	No. 6	8:45	9:45	
	3	8:50	9:50	
	16	10:30	11:30	No. 16 PS was repaired after measurement
	1	10:45	11:45	
	4	14:20	15:20	
	10	14:30	15:30	
	9	16:20	17:20	
June 26	4	16:00	16:00	
27	2	22:00	22:00	
July 26	5	18:00	18:00	
27	16	19:00	19:00	

Measurement Result


Measurement results for the four pumping stations are shown in TABLE 4.2.1.2. Regarding the results of the four pumping stations, the fluctuation of hourly discharge rates is less than 5 percent to the average figure.

TABLE 4.2.1.2 ONE DAY MEASUREMENT RESULT  
AT THE FOUR PUMPING STATIONS

Time	Pumping Station	No. 2 (cu.m/hr)	No. 4 (cu.m/hr)	No. 5 (cu.m/hr)	No. 16 (cu.m/hr)	Remarks
0 - 1		63	62	0	0	
1 - 2		62	62	0	0	
2 - 3		64	62	0	0	
3 - 4		64	63	0	0	
4 - 5		63	64	0	0	
5 - 6		60	64	0	0	
6 - 7		59	64	20	0	
7 - 8		61	64	20	38	
8 - 9		62	64	20	40	
9 - 10		61	64	20	41	
10 - 11		62	62	19	40	
11 - 12		62	64	20	41	
12 - 13		-	-	20	41	
13 - 14		-	-	20	40	No. 2 & No. 4 Brownout
14 - 15		-	-	19	39	
15 - 16		-	-	19	39	
16 - 17		63	65	19	39	
17 - 18		61	65	19	39	
18 - 19		60	65	19	39	
19 - 20		61	64	19	40	
20 - 21		61	64	19	39	
21 - 22		62	62	19	41	
22 - 23		62	61	0	0	
23 - 24		64	62	0	0	
<hr/>						
Hourly Average Rate (cu.m/hr)		62	63	19	40	
Daily Discharge Rate (cu.m/hr)		1,488	1,512	456	960	

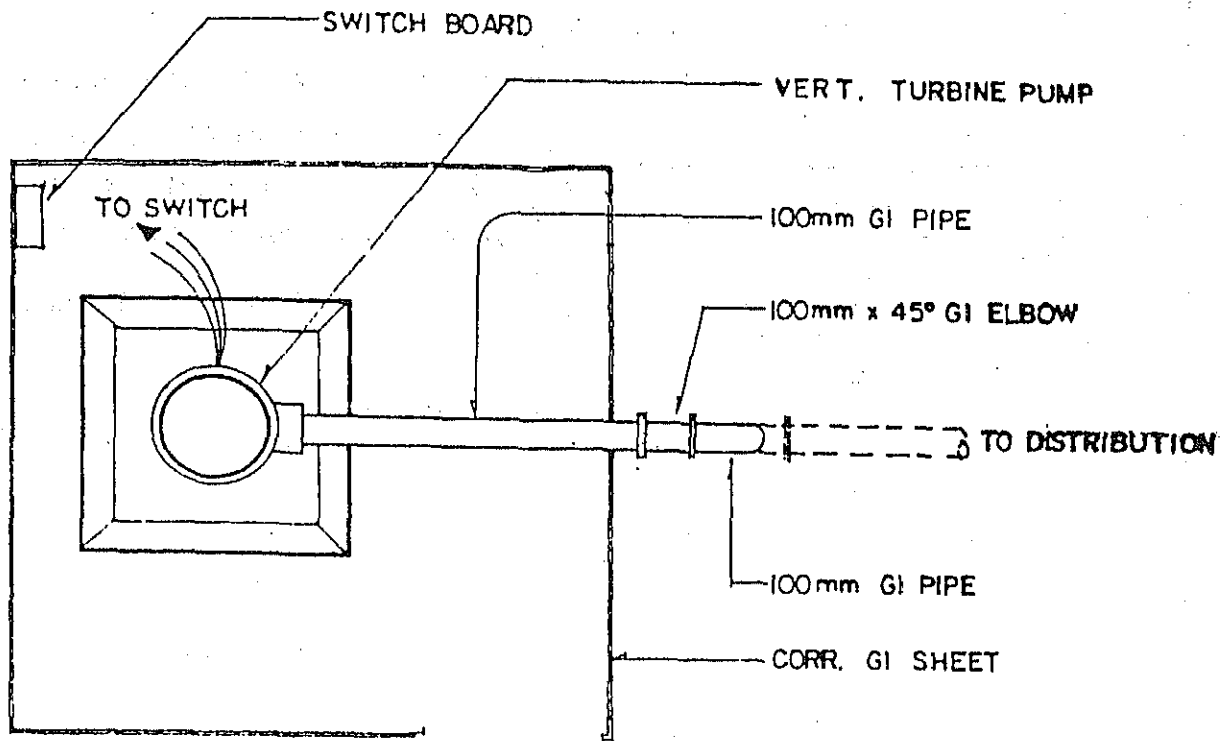


P L A N

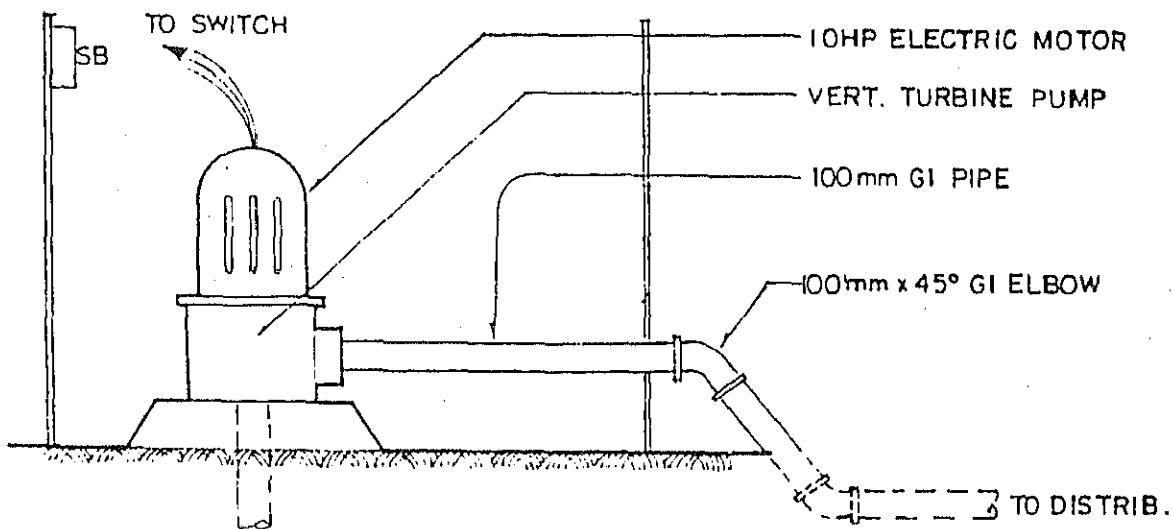


ELEVATION

GALVAN PUMPING STATION  
WELL NO. 1

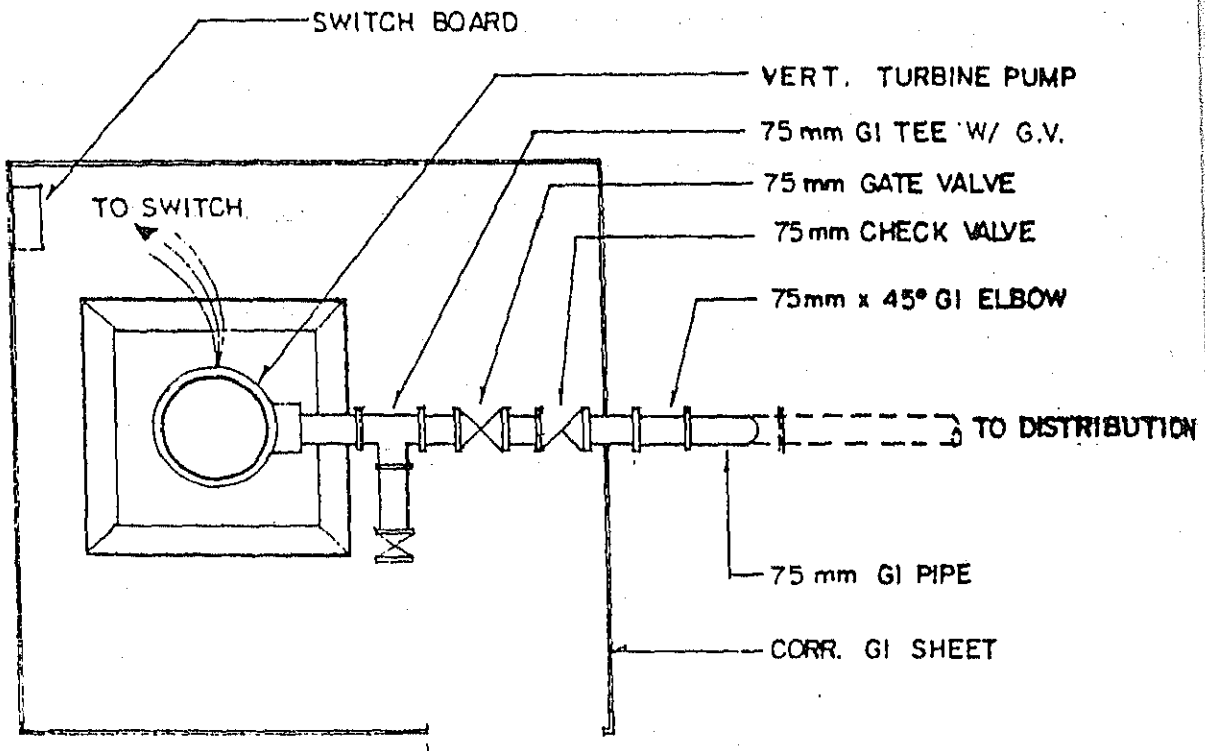

P L A N

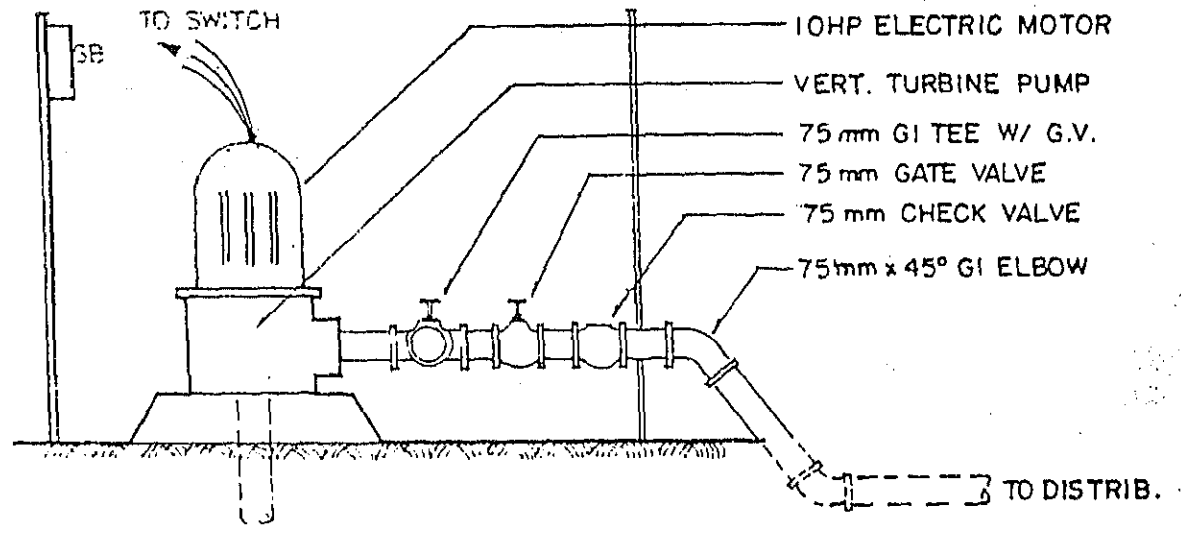

ELEVATION

MALUED PUMPING STATION  
WELL NO. 7



## APPENDIX 4.2.2 PUMP EFFICIENCY TEST

The required condition in conducting pump efficiency testing are given below:

- (1) There is an existing functioning gate valve, sounding hole and pressure gauge located properly at the pump station.
- (2) There is a proper and convenient place to install the portable flow meter.

Voltage, electric current and discharge rate measurement should be made several times depending on the water pressure variation.

### Selection of pump station for pump testing

During the survey, the existing facilities, of the pump stations were investigated, especially the existence of functioning gate valve, pressure gauge and sounding hole. All the pump stations had no pressure gauges and sounding holes. Out of the fifteen (15) pump stations, No. 10 located along Arellano St. has a record on pumping water level. TABLE 4.2.2.1 shows the collected information.

Pump station No. 10 was selected for this test in the light of the aforementioned requirements. However, a hole was drilled to install the pressure gauge. The reliable data about the pumping water level provided by the DAWASA engineers was also utilized.

### Field measurement

Variations of water pressure and discharge rate were measured at the different opening ratio of the gate valve. TABLE 4.2.2.2 shows the test data obtained at pump station No. 10.

TABLE 4.2.2.1 INFORMATION ASSOCIATED WITH THE REQUIREMENTS FOR THE TEST

P.S. No.	Location	Type of Pump	Pump Cap. (CMD)	Const. Well	Year Pump	Operation Status	Existence		P.M.L. Setting (m)	Pump* Setting (m)	Remarks
							Gate Value	Present Sounding Hole			
1	Galvan St.	Turbine Pump	540	NDA	NDA	4:00AM-10:00PM (18 hrs.) 24 hrs	No	No	-	15.24	
2	In front of City Hall Rizal St.	"	1370	"	"		Yes	"	9.15	21.34	Gate Value not functioning
3		"	1370	1952	1952	4:00AM-12MN (20 hrs) 24 hrs	Yes	"	7.6	27.44	Gate Value not functioning
4	A.B.F east	"	1320	NDA	NDA		Yes	"	18.29	30.49	Gate Value not functioning
5	Burgos St.	"	540	1960	1960	4:00AM-10PM (18 hrs)	Yes	"	-	-	
6	Perez St.	"	1090	1978	1978	4:00AM-10PM (18 hrs)	Yes	"	-	18.29	Gate Value no handle
7	Egy Malued	"	540	1967	1967	4:00AM-10PM (18 hrs)	Yes	"	-	18.29	
8	Noble St.	"	540	1974	1974	4:00AM-10PM (18 hrs)	Yes	"	-	15.24	
9	Caranglaan	"	540	1974	1974	4:00AM-10PM (18 hrs)	Yes	"	-	15.24	
10	Avellano St.	"	540	1971	1971	4:00AM-10PM (18 hrs)	Yes	"	10.7	15.24	
11	Egy. Lasip	"	540	1972	1972	4:00AM-10PM (18 hrs)	Yes	"	18.29	27.44	Gate Value no handle
12	Amado St.	"	540	1973	1973	4:00AM-10PM (18 hrs)	Yes	"	-	27.44	
13	Tondalugan	"	-	1976	-		-	-	-	-	abandoned in 1983
14	Noble St.	"	540	1970	1970	4:00AM-10PM (18 hrs)	Yes	No	-	24.3	
15	Egy. Malued	"	540	1977	1977	4:00AM-10PM (18 hrs)	Yes	"	16.8	21.34	Gate Value no handle
16	A.B.F West	"	1320	1980	1980	4:00AM - 8:00PM (16 hrs)	Yes	"	18.9	30.49	Gate Value no handle

NDA - No data available

\* - Data provided by the NAWASA.

TABLE 4.2.2.2  
TEST DATA ON PUMP STATION No. 10  
DAGUPAN CITY, PANGASINAN

STEP	(LPS)	Pd (m)	PWL (m)	TDH (m)	V AVE. (Volts)	I AVE. (Amp.)	WHP <sup>2/</sup>		IHP <sup>3/</sup>		Overall <sup>4/</sup> Eff(%)	PUMP <sup>5/</sup> (%)	BHP <sup>6/</sup> (Hp)
							HP	KW	HP	KW			
1	7.72	6.1	10.7	17.8	220	20.3	1.8	1.34	6.6	4.9	27.3	32.1	5.6
2	7.70	6.5	10.7	18.2	225	20	1.84	1.37	6.6	4.9	27.9	32.8	5.6
3	7.65	6.8	10.7	18.5	225	20	1.86	1.39	6.6	4.9	28.2	33.2	5.6
4	7.61	7.7	10.7	19.4	225	20	1.94	1.45	6.6	4.9	29.4	34.6	5.6
5	7.58	7.95	10.7	19.7	221	20.5	1.96	1.46	7.7	5.0	29.3	34.5	5.7
6	7.51	8.4	10.7	20.1	221.7	19.5	1.98	1.48	6.4	4.8	30.9	36.4	5.4
7	7.50	8.8	10.7	20.5	223	19.0	2.02	1.50	6.2	4.6	32.6	38.4	5.3
8	7.45	9.2	10.7	20.9	222.7	18.5	2.05	1.53	6.1	4.6	33.6	39.5	5.2
9	7.37	9.9	10.7	21.6	221	18.5	2.09	1.56	6.0	4.5	34.8	40.9	5.1
10	7.32	10.2	10.7	21.9	221	18.0	2.11	1.57	5.9	4.4	35.8	42.1	5.0
11	6.25	13.0	10.7	24.7	220	18.0	2.03	1.51	5.8	4.3	35.0	41.2	4.9
12	5.68	13.5	10.7	25.2	218.5	18.0	1.89	1.41	5.8	4.3	32.6	38.4	4.9

- 1/ TDH = Pd + Ps (PWL) + hf, WHERE hi is ASSUMED 1.0 m
- 2/ WHP = (Q x TDH) / 76.1
- 3/ IHP = (VAVE x I AVE x 3 x P.F)/1000 ; ASSUMED P.F. = 0.85
- 4/ OVERALL EFF = (WHP x 100) / IHP
- 5/ PUMP EFF =  $\frac{\text{OVERALL EFF}}{\text{MOTOR EFF}}$  ; ASSUMED MOTOR EFF = 0.85
- 6/ BHP = WHP / PUMP eff = IHP x MOTOR EFF.

### APPENDIX 4.2.3 WATER PRESSURE IN THE SERVICE AREA

Variations in pressures at strategic points in the distribution system and in the pump stations were monitored on a 24-hour basis utilizing automatic pressure recorders and pressure gauges.

The following approach was employed to achieve the purpose of this pressure survey.

#### A. Preparatory Work

- (1) Preliminary survey and discussion with the waterworks personnel to pinpoint the proposed pressure test points.
- (2) Made some posters/placards informing the public regarding the on-going pressure survey.
- (3) Hired some personnel/recorders for this survey.

#### B. Implementation of the Survey

- (1) Briefing of the hired personnel/recorders regarding this pressure survey.
- (2) Brought the personnel/recorders to their designated area.
- (3) Field measurement itself.

The following were considered in selecting the test points:

- a) All the existing pump stations should be included in this survey.
- b) The total number of test points should be around thirty (30).

The test point locations are shown in FIGURE 4.2.3.1. TABLE 4.2.3.1 shows the 24-hour pressure recordings.

TABLE 4.2.3.1

## 24-HOUR PRESSURE RECORDING IN THE DISTRIBUTION SYSTEM

	No.	Location	Recorded	Pressure Range <sub>2</sub> (kg/cm <sup>2</sup> )	Consumer Type	Diameter of Connection	
Pump Station	1	Galvan St.	6-29-86	0.70-0.99	-	A.P.R. was installed on the discharge pipe	
	2	Infront of City Hall	6-29-86	1.22-1.33	-		
	"	3	Rizal St.	6-28-86	0.25-0.49	-	"
	"	4	A.B.F. East	6-29-86	0.92-0.99	-	"
	"	5	Burgos St.	6-28-86	0.17-0.42	-	"
	"	6	Perez St. (Mkt.)	6-30-86	0.07-0.42	-	"
	"	7	Dag-Malved Rd.	6-27-86	0.25-0.63	-	"
	"	8	Nable St.	6-28-86	0.32-0.63	-	"
	"	9	Cuanglaan	6-29-86	0.50-0.92	-	"
	"	10	Arellano St.	6-29-86	0.63-1.0	-	"
	"	11	Pogo Grande	6-27-86	0.14-0.35	-	"
	"	12	Amado St.	6-31-86	0.21-0.53	-	"
	"	14	Nable St.	6-26-86	0.70-1.02	-	"
	"	15	Dag-Binmaley Rd.	6-27-86	0.42-0.77	-	"
	"	16	A.B.F. East	6-28-86	1.12-1.48	-	"
	Service Area	1	Back of Rosita Mktg.	7-4-86	0.04-0.35	Public	1/2"
"		2	Fernandez St.	7-4-86	0 -0.28	Faucet	
"		3	Lasip Grande Elem. Sch.	7-1-86	0 -0.21	Institutional	1/2"
"		4	Amado St.	7-2-86	0 -0.28	Public Faucet	1/2"
"		5	A.B.F. West Ext.	7-2-86	1.06-1.06	"	3/4"
"		6	Queenan St.	7-4-86	0.28-0.69	"	1/2"
"		7	Bonifacio St.	6-27-86	0.07-0.32	"	1/2"
"		8	Nable St.	6-28-86	0.07-0.63	"	3/4"
"		9	Nable St.	6-26-86	0.63-1.06	"	3/4"
"		10	Nable St.	6-27-86	0.46-0.99	"	3/4"
"		11	Avellano St.	7-03-86	0.04-0.35	"	3/4"
"		12	Avellano St.	6-26-86	0.30-1.0	"	1/2"
"		13	Along Nat'l. Hi-way	7-03-86	0.07-0.56	"	1/2"
"		14	Perez St. (Mkt.)	7-03-86	0.11-0.60	"	1/2"
"		15	Pantal St.	6-26-86	0.4 -1.2	Domestic	1/2"
"		16	A.B.F. West	6-26-86	0.5 -1.2	Public Faucet	1/2"
"		17	Caranglaan North	6-26-86	0 -0.7	Domestic	1/2"
"	18	Bgy. Lucao	6-26-86	0 -0.4	Domestic	1/2"	
"	19	Lucao	7-31-86	0.18-0.56	Domestic	1/2"	
"	20	A.B.F. East	6-26-86	1.5 -2.2	Commercial	3/4"	
"	21	Arellano St.	6-26-86	0.3 -1.0	Public Faucet	1/2"	
"	22	Lasip Grande	7-31-86	0 -0.07	Domestic	1/2"	
"	23	A. B.F. East	6-26-86	1.0 -2.2	Commerical		

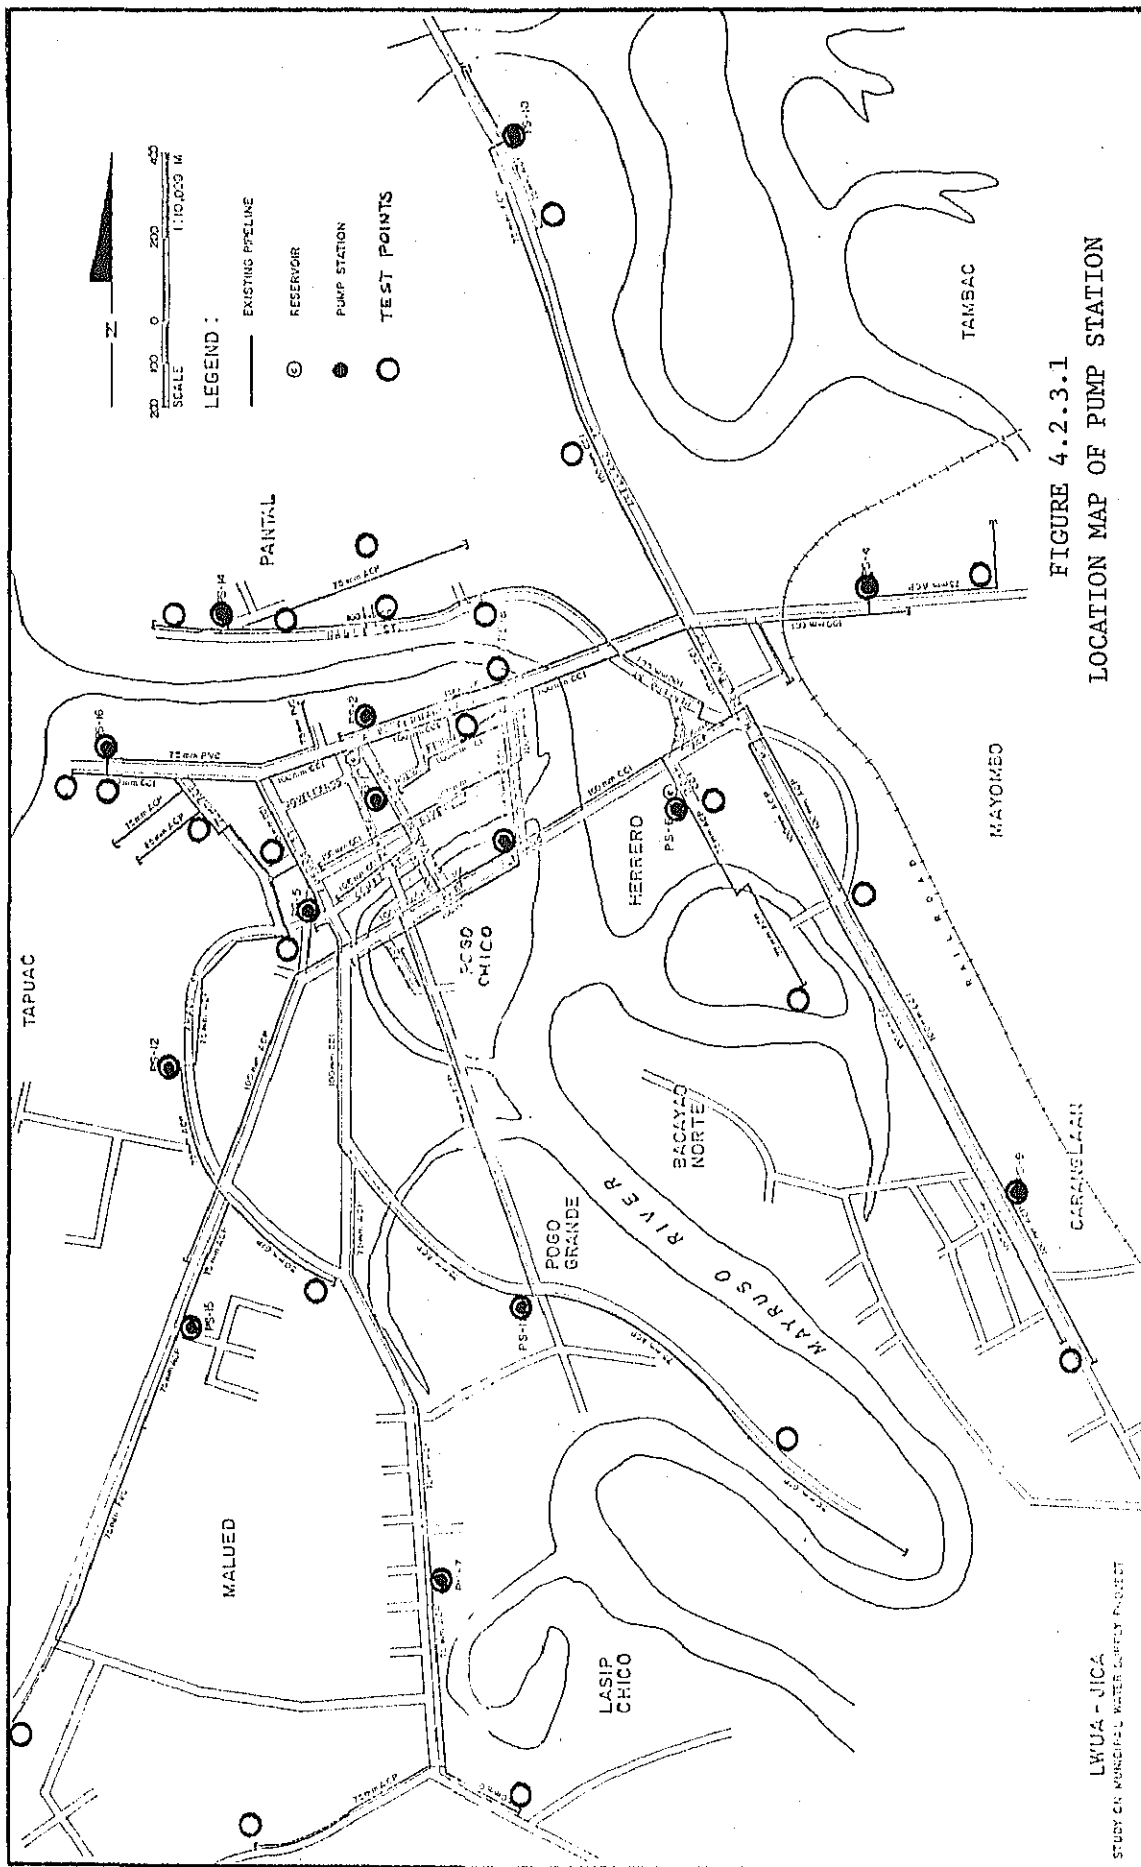


FIGURE 4.2.3.1  
 LOCATION MAP OF PUMP STATION

LWUA - JICA  
 STUDY ON MUNICIPAL WATER SUPPLY PROJECT

APPENDIX 6.6.1.1 WATER WELL INVENTORY


Owner's Number	LWUA JICA Well No.	<u>L</u> <u>o</u> <u>a</u> <u>i</u> <u>o</u> <u>n</u>	Elevation (m amsl)	Completion Date	Well Depth (m)	Casing Depth (m)	Casing Dia. (mm)	Static Water Level (m bgl)	Discharge (lps)	Specific Capacity (lps/m)	Conductivity (micro om)	Temperature (°C)
6504	1	Estanza, Lingayen	1.0	12-24-54	83	83	150					
44691	2	Bacabac, Bugallon	1.4	2-2-76	244	44/198	350/200		57	2.65		
6508	3	Poblacion, Bugallon	2.0	9-22-69	52	13'39	150/112	2.5	1.6	0.74		
8001	4	Balangobong, Lingayen	1.0	1-31-55	176	176	150	FF			1000	32
42-68-03	5	Pangapisan, Lingayen	1.0		100	100		FF			1000	32
43-62-33	6	Tonton, Lingayen	1.0	3-14-69	200	200	150	FF			530	32
19956	7	Baybay, Lopez, Binmaley	1.0	1967			150					
7832	8	Nagueiguel, Lingayen	1.0	10-31-62	199	199	100					
436061	9	Nagpalangan, Lingayen	1.5	9-5-59	170	170	100	1.2		0.18		
7968	10	San Isidro Norte, Binmaley	1.0	7-31-55	177		150	FF			556	32
12639	11	San Isidro, Binmaley	1.0	1956							509	31
7831	12	Biec East, Binmaley	1.5	12-27-60	130	130	100	0.6	0.6	0.23	497	32
20491	13	Naguilayan, Binmaley	1.5	10-31-56	174			2			450	31
5183	14	Caloocan Norte, Binmaley	1.0	7-31-56	174			5.8	0.13	0.02	444	31
5831	15	Canaoalan West, Binmaley	1.5	1-30-57	117	114	100	1.8	0.95		461	31
	16	Linoc West, Binmaley	1.5	6-12-56	258			6.1			400	31
	17	Canaoalan, Binmaley	1.5	7-11-60							1220	27
	18	Caloocan Sur, Binmaley	1.0	3-17-58	90	17/73	100/63	2.4	0.63	0.2	400	31
	19	Canaoalan, Binmaley	1.5	1-12-76	374	53.5/254.8	350/200	FF	88	4.9	1120	32
	20	Papagueyan, Binmaley	1.3	1-26-67	143		100				380	31
	21	Canaoalan, Binmaley	1.5	3-31-54	143		50	8.5			860	30
	22	Carael, Dagupan City	1.5	6-6-77	151	142.7						
	23	Carael, Dagupan City	1.5	4-15-50	189							
	24	Calmay, Dagupan City	2.0	9-20-73			100	8.2			320	32
	25	Pantal West, Dagupan City	2.0	11-28-53	155		150				980	29
	26	Gilig, Dagupan City	2.0	1928			150	6.5			590	31
	27	Malued, Dagupan City	2.0	6-12-58			150				1000	28
	28	Lasip, Grande, Dagupan City	2.0				150	3.5			460	30
	29	Lasip, Calasiao	3.0				150				500	30





CL-8	73	Taloy, Malasiqui	7	10-2-75	252	40/220	350/200	63	2.38	1000	30
	74	Buenlag, Calasiao	3.0				100			1540	30
	75	Macabito, Calasiao	5.0				100			1400	29
	76	Macabito, Calasiao	5.0	1986						1230	29
	77	Macabito, Calasiao	5.0				100			1080	28
	78	Balengueo, Sta. Barbara	5.0	1984			100			1320	30
	79	Bogtong, Malasiqui	5.0				150			146	31
19003	80	Bogtong, Malasiqui	5.0	1958			150			1170	30
43-60-81	81	Pasima, Malasiqui	10	5-21-60	46	34	100	4.6	0.63		
	82	Poblacion, Malasiqui	10								
8089	83	Poblacion, Malasiqui	10	9-13-55	62.5	62.5	250	3.1	1.26	605	29
GP-68	84	Alaga, Malasiqui	12		158	138	400			260	30
GP-86	85	Lasip, Malasiqui	12		149	146	400	3.3	4.5	280	30
GP-84	86	Lasip, Malasiqui	12		148	145	400	2	3.7	610	29
	87	Maticmatic, Sta. Barbara	17				150			605	29
GP-25	88	Maticmatic, Sta. Barbara	15	9-2-77	156	154	400		7.1		
	89		15								
	90	Amanaoc, Mavandan	17							620	29
GP-41	91	Banzal, Sta. Barbara	17		123	108	400		6.8		
18974	92	Naguilayan, Binmaley	1.5	1958						580	32
	93	Naguilayan, Binmaley	1.5							1000	30
	94	Naguilayan, Binmaley	1.5	1985						820	29
	95	Camaley, Binmaley	1.5							520	32
	96	Camaley Centro, Binmaley	1.5							560	30
	97	Calit, Binmaley	1.5							1000	28
	98	Banawang, Calasiao	1.8				150	3.8		435	30
	99	Mancod, Calasiao	1.8				100			1115	28
5268	100	Lucao, Dagupan City		2-18-51	189					933	28
20702	101	Dagupan City	2.0	2-22-59				9.0	1.26		

APPENDIX 6.6.1.2 WELL LITHOLOGIC LOGS

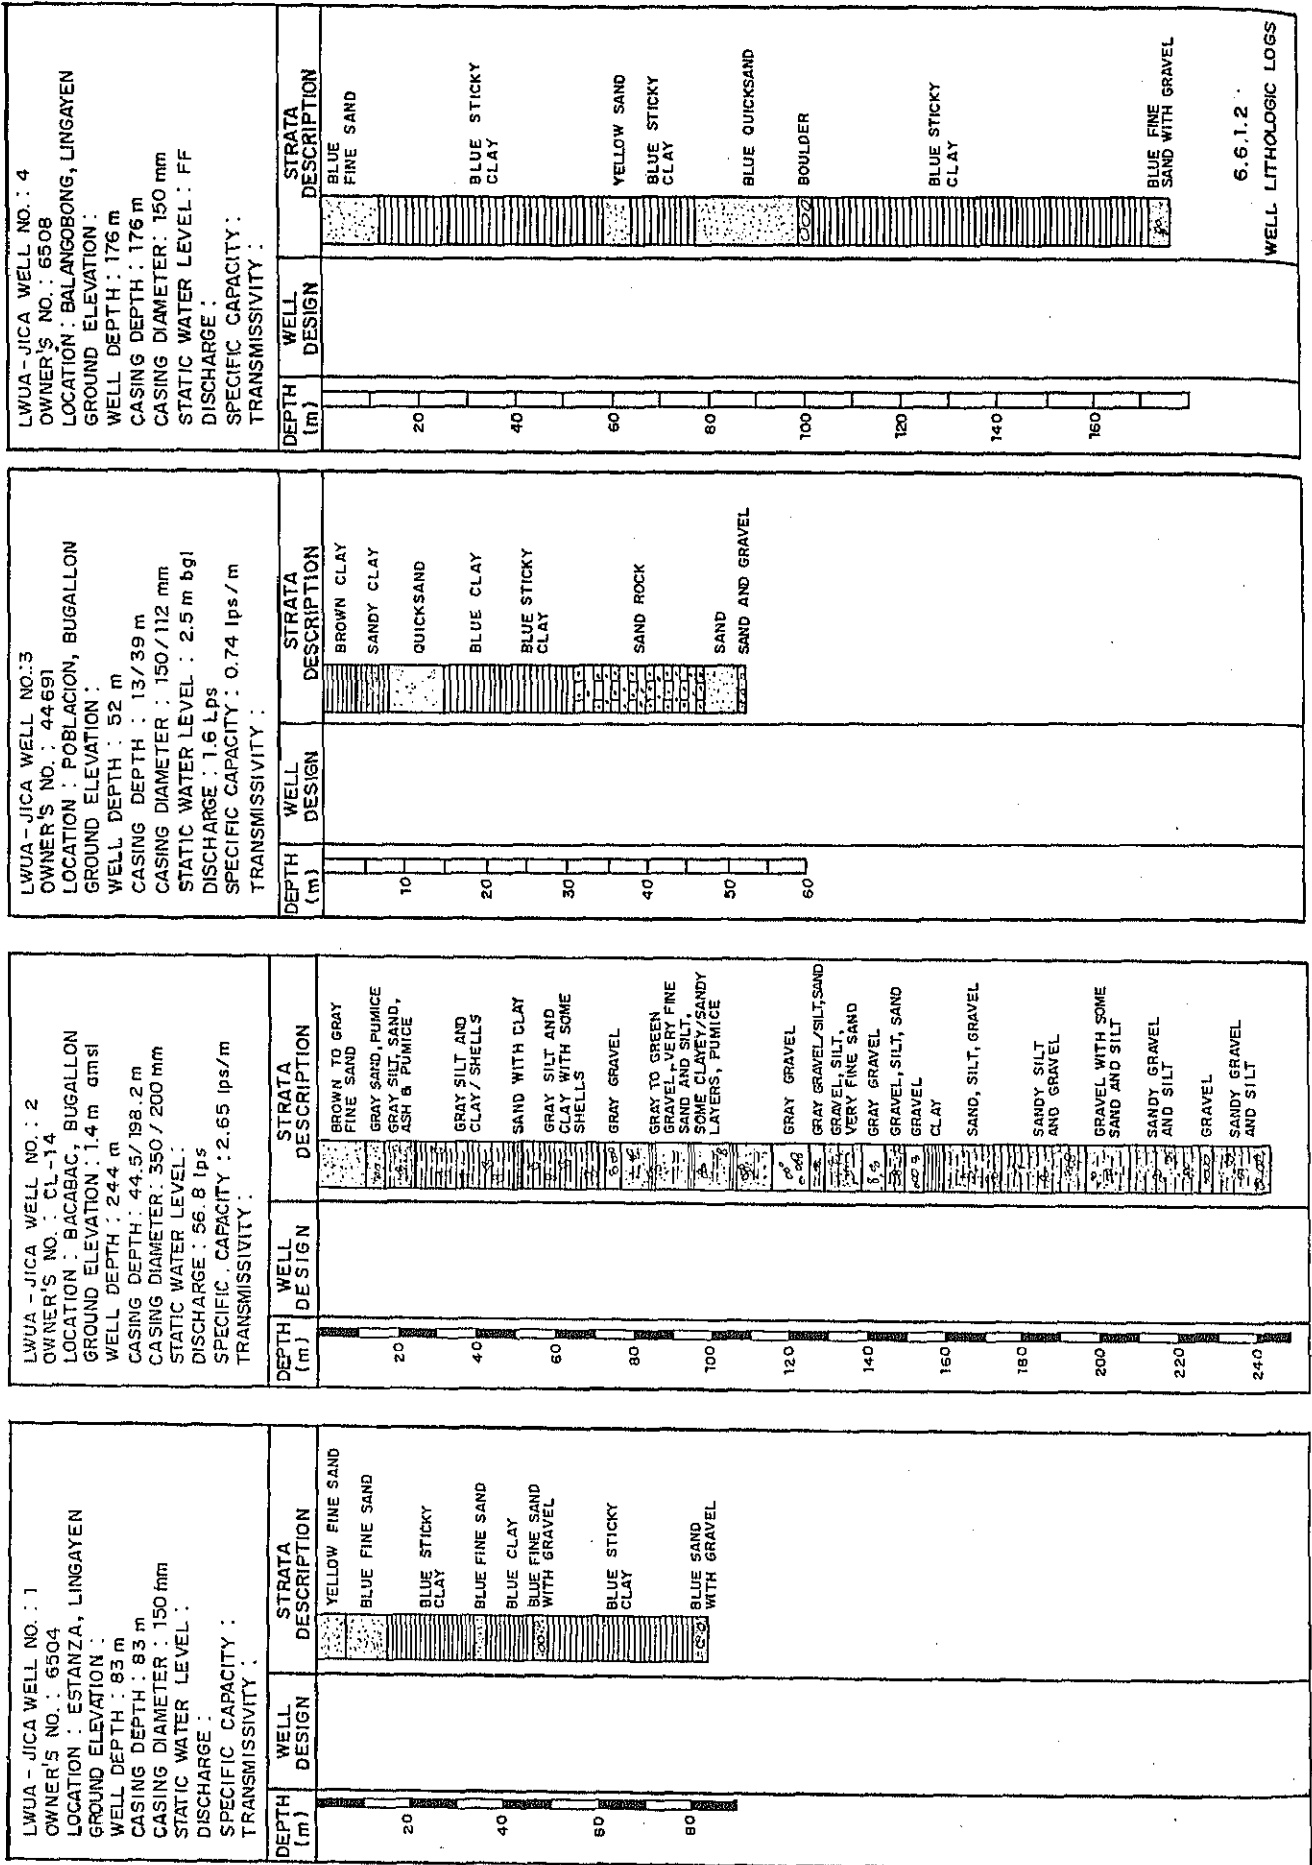

DEPTH (m)	WELL DESIGN	STRATA DESCRIPTION
20		SAND
40		BLUE CLAY
60		BLUE SAND
80		TUFFACEOUS CLAY
100		CLAY
120		CLAY
140		CLAY
160		BLUE SAND
180		BLUE SANDY CLAY
200		BLUE STICKY CLAY

DEPTH (m)	WELL DESIGN	STRATA DESCRIPTION
20		SANDY CLAY
40		BLUE CLAY
60		SANDY CLAY
80		BLUE CLAY
100		SANDY CLAY
120		BLUE CLAY
140		SANDY CLAY
160		BLUE STICKY CLAY
180		BLUE CLAY
200		BLUE STICKY CLAY

DEPTH (m)	WELL DESIGN	STRATA DESCRIPTION
20		QUICKSAND
40		BLUE SANDY CLAY
60		BLUE STICKY CLAY
80		BLUE SANDY CLAY
100		BLUE TUFF
120		BLUE SANDY CLAY
140		BLUE TUFF
160		SAND AND GRAVEL
180		SAND AND GRAVEL

DEPTH (m)	WELL DESIGN	STRATA DESCRIPTION
20		FINE SAND
40		SANDY CLAY
60		BLUE CLAY SAND AND GRAVEL
80		SANDY CLAY
100		HARD BLUE CLAY
120		BLUE CLAY
140		FINE SAND
160		HARD BLUE CLAY
180		HARD ROCK TUFF WITH CLAY
200		LIMESTONE
220		BROWN TUFF
240		BLUE FINE SAND
260		FINE SAND

6.6.1.2  
WELL LITHOLOGIC LOGS


LWUA - JICA WELL NO. : 7  
OWNER'S NO. : 42-68-03  
LOCATION: TONTON, LINGAYEN  
GROUND ELEVATION :  
WELL DEPTH : 200 m  
CASING DEPTH : 200 m  
CASING DIAMETER : 150 mm  
STATIC WATER LEVEL :  
DISCHARGE :  
SPECIFIC CAPACITY :  
TRANSMISSIVITY :

LWUA - JICA WELL NO. : 8  
OWNER'S NO. : 43-62-33  
LOCATION: NAGUERGUEL, LINGAYEN  
GROUND ELEVATION :  
WELL DEPTH : 199 m  
CASING DEPTH : 199 m  
CASING DIAMETER : 100 mm  
STATIC WATER LEVEL :  
DISCHARGE :  
SPECIFIC CAPACITY :  
TRANSMISSIVITY :

LWUA - JICA WELL NO. : 9  
OWNER'S NO. : 43-62-33  
LOCATION: NAGUERGUEL, LINGAYEN  
GROUND ELEVATION :  
WELL DEPTH : 199 m  
CASING DEPTH : 199 m  
CASING DIAMETER : 100 mm  
STATIC WATER LEVEL :  
DISCHARGE :  
SPECIFIC CAPACITY :  
TRANSMISSIVITY :

LWUA - JICA WELL NO. : 10  
OWNER'S NO. : 19956  
LOCATION: MAGPALANGAN, BINMALEY  
GROUND ELEVATION :  
WELL DEPTH : 171 m  
CASING DEPTH : 171 m  
CASING DIAMETER : 100 mm  
STATIC WATER LEVEL : 1.2 m bgl  
DISCHARGE :  
SPECIFIC CAPACITY : 0.18 lps/m  
TRANSMISSIVITY :

LWUA - JICA WELL NO. : 12  
OWNER'S NO. : 7832  
LOCATION: SAN ISIDRO, BINMALEY  
GROUND ELEVATION :  
WELL DEPTH : 177 m  
CASING DEPTH :  
CASING DIAMETER :  
STATIC WATER LEVEL :  
DISCHARGE :  
SPECIFIC CAPACITY :  
TRANSMISSIVITY :

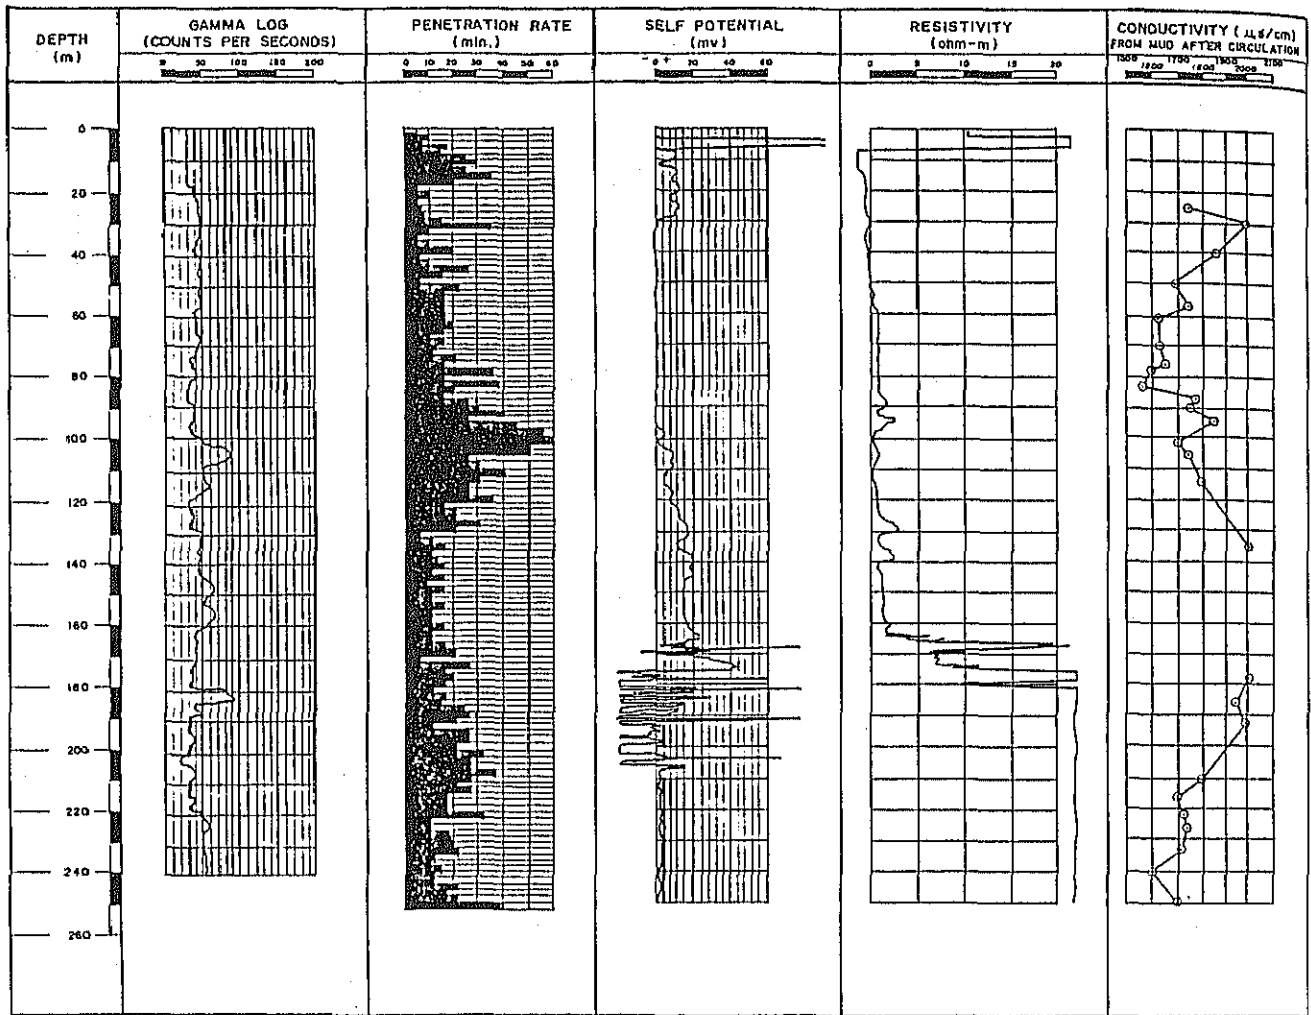


**STRATA DESCRIPTION**

**WELL DESIGN**

**WELL DATA**

18	SAND
20	SILT
	SILT WITH SHELLS
85	SAND AND GRAVEL WITH SILT AND SHELLS
72	SAND AND GRAVEL WITH SILT AND SHELLS
80	SILTY SAND WITH SHELLS
	SILT WITH GRAVEL AND SHELLS
104	SAND AND GRAVEL WITH SILT
	SILTY SAND AND GRAVEL WITH SHELLS
181	SILT WITH GRAVEL
173	SILTY SAND WITH SHELLS
185	SAND AND GRAVEL
206	SAND AND GRAVEL WITH SILT
209	SILT
217	SILT WITH GRAVEL
221	SAND AND GRAVEL WITH SILT
231	SILT
	SAND AND GRAVEL WITH SILT

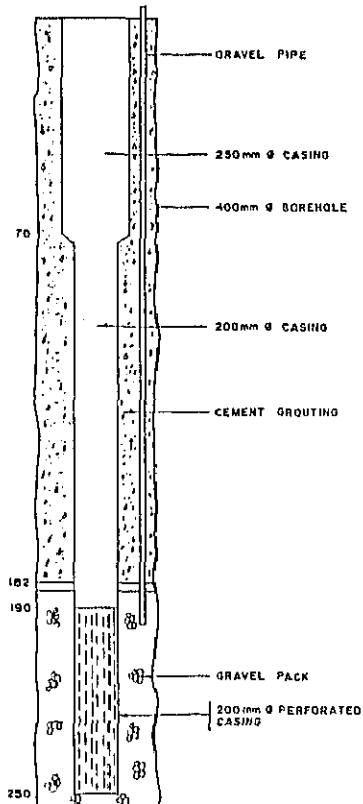

LWUA - JICA WELL NO: B  
 ELEVATION : 2 m amsl  
 WELL DEPTH : 250 m  
 WELL DIAMETER : 250 AND 200mm  
 STATIC WATER LEVEL : +1.37 m bgl  
 PUMPING WATER LEVEL : 25.6 m bgl  
 DISCHARGE : 32 lps  
 SPECIFIC CAPACITY : 1/m<sup>2</sup>  
 DATE OF TEST : FEBRUARY, 1980

**WATER QUALITY**

**PHYSICAL :**

COLOR \_\_\_\_\_ 29 APHA  
 TURBIDITY \_\_\_\_\_ 2 JTU  
 TDS \_\_\_\_\_ 1110 ppm CaCO<sub>3</sub>  
 CONDUCTIVITY \_\_\_\_\_ 1580 µmhos/cm

**CHEMICAL :**

pH \_\_\_\_\_ 7.6 mg/l  
 TOTAL ALKALINITY \_\_\_\_\_ 96  
 PHENOPHTHALEIN \_\_\_\_\_ 0  
 ALKALINITY  
 TOTAL HARDNESS \_\_\_\_\_ 56  
 CALCIUM HARDNESS \_\_\_\_\_ 52  
 MAGNESIUM HARDNESS \_\_\_\_\_ 4  
 IRON \_\_\_\_\_ 0.65  
 FLUORIDE \_\_\_\_\_ 0.10  
 CHLORIDE \_\_\_\_\_ 98.4  
 SULPHATE \_\_\_\_\_ 58  
 NITRATE \_\_\_\_\_ 0.13  
 NITRITE \_\_\_\_\_ 0.12  
 MANGANESE \_\_\_\_\_ 0  
 SODIUM \_\_\_\_\_ 380  
 POTASSIUM \_\_\_\_\_ 72  
 CARBONATE ALKALINITY \_\_\_\_\_ 0  
 BICARBONATE ALKALINITY \_\_\_\_\_ 98  
 AMMONIA \_\_\_\_\_ 1.04

HYDROGEN SULFIDE GAS \_\_\_\_\_  
 NEGATIVE ON LEAD  
 ACETATE PAPER

LWUA - JICA WELL NO: 14 OWNER'S NO : 436061 LOCATION : NAGULAYAN , BINMALEY GROUND ELEVATION : WELL DEPTH : 130 m CASING DEPTH : 130 m CASING DIAMETER : 100mm STATIC WATER LEVEL : 2.1m bgl DISCHARGE : 0.6 ips SPECIFIC CAPACITY : 0.23 ips/m TRANSMISSIVITY :		STRATA DESCRIPTION SANDY CLAY FINE SAND BLUE STICKY CLAY YELLOW STICKY CLAY FINE SAND QUICKSAND BLUE SANDY CLAY BLUE CLAY QUICKSAND YELLOW CLAY FINE SAND GRAY CLAY & F. SAND GRAY CLAY BROWN CLAY BLUE CLAY	WELL DESIGN 	DEPTH (m) 20 40 60 80 100 120 140
--	--	---	-----------------	--

LWUA - JICA WELL NO: 16 OWNER'S NO: 7968 LOCATION :CALOOCAN NORTE ,BINMALEY GROUND ELEVATION : WELL DEPTH : 174 m CASING DEPTH : CASING DIAMETER : STATIC WATER LEVEL : 2.1m bgl DISCHARGE : 0.13 ips SPECIFIC CAPACITY : 0.02 ips /m TRANSMISSIVITY :		STRATA DESCRIPTION FINE SAND SAND FINE SAND FINE SAND AND BROWN SANDY CLAY BROWN HARD CLAY BROWN CLAY BLUE SANDY CLAY BROWN HARD CLAY BLUE CLAY FINE SAND HARD BLUE CLAY SANDSTONE FINE SAND	WELL DESIGN 	DEPTH (m) 20 40 60 80 100 120 140 160 180
--	--	---	-----------------	--

LWUA - JICA WELL NO : 18 OWNER'S NO : 12639 LOCATION :LINOC WEST, BINMALEY GROUND ELEVATION : WELL DEPTH : 117 m CASING DEPTH : 114 m CASING DIAMETER : 100 mm STATIC WATER LEVEL : 1.2 m bgl DISCHARGE : 0.95 ips SPECIFIC CAPACITY : TRANSMISSIVITY :		STRATA DESCRIPTION FINE SAND QUICKSAND SANDY CLAY BLUE STICKY CLAY SAND BLUE STICKY CLAY YELLOW STICKY CLAY TUFFACEOUS CLAY QUICKSAND TUFFACEOUS CLAY CLAY SAND CLAY SAND AND GRAVEL	WELL DESIGN 	DEPTH (m) 20 40 60 80 100 120
---	--	--	-----------------	---

LWUA - JICA WELL NO: 20 OWNER'S NO : 7831 LOCATION : CALOOCAN SUR, BINMALEY GROUND ELEVATION : WELL DEPTH : 258 m CASING DEPTH : CASING DIAMETER : STATIC WATER LEVEL : DISCHARGE : SPECIFIC CAPACITY : TRANSMISSIVITY :		STRATA DESCRIPTION SAND CLAY SAND CLAY SAND CLAY SAND CLAY SAND CLAY SAND	WELL DESIGN 	DEPTH (m) 20 40 60 80 100 120 140 160 180 200 220 240 260
--	--	--	-----------------	--

6.6.1.2  
WELL LITHOLOGIC LOGS


<p>LWUA - JICA WELL NO: 22.          OWNER'S NO : 20491          LOCATION : PARAYAO , BINMALEY          GROUND ELEVATION :          WELL DEPTH : 90m          CASING DEPTH : 17 / 73m          CASING DIAMETER : 100 / 63mm          STATIC WATER LEVEL : 1.2m bgj          DISCHARGE : 0.63 lps          SPECIFIC CAPACITY : 0.2 lps/m          TRANSMISSIVITY :</p>		<p>DEPTH (m)</p> <p>20</p> <p>40</p> <p>60</p> <p>80</p> <p>100</p>	<p>WELL DESIGN</p>	<p>STRATA DESCRIPTION</p> <p>YELLOW CLAY</p> <p>QUICKSAND</p> <p>BLUE CLAY</p> <p>TUFFACEOUS CLAY</p> <p>QUICKSAND</p> <p>FINE SAND</p> <p>QUICKSAND</p> <p>BLUE CLAY</p> <p>TUFFACEOUS CLAY SAND WITH SHELL</p> <p>TUFFACEOUS CLAY</p> <p>SAND AND GRAVEL</p>
---	--	---	--------------------	--

<p>LWUA - JICA WELL NO : 25          OWNER'S NO : 5933          LOCATION :          GROUND ELEVATION :          WELL DEPTH : 143.3m          CASING DEPTH :          CASING DIAMETER : 100mm          STATIC WATER LEVEL :          DISCHARGE :          SPECIFIC CAPACITY :          TRANSMISSIVITY :</p>		<p>DEPTH (m)</p> <p>20</p> <p>40</p> <p>60</p> <p>80</p> <p>100</p> <p>120</p> <p>140</p>	<p>WELL DESIGN</p>	<p>STRATA DESCRIPTION</p> <p>CLAY</p> <p>SAND</p> <p>CLAY</p> <p>SAND</p> <p>CLAY</p> <p>SAND</p> <p>CLAY</p> <p>SAND</p>
--	--	---	--------------------	---

<p>LWUA - JICA WELL NO: 28          OWNER'S NO: 5183          LOCATION: PANTAL WEST, DAGUPAN CITY          GROUND ELEVATION :          WELL DEPTH : 189 m          CASING DEPTH :          CASING DIAMETER :          STATIC WATER LEVEL :          DISCHARGE :          SPECIFIC CAPACITY :          TRANSMISSIVITY :</p>		<p>DEPTH (m)</p> <p>20</p> <p>40</p> <p>60</p> <p>80</p> <p>100</p> <p>120</p> <p>140</p> <p>160</p> <p>180</p> <p>200</p>	<p>WELL DESIGN</p>	<p>STRATA DESCRIPTION</p> <p>CLAY</p> <p>SAND</p> <p>CLAY</p> <p>CLAY AND GRAVEL</p> <p>SAND</p> <p>CLAY</p> <p>SAND</p> <p>CLAY</p> <p>SAND</p> <p>CLAY</p> <p>SAND</p> <p>SAND AND GRAVEL</p>
--	--	--	--------------------	---

<p>LWUA - JICA WELL NO: 54          OWNER'S NO : 5517          LOCATION : BONGAN BOQUIG, DAGUPAN CITY          GROUND ELEVATION :          WELL DEPTH : 210 m          CASING DEPTH :          CASING DIAMETER :          STATIC WATER LEVEL :          DISCHARGE :          SPECIFIC CAPACITY :          TRANSMISSIVITY :</p>		<p>DEPTH (m)</p> <p>20</p> <p>40</p> <p>60</p> <p>80</p> <p>100</p> <p>120</p> <p>140</p> <p>160</p> <p>180</p> <p>200</p>	<p>WELL DESIGN</p>	<p>STRATA DESCRIPTION</p> <p>SAND</p> <p>CLAY</p> <p>BLACK CLAY</p> <p>CLAYEY SAND</p> <p>CLAY</p> <p>SAND</p> <p>SAND AND GRAVEL</p> <p>CLAY</p> <p>LOOSE SAND</p> <p>CLAY</p> <p>CLAY WITH SAND</p> <p>TUFFACEOUS CLAY</p> <p>SAND</p> <p>CLAY</p> <p>SAND</p> <p>CLAY</p> <p>SAND</p>
--	--	--	--------------------	--

6.6.1.2  
 WELL LITHOLOGIC LOGS

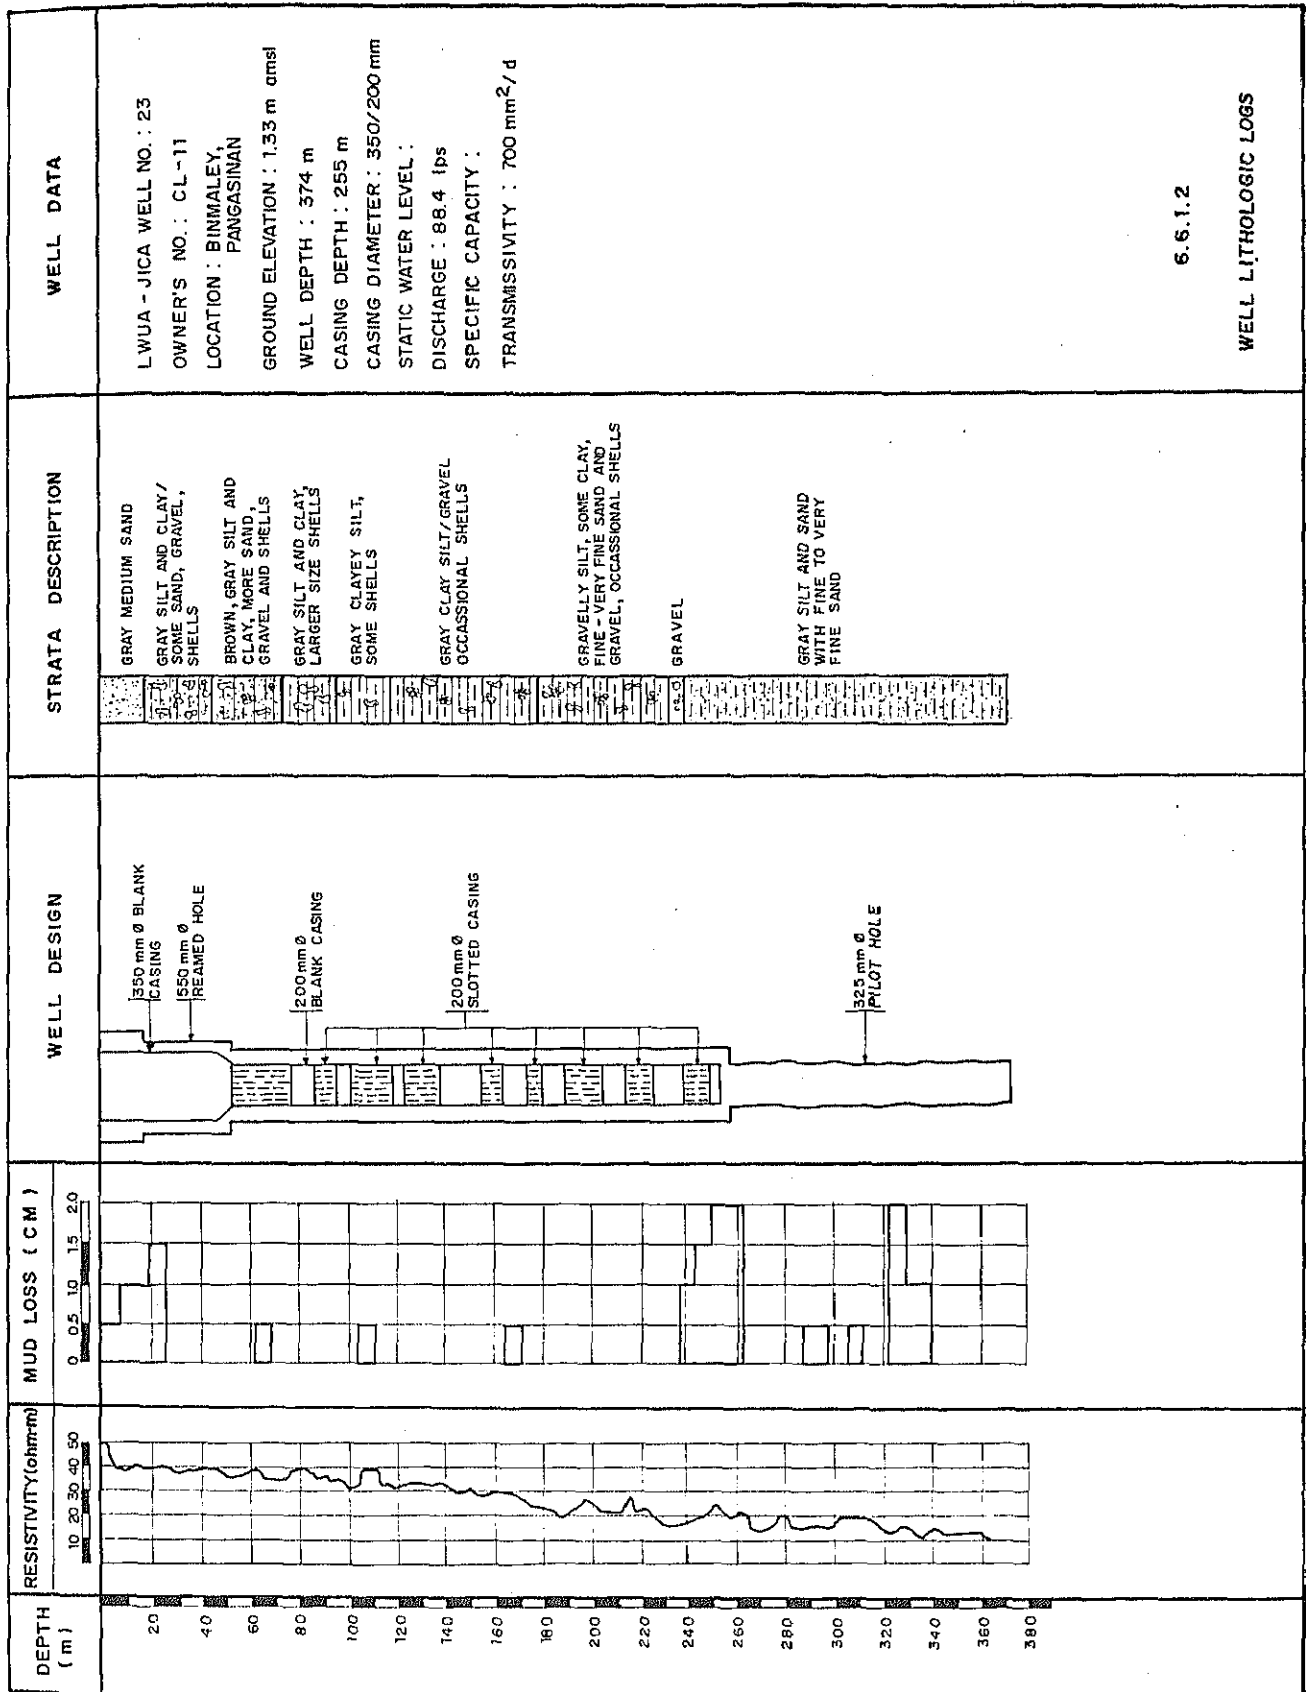


6.5.1.2

WELL LITHOLOGIC LOGS

DEPTH (m)	WELL DESIGN	STRATA DESCRIPTION
20		CLAY
20		SAND
40		CLAY
60		GRAVEL
60		CLAY
80		SAND
100		CLAY
120		SAND
140		CLAY
160		SAND
160		CLAY
160		SAND
180		SAND & GRAVEL
<p>LWUA - JICA WELL NO. : 56  OWNER'S NO. : 5128  LOCATION : DAGUPAN CITY  GROUND ELEVATION :  WELL DEPTH : 173 m  CASING DEPTH :  CASING DIAMETER :  STATIC WATER LEVEL :  DISCHARGE :  SPECIFIC CAPACITY :  TRANSMISSIVITY :</p>		
20		BROWN SANDY CLAY
20		YELLOW SANDY CLAY
40		BLUE SAND
40		BLUE STICKY CLAY
60		BROWN STICKY CLAY
60		YELLOW SANDY CLAY
80		BROWN SANDY CLAY
120		BLUE STICKY CLAY
140		BLUE SAND
150		
<p>LWUA - JICA WELL NO. : 70  OWNER'S NO. : 5366  LOCATION : BOLINGUIT, SAN CARLOS CITY  GROUND ELEVATION :  WELL DEPTH : 142 m  CASING DEPTH :  CASING DIAMETER :  STATIC WATER LEVEL :  DISCHARGE :  SPECIFIC CAPACITY :  TRANSMISSIVITY :</p>		
20		SANDY CLAY
40		TUFF
60		STICKY CLAY SAND WITH GRAVEL
80		
100		
120		
140		
160		
180		
<p>LWUA - JICA WELL NO. : 71  OWNER'S NO. : 10795  LOCATION : MALABAGO, CALASIAO  GROUND ELEVATION :  WELL DEPTH : 70 m  CASING DEPTH : 24/46 m  CASING DIAMETER : 150/113 mm  STATIC WATER LEVEL :  DISCHARGE :  SPECIFIC CAPACITY :  TRANSMISSIVITY :</p>		
10		YELLOW CLAY
20		CORAL ROCK
20		BLUE STICKY CLAY
30		YELLOW STICKY CLAY
40		QUICKSAND
50		
60		
70		
80		
<p>LWUA - JICA WELL NO. : 81  OWNER'S NO. : 43-60-81  LOCATION : PASIMA, MALASIQUI  GROUND ELEVATION :  WELL DEPTH : 46 m  CASING DEPTH : 34 m  CASING DIAMETER : 100 mm  STATIC WATER LEVEL : 4.60 m bgl  DISCHARGE : 0.63 lps  SPECIFIC CAPACITY : 0.21 lps/m  TRANSMISSIVITY :</p>		


6.6.1.2  
WELL LITHOLOGIC LOGS




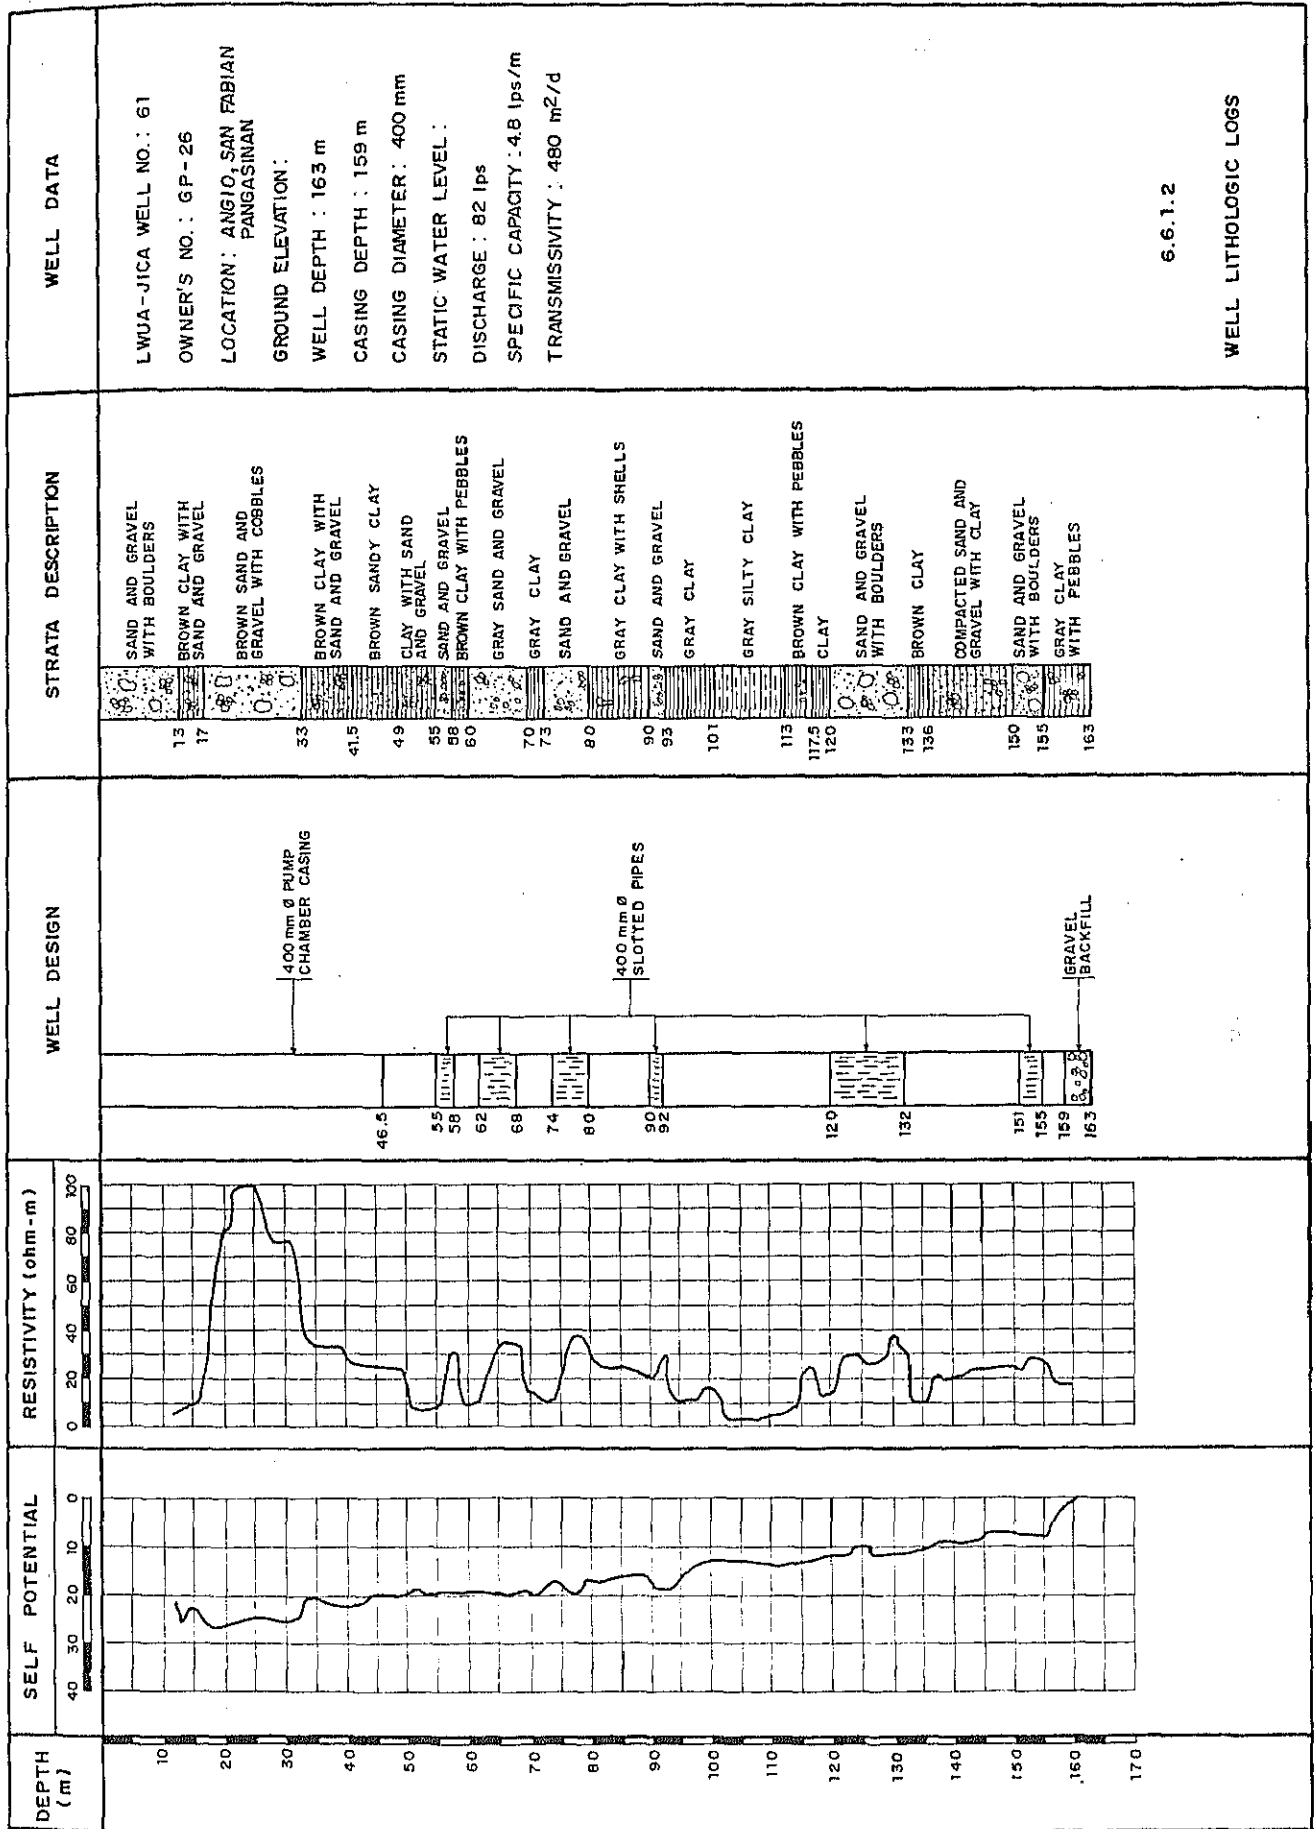





6.6.1.2

WELL LITHOLOGIC LOGS

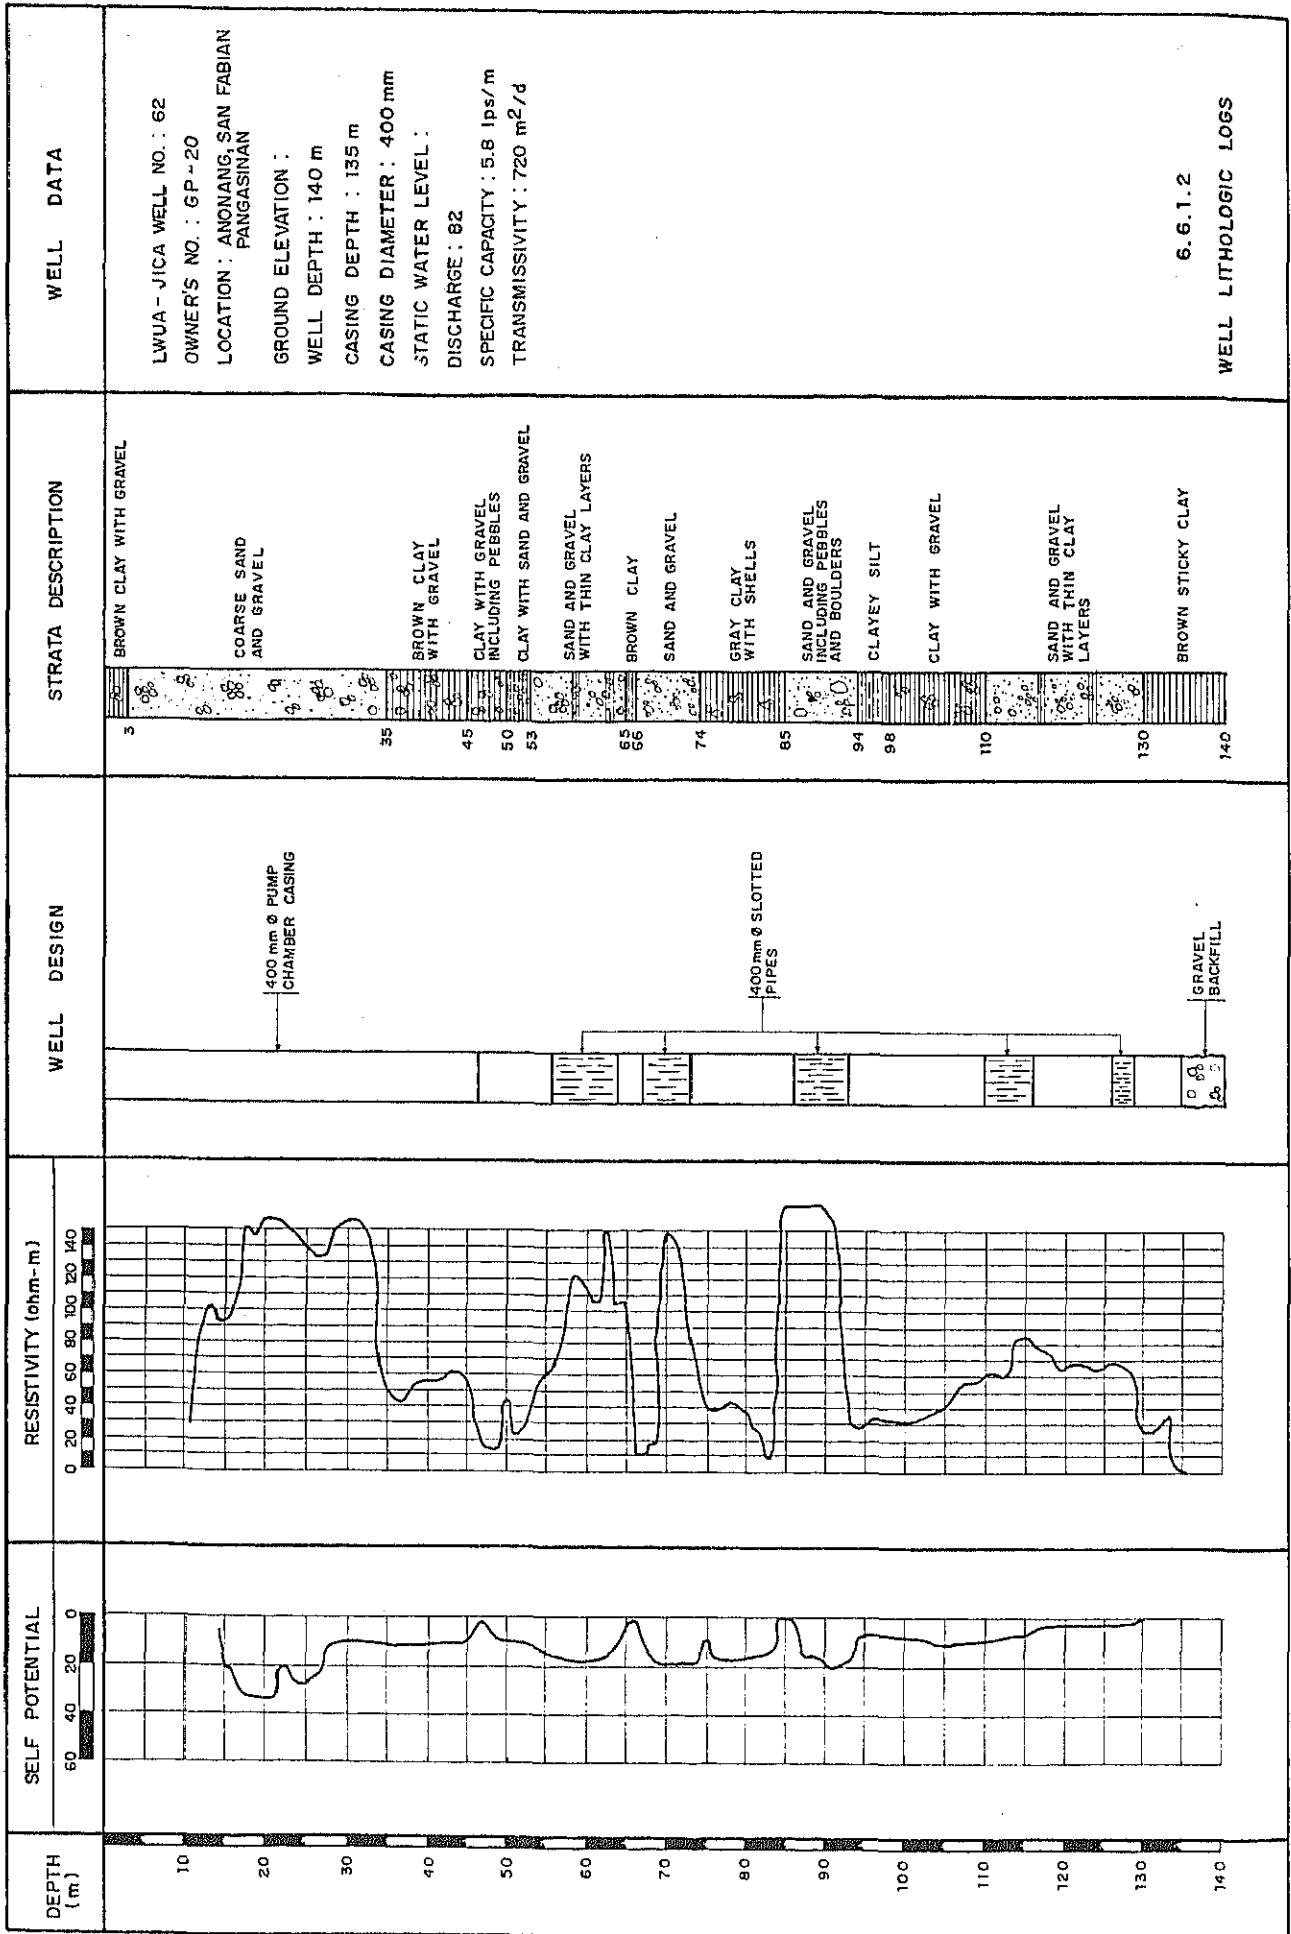


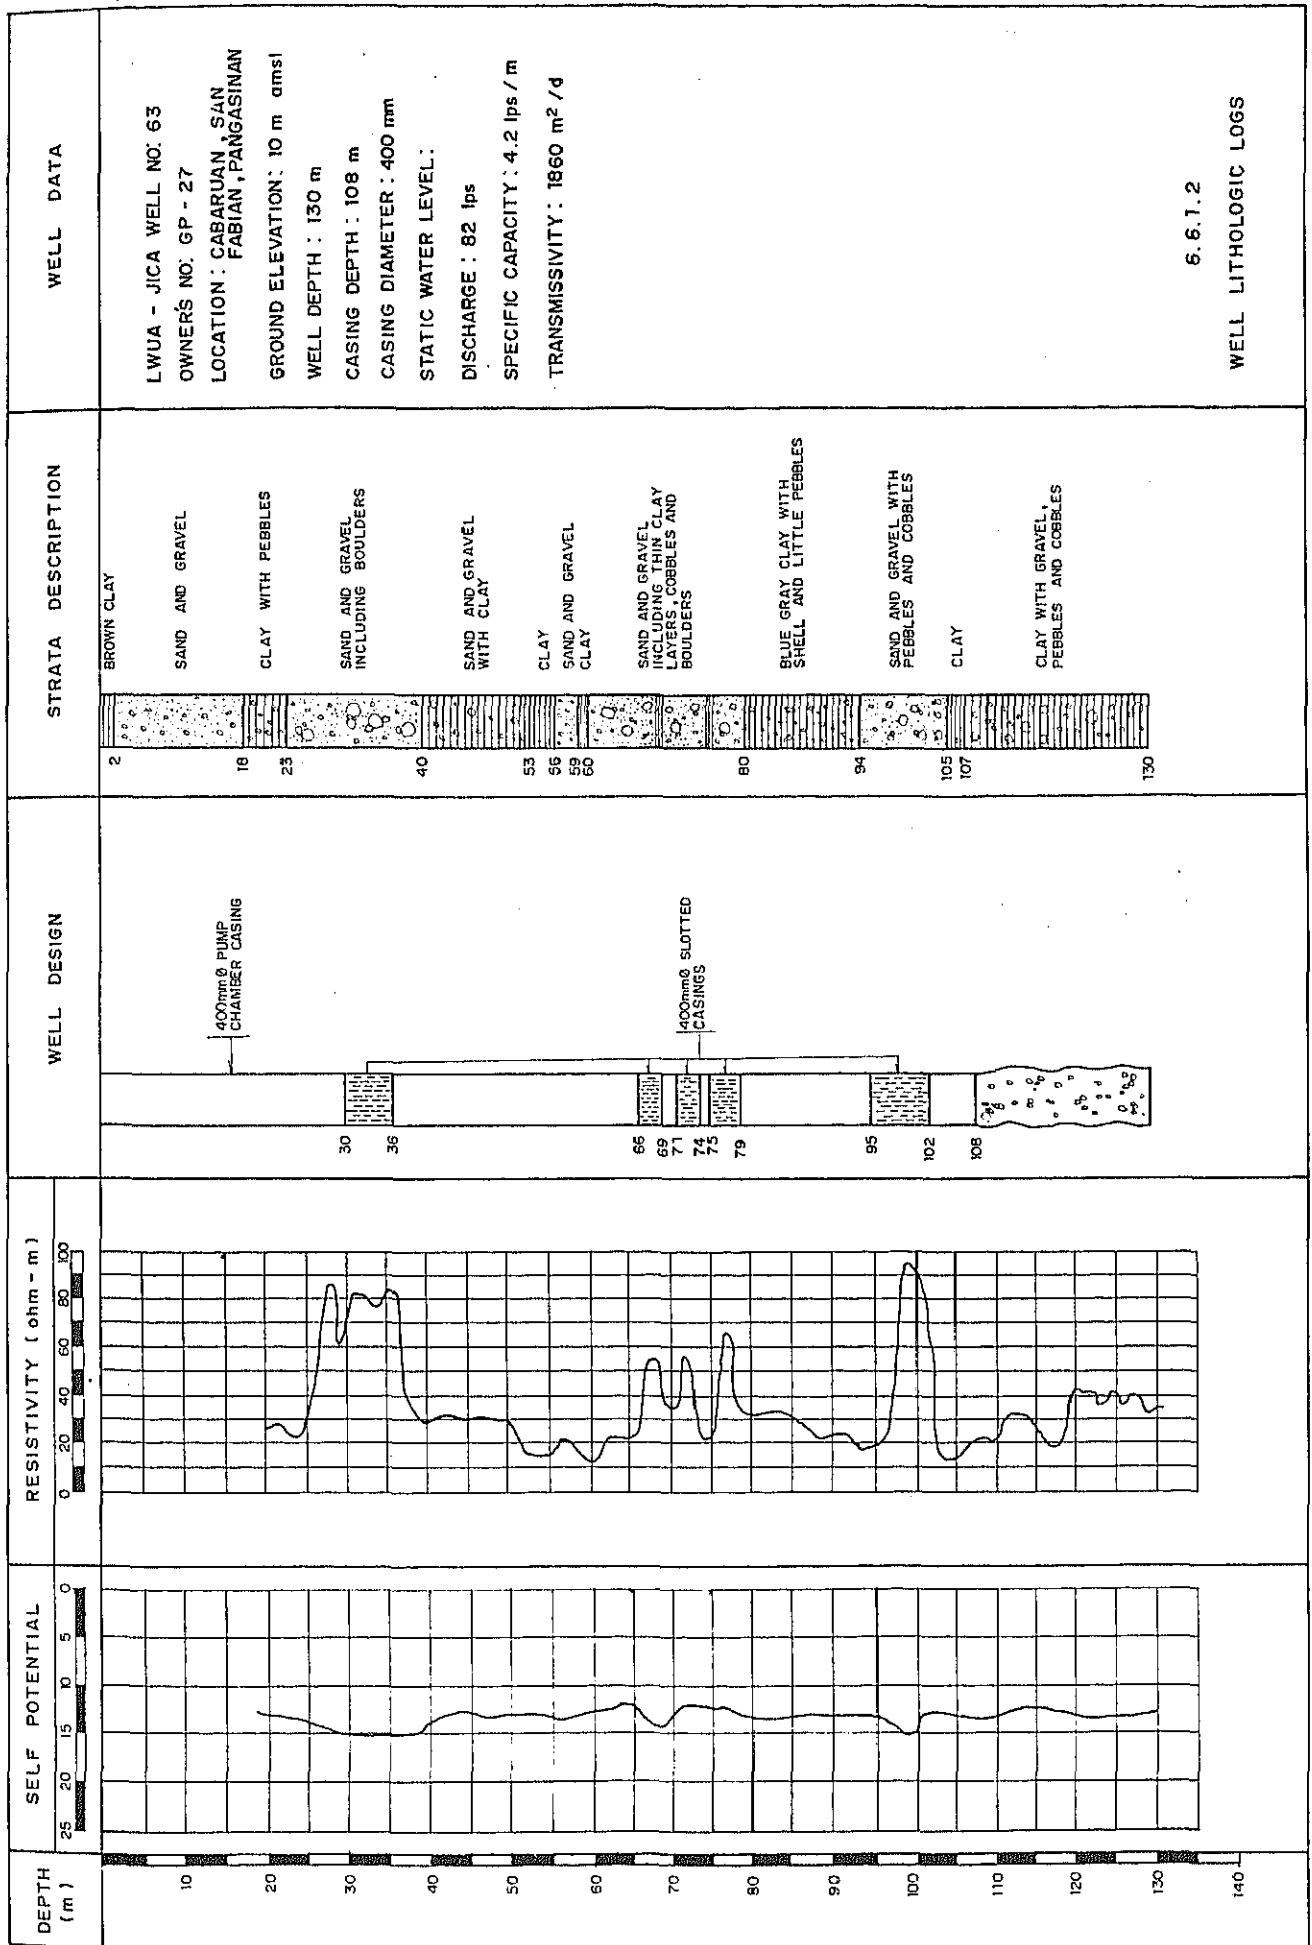

6.6.1.2  
WELL LITHOLOGIC LOGS

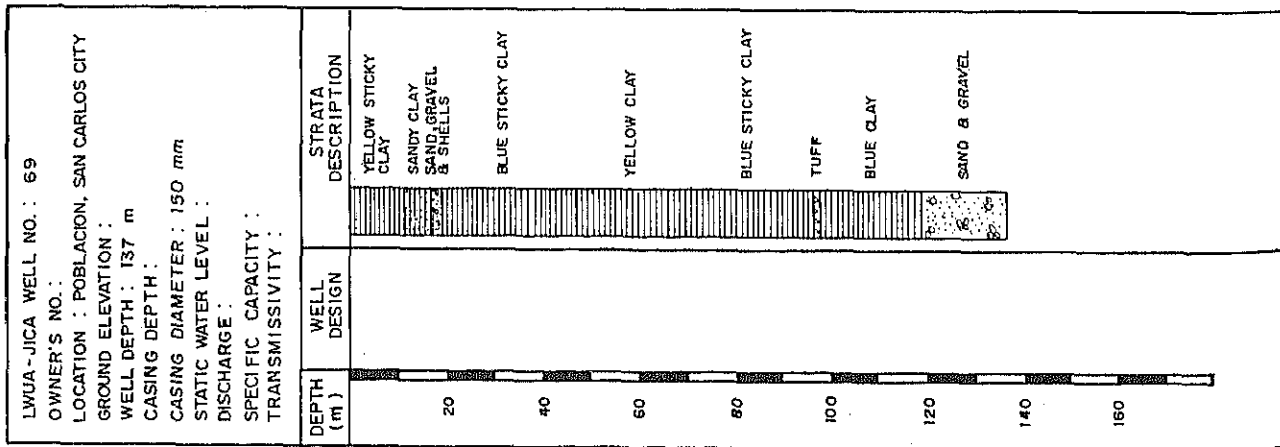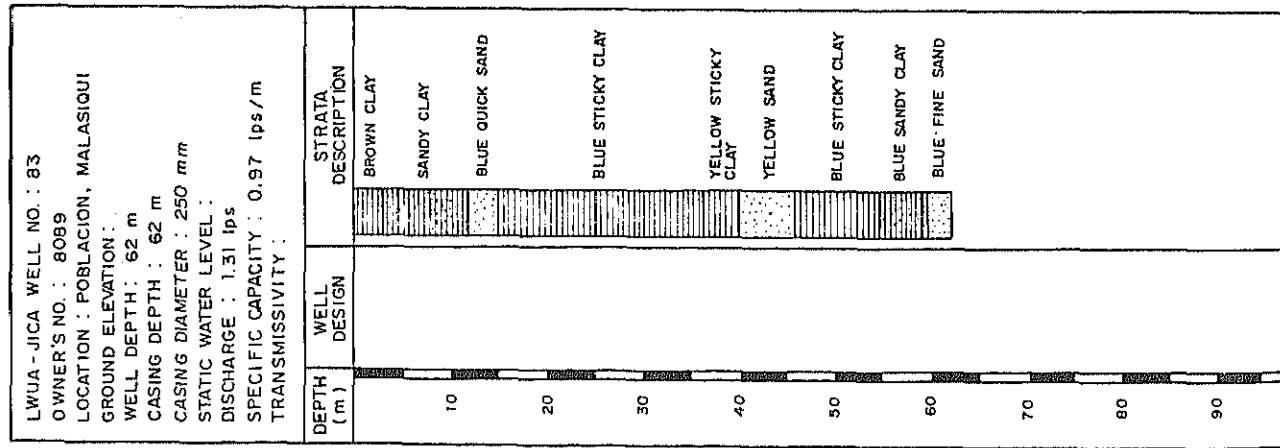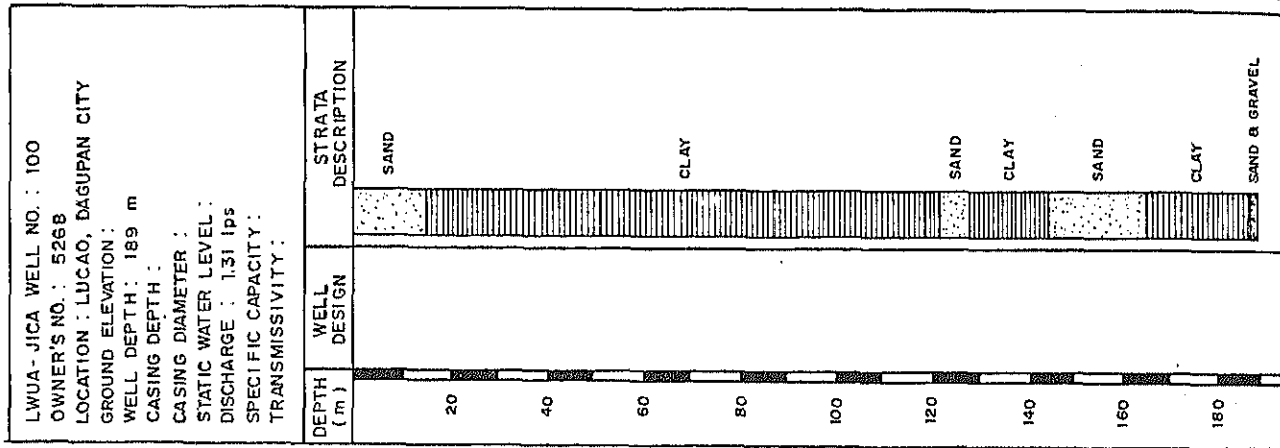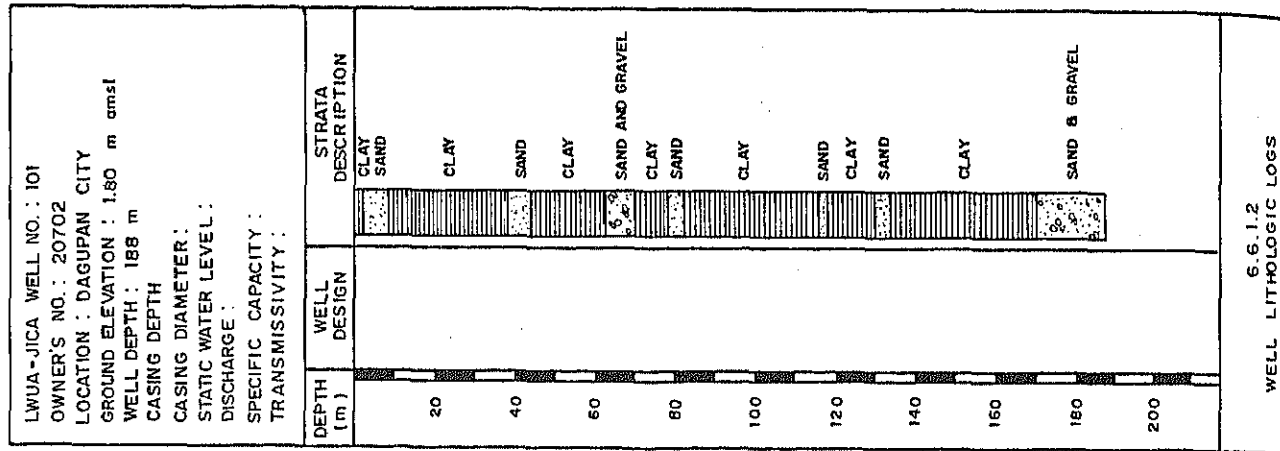


6.6.1.2  
 WELL LITHOLOGIC LOGS

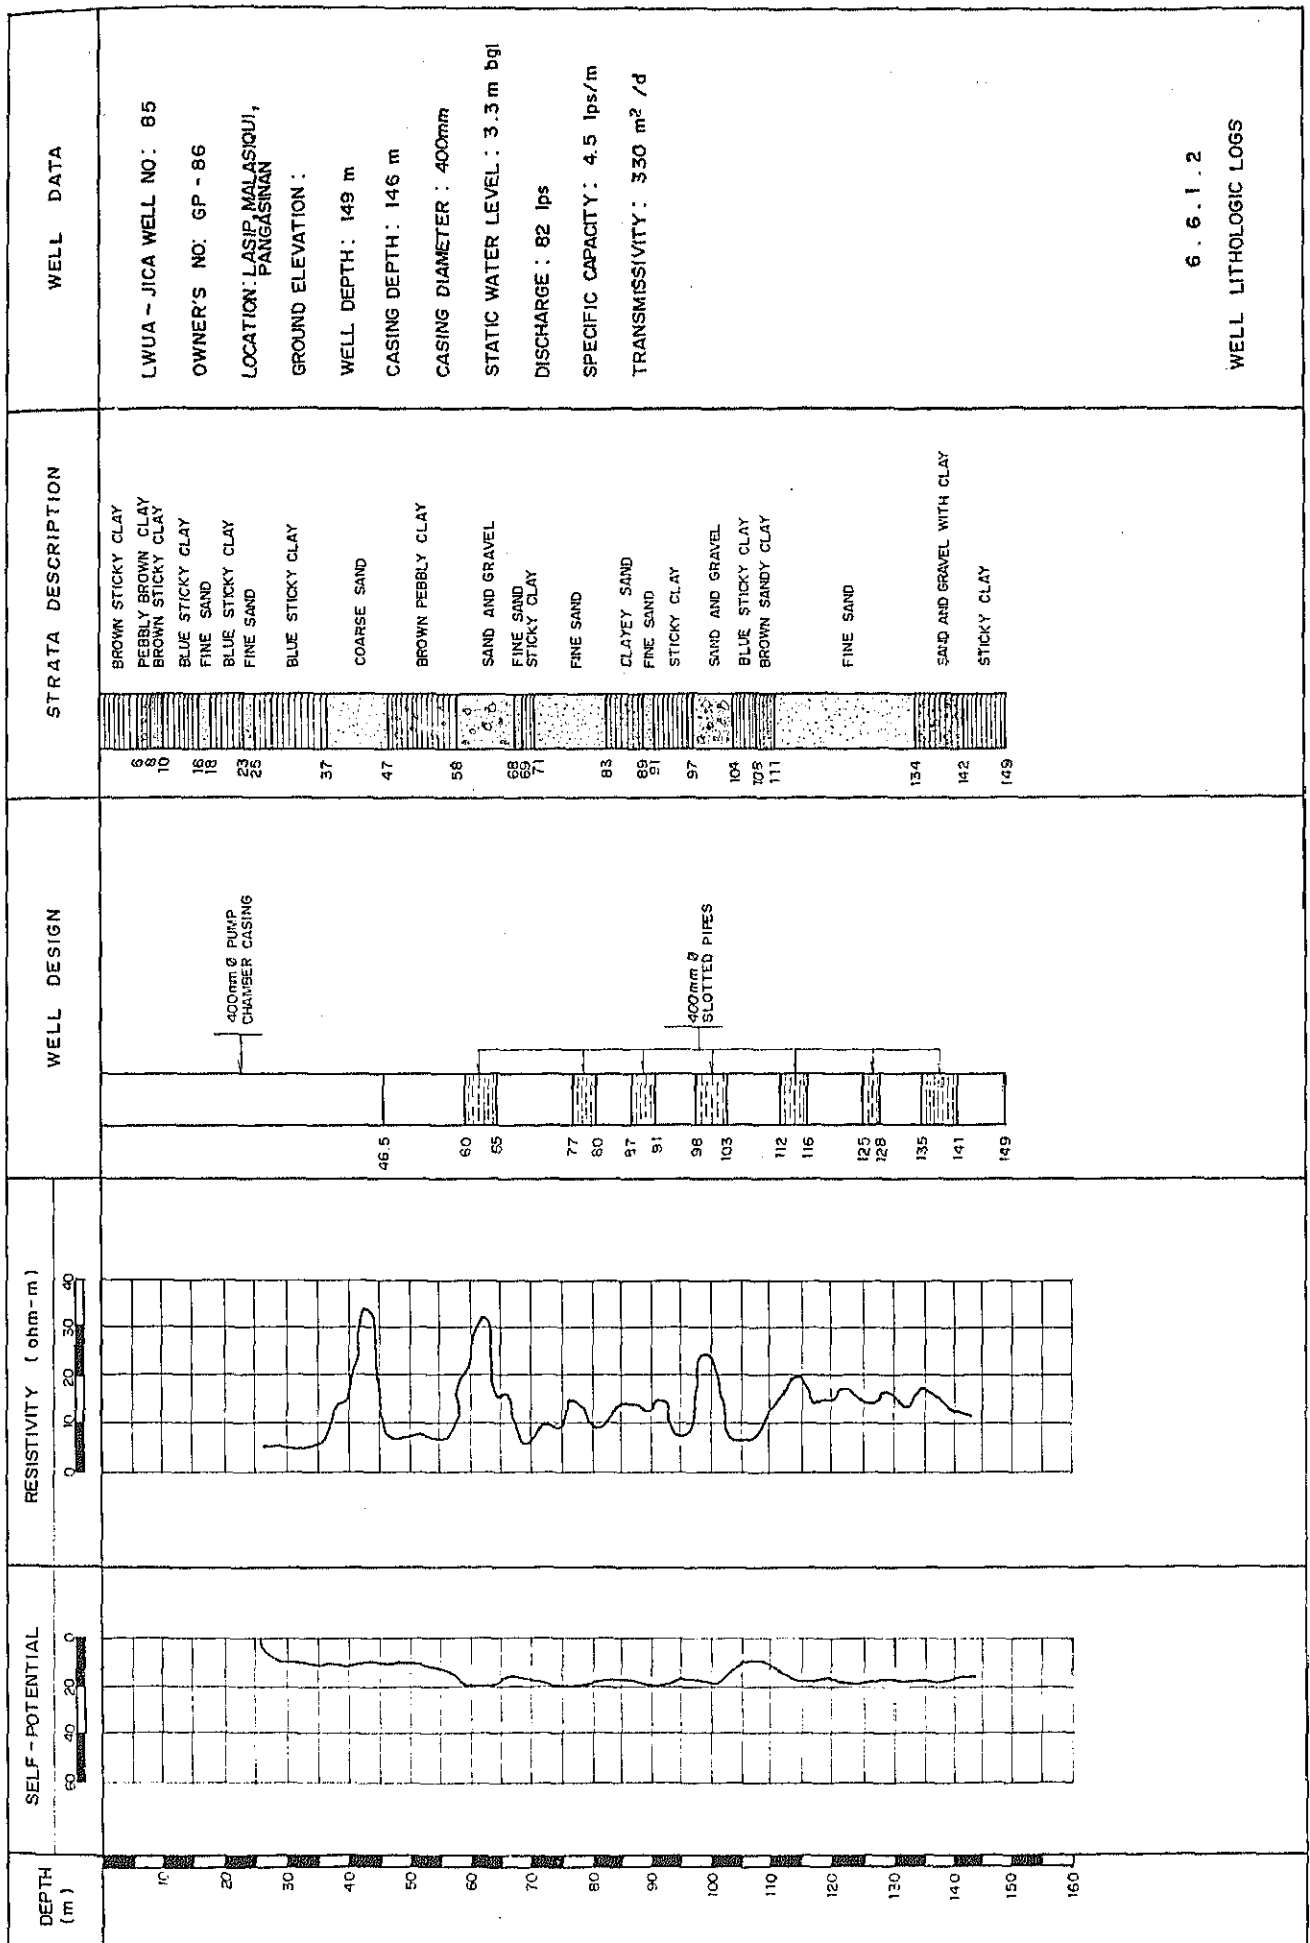


6.6.1.2


WELL LITHOLOGIC LOGS

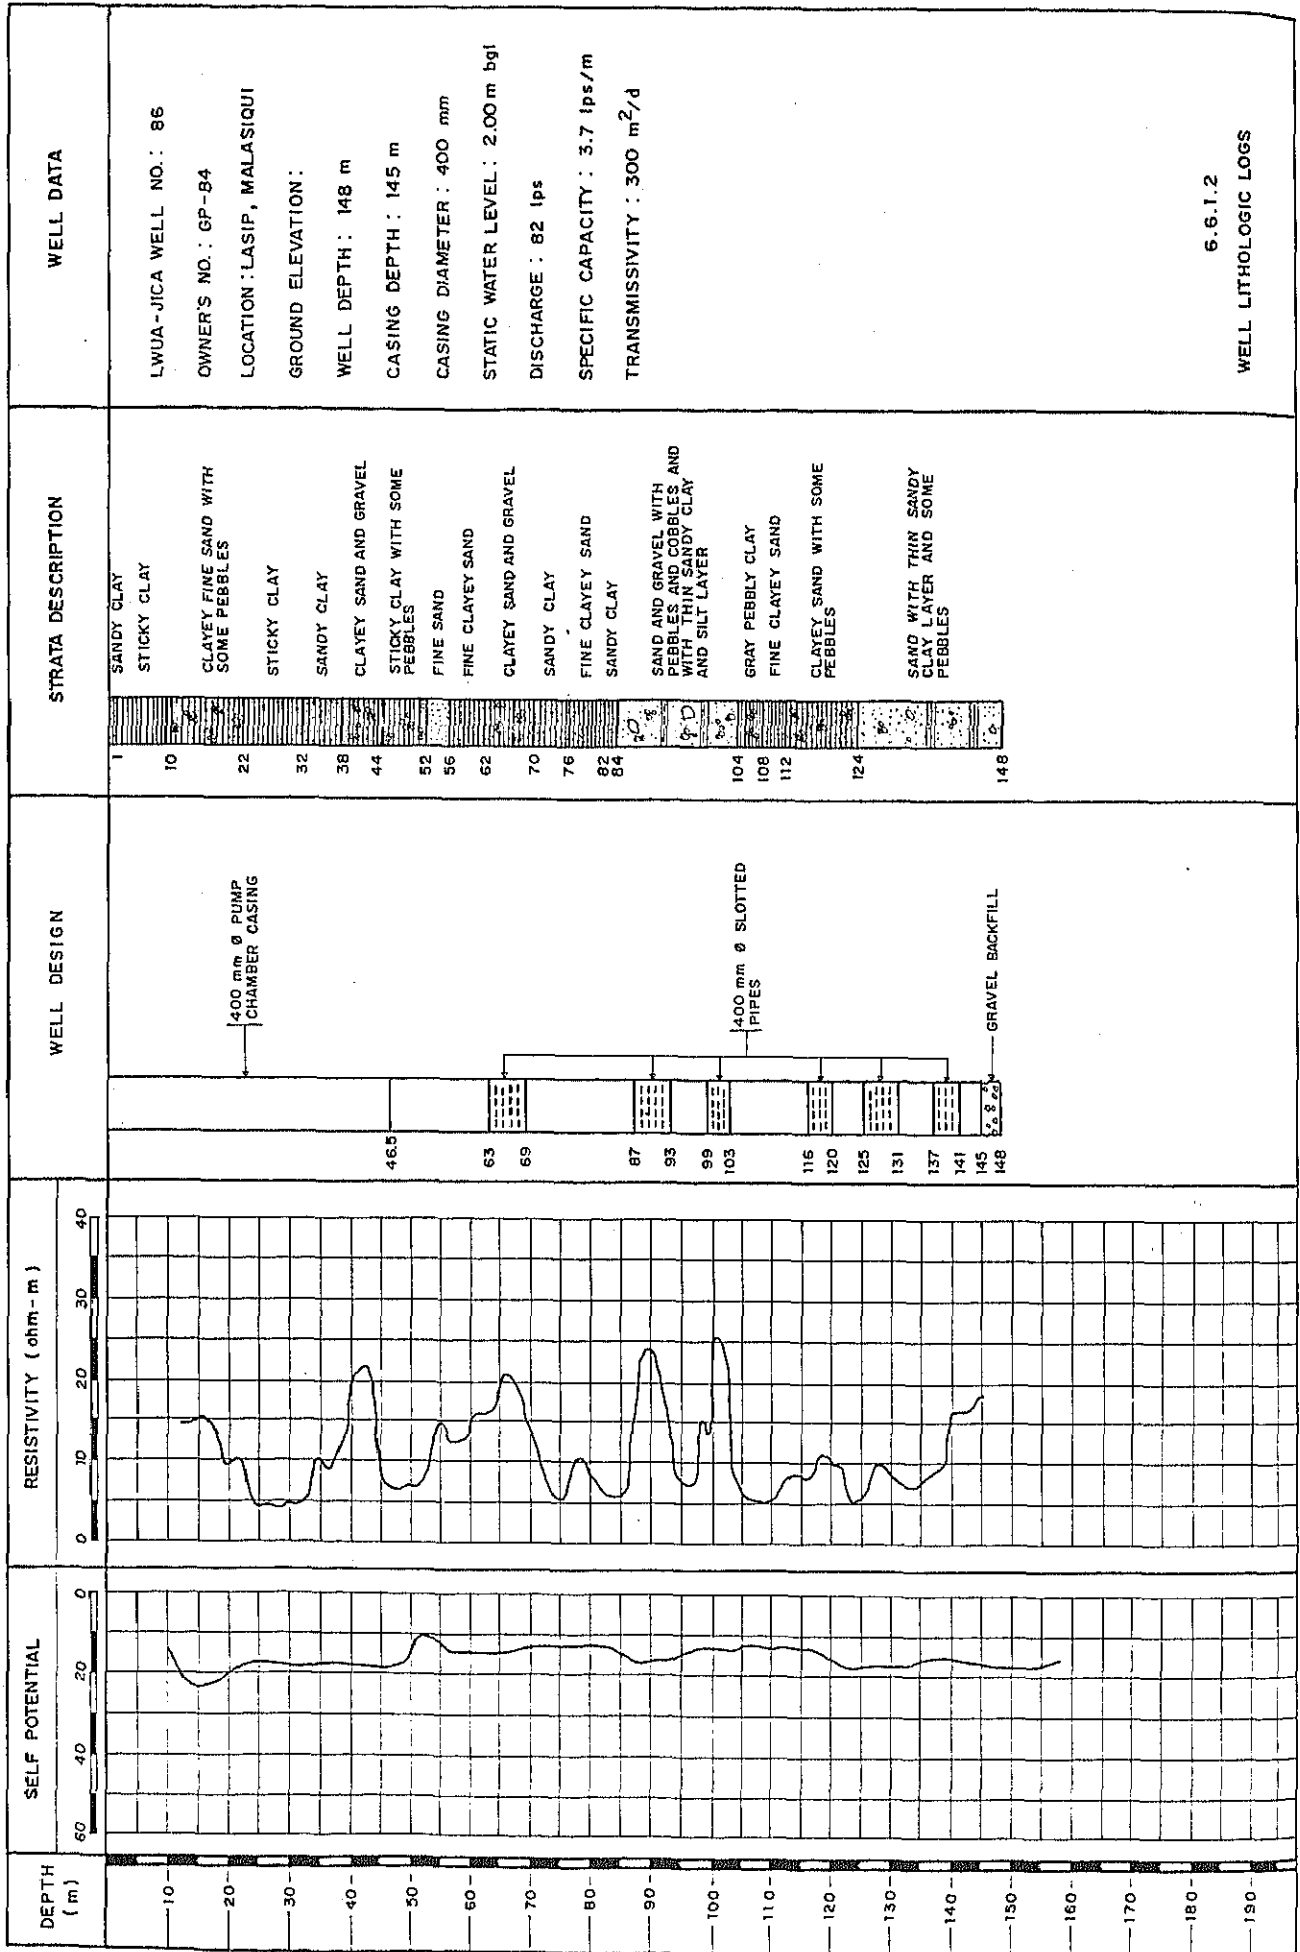

6.6.1.2  
WELL LITHOLOGIC LOGS

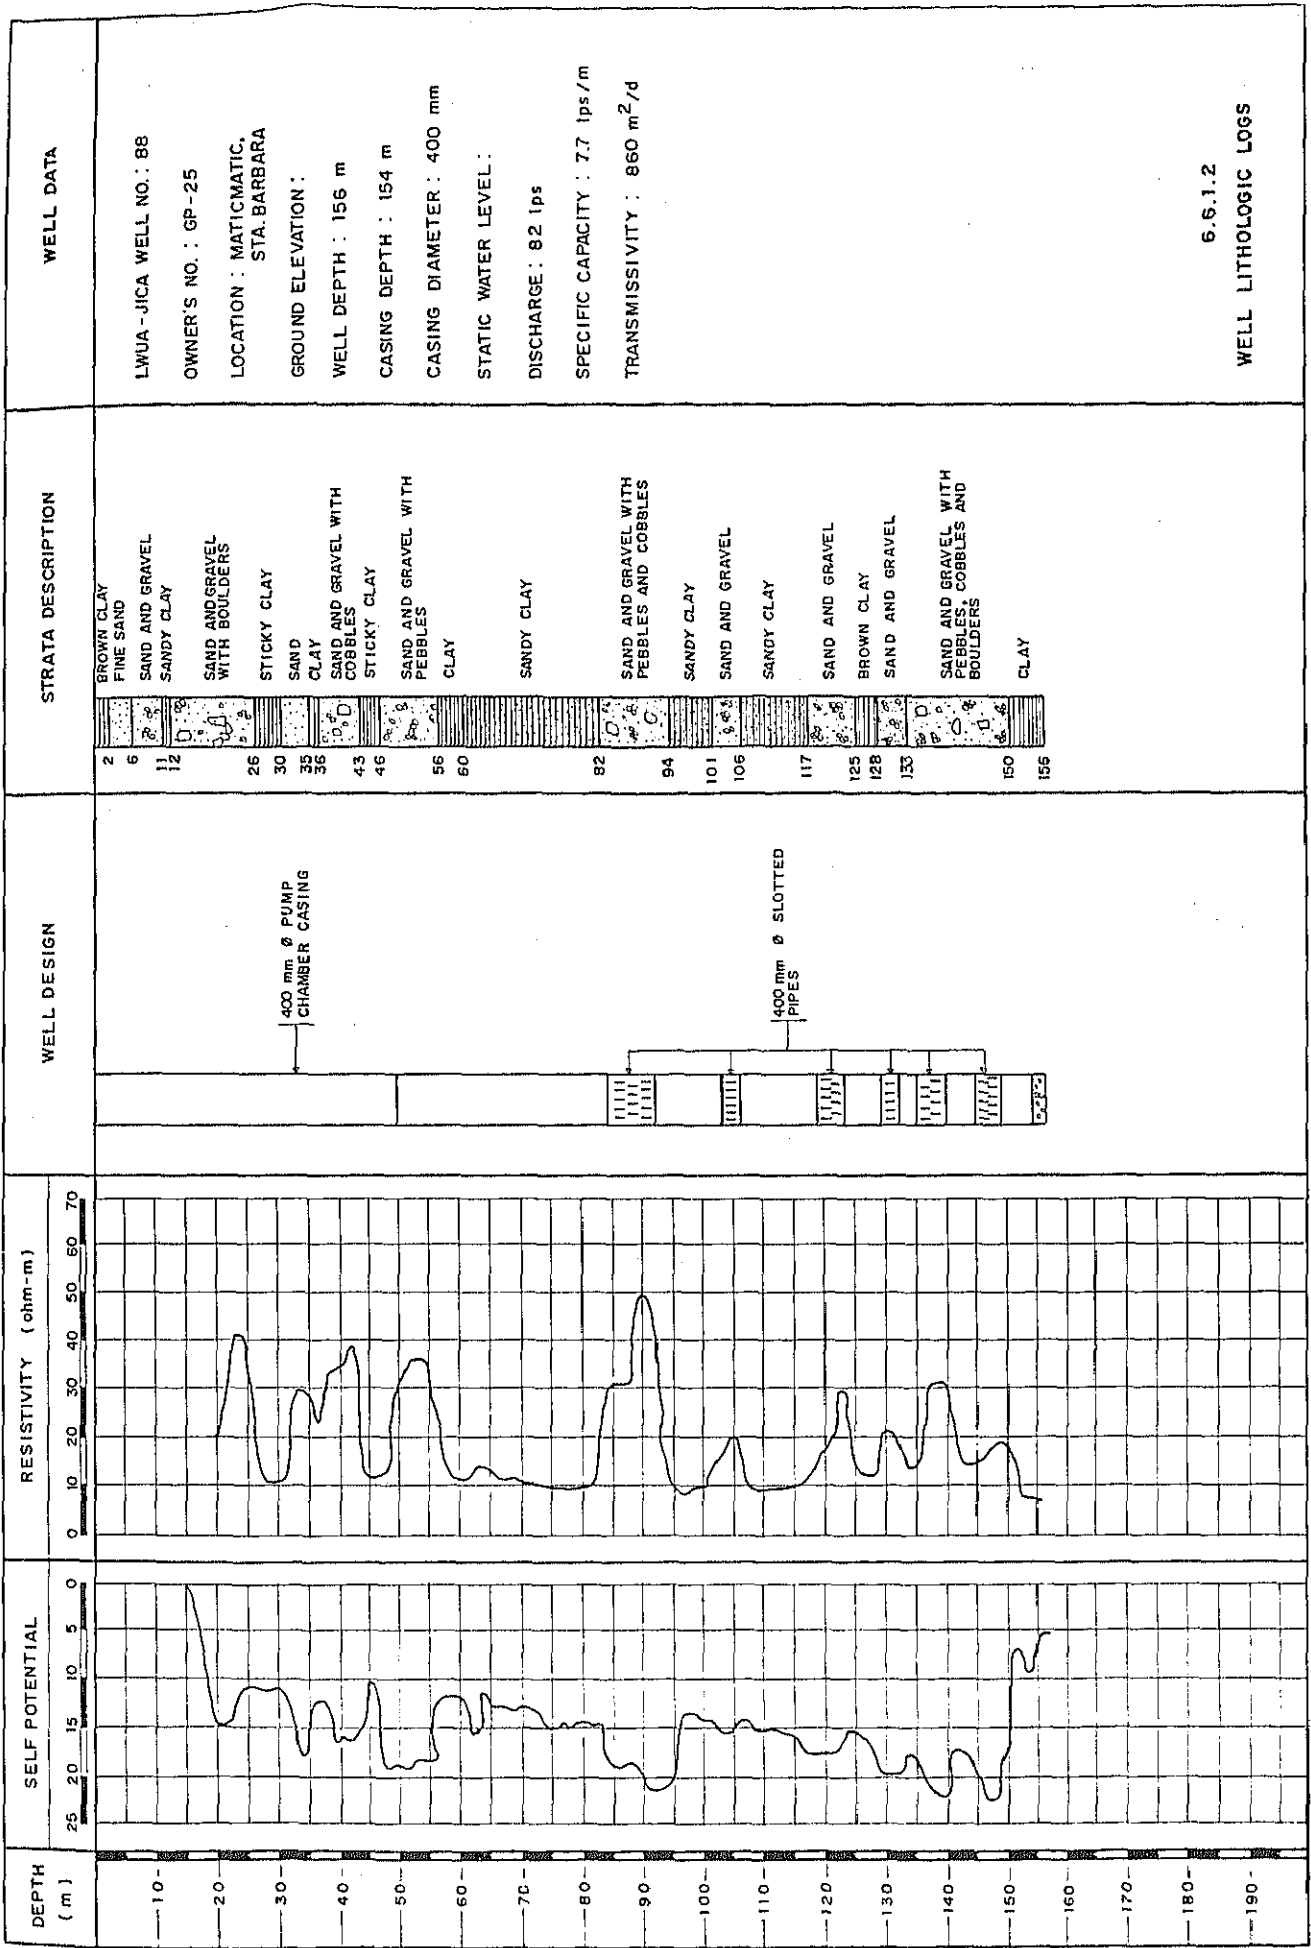


6.6.1.2  
WELL LITHOLOGIC LOGS

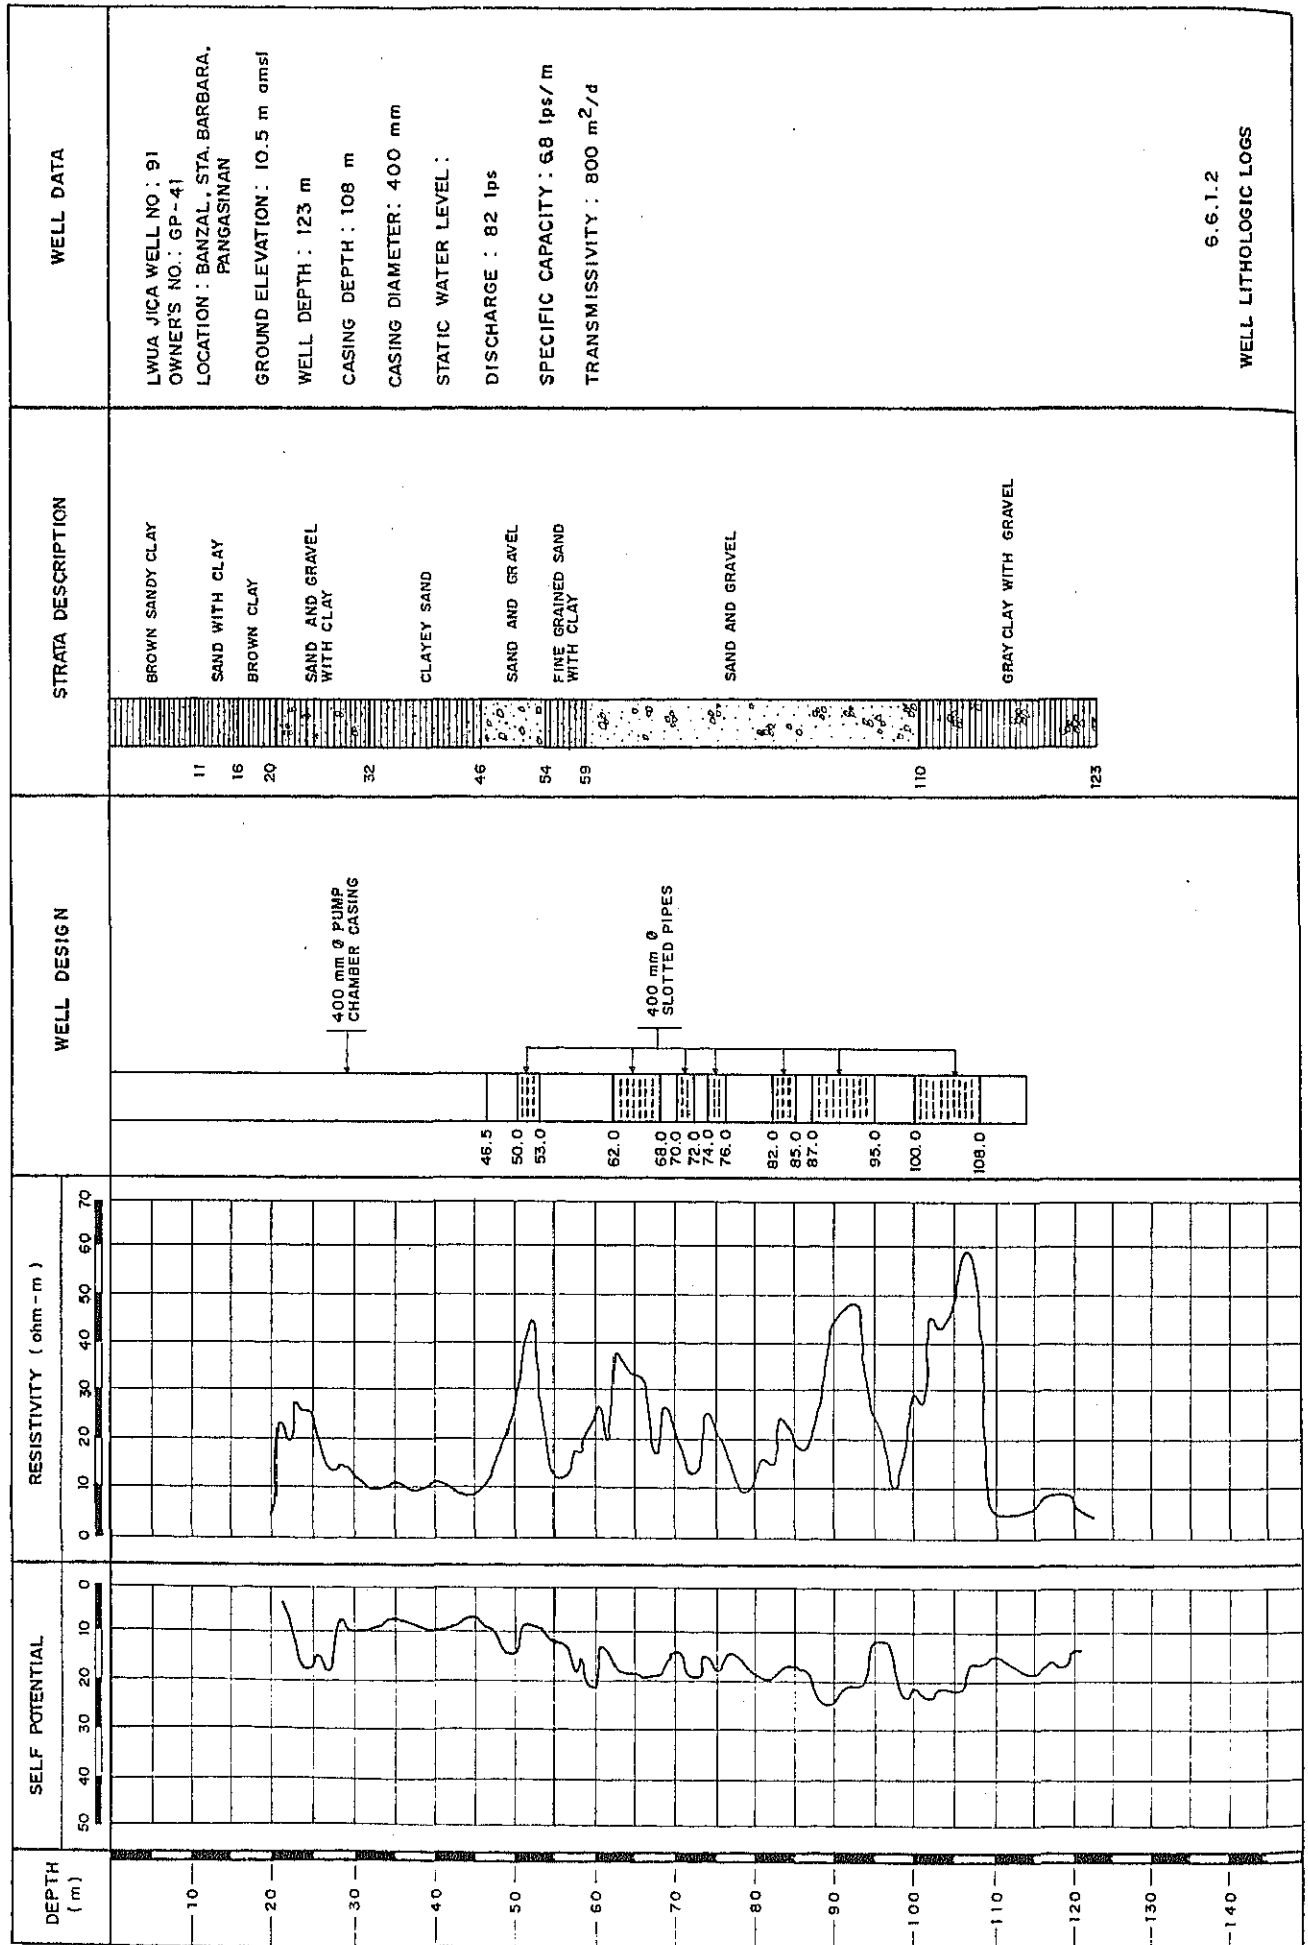

6.6.1.2  
WELL LITHOLOGIC LOGS



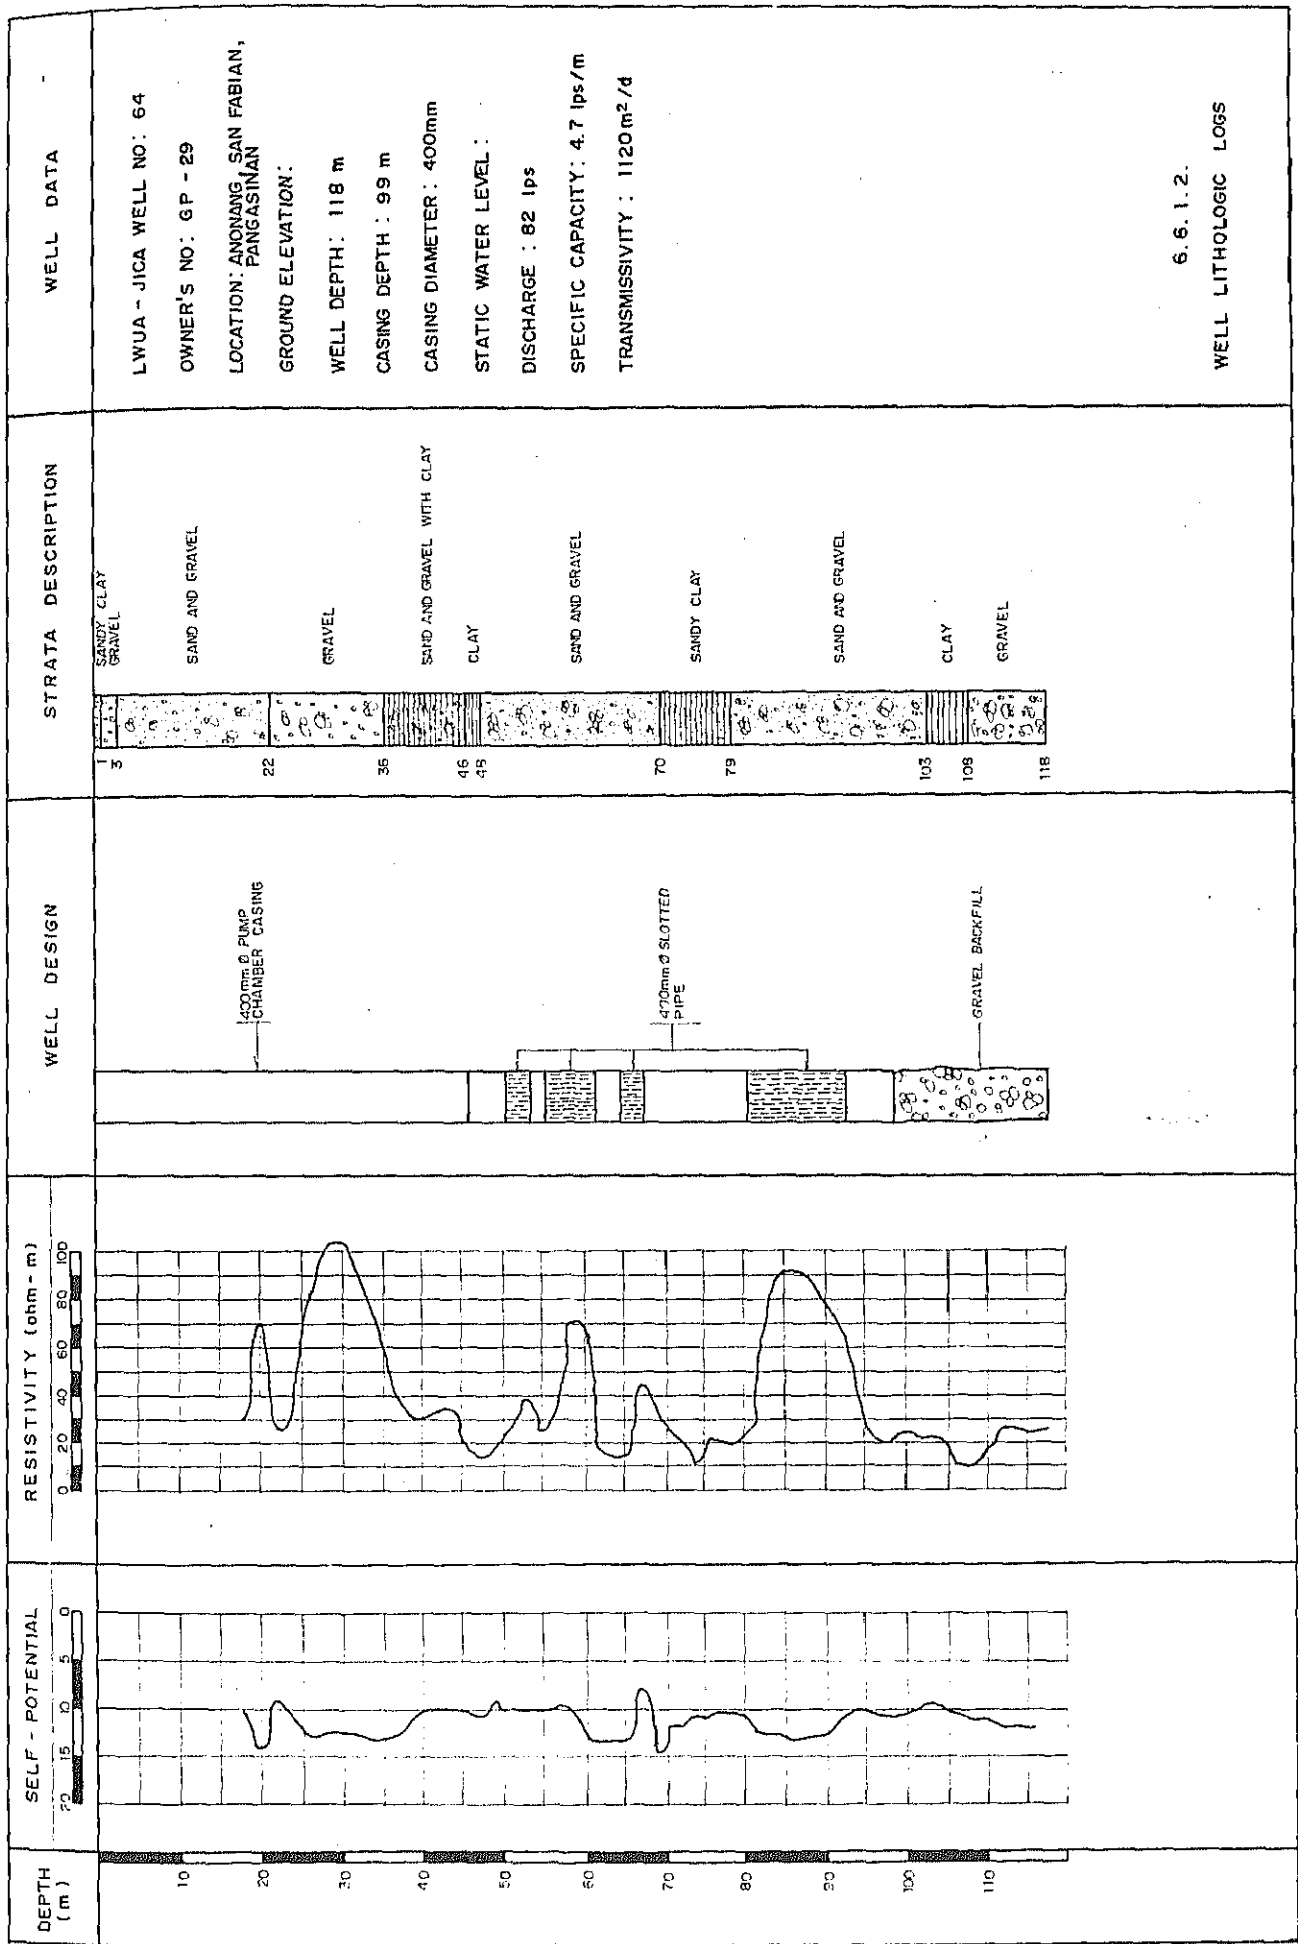

#### APPENDIX 6.6.2.1 GEORESISTIVITY SURVEY

A surface georesistivity survey was performed at the alluvial plains encompassing the municipalities of Binmaley, Calasiao, Sta. Barbara, Mangaldan and Dagupan City. The investigation was aimed to explore the stratigraphic sequence of the different lithological units in terms of resistivity and thickness; to define the extent of saline water intrusion into the shallow aquifer and to select the most favorable area for groundwater exploitation.

##### 1) Location of Measurements

A total of 37 Vertical Electrical Soundings (VES) including some calibrations were carried out at Cullao, Malanay, Gueguesangan in Sta. Barbara; San Miguel, Ambonao, Calit and Banaoang in Calasiao; Tebeng in Dagupan City; and Amulid in Mangaldan.

##### 2) Fieldwork

Resistivity prospecting involves the passage of an electric current into the ground through a pair of circuit electrodes (AB) and the measurement of the resulting potential drop on the earth's surface between a pair of potential electrodes (MN). The arrangement of measurements was patterned after the Schlumberger configuration with a maximum current electrode separation of 1,800 m.

The impressed current (I) and the resulting potential drop (V) were recorded for consecutive MN/2 and AB/2 separation. The results

were then recorded on the data sheet where the apparent resistivity (Pa) was calculated using the formula below:

$$PA = \frac{(AB/2)^2 - (MN/2)^2}{MN} \frac{AV}{I} \text{ or } Pa = \frac{kV}{I}$$

### 3) Method of Interpretation

The field data gathered were plotted on transparent double log paper with the measured apparent resistivity representing the ordinate and half the current electrode separation as abscissa.

The true layer resistivities and thicknesses were obtained by comparing the field curves with precalculated auxiliary and master curves.

### 4) Equipment

Georesistivity Equipment (GRM 3,000) is powered by dry cells with a maximum output of 270 volts and can read up to 3 amperes. For deeper soundings, it can be powered by a 1500 watt engine generator power supply which can provide either direct or electroring circuit.

### 5) Results of Georesistivity Survey

The interpreted true resistivity values and the corresponding depths of geologic contact are presented in TABLE 6.6.2.1.1 (1) to (4) and were based from field survey graphs.

TABLE 6.6.2.1 (1)  
DEDUCED VALUES OF GEORESISTIVITY SOUNDING MEASUREMENTS  
DAGUPAN CITY

Vertical Electrical Sounding Number	Location	Elevation (mams l)	Resistivity (ohm-m) Depth from Ground Surface (m)	SUB - SURFACE LAYER								
				1	2	3	4	5	6	7		
1	Tullao, Sta. Barbara	6	ρ	17	11	20	9					
			h	17.0	49.3	249.3						
2	Malanay, Sta. Barbara	6	ρ	6	24	17	8					
			h	5.4	24.8	264.8						
3	San Miguel, Calasiao	5	ρ	20	10	16	2					
			h	12.0	61.2	253.2						
4	Tebeng, Dagupan City	5	ρ	15	3	14	3					
			h	9.5	39.9	279.9						
5	Ambonao, Calasiao	5	ρ	10	5	18	10					
			h	9.5	43.7	268.7						
6	Gueguesangen, Sta. Barbara	5	ρ	7	19	11	18	11				
			h	2.6	29.1	120.9	270.9					
7	Calit, Calasiao	5	ρ	410	20	2	13	18				
			h	3.1	10.2	52.7	277.7					
8	Banaoang, Calasiao	5	ρ	31	46	4	11	17				
			h	2.5	12.0	79.2	271.2					
9	Ambonao, Calasiao	5	ρ	4	6	17	9					
			h	12.7	43.2	268.2						
10	Anulid, Mangaldan	5	ρ	27	9	15	10					
			k	11.0	48.4	273.4						

TABLE 6.6.2.1 (2)  
 DEDUCED VALUES OF GEORESISTIVITY SOUNDING MEASUREMENTS  
 DAGUPAN CITY

VERTICAL ELECTRICAL SOUNDING NUMBER	LOCATION	ELEVATION (m above sea level)	RESISTIVITY ( $\Omega$ -cm)	SUB - SURFACE LAYER								
				1	2	3	4	5	6	7		
11	Caranglaan, Dagupan City	4	h	8	3	12	6					
12	Mangin, Dagupan City	4	h	6	2	15	6					
13	Naguilayan, Bimale	4	h	6.2	34.1	272.1						
14	Gayanan, Bimale	4	h	100	3	0.5	6	38				
15	Lacoo, Dagupan City	4	h	1.6	6.4	32.2	301.9					
16	Malued, Dagupan City	4	h	125	6	0.9	7	28				
17	Taruac, Dagupan City	4	h	2.8	5.9	47.2	314.0					
18	Pogo Lasin, Dagupan City	4	h	50	10	1	6	39				
19	Caranglaan, Dagupan City	4	h	2.9	9.0	57	305.4					
20	Bolosan, Dagupan City	4	h	48	24	2	8	18				
			h	3.1	12.7	60.7	300.7					
			h	37	4	0.8	6	23				
			h	2.2	8.6	37.1	303.5					
			h	14	21	2	5					
			h	2.8	6.2	50.0						
			h	8	5	11	7					
			h	6.8	45.6	275.6						
			h	10	2	12	7					
			h	7.7	32.3	263.3						

TABLE 6.6.2.1 (3)

DEDUCED VALUES OF GEORESISTIVITY SOUNDING MEASUREMENTS

DAGUPAN CITY

VERTICAL ELECTRIC SOUNDING NUMBER	LOCATION	ELEVATION (m o m s l)	RESISTIVITY (ohm m)	SUB - SURFACE LAYER								
				DEPTH FROM GROUND SURFACE (m)	1	2	3	4	5	6	7	
21	Anulida, Mengaldan	4	p	0.6	1.6	11	4					
			h	8.2	39.4	259.4						
22	Anulida, Mengaldan	4	p	8	5	12	7					
			h	13	55.9	258.9						
23	Memalinging, Dagupan City	4	p	0.9	2	8	4					
			h	9.7	33.0	249.0						
24	Massin, Mengaldan	3	p	0.9	2	10	4					
			h	8.5	33.1	241.8						
25	Massin, Mengaldan	3	p	23	8	17	8					
			h	5.6	34.7	236.3						
26	Camealan West, Minalay	3	p	30	0.8	8	32					
			h	2.6	37.7	296.7						
27	Carnak West, Dagupan City	3	p	20	2	0.2	12	48				
			h	4.2	11.3	30.1	293.8					
28	Calmay, Dagupan City	3	p	64	6	0.8	5					
			h	3.8	8.7	50.7						
29	Fental, Dagupan City	3	p	6	0.6	4	25					
			h	7.6	38.4	342.4						
30	Bena, Dagupan City	2	p	50	2	1.6	8	72				
			h	1.0	19.0	65.8	134.6					

TABLE 6.6.2.1 (4)  
 DEDUCED VALUES OF GEORESISTIVITY SOUNDING MEASUREMENTS

VERTICAL ELECTRICAL SOUNDING NUMBER	LOCATION	ELEVATION (m amsl)	RESISTIVITY (ohm-m)	SUB - SURFACE LAYER									
				DEPTH FROM GROUND SURFACE	1	2	3	4	5	6	7		
31	Bonnan Lengos, Dagupan City	2	p	31	6	13	8						
32	Talagtoga Mangaldan	2	h	70	4	18	10						
33	Calococan Sur, Binalaey	2	h	2.9	29.0	272.0							
34	Binalaey, Binalaey	2	p	760	19	1.2	9	30					
35	Sabangas, Dagupan City	2	h	3.8	11.4	51.9	311.9						
36	Bonnan Cheset, Dagupan City	2	p	68	3	0.8	6	30					
37	Bonnan Cheset, Dagupan City	2	h	2.9	8.4	60.1	303.7						
			p	80	8	1.2	6	45					
			h	1.9	11.4	68.4	340.4						
			p	1100	55	3	15	40					
			h	3.0	13.2	70.4	328.8						
			p	3000	150	4	18	70					
			h	2.7	9.9	69.4	273.4						
			p										
			h										
			p										
			h										
			p										
			h										

a) Calibration Soundings

For hydrogeological interpretation of electrical soundings, it is necessary to establish the pertinent resistivity of the different lithological units at depth by performing resistivity measurements at a convenient point as close as possible to a well with known lithology or to the geologic outcrops.

Six resistivity measurements were executed near deepwells drilled at Bonoan Boquig, Lasip Chico, Manguin and Calmay. The relation of resistivity to the specific lithological unit is presented in FIGURE 6.6.2.1.1 summarized below.

<u>Range of Resistivity (ohm-m)</u>	<u>Lithological Composition</u>
0.5 - 1.5	Clay, silt, sand and gravel intruded with saline water
2 - 10	Sand and gravel deposited in combination with high percentage composition of clay and silt
11 - 18	Silt, sand and gravel saturated with fresh water
23 - 72	Upper Miocene to Pliocene rock units (basement formation)
1000 - 3000	Isolated sand dune





## b) Interpretation of Survey Results

The result of the georesistivity survey can be summarized in the following electrostratigraphic sections, iso-resistivity maps and isotransverse resistance map.

### Electrostratigraphic Sections

With reference to the results of the calibration soundings, the lateral and vertical relationships of the alluvial sediments may be subdivided into five layers as shown in FIGURES 6.6.2.1.2~6.6.2.1.13

Layer 1 which exhibits low to relatively high resistivity values in the range of 0.6 to 3,000 ohm-m forms the superficial layer. The layer with resistivity responses not exceeding 10 ohm-m corresponds to clay and sand sediments saturated with fresh or brackish water. The values of 50 ohm-m or more can be correlated to comprise partly cemented sand and gravel saturated with freshwater. The coast near areas exhibiting resistivity values of 1,000 to 3,000 ohm-m corresponds to isolated sand dune.

Layer 2 comprises the fluvial sediments of clay, silt, sand and gravel intruded with saline water. The invasion occurs in the western belt of the investigation area and its approximate extent is presented

in FIGURE 6.6.3 of Main Text. This layer is believed not to exceed 70 m in depth and has resistivity value ranging from 0.5 to 1.5 ohm-m.

Layer 3 exhibits resistivity values ranging from 2 to 10 ohm-m conforming to sand and gravel deposited in combination with high percentage composition of silt and clay. This layer abuts on the basement formation at a depth of approximately 300 to 350 m below ground surface in an area northwest of Dagupan City. The extent of deposition in the southern portion tends to increase in depth as it underlies Layer 4 as shown in FIGURE 6.6.2.1.5.

Layer 4 corresponds to resistivity values in the range of 11 to 20 ohm-m. The layer is deposited as a lens-shaped formation overlying and underlying Layer 3 as shown in most electrostratigraphic sections. This layer is in near contact Layer 2 and overexploitation of groundwater upstream may lead to this association especially in zones high permeability. Most of the deepwell drilled in the study area withdraw water partly from this formation. Tapping this layer for groundwater extraction maybe possible and the aquifer may yield fair hydraulic characteristics.

Layer 5 presented resistivity values in the range of 23 to 72 ohm-m and is believed to be the basement formation. It is assumed part of the Upper Miocene rock sequence comprising mostly of fine to medium grains of clastic sediments composed of mudstone and sandstone. The lithological units are mainly exposed at the mountain plains north-east and southeast of Dagupan City.

The interfinger fronts of Layers 3, 4 and the basement formation are presented in FIGURE 6.6.3 of the Main Text.

#### Isoresistivity Maps

The isoresistivity maps presented in FIGURES 6.6.2.1.14~6.6.2.1.16 for current electrode separations equivalent to 100,200 and 300 m, respectively, show uniform trend of resistivity increases as it enters the area immediately southeast of Dagupan City. This conforms to the sounding points located within the boundaries of 10 ohm-m or more contour line.

The resistivity measurements may indicate fair aquifer potentials with good water retention capabilities in this area. The electrostratigraphic sections revealed that this formation has resistivity values in the range of 11 - 20 m with an average thickness of 250 m.

### Isotransverse Resistance Map

The isotransverse resistance map presented in FIGURE 6.6.2.1.17 can be regarded as a hydrogeological map because the transverse resistance is controlled by both thickness and permeability of the aquifer. The areas bounded by greater isotransverse resistance contour line should coincide to an aquifer with greater potential.

The area enclosed by 4,000 ohm-m or more contour line is presumed to comprise permeable layer capable of sustaining medium-capacity withdrawal through deepwells.


The resistivity responses were translated into its corresponding lithological units as interpreted from the calibration soundings shown in FIGURE 6.6.2.1.1.

#### c) Findings/Recommendations


Dagupan City is situated downstream of the hydrogeological system that extends from the southern periphery of Lingayen Gulf towards the northwestern part of Tarlac Province. Uncontrolled groundwater withdrawal upstream of this system led to the intrusion of saline water into the shallow aquifer deeper inland. Hence, it is not advisable to extract water from this aquifer as rate of intrusion is not determined.

The deeper aquifer may offer fair hydraulic parameters enough to sustain medium-capacity withdrawal through deepwells. The formation has an average thickness of 250 m and has been identified in an area southeast of Dagupan City.

SECTION A - A'

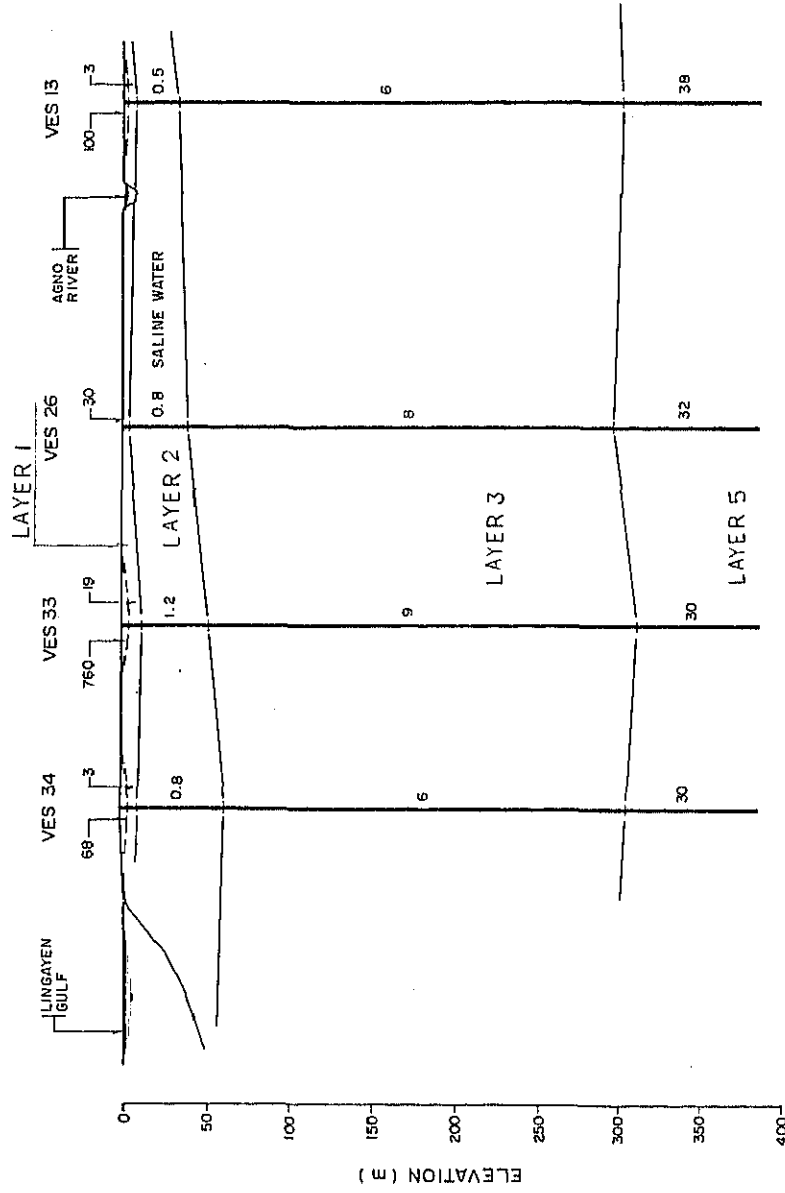


LEGEND :



VERTICAL SCALE 1: 3000 m  
 HORIZONTAL SCALE 1: 30,000 m

FIGURE 6.6.2.1.2  
 ELECTROSTRATIGRAPHIC SECTION A-A'  
 DAGUPAN CITY

SECTION B - B'

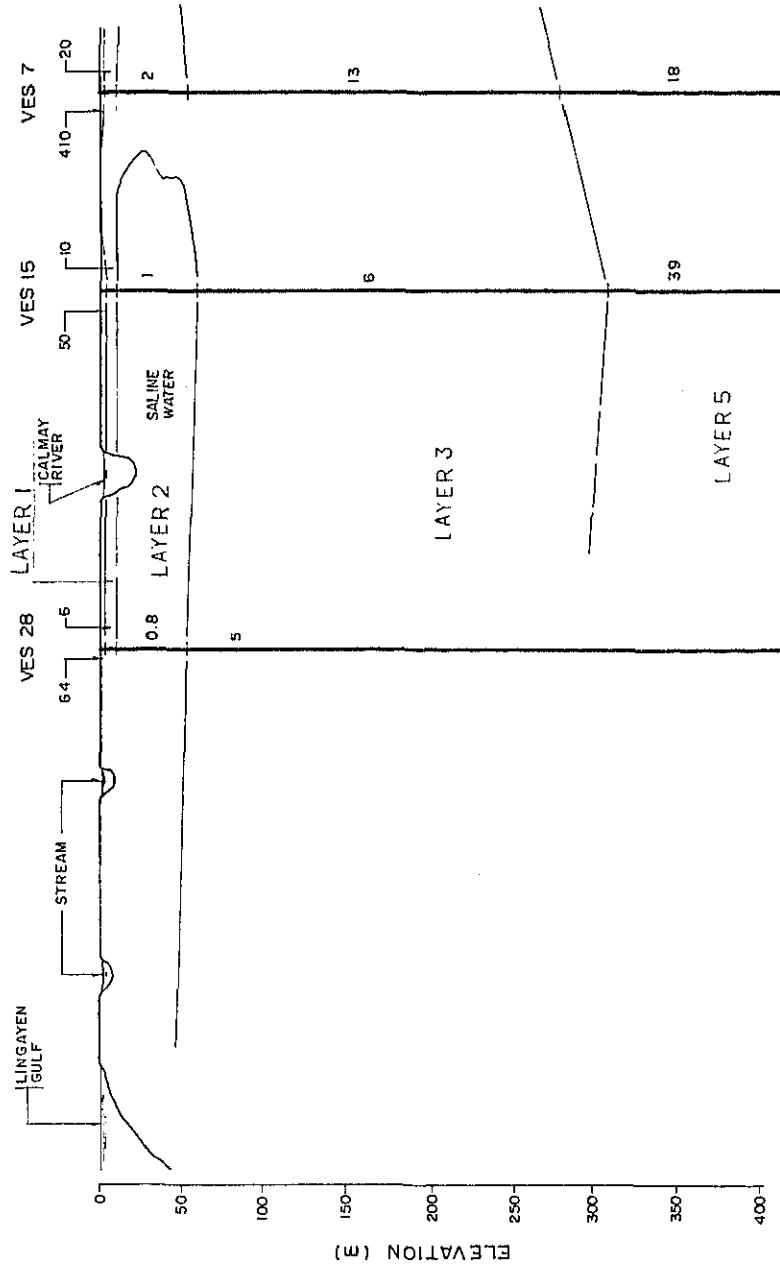

LEGEND :

VES 7  
 |  
 6  
 |  
 RESISTIVITY  
 (ohm·m)

VERTICAL SCALE 1: 3000 m  
 HORIZONTAL SCALE 1: 30,000 m

FIGURE 6.6.2.1.3  
 ELECTROSTRATIGRAPHIC SECTION B-B'  
 DAGUPAN CITY

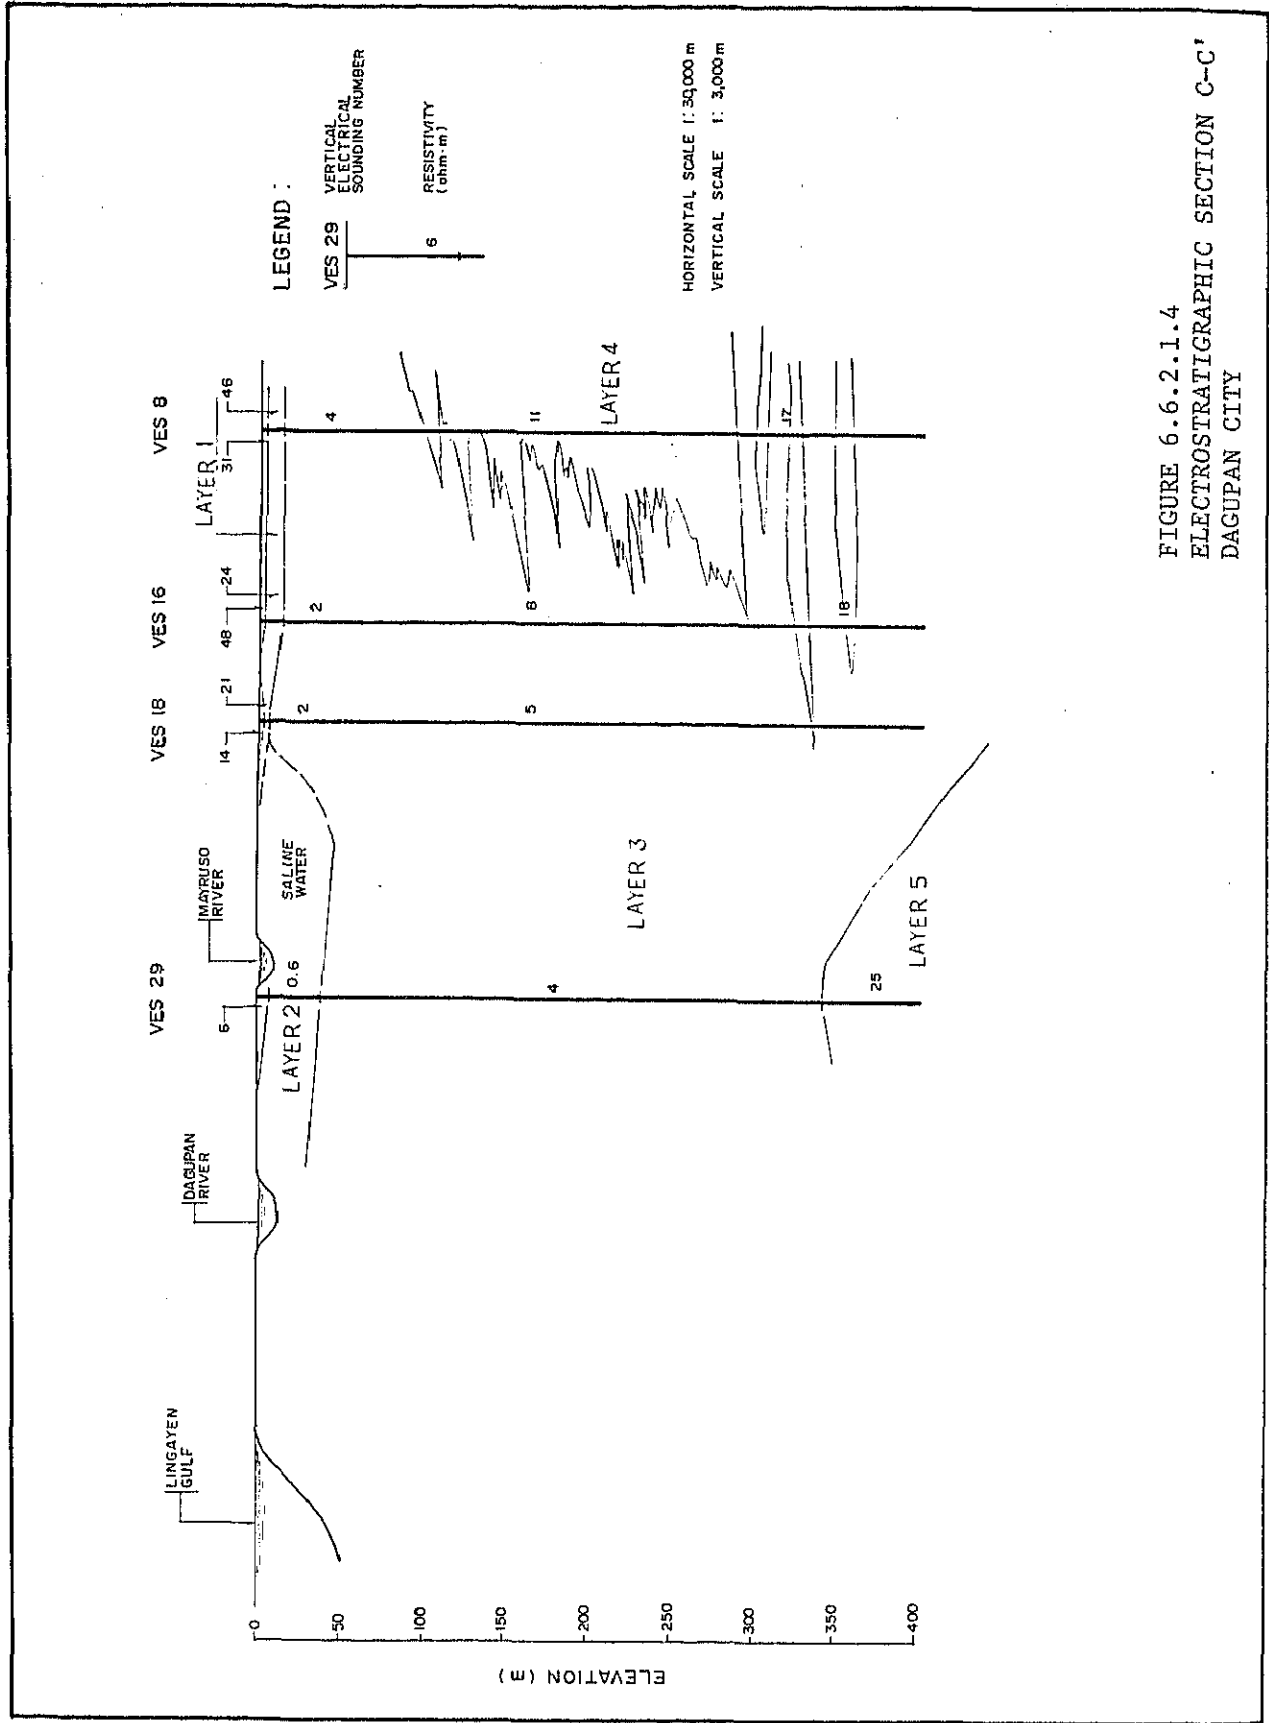


FIGURE 6.6.2.1.1.4  
ELECTROSTRATIGRAPHIC SECTION C-C'  
DAGUPAN CITY





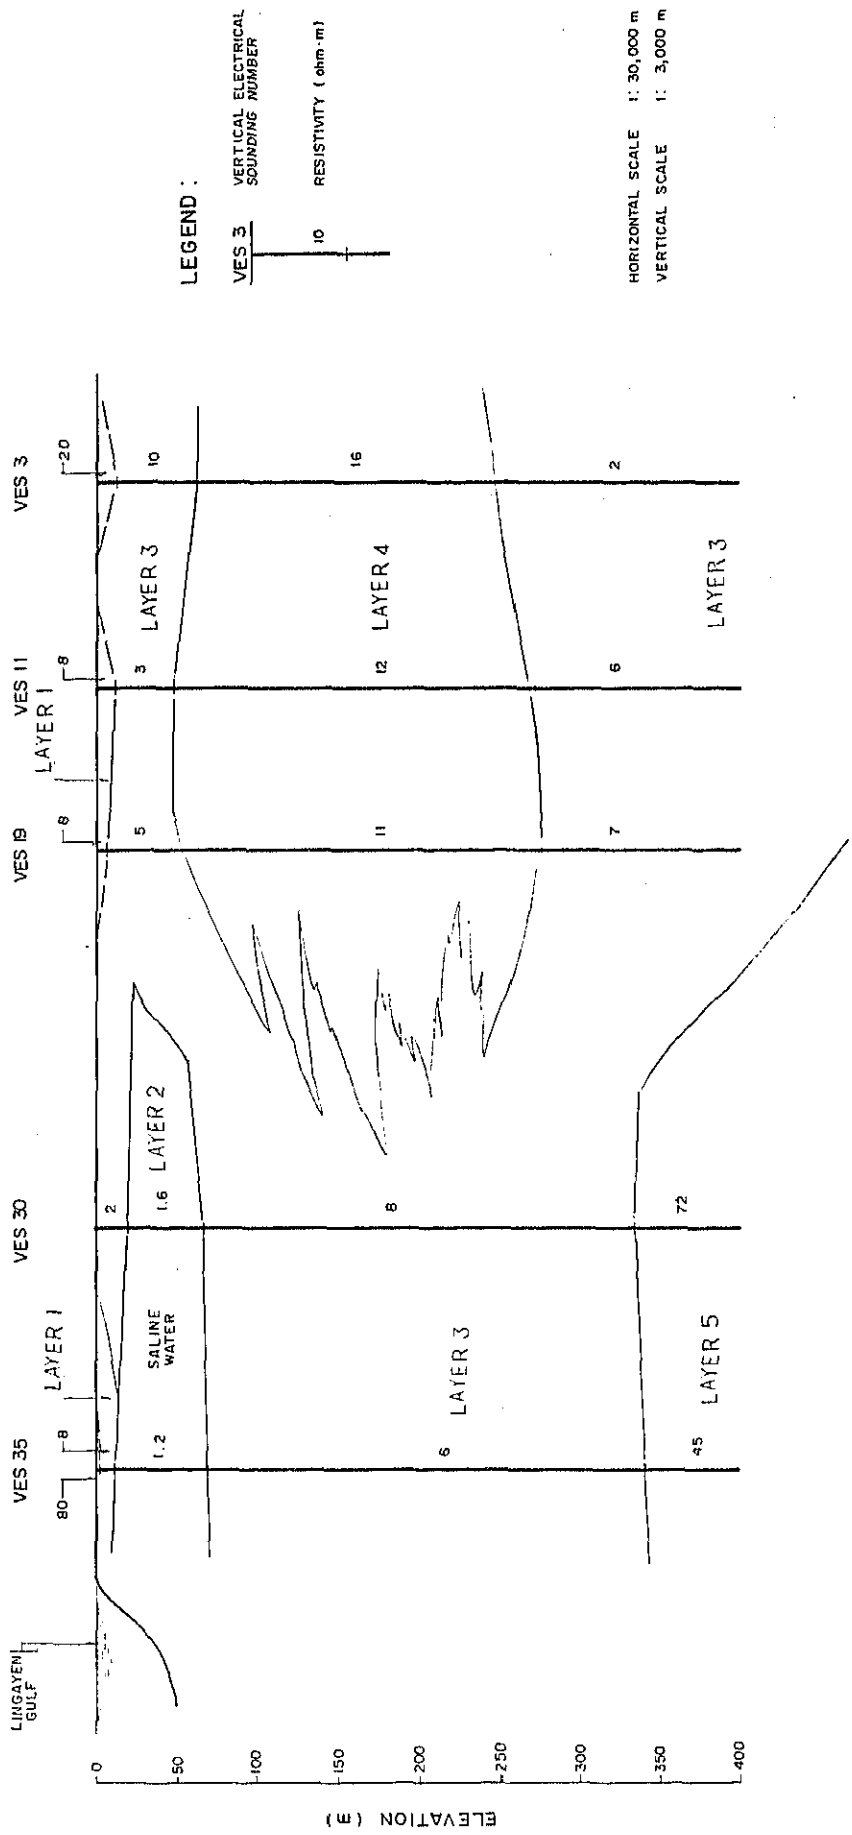


FIGURE 6.6.2.1.5  
ELECTROSTRATIGRAPHIC SECTION D-D'  
DAGUPAN CITY



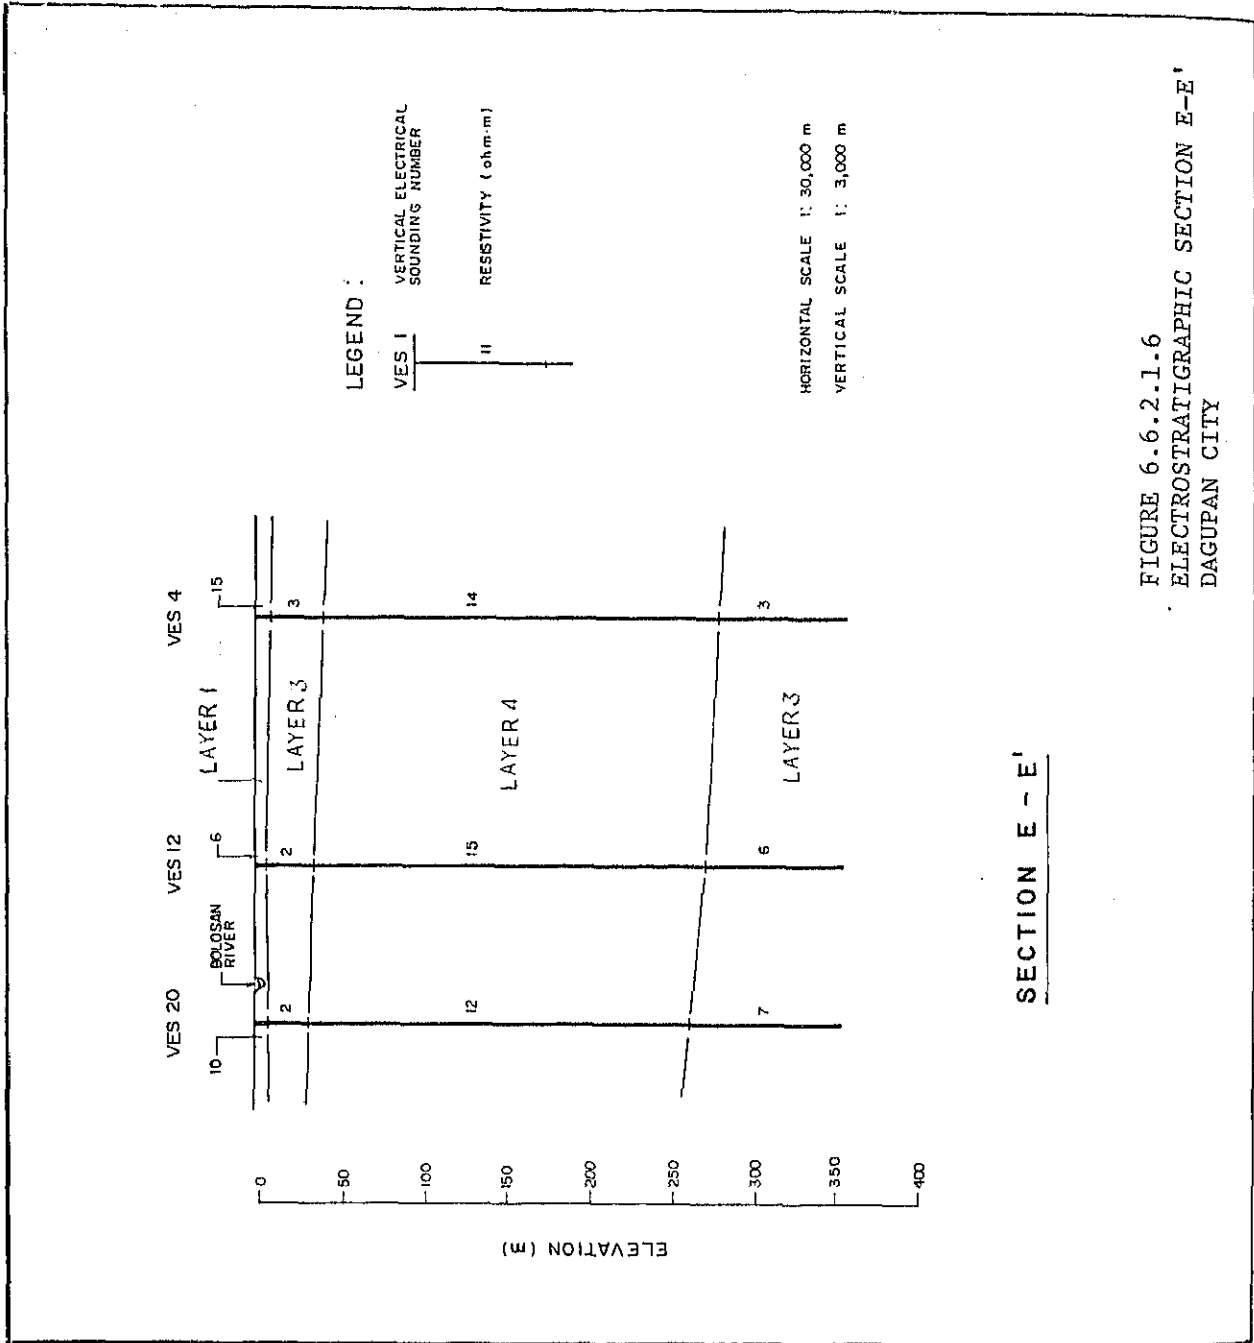

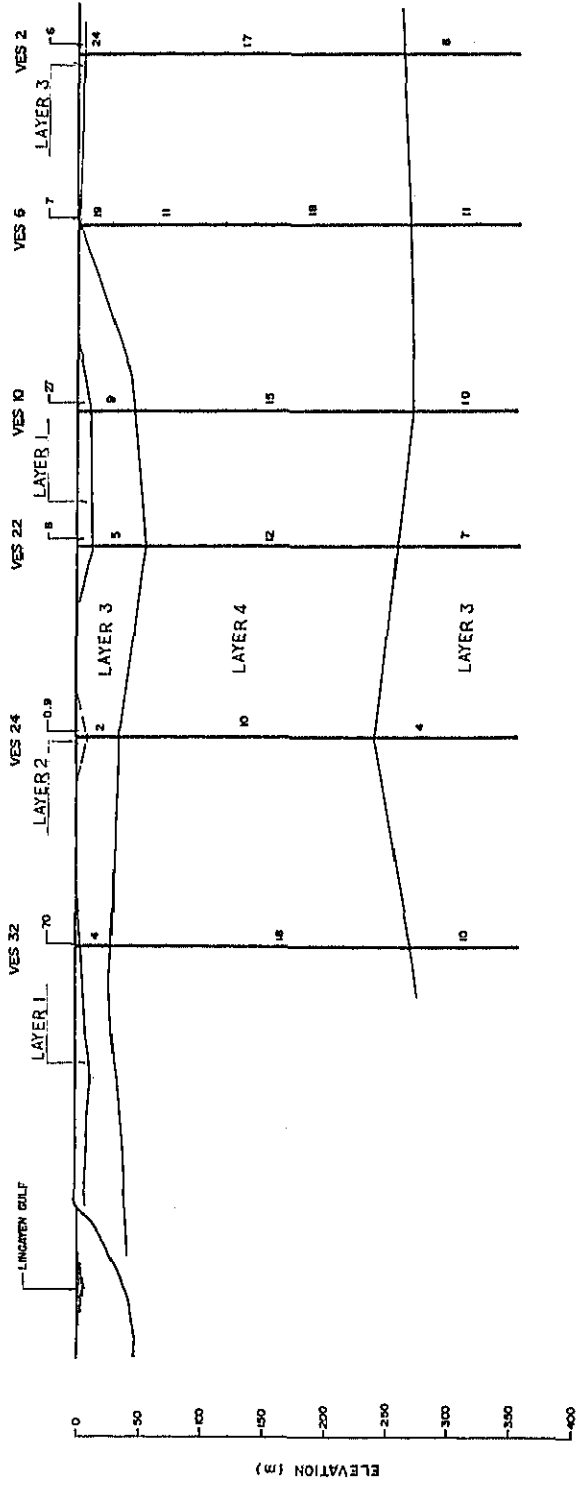

SECTION G - G'

FIGURE 6.6.2.1.8  
 ELECTROSTRATIGRAPHIC SECTION G-G'  
 DAGUPAN CITY

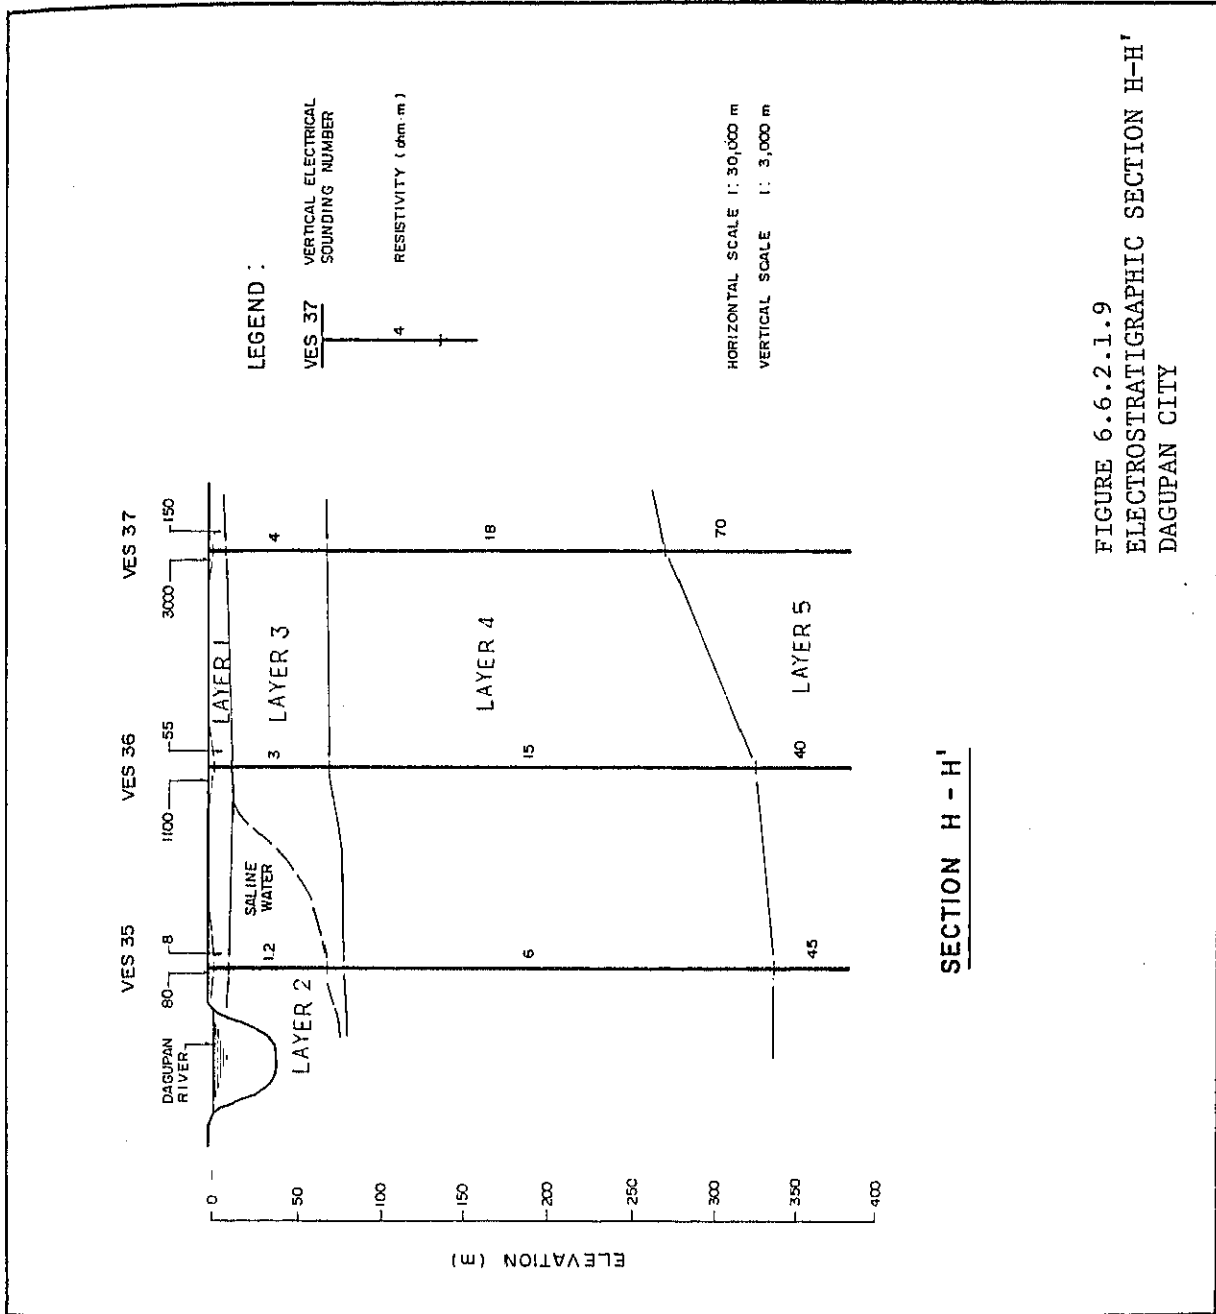


FIGURE 6.6.2.1.9  
 ELECTROSTRATIGRAPHIC SECTION H-H'  
 DAGUPAN CITY

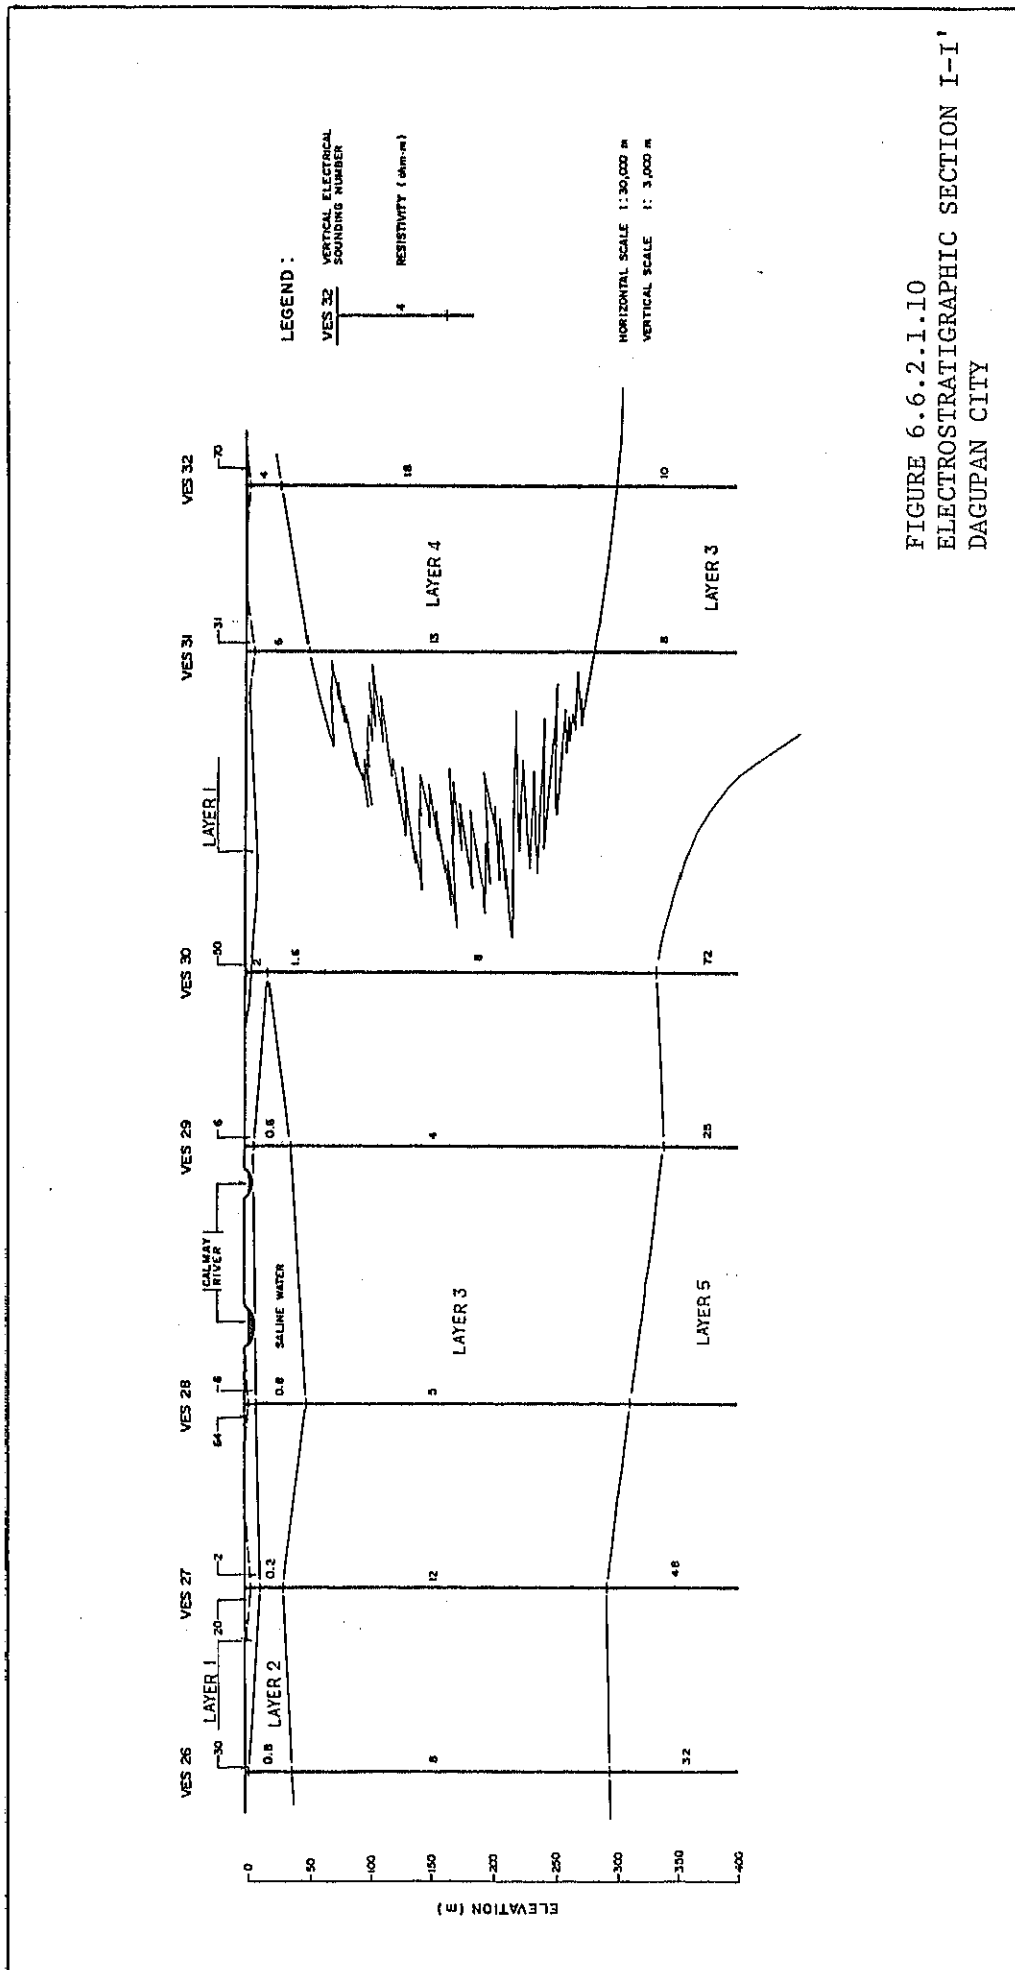


FIGURE 6.6.2.1.1.10  
 ELECTROSTRATIGRAPHIC SECTION I-I'  
 DAGUPAN CITY



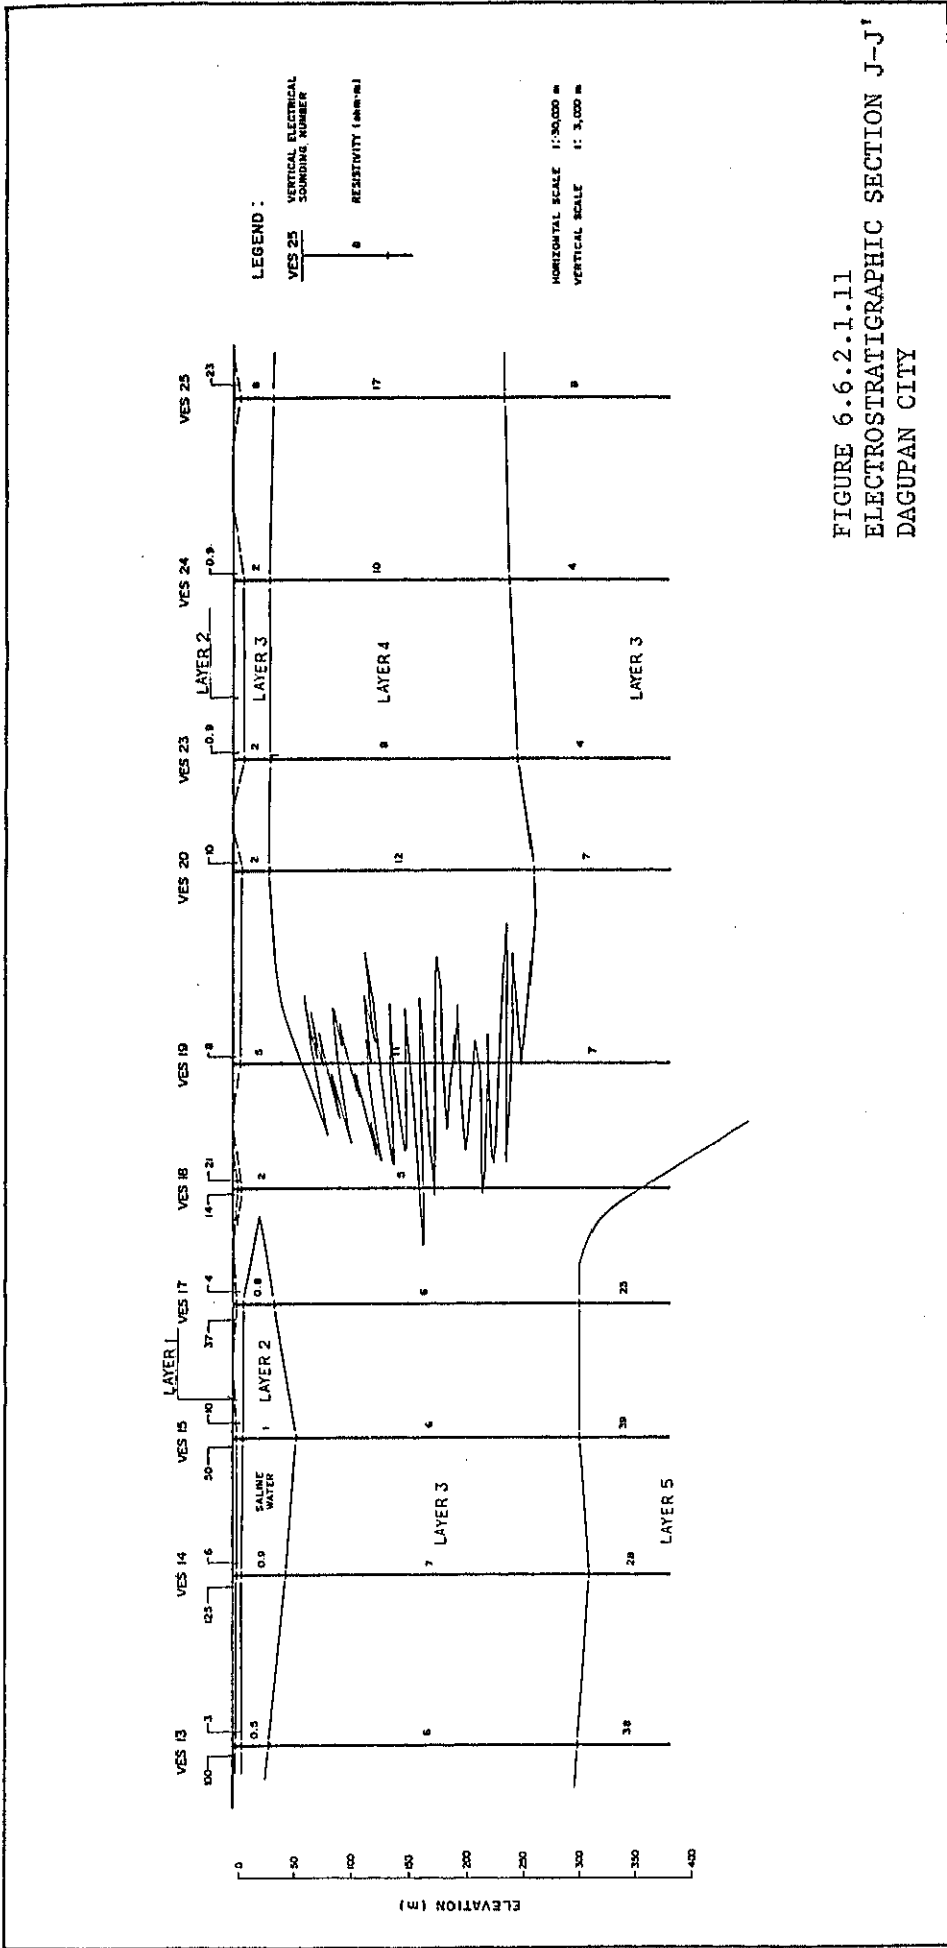


FIGURE 6.6.2.1.11  
 ELECTROSTRATIGRAPHIC SECTION J-J'  
 DAGUPAN CITY

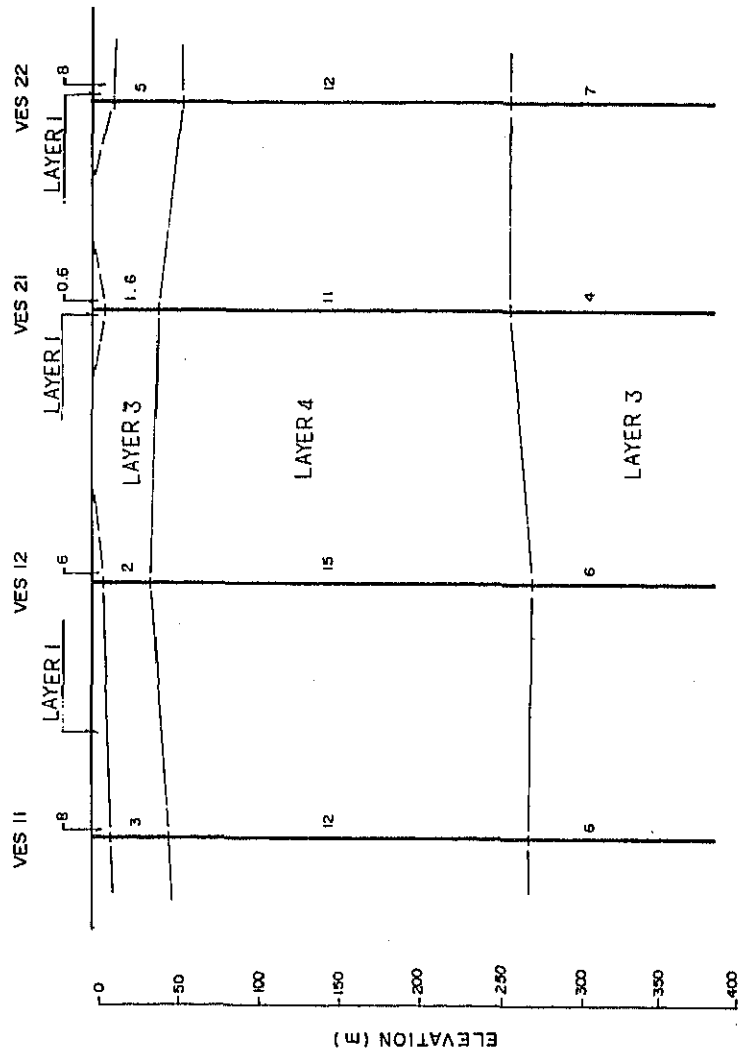

LEGEND :

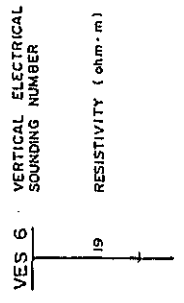


HORIZONTAL SCALE 1: 30,000 m  
 VERTICAL SCALE 1: 3,000 m


SECTION K - K'

FIGURE 6.6.2.1.12  
 ELECTROSTRATIGRAPHIC SECTION K-K'  
 DAGUPAN CITY



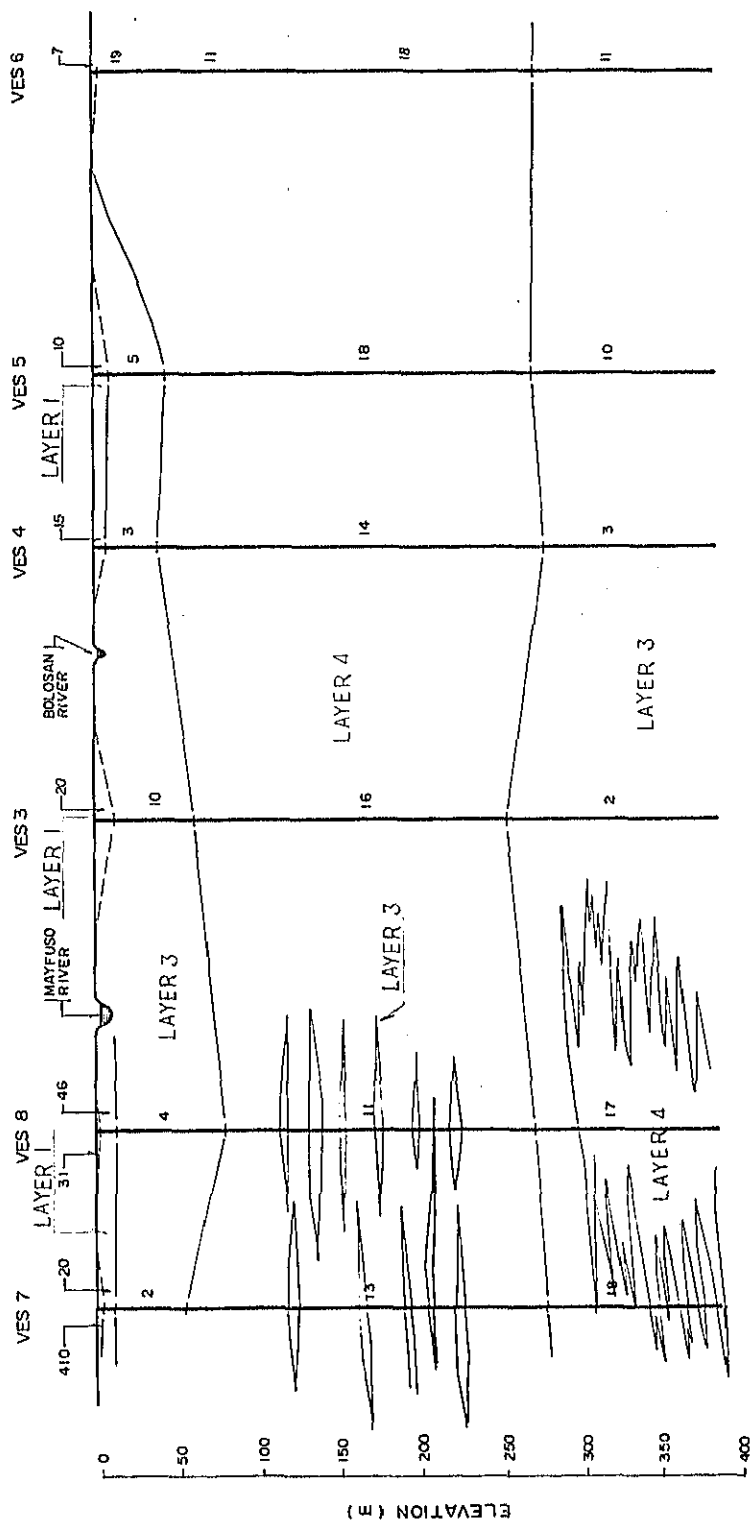

LEGEND:

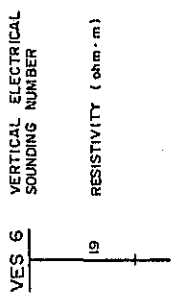

HORIZONTAL SCALE 1: 30,000 m  
 VERTICAL SCALE 1: 3,000 m

SECTION L-L'

FIGURE 6.6.2.1.1.13  
 ELECTROSTRATIGRAPHIC SECTION L-L'  
 DAGUPAN CITY









FIGURE 6.6.2.1.17  
ISORESISTIVITY MAP  
DAGUPAN CITY

## APPENDIX 6.7.1 WATER QUALITY EXAMINATION

### (1) Objective

The objective of this survey is to evaluate the water quality of the existing sources. Furthermore, the survey is focused on the clarification of geochemical feature in relation to the hydrogeological conditions of the study area.

The examination result will be reflected in the prospective water supply plan.

### (2) Implementation period

- 1) Preparatory work : July 26-27
- 2) Field examination : July 28
- 3) Sampling and laboratory analysis : July 28

### (3) General Approach and Methodology

#### 1) Sampling Points

Water samples were collected from the selected sampling points for physical, chemical and bacteriological examination.

#### Selection of sampling point

The sampling points were selected considering the following conditions:

- To cover all existing deep wells.
- To evaluate the hydrogeological and geochemical features in the study area.

- To determine the bacteriological quality of supplied water.

The selected sampling point were shown in TABLE 6.7.1.1 and FIGURE 6.7.1.1.

TABLE 6.7.1.1 LOCATION OF SAMPLING POINT

Item of Examination	Sample No.	Sampling Point	Remarks
Physical/Chemical Examination	1	Deep Well, Pump St. No. 1, Bgy I	
	2	" " No. 2, "	
	3	" " No. 3, "	
	4	" " No. 4, Pantal	
	5	" " No. 5, Bgy IV	
	6	" " No. 6, Herrera	
	7	" " No. 7, Malued	
	8	" " No. 8, Pantal	
	9	" " No. 9, Caranglaan	
	10	" " No. 10, Pantal	
	11	" " No. 11, Pogo G.	
	12	" " No. 12, Tapuac	
	13	" " No. 14, Pantal	
	14	" " No. 15, Malued	
	15	" " No. 16, Pob. Oeste	
	16	: , Carael (BWP)	
	17	Spring, Bonuan Guesset	
	18	River, Mayruso River	
	19	Shallow Well, Bacayao Norte	
Bacteriological Examination	20	Service Connection in Lucao	
	21	" " in Bgy I	
	22	Public Faucet in Pantal	
	23	" " in Pob. Oeste	

## 2) Sampling and Pre-treatment

Water samples were collected and pretreated in such manner to correspond respective chemical constituents to be analyzed in the laboratory as follows:

Sample Container / Pretreatment

Items to be analyzed

o 1,000 ml polyethylene bottle

Water Temperature, pH EC, TDS,  $\text{Ca}^{2+}$ ,  $\text{Mg}^{2+}$   
 $\text{Na}^+$ ,  $\text{K}^+$ ,  $\text{SO}_4^{2-}$ ,  $\text{CO}_3^{2-}$ ,  $\text{HCO}_3^-$ ,  $\text{Cl}^-$ ,  $\text{Fe}^+$ , Mn





o 500 ml polyethylene bottle  
with 1 ml of conc. H<sub>2</sub>SO<sub>4</sub> to  
maintain pH below 1.0

NH<sub>3</sub>-N, NO<sub>3</sub>-N, Fe<sup>+</sup>

o 100 ml pre-disinfected poly-  
ethylene bottle

Coliform Group Bacteria (MPN)

In addition to the chemical pretreatment, all the collected water samples in the respective polyethylene bottles were kept in the black polyethylene bags with crushed ice to maintain water temperature below 4°C during the transportation to the laboratory.

### 3) Field Examination

Water temperature, pH and EC were measured in the field at the time of water sampling.

#### Implementation procedure

Since the collected water samples need to be delivered to the laboratory within 8 hours from the time of sampling, the water sampling was carried out in the early morning from 6:30 to 8:00 on 28 July, 1986. Thus the water samples were delivered to the Laboratory in Manila at 1:30 P.M.

### (4) Result of water quality examination

The result of field and laboratory analysis is presented in TABLE 6.7.1.2.

The procedure of water quality analysis was based on the Philippine Standard Method for the Analysis of Air and Water (Volume 2).

### (5) Discussion and conclusion

The following facts are obtained from the water quality analysis:

1) 7 samples out of 18 samples which were collected as drinking water sources excluding river water, are not satisfied with the National

Standard for Drinking Water (NSDW).

2) Among those samples unsuitable to NSDW, three samples of P. S. No. 12, No. 16 and Deep Well (Crae1) are also unsuitable for color.

3) The rest four samples of PS No. 6, No. 10, No. 14 and Shallow Well (Bacayao Norte) are unsuitable for Ca, Cl and TDS, or Cl and TDS.

4) pH range of the all samples is high. This can be recognized as the sign of sea water intrusion.

5) Turbidity of the samples is within the criteria of drinking water except for surface water sample.

6) All the samples of Fe and Mn contents are within the criteria of drinking water.

7) Sea water intrusion was expected for existing well No. 6, No. 10, No. 14 and Shallow Well of Bacayao Norte from the result of electric conductivity in the field examination. This matter was proved by the analysis of TDS,  $\text{Na}^+$  and  $\text{Cl}^-$ .

TABLE 6.7.1.1.2 WATER QUALITY ANALYSIS

DACUPAN CITY

Sample Number and Location	Turb. (FTU)	TDS (mg/L)	PH (-)	EC (MS/CM)	Alk. (mg/L)	Hard. (mg/L)	Acid (mg/L)	Na (mg/L)	K (mg/L)	Ca (mg/L)	Mg (mg/L)	CO <sub>3</sub> (mg/L)	HCO <sub>3</sub> (mg/L)	Cl (mg/L)	SO <sub>4</sub> (mg/L)	Fil (mg/L)	Mo form (mg/L)	Temp. (C)	NH <sub>3</sub> N (mg/L)	NO <sub>2</sub> N (mg/L)	NO <sub>3</sub> N (mg/L)
1 Pump Station #1	0.49	253	8.12	367	142	60	0	67.5	2.5	20.8	1.9	33.6	104.9	27.9	22.5	0.05	nil	30.1	0.03	1.32	
2 Pump Station #2	0.63	211	7.98	324	123	67	0	50.0	3.0	24.0	1.7	22.8	103.7	18.7	16.5	0.1	nil	29.5	0.02	0.81	
3 Pump Station #3	0.47	224	8.04	348	152	75	0	49.0	3.8	18.0	7.3	33.6	117.1	18.6	13.0	0.2	nil	30.5	0.03	0.80	
4 Pump Station #4	0.58	234	7.58	351	133	67	0	54.5	3.2	20.8	3.6	33.6	93.9	18.6	26.0	0.05	nil	30.5	0.01	2.24	
5 Pump Station #5	0.66	256	7.85	328	171	60	0	73.5	3.3	18.0	3.6	33.6	140.3	23.2	15.0	0.08	nil	30.5	0.03	0.46	
6 Pump Station #6	0.46	1,856	7.29	2,710	190	270	12	525.0	5.0	84.0	14.6	0	231.8	928.8	8.0	0.1	nil	28.5	0.13	1.33	
7 Pump Station #7	0.74	280	7.97	408	180	37	0	88.0	4.2	8.8	3.6	22.8	173.2	27.9	9.0	0.20	nil	28.2	0.03	1.04	
8 Pump Station #8	0.82	224	7.86	373	142	67	0	54.5	2.9	24.0	1.7	22.8	126.9	18.6	19.5	0.13	nil	29.5	0.02	0.75	
9 Pump Station #9	1.02	288	7.81	440	153	60	0	75.0	2.5	18.0	3.6	33.6	118.3	32.5	15.5	0.05	nil	28.2	0.03	1.20	
10 Pump Station #10	0.61	1,152	7.45	1,800	350	127	0	355.0	3.2	26.8	14.6	33.6	358.7	390.1	6.0	0.08	nil	28.8	0.09	1.80	
11 Pump Station #11	0.70	307	8.12	427	180	52	0	82.5	2.5	18.0	1.7	33.6	151.3	27.9	8.0	0.05	nil	29.8	0.03	1.37	
12 Pump Station #12	0.55	288	8.65	400	209	30	0	85.0	1.2	6.0	3.6	33.6	186.7	13.9	2.0	0.20	nil	30.0	0.05	2.96	
13 Pump Station #14	1.75	1,792	7.09	2,760	313	277	14	480.0	5.0	84.0	16.3	0	381.9	698.9	9.0	0.08	nil	29.0	0.08	0.97	
14 Pump Station #15	0.53	333	8.04	251	228	52	0	105.0	2.4	14.8	3.6	33.6	209.8	27.9	6.0	0.10	nil	29.9	0.03	1.21	
15 Pump Station #16	0.62	371	8.06	546	199	30	0	112.5	2.0	6.0	3.6	33.6	174.5	62.7	8.0	0.15	nil	29.8	0.03	1.70	
16 Carael (BWP)	0.56	460	8.15	364	318	67	0	138.0	3.9	24.0	1.7	45.6	295.2	34.8	2.0	0.10	0.05	30.1	0.07	3.96	
17 Bonnan Guesset (Spring)	0.43	179	8.32	241	100	52	0	41.0	3.4	14.8	3.6	33.6	53.7	13.9	25.5	0.05	nil	28.5	0.02	0.47	
18 Mayruso (River)	7.50	320	7.44	490	191	202	12	18.5	4.1	58.4	13.6	0	233.0	32.5	7.0	0.08	nil	28.5	nil	2.87	
19 Bacayao Norte (Shallow Well)	0.90	986	7.25	1,590	328	105	16	300.0	4.0	24.0	10.9	0	400.2	301.8	2.0	0.05	nil	28.0	0.09	0.71	

Philippine National Standard for Drinking Water

Water Quality: Physical, Chemical and Radiological Requirements

Bacteriological Quality Standards

Parameter		Maximum Permissible level*
Turbidity		5 units
Color		5 units (s) **
Odor		Unobjectionable
Threshold odor number		Note more than 3
Taste		Unobjectionable
Total Solids		500 (s)
pH		6.5 - 8.5
Phenolic substances		0.001
Radioactive Subs.	Gross Alpha	3 pCi/l
	Gross Beta	30pCi/l
Trace Elements	Arsenic	0.05
	Barium	1.0
	Cadmium	0.01
	Chromium	0.05
	Copper	1.0
	Cyanide	0.05
	Fluoride	0.6
	Iron	1.0
	Lead	0.05
	Manganese	0.5 (s)
	Mercury	0.002
	Selenium	0.01
	Zinc	5.0 (s)
Organic Chemicals	: Synthetic Detergents (MBAS)	0.5
	: Oil & Grease	Nil
Persistent Pesticides	: Aldrin	0.001
	: DDT	0.05
	: Dieldrin	0.001
	: Chlordane	0.003
	: Endrin	0.0002
	: Heptachlor	0.0001
	: Lindane	0.004
	: Toxaphane	0.005
	: Methoxychlor	0.1
: 2,4 --E	0.1	
: 2, 4, 5 -- T	0.01	
PCB		Nil
Other Chemicals	: Calcium	75
	: Chloride	200 (s)
	: Magnesium	50 (s)
	: Nitrate (NO <sub>3</sub> )	30
	: Sulfate	200 (s)
	: Hydrogen sulfide	0.05 (s)

**Minimum Requirements on Bacteriological Quality**

a) Chlorinated or Otherwise Disinfected Supplies  
Efficient treatment culminating in chlorination or some other form of disinfection should yield a water free or any coliform organism however polluted the original raw water may have been. In practice it should not be possible to demonstrate the presence of coliform organisms in any sample of 100ml. The efficacy of the purification process and method of sampling should be looked into when a sample of the water entering the distribution system does not conform to this standard. In testing chlorinated water, presumptive positive tubes should always be subjected to appropriate confirmatory tests.

b) Non-disinfected Supplies

Where supplies of this sort exist, no water entering the distribution system should be considered satisfactory if it yields E coli in 100ml. If E. coli is absent, the presence of not more than 3 coliform organisms per 100ml may be tolerated in occasional samples from established non-disinfected pipes supplies, provided that they have been regularly and frequently tested and that the catchment area and storage conditions are found to be satisfactory. If repeated samples show the presence of coliform organisms, steps should then be taken to discover and, if possible, remove the source of pollution. If the number of coliform organisms increases to more than 3 per 100ml, the supply should be considered unsuitable for use without disinfection.

c) Individual or Small Community Supplies

Where supply of waters are individual wells, bores and springs everything possible should be done to prevent pollution of the water. It should be possible to reduce the coliform count of water from even a shallow well to less than 10 per 100ml. Persistent failure to achieve this, particularly if E. coli is repeatedly found, should, as a general rule lead to chlorination or boiling of the water for domestic consumption.

\* All units are in mg/l unless, otherwise stated.

\*\* (s) - Secondary standards; compliance with the standard and analysis are not obligatory.

F. COST COMPARISON

General

Analysis and evaluation of alternative are based largely on present-worth cost studies, taking into consideration the salvage value after the design period. Cost comparison is based on present worth of net disbursement during the period of 1980-2010 without any escalation factor applied to the 1980 unit prices.

If the differences between net PW cost of an alternative and that of the least-cost alternative is within the limit of cost estimating accuracy (10-15%) further cost comparison shall be made applying escalation factor to 1980 unit prices. For escalation rates, refer to Chapter VII-C: Escalation Rates. Moreover, non-economic parameters may also be influence the selection of the recommended plan.

Construction Cost

Construction cost estimates of the proposed improvements are based on the projected July 1980 unit prices. All estimates on imported materials are based on an exchange rate of ₱7.40 per 1 US dollar. Further, it is assumed that no custom duty will be charged on items imported for the public water supply project. The cost of any facility to be replaced during the design period (1980-2010) is included under the capital cost for the particular year.

Annual Cost

Annual costs are all costs associated with the maintenance, operation, and management of the project. These include labor, power, chemical and maintenance costs. These estimates are carried out for the period 1980-2010. The present-worth cost of annual expenditure is based on uniform and gradient series at a given interest.

Personnel and maintenance costs may abruptly increase as additional facilities are put into operation - e.g., the power cost at a pump station increases in relation to the daily pumpage of water.

Salvage Value

The salvage values of facilities at the end of the design period 2010 are important in calculating net present worth of the total expenditures. It is assumed that the value of a facility depreciates linearly throughout its service life therefore, a facility with longer service life depreciates less than a facility with shorter service life (Refer to Table VI-1 for service life of different facilities). Moreover, a facility constructed at a later stage has higher salvage value than one constructed at an earlier stage.

TABLE VI-1

SERVICE LIFE CATEGORIES OF FACILITIES

Civil Works	Economic Life	Equipment	Economic Life
Wells	30 years	Wells (pumping engine or motors)	15 years
Springs	50	Springs (vales, pipes)	50
Transmission Mains	50	Transmission (pipes, valves)	50
Storage Facilities	50	Storage (valves, pipes, level gauge, etc.)	50
Disinfection Facilities	50	Disinfection facilities (chlorinators, mech-	
Distribution Mains	50	anical equipment and filter equipment,	
Internal Network	50	pipes, valves)	15
Service Connections	50	Distribution mains (pipes, valves)	50
Fire Hydrants	50	Internal networks (pipes, valves)	50
Operational Buildings	50	Service connections (meters, pipes)	50
		Operational buildings (workshop, etc.)	15
		Fire hydrants	30
		Vehicles	7

### Net Present Worth

The net present worth cost of an alternative scheme is the difference between the total present worth of capital cost and annual cost minus the present worth of salvage values.

#### For Construction Cost:

$$C_n = C_c - C_s$$

$$C_c = C \times \frac{1}{(1+i)^n}$$

$$C_s = C \times \frac{1}{(1+i)^{nx}} \times \left(1 - \frac{nx - n}{SL}\right)$$

#### For Annual Cost:

$$C_c = A_c \times \frac{1}{(1+i)^n}$$

where,

$C_n$  = net present worth comparable cost

$C_c$  = present worth of construction cost

$C_s$  = present worth of salvage value (design year)

$C$  = construction cost

$SL$  = service life

$i$  = discount rate

$nx$  = number of years between design year and base year

$n$  = number of years between year of construction and base year

$A_c$  = annual cost

## 7.2.1.1. Hydraulic Simulation of Technical Alternatives

The infiltration gallery and the radial well are considered as the alternatives for water intake facility. To determine the design parameter of each facility, the following hydraulic simulation was carried out.

Radial Well

$$Q = \pi k (H^2 - h^2) / \ln(R/r_o)$$

where,

Q = planned yield; 5,400 cu.m/day

k = permeability coefficient;  $5 \times 10^{-4}$  m/sec


H = aquifer thickness; 15 m

h = effective aquifer thickness during pumping (m)

R = radius of influence area; 400 m

$r_o$  = radius of radial collector (m)

H - h = drawdown (m)

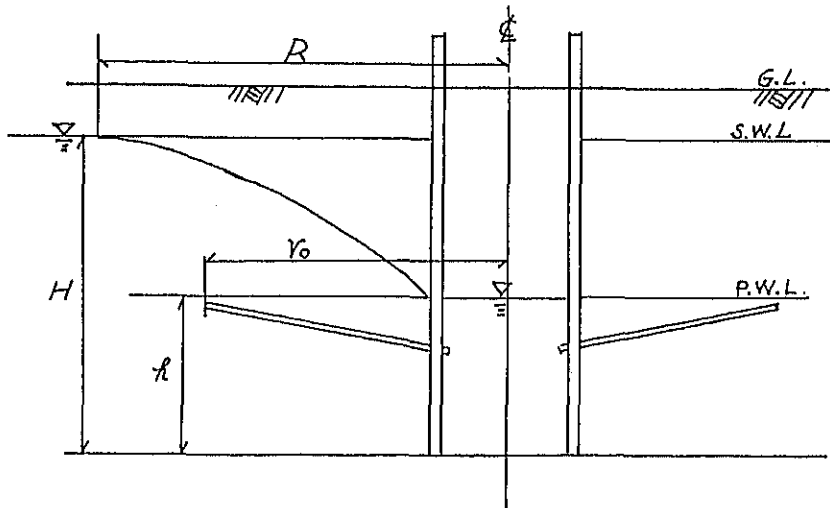

Through the trial simulation of the above formula, the design parameter of the radial well was determined to be 9 m for the effective aquifer thickness and 15.5 m for the radius of radial collector. By these parameters, the planned yield is computed to be approximately 6,010 cu.m/day. Thus, four units of radial well can meet the required water demand.

## Infiltration Gallery

$$Q = k \times L \times (H^2 - h_0^2) \times R^{-1} \times (t + 0.5 \times r_0) / h_0 \times \sqrt[4]{(2 \times h_0 - t) / h_0}$$

where,

Q = planned yield; 5,400 2,880 cu.m/day

k = permeability coefficient;  $5 \times 10^{-4}$  m/sec

L = length of gallery (m)


H = aquifer thickness; 15 m

$h_0$  = height of gallery from the bottom of aquifer; 11 m

R = radius of influence area; 400 m

t = depth of water in gallery (m)

$r_0$  = radius of gallery (m)

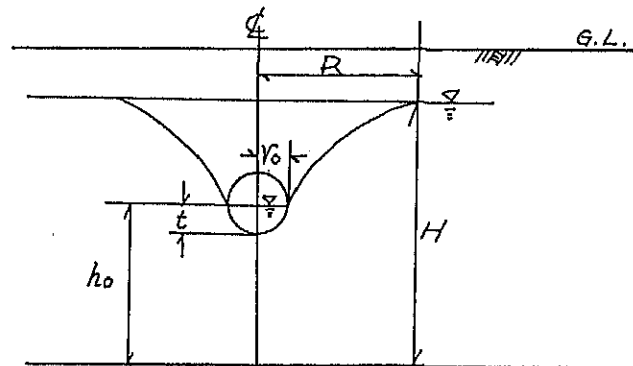

As well as the radial well, the design parameter of infiltration gallery was determined to be 1.5 m for both the depth of water in gallery and the radius of gallery, and 910 m for the gallery length. By these parameters, the planned yield is computed to be approximately 5,400 cu.m/day.

### 7.2.1.2. Cost Estimates


#### Radial Well

The construction cost of the radial well is estimated to be approximately ₱1,240,000 per one unit, as shown in TABLE 7.2.1.1.



## Infiltration Gallery

In order to install the infiltration gallery in the river bed, the volume of excavation and backfilling with relevant civil works is required. The following is a rough sketch of the cross-section of river bed excavation.

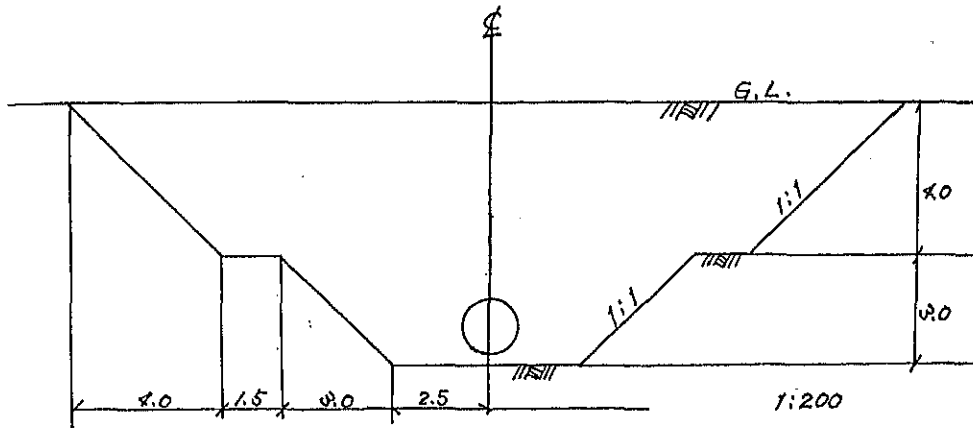

The given cross-section has an area of 96 sq.m. When 910 m of the required length of infiltration gallery is taken into account, the total excavation volume will be about 87,360 cu.m. At ₱103/cu.m of the unit cost for excavation, this work item will require at about ₱9.0 million.

### 7.2.1.3 Conclusion

In accordance with the above cost estimates, it is clear that the radial well is quite economical than the infiltration gallery.

TABLE 7.2.1.1.1 COST ESTIMATES OF RADIAL WELL

Item	Description	Unit	Qty	Unit Cost (Peso)	Cost (Peso)
1. Concrete Caisson					
1.1 Steel Shoe	ø6.0 m(OD) x ø7.0 m(ID) x 1.0 m(H) (t=6 mm)	kg	2,500	26	65,000
1.2 Excavation	ø7.0 m x 17.5 m(D)	cu.m	673	103	69,320
1.3 Disposal Material	ø7.0 m x 17.5 m(H)	cu.m	673	24	16,150
1.4 Concrete (3,000 psi)	Caisson: ø6.0 m(ID) x ø7.0 m(OD) x 18.5 m(H) for wall ø6.0 m(ID) x 1.5 m(H) for anchor Cover with slab: ø7.0 m x 0.2 m(H) + (0.3x0.3x4.8x4 - 0.3x0.3x0.3x2)	cu.m	231	1,170	270,270
1.5 Reinforcement	20 kg for every 1.0 cu.m of concrete	kg	4,820	15	72,300
1.6 Formwork	Caisson: (ø6.0 m x ø7.0 m) x 18.5 m(H) Cover/slab: ø7.0 m for horizontal 0.3x(0.90x4x1.7x4)x4 for vertical	sq.m	756	110	83,160
		sq.m	29	140	4,060
		sq.m	13	110	1,430
	<u>Total for Item 1</u>				<u>593,390</u>
2. Radial Collector					
2.1 Collector Pipe	GI, ø75 mm x 3 m (ø12 mm, 400 holes) x 2 pcs. x 48 collectors	m	288	270	77,760
	GI, ø75 mm x 3 m (ø12 mm, 300 holes) x 48 collectors	m	144	270	38,880
	GI, ø75 mm x 3.5 m (blank) x 48 collectors	m	168	180	30,240
	GI, Cap, ø75 mm	pcs.	48	30	1,440
2.2 Gate Valve	ø75 mm	pcs.	48	2,690	129,120
2.3 Water Stopper	ø75 mm	pcs.	48	1,340	64,320
2.4 Horizontal Boring	Caisson Wall, t=0.5 m Radial Well, 12 m x 48 collectors	holes m	48 576	1,500 1,160	72,000 668,160
	<u>Total for Item 2</u>				<u>1,081,920</u>
	<u>TOTAL OF ITEM 1 &amp; 2</u>				<u>1,675,310</u>
3. Temporary Facility	5% of Total of Item 1 & 2				83,765
	<u>TOTAL COST</u>				<u>1,759,075</u>

APPENDIX 7.2.2 DATA ON THE UNIT COST FOR ESTIMATION OF PROJECT COST

(1) Deep Well Construction : Peso

<u>Depth (m)</u>	<u>Casing size (m/m)</u>	<u>Cost</u>
200	250	940,000
200	300	1,160,000
250	150	640,000

BREAKDOWN OF COSTS IN %

	<u>Local Component</u>			<u>F E C</u>		<u>Total</u>
	<u>Material</u>	<u>Labor</u>		<u>Direct</u>	<u>Indirect</u>	
		<u>Skilled</u>	<u>Unskilled</u>			
Equipment	17	-	-	-	20	37
Civil Works	33	8	5	-	17	63
<b>Total</b>	<b>50</b>	<b>8</b>	<b>5</b>	<b>-</b>	<b>37</b>	<b>100</b>

(2) Deep Well Pump Station (Electric Motor Drive) : Thousand Peso

<u>KW</u>	<u>Cost</u>
7	450
15	560
22	640
29	720
37	790
44	840
51	890
59	960
66	1,020
74	1,080

BREAKDOWN OF COSTS IN %

	<u>Local Component</u>			<u>F E C</u>		<u>Total</u>
	<u>Material</u>	<u>Labor</u>		<u>Direct</u>	<u>Indirect</u>	
		<u>Skilled</u>	<u>Unskilled</u>			
Equipment	9	-	-	42	5	56
Civil Works	21	9	5	-	9	44
<b>Total</b>	<b>30</b>	<b>9</b>	<b>5</b>	<b>42</b>	<b>14</b>	<b>100</b>

(5) Pipeline Cost

Following pipe materials are presently available in the Philippines:

- GI (galvanized iron),
- PE (poly-ethylene),
- PB (poly-butylene),
- PVC (poly-vinyl-chloride),
- SP (steep pipe),
- CI (cost iron), and
- AC (asbestos cement).

Among these materials, the use of CI pipe is limited due to its high cost and AC pipe is also rare by safety reason.

Followings are comparison of unit cost at the 1985 price level.

Diameter (mm)	(Unit: ₱/m)				
	GI	PE	PB	PVC	SP
13	20.8	13.8	9.1	-	-
19	24.7	19.9	13.6	-	-
25	32.3	25.3	22.0	-	-
38	59.2	41.5	44.7	-	-
50	87.5	61.4	76.4	33.9	-
63	117.7	-	-	48.0	-
75	180.3	-	-	81.3	-
100	230.8	-	-	122.4	235.0
150	-	-	-	256.9	250.0
200	-	-	-	506.5	290.0
250	-	-	-	-	315.0
300	-	-	-	-	425.0
400	-	-	-	-	520.0
500	-	-	-	-	700.0
600	-	-	-	-	890.0

Based on the above comparison, SP is advantageous for the diameter of 200 mm and above than PVC. Thus, for the cost estimates of major transmission and distribution pipes, SP is considered for diameter of 200 mm and above, while PVC for diameter of less than 150 mm taking into account the transportation cost and easy installation.

(3) Booster Pump Station

$$C = (72.16 - 13.68 \log Q) \times Q^{(0.42 + 0.1 \log Q)} \times H^{0.305(\log Q - 0.7)} \left(\frac{6}{H} - 0.25\right)$$

where,

C = cost for electric motor drive (thousand peso)

Q = design capacity (l/sec)

H = total dynamic head (m)

BREAKDOWN OF COSTS IN %

	Local Component			F E C		Total
	Material	Labor		Direct	Indirect	
		Skilled	Unskilled			
Equipment	11	-	-	53	2	66
Civil Works	17	9	6	-	2	34
Total	28	9	6	53	4	100

(4) Radial Well

Inner Diameter(m)	Inner Depth (m)	Collection Pipe Length (m/hole)	Unit Cost (₱)
5	10	7.5	1,240,000
6	16	12.5	1,760,000

BREAKDOWN OF COSTS IN %

	Local Component			F E C		Total
	Material	Labor		Direct	Indirect	
		Skilled	Unskilled			
Equipment	1	-	-	18	1	20
Civil Works	25	2	2	-	51	80
Total	26	2	2	18	52	100

<u>Diameter (mm)</u>	<u>Unit Cost (₱/m)</u>
150(PVC)	410
200(SP)	520
250( ")	630
300( ")	760
350( ")	900
400( ")	970
450( ")	1,160
500( ")	1,330
600( ")	1,600
700( ")	1,910

Source : LWUA Design Dept.

BREAKDOWN OF COSTS IN %

	Local Component			F E C		Total
	Material	Labor		Direct	Indirect	
		Skilled	Unskilled			
Equipment	23	-	-	4	27	54
Civil Works	17	7	4	-	18	46
Total	40	7	4	4	45	100

(6) Valve In-place Cost

<u>Diameter (mm)</u>	<u>Gate Valve (₱)</u>	<u>Butterfly Valve (₱)</u>
50	1,700	-
75	2,900	-
100	3,900	-
150	5,300	-
200	6,700	-
250	11,200	-
300	-	34,800
350	-	74,400
400	-	95,200
450	-	125,900
500	-	174,000
600	-	243,600
700	-	313,200

Source : LWUA Design Dept.

BREAKDOWN OF COSTS IN %

	Local Component			F E C		Total
	Material	Labor		Direct	Indirect	
		Skilled	Unskilled			
Equipment	9	-	-	63	5	77
Civil Works	12	3	6	-	2	23
Total	21	3	6	63	7	100

(7) Internal Network

Population Density (Person/ha)	Total Length of Pipeline (m/ha)	Unit Cost (₱/ha)	
		Diameter (100/150)	Diameter (75/100)
50	64	18,300	14,900
60	67	19,300	15,700
75	72	20,900	16,800
100	80	23,100	18,700
150	90	25,700	21,000
200	100	28,300	-
250	108	30,400	-
300	116	32,500	-

BREAKDOWN OF COSTS IN %

	Local Component			F E C		Total
	Material	Labor		Direct	Indirect	
		Skilled	Unskilled			
Equipment	22	-	-	7	27	56
Civil Works	17	7	4	-	16	44
Total	39	7	4	7	43	100

## (8) In-place of Service Connections

Diameter (inch)	Without Meter ₱/unit	With Meter ₱/unit	Meters ₱/unit
1/2	450	810	400
5/8 - 3/4	520	1,280	880

## SERVICE CONNECTION WITHOUT METER

## BREAKDOWN OF COSTS IN %

	Material	Local Component		Direct	F E C		Total
		Labor			Indirect		
		Skilled	Unskilled				
Equipment	9	-	-	60	2.5		71.5
Civil Works	17	3	6	-	2.5		28.5
<b>Total</b>	<b>26</b>	<b>3</b>	<b>6</b>	<b>60</b>	<b>5</b>		<b>100</b>

## SERVICE CONNECTION WITHOUT METER

## BREAKDOWN OF COSTS IN %

	Material	Local Component		Direct	F E C		Total
		Labor			Indirect		
		Skilled	Unskilled				
Equipment	4	-	-	83	2		89
Civil Works	6	1	3	-	1		11
<b>Total</b>	<b>10</b>	<b>1</b>	<b>3</b>	<b>83</b>	<b>3</b>		<b>100</b>

## (9) Fire Hydrant In-place Cost

Type	Size (mm)	Unit Cost (₱)
Commercial	150	16,800
Residential	100	9,400

## BREAKDOWN OF COSTS IN %

	Material	Local Component		Direct	F E C		Total
		Labor			Indirect		
		Skilled	Unskilled				
Equipment	8	-	-	57	5		70
Civil Works	10	8	10	-	2		30
<b>Total</b>	<b>18</b>	<b>8</b>	<b>10</b>	<b>57</b>	<b>7</b>		<b>100</b>



## (10) Elevated Tank/Ground Reservoir

$$\text{Elevated Tank: } C = 0.615 H^{1.144} V^{0.749}$$

$$\text{Ground Reservoir: } C = 20.05 V^{0.639}$$

where, C = cost (thousand peso)

H = overflow elevation above ground level

V = storage volume (cu.m)

## BREAKDOWN OF COSTS IN %

	Local Component			F E C		Total
	Material	Labor		Direct	Indirect	
		Skilled	Unskilled			
Equipment	4	-	-	3	2	9
Civil Works	53	5	7	-	26	91
Total	57	5	7	3	28	100

## (11) Gas Chlorinator In-place Cost

Type	Water Flow Condition	Maximum Chlorine Feed (kg/day)	Unit cost <sup>1/</sup> (P)
I-A	constant	22	98,100
I-B	constant	45	119,100
II-A	Variable	22	147,700
II-B	Variable	45	169,300

<sup>1/</sup> Empty gas cylinders and automatic switchover include

TYPE I-A, I-B  
BREAKDOWN OF COSTS IN %

	Local Component			F E C		Total
	Material	Labor		Direct	Indirect	
		Skilled	Unskilled			
Equipment	15	-	-	41	5	61
Civil Works	25	6	3	-	5	39
Total	40	6	3	41	10	100

TYPE II-A, II-B  
BREAKDOWN OF COSTS IN %

	Local Component			F E C		Total
	Material	Labor		Direct	Indirect	
		Skilled	Unskilled			
Equipment	21	-	-	53	2	76
Civil Works	12	6	2	-	4	24
Total	33	6	2	53	6	100

(12) Administration & Operation Building

Future Service Population	Administration Bldg. (Thousand Peso)	Operation Center (Thousand Peso)
30,000	1,000	810
40,000	1,110	890
50,000	1,220	990
60,000	1,320	1,090
70,000	1,410	1,180
80,000	1,500	1,280
100,000	1,610	1,380
110,000	1,820	1,590

ADMINISTRATION BUILDING  
BREAKDOWN OF COSTS IN %

	Local Component			F E C		Total
	Material	Labor		Direct	Indirect	
		Skilled	Unskilled			
Equipment	20	-	-	-	16	36
Civil Works	42	7	5	-	10	64
Total	62	7	5	-	26	100

OPERATION CENTER  
BREAKDOWN OF COSTS IN %

	Local Component			F E C		Total
	Material	Labor		Direct	Indirect	
		Skilled	Unskilled			
Equipment	14	-	-	30	6	50
Civil Works	26	10	5	-	9	50
Total	40	10	5	30	15	100

(13) Energy Cost

$$C = N_p \times h \times P_u \times (E_m)^{-1}$$
$$N_p = Q \times g \times H \times (\text{Eff.} \times 1,000)^{-1}$$

where,

C = cost (thousand peso)  
N<sub>p</sub> = pump power demand (kw)  
h = hours of operation  
P<sub>u</sub> = unit power cost (₱/kwh)  
E<sub>m</sub><sup>u</sup> = motor efficiency (0.85)  
Q<sup>m</sup> = water pumped (kg/sec)  
g = gravity constant (9.81m/sq.sec)  
H = manometric head (m)  
Eff. = pump efficiency (average = 0.70)

(14) Chemical Cost

$$C = (\text{Annual Water Demand}) \cdot D \cdot U_{CL} \times 10^{-3}$$

where,

C = annual cost for chlorine (₱)  
D = chlorine dosage (mg/l)  
U<sub>CL</sub> = unit cost of chlorine gas (₱/kg)

(15) Minimum Cost Diameter

Following cost function is applied to determine the most economical diameter of pipelines that are not simulated by the network analysis.

$$D_{\text{min.}} = 187.7 Q^{0.486} C^{-0.315} (E_c/O_e)^{0.17}$$

where,

D<sub>min.</sub> = minimum cost diameter  
Q = water flow (l/sec)  
C = "C" value (Hazen William Formula)  
E<sub>c</sub> = energy cost (₱/kwh)  
O<sub>e</sub> = overall efficiency


APPENDIX 7.3.1      COMPUTER-AIDED HYDRAULIC ANALYSIS OF DISTRIBUTION  
SYSTEM (Dagupan City)

o List of Computed Cases

Alternative	D-A	(1995, 2010)
	D-A	(Fire at LUCAO/2010)
	D-B	(1995, 2010)

o Note

This appendix shows the results of Hydraulic Analysis aided by the computer. The distribution network is shown in the figure of following page. The nodes, however, with no flow and 20.00 m in Dynamic Head was treated as a dummy node. Those nodes can be ignored and have no relation to the computation results.

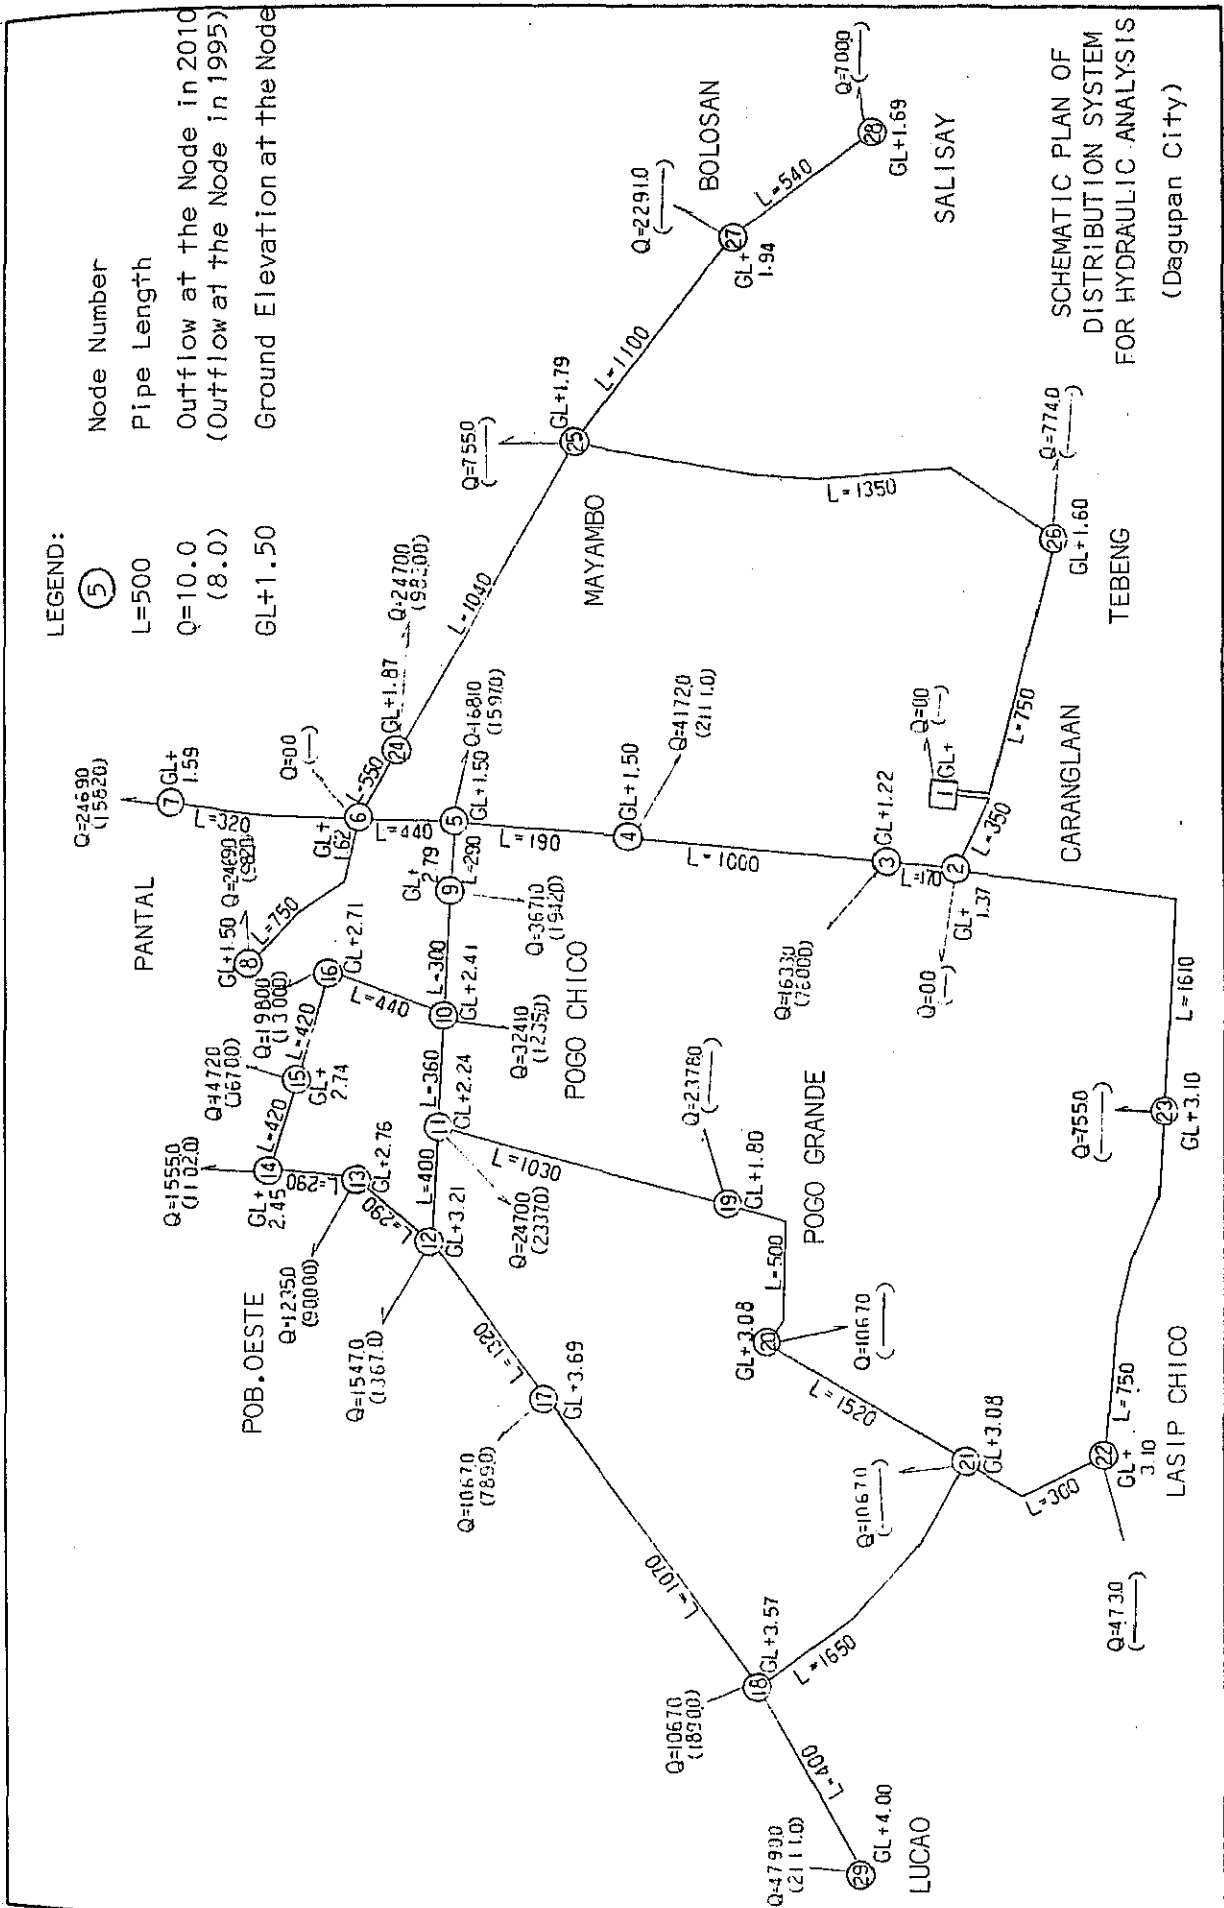

ALTERNATIVE D-A (Recommended Plan, Single Pipeline Alignment)  
Year 1995

<< NODES >>

NODE No.	GROUND ELEV. (m)	FLOW (cu. m/day)	H. G. L. ELEV. (m)	DYNAMIC HEAD (m)	STATIC HEAD (m)
1	30.00	0.00	30.00	0.00	0.00
2	1.37	0.00	29.83	28.45	28.63
3	1.22	76.00	29.85	28.43	28.78
4	1.50	2111.00	28.60	27.10	28.50
5	1.50	1597.00	28.44	26.94	28.50
6	1.62	0.00	28.14	26.52	28.38
7	1.59	1582.00	27.27	25.68	28.41
8	1.50	952.00	27.29	25.79	28.50
9	2.79	1942.00	28.06	25.27	27.21
10	2.41	1235.00	27.59	25.18	27.59
11	2.24	2337.00	27.14	24.90	27.76
12	3.21	1357.00	26.70	23.49	26.79
13	2.76	90.00	26.68	23.92	27.24
14	2.45	1102.00	26.55	24.10	27.55
15	2.74	367.00	27.04	24.30	27.26
16	2.71	1300.00	27.15	24.44	27.29
17	3.69	769.00	25.23	21.54	26.31
18	3.57	189.00	24.54	20.97	25.43
19	1.80	0.00	21.80	20.00	28.20
20	3.08	0.00	23.08	20.00	28.92
21	3.08	0.00	23.08	20.00	28.92
22	3.10	0.00	23.10	20.00	28.90
23	3.10	0.00	23.10	20.00	28.90
24	1.87	982.00	27.96	26.09	28.13
25	1.79	0.00	21.79	20.00	28.21
26	1.60	0.00	21.60	20.00	28.40
27	1.94	0.00	21.94	20.00	28.06
28	1.69	0.00	21.69	20.00	28.31
29	4.00	2111.00	24.32	20.32	26.00

Iteration Times : 11

ALTERNATIVE D-A (Recommended Plan, Single Pipeline Alignment)  
Year 1995

<< PIPELINE >>

PIPE No.	NODE No. from-to	DIA. (mm)	LENGTH (m)	H-W C	FLOW (cu. m/day)	VEL. (m/sec)	HEADLOSS (m) (0/00)
1	2	1	700.	130.	-20159.	-0.61	-0.17
2	2	3	600.	130.	20159.	0.83	0.18
3	3	4	600.	130.	20083.	0.82	1.05
4	4	5	600.	130.	17972.	0.74	0.16
5	5	6	350.	120.	3546.	0.43	0.30
6	5	7	500.	120.	12829.	0.76	0.37
7	6	7	200.	110.	1562.	0.58	2.72
8	6	8	200.	110.	982.	0.36	0.84
9	6	24	250.	120.	982.	0.23	0.18
10	9	10	450.	120.	10887.	0.79	0.48
11	10	11	400.	120.	6980.	0.64	0.45
12	10	16	300.	110.	2672.	0.44	0.44
13	11	12	350.	120.	4643.	0.56	0.45
14	12	13	200.	110.	186.	0.07	0.02
15	12	17	300.	120.	3089.	0.51	0.11
16	13	14	100.	110.	97.	0.14	0.13
17	14	15	200.	110.	1005.	-0.37	-0.49
18	15	16	300.	120.	-1372.	-0.22	-0.10
19	17	18	300.	120.	2300.	0.35	0.69
20	18	29	300.	120.	2111.	0.35	0.22

ALTERNATIVE D-A (Recommended Plan, Single Pipeline Alignment)  
Year 2010

<< NODES >>

NODE No.	GROUND ELEV. (m)	FLOW (cu. m/day)	H. G. L. ELEV. (m)	DYNAMIC HEAD (m)	STATIC HEAD (m)
1	30.00	0.00	30.00	0.00	0.00
2	1.37	0.00	29.15	27.18	28.63
3	1.22	1633.00	28.43	27.21	28.78
4	1.50	4172.00	24.50	23.00	28.50
5	1.50	1681.00	23.88	22.38	28.50
6	1.52	0.00	21.76	20.14	28.38
7	1.59	2469.00	19.78	18.19	28.41
8	1.50	2469.00	17.11	15.61	28.50
9	2.79	3671.00	22.60	19.81	27.21
10	2.41	3241.00	20.96	18.55	27.59
11	2.24	2470.00	18.56	17.32	27.75
12	3.21	1547.00	18.40	15.19	26.79
13	2.75	1235.00	17.95	15.20	27.24
14	2.45	1555.00	18.05	15.60	27.55
15	2.74	1472.00	19.26	16.52	27.26
16	2.71	1980.00	19.73	17.02	27.29
17	3.69	1067.00	14.70	11.01	25.31
18	3.57	1067.00	12.75	9.19	25.43
19	1.80	2378.00	12.09	10.29	26.20
20	3.08	1067.00	10.15	7.07	26.92
21	3.08	1067.00	14.45	11.37	26.92
22	3.10	473.00	15.56	12.46	26.90
23	3.10	755.00	19.01	15.91	26.90
24	1.87	2470.00	17.72	15.85	28.13
25	1.79	755.00	15.33	13.54	28.21
26	1.60	774.00	20.69	18.09	28.40
27	1.94	2291.00	12.54	10.60	28.06
28	1.69	700.00	11.22	9.53	28.31
29	4.00	4790.00	11.76	7.76	25.00

Iterations : 6

ALTERNATIVE D-A (Recommended Plan, Single Pipeline Alignment)  
Year 2010

<< PIPELINE >>

PIPE No.	NODE No. from-to	DIA. (mm)	LENGTH (m)	H-W C	FLOW (cu. m/day)	VEL. (m/sec)	HEADLOSS (m) (0/00)
1	2 1	700.	350.	130.	-47529.	-1.43	-0.85
2	2 2	500.	170.	130.	42648.	0.72	-2.44
3	2 3	250.	1610.	120.	4882.	1.15	4.23
4	3 4	600.	1000.	130.	41018.	1.68	6.29
5	4 5	600.	190.	130.	36852.	1.51	3.93
6	5 6	350.	440.	120.	10242.	1.23	3.22
7	6 7	500.	290.	120.	24938.	1.47	2.12
8	7 8	200.	320.	110.	2469.	0.91	4.41
9	8 9	200.	750.	110.	2469.	0.91	6.20
10	9 10	450.	550.	120.	5305.	1.25	6.20
11	10 11	450.	300.	120.	21270.	1.55	4.04
12	11 12	400.	360.	120.	12948.	1.19	1.65
13	12 13	300.	440.	120.	5084.	0.83	3.88
14	13 14	350.	400.	120.	7793.	0.94	2.79
15	14 15	200.	1030.	110.	2657.	0.99	2.91
16	15 16	200.	290.	110.	1156.	0.43	1.16
17	16 17	300.	1320.	120.	5091.	0.83	7.47
18	17 18	100.	290.	110.	-79.	-0.12	0.44
19	18 19	200.	420.	120.	-1634.	-0.60	0.44
20	19 20	200.	420.	120.	-3104.	-0.51	-0.09
21	20 21	300.	1070.	120.	4025.	0.66	-1.21
22	21 22	250.	1650.	120.	-1830.	-0.43	-0.47
23	22 23	300.	400.	120.	4790.	0.78	1.81
24	23 24	100.	500.	120.	309.	0.46	-1.69
25	24 25	150.	1520.	110.	309.	0.46	1.80
26	25 26	250.	300.	120.	-758.	-0.50	1.93
27	26 27	250.	750.	120.	-3654.	-0.86	-4.30
28	27 28	250.	1040.	120.	-4125.	-0.97	-1.10
29	28 29	150.	1350.	110.	2835.	0.67	-3.45
30	29 30	250.	1100.	120.	-911.	-0.60	-4.61
31	30 31	150.	750.	110.	2991.	0.71	-2.39
32	31 32	150.	540.	110.	-1685.	-1.10	-5.36
					700.	-0.46	-1.10
					-700.	0.46	-9.31
							-12.41
							-1.32
							-2.44

ALTERNATIVE D-A (Recommended Plan, Single Pipeline Alignment)  
 Year 2010, Fire at LUCAD

<< NODES >>

NODE No.	GROUND ELEV. (m)	FLOW (cu. m/day)	H.G.L. ELEV. (m)	DYNAMIC HEAD (m)	STATIC HEAD (m)
1	30.00	0.00	30.00	0.00	0.00
2	1.37	0.00	29.56	28.19	28.63
3	1.22	1014.00	29.20	27.98	28.78
4	1.56	2591.00	27.24	25.74	28.50
5	1.50	1044.00	26.93	25.43	28.50
6	1.62	0.00	26.06	24.44	28.38
7	1.59	1534.00	25.24	23.65	28.41
8	1.50	1534.00	24.13	22.63	28.50
9	2.79	2280.00	25.21	23.42	27.21
10	2.41	2013.00	25.25	22.84	27.59
11	2.24	1534.00	24.28	22.04	27.16
12	3.21	961.00	23.27	20.06	26.79
13	2.76	767.00	23.17	20.41	27.24
14	2.45	966.00	23.78	21.33	27.55
15	2.74	914.00	24.46	21.72	27.26
16	2.71	1230.00	24.68	21.97	27.29
17	3.59	663.00	18.71	15.02	26.31
18	3.57	663.00	18.76	12.19	26.43
19	1.80	1477.00	20.54	18.74	28.20
20	3.08	663.00	17.80	14.72	26.92
21	3.10	294.00	18.53	15.45	26.92
22	3.10	294.00	18.47	16.37	26.90
23	3.10	458.00	22.20	19.10	26.90
24	1.67	1533.00	24.42	22.55	28.13
25	1.79	489.00	23.45	21.67	28.21
26	1.60	481.00	23.92	24.32	28.40
27	1.94	1423.00	22.30	20.35	28.05
28	1.59	435.00	21.76	20.07	28.31
29	4.05	6775.00	13.86	9.81	23.95

Iteration Times : 6

ALTERNATIVE D-A (Recommended Plan, Single Pipeline Alignment)  
 Year 2070, Fire at LUCAD

<< PIPELINE >>

PIPE No.	NODE No. from-to	DIA. (mm)	LENGTH (m)	H-W C	FLOW (cu. m/day)	VEL. (m/sec)	HEADLOSS (m) (0/100)
1	2	700	1700	130	-33303	-1.00	-0.44
2	3	600	350	130	29197	1.20	1.26
3	4	250	1610	120	4106	0.97	7.36
4	5	600	1900	130	28184	1.15	4.57
5	6	600	190	130	25593	1.05	1.96
6	7	350	440	120	6330	0.76	0.31
7	8	500	290	120	18222	1.07	0.82
8	9	200	320	110	1534	0.57	2.47
9	10	200	750	110	1534	0.57	2.57
10	11	250	550	120	3262	0.77	2.98
11	12	450	300	120	15942	1.16	1.64
12	13	400	360	120	10597	0.98	0.97
13	14	300	440	120	3333	0.55	2.68
14	15	350	400	120	7213	0.87	1.28
15	16	200	1030	110	1850	0.68	1.01
16	17	200	390	110	543	0.20	3.63
17	18	300	1320	120	5709	0.93	3.74
18	19	180	290	110	224	0.33	4.57
19	20	200	420	110	-1190	-0.44	-0.62
20	21	300	420	120	-2103	-0.34	-1.60
21	22	300	1070	120	5046	0.83	-0.54
22	23	250	1650	130	-2391	-0.56	-2.95
23	24	300	400	120	6775	1.11	2.77
24	25	180	500	110	373	0.55	-1.90
25	26	150	1520	110	-290	-0.19	2.74
26	27	250	300	120	-3343	-0.79	-0.48
27	28	250	750	120	-3637	-0.86	-3.12
28	29	250	1040	120	1729	0.41	-2.74
29	30	150	1350	110	-598	-0.41	0.96
30	31	250	1100	120	1858	0.34	-2.46
31	32	150	750	110	-1079	-0.71	1.16
32	27	150	540	110	435	0.28	-4.08
							0.55
							1.01



ALTERNATIV D-B (Parallel Pipeline Alignment of Recommended Plan)  
Year 1995

<< NODES >>

NODE No.	GROUND ELEV. (m)	FLOW (cu.m/day)	H.G.L. ELEV. (m)	DYNAMIC HEAD (m)	STATIC HEAD (m)
1	30.00	0.00	30.00	0.00	0.00
2	1.37	0.00	28.26	28.89	28.53
3	1.22	76.00	27.42	26.20	28.78
4	1.50	2111.00	22.49	20.99	28.50
5	1.50	1597.00	21.73	20.23	28.50
6	1.52	0.00	15.39	14.77	28.38
7	1.59	1582.00	12.86	11.27	28.41
8	1.50	992.00	12.97	11.47	28.50
9	2.79	1942.00	20.62	17.83	27.21
10	2.41	1235.00	19.01	15.60	27.59
11	2.24	2337.00	17.99	15.75	27.76
12	3.21	1367.00	16.76	13.55	26.79
13	2.78	150.00	15.64	12.88	27.24
14	2.45	1102.00	9.03	6.58	27.55
15	2.74	367.00	10.53	7.79	27.25
16	2.71	1300.00	17.22	14.51	27.29
17	3.69	789.00	13.20	9.51	26.31
18	3.57	189.00	11.53	7.96	26.43
19	1.80	0.00	21.80	20.00	28.20
20	3.08	0.00	23.08	20.00	28.92
21	3.08	0.00	23.08	20.00	26.92
22	3.10	0.00	23.10	20.00	26.90
23	3.10	0.00	23.10	20.00	26.90
24	1.97	982.00	13.83	12.01	28.13
25	1.79	0.00	21.79	20.00	28.21
26	1.60	0.00	21.60	20.00	28.40
27	1.94	0.00	21.94	20.00	28.05
28	1.69	0.00	21.69	20.00	28.31
29	4.00	2111.00	11.00	7.00	26.00

Iteration Times : 6

ALTERNATIV D-B (Parallel Pipeline Alignment of Recommended Plan)  
Year 1995

<< PIPELINE >>

PIPE No.	NODE No. from-to	DIA. (mm)	LENGTH (m)	H-W C	FLOW (cu.m/day)	VEL. (m/sec)	HEADLOSS (m) (D/100)
1	1 2	450.	350.	120.	-20144.	-1.47	-1.74
2	2 3	450.	170.	120.	20146.	1.47	0.84
3	3 4	450.	1000.	120.	20070.	1.46	4.93
4	4 5	450.	190.	120.	17961.	1.31	0.76
5	5 6	200.	440.	110.	3546.	1.31	5.34
6	6 7	400.	290.	120.	12823.	1.18	3.81
7	7 8	150.	320.	110.	1582.	1.04	3.53
8	8 9	150.	750.	110.	982.	0.64	3.43
9	9 10	150.	550.	110.	982.	0.64	2.51
10	10 11	350.	300.	120.	10882.	1.31	1.62
11	11 12	350.	360.	120.	7685.	0.92	1.02
12	12 13	200.	440.	110.	1963.	0.72	1.79
13	13 14	300.	400.	120.	5349.	0.88	1.23
14	14 15	150.	290.	110.	895.	0.59	1.12
15	15 16	250.	1320.	120.	3087.	0.73	3.56
16	16 17	100.	290.	110.	805.	1.19	6.51
17	17 18	100.	420.	110.	-296.	-0.44	-1.50
18	18 19	100.	420.	110.	-663.	-0.98	-6.59
19	19 20	250.	1070.	120.	2299.	0.54	1.67
20	20 29	250.	400.	120.	2111.	0.50	1.33

ALTERNATIVE D-B (Parallel Pipeline Alignment of Recommended Plan)  
Year 2010

<< NODES >>

NODE No.	GROUND ELEV. (m)	FLOW (cu. m/day)	H.G.L. ELEV. (m)	DYNAMIC HEAD (m)	STATIC HEAD (m)
1	30.00	0.00	30.00	0.00	0.00
2	1.37	0.00	28.21	26.84	28.53
3	1.22	1633.00	27.27	26.05	28.78
4	1.50	4172.00	22.13	20.63	28.50
5	1.50	1681.00	21.33	19.83	28.50
6	1.59	0.00	18.66	17.04	28.38
7	1.59	2469.00	16.43	14.84	28.41
8	1.50	2469.00	13.43	11.93	28.50
9	2.79	3671.00	20.21	17.48	21.21
10	2.41	3241.00	19.17	16.76	21.59
11	2.24	2470.00	18.39	16.15	21.76
12	3.21	1547.00	17.29	14.08	26.79
13	2.76	1235.00	15.72	12.96	27.24
14	2.45	1555.00	15.14	12.69	27.55
15	2.74	1472.00	17.11	14.37	27.26
16	2.71	1980.00	17.93	15.22	27.29
17	3.69	1067.00	14.76	11.07	26.31
18	3.57	1067.00	12.51	8.94	26.43
19	1.80	2378.00	10.66	8.86	28.20
20	3.08	1067.00	10.31	7.23	25.92
21	3.10	473.00	15.15	11.03	25.92
22	3.10	755.00	18.46	15.36	26.90
23	1.87	2470.00	16.02	14.15	28.13
24	1.79	755.00	13.74	11.95	28.21
25	1.60	774.00	19.93	18.33	28.40
26	1.94	2291.00	10.84	9.00	28.05
27	1.69	7700.00	9.63	7.94	28.31
28	4.00	4790.00	11.37	7.37	26.00

Iteration Times : 7

ALTERNATIVE D-B (Parallel Pipeline Alignment of Recommended Plan)  
Year 2010

<< PIPELINE >>

PIPE No.	NODE No. from--to	DIA. (mm)	LENGTH (m)	H-W C	FLOW (cu. m/day)	VEL. (m/sec)	HEADLOSS (m) (0/00)
1	1 2	450	350	120	-20469	-1.49	-1.79
2	2 2	500	350	120	-27005	-1.59	-1.79
3	2 3	450	170	120	21347	1.55	5.52
4	2 4	450	170	120	21347	1.55	5.52
5	2 5	450	1610	120	4782	1.13	9.75
6	3 4	450	1000	120	20531	1.49	5.14
7	3 5	450	1000	120	20531	1.49	5.14
8	4 4	450	190	120	18447	1.34	4.22
9	4 5	450	190	120	18447	1.34	4.22
10	5 5	200	440	110	2439	0.90	2.67
11	5 6	300	440	120	7730	1.27	2.67
12	5 7	400	290	120	12523	1.15	1.06
13	5 8	400	290	120	12523	1.15	1.06
14	6 6	150	320	110	1235	0.81	2.23
15	6 7	150	320	110	1235	0.81	2.23
16	6 8	150	750	110	1234	0.81	5.23
17	6 9	150	750	110	1234	0.81	5.23
18	6 24	150	550	110	1010	0.66	2.65
19	6 25	150	550	120	4222	1.00	2.65
20	9 10	350	300	120	8831	1.06	4.81
21	9 9	400	300	120	12546	1.16	3.66
22	10 10	350	360	120	6674	0.80	1.10
23	10 11	350	360	120	6674	0.80	1.10
24	10 16	200	440	110	1617	0.60	0.79
25	10 16	250	440	120	3173	0.75	2.83
26	11 11	300	400	120	5029	0.82	1.25
27	11 12	250	400	120	3114	0.73	1.09
28	11 19	200	1030	110	2736	0.71	2.74
29	11 13	150	290	110	1080	0.71	7.73
30	12 12	100	290	110	372	0.55	1.58
31	12 17	250	1320	120	2573	0.61	5.44
32	12 17	250	1320	120	2573	0.61	1.92
33	13 14	100	290	110	216	0.51	2.54
34	14 15	100	420	110	-343	-0.51	0.58
35	14 15	150	420	110	-996	-0.65	-4.69
36	15 15	100	420	110	-214	-0.32	-1.97
37	15 16	250	420	120	-2587	-0.61	-4.69
38	17 18	250	1070	120	2101	0.61	-0.82
39	17 18	200	1070	110	1371	0.51	-1.96
40	18 21	250	1850	120	-1778	-0.42	2.25
41	18 29	250	400	120	3173	0.75	2.10
42	18 29	200	400	110	1617	0.60	-0.97
43	19 20	150	500	110	358	0.23	1.13
44	20 21	150	520	110	-709	-0.46	2.83
45	21 22	250	500	120	-3554	-0.84	0.35
46	22 23	250	750	120	-4027	-0.95	-3.80
47	24 25	250	1040	120	-984	-0.65	-1.05
48	25 26	150	1350	110	-984	-0.64	-3.30
49	25 27	150	1100	120	-2881	-0.71	2.28
50	25 27	150	750	110	-1756	-0.71	-6.19
51	27 28	150	540	110	-700	-0.46	-10.07
							-13.43
							-2.44

Bazupuan	ITEM	Phase I (Stage 1)		Phase I (Stage 2)		Phase I		Phase I		
		UNIT COST	NUMBER	COST	NUMBER	COST	NUMBER	COST	NUMBER	COST
1	SOURCE FACILITY									
	(1) DEEP WELL CONSTRUCTION	640000	8	5120	7	4480	15	9600	0	0
	(2) DEEP WELL PUMP w/HOUSE	450000	8	3600	7	3150	15	6750	0	0
	Flow Meter D=100	25000	8	200	7	175	15	375	0	0
	(3) DEEP WELL PUMP REPAIR	252000	10	2520	0	0	10	2520	0	0
	Flow Meter D=100	25000	10	250	0	0	10	250	0	0
	(4) RADIAL WELL	1760000	0	0	0	0	0	0	4	7040
	WELL PUMP	403000	0	0	0	0	0	0	9	3627
	RADIAL WELL PUMP HOUSE	834000	0	0	0	0	0	0	4	2536
	SUB-TOTAL			11690		7805		19495		13203
2	TRANSMISSION FACILITIES									
	(1) Main Pipe D=600 (Steel)	1600	0	0	0	0	0	26000	41600	
	(2) Main Pipe									
	D=150 (PVC Pipe)	410	5400	2214	3850	1578	9250	3793	0	
	D=200 (Steel Pipe)	520	1500	780	1050	546	2550	1326	0	
	D=250 (Steel Pipe)	630	1000	630	1050	662	2050	1292	0	
	D=300 (Steel Pipe)	760	750	570	550	418	1300	988	2400	
	D=350 (Steel Pipe)	900	4000	3600	700	630	4700	4230	1824	
	SUB-TOTAL			7794		3835		11629		43424
3	Slow Sand Filtration Plant		0	0	0	0	0	0	1	9544
4	DISTRIBUTION FACILITIES									
	(1) Reservoir		(2400)	2898	0	0	(2400)	2898	(4550)	4362
	(2) Pump Facility (Equip.)			1784		800		2584		3394
	-do- (Civil)			1331		0		1331		1748
	(3) Chlorination Facility	98100	11	1079	0	0	11	1079	45kg/dx1	119
	(4) Electric Sub-station		200KVA	2620			200KVA	2620	400KVA	1020
	(5) Distribution pipes									
	1) Main Pipes									
	D=150 (PVC Pipe)	410	0	0	0	0	0	4160	1706	
	D=200 (Steel Pipe)	520	0	0	1780	926	1780	926	1030	
	D=250 (Steel Pipe)	630	0	0	550	347	550	347	6150	
	D=300 (Steel Pipe)	760	440	334	3210	2440	3650	2774	0	
	D=350 (Steel Pipe)	900	440	398	400	360	840	756	0	
	D=400 (Steel Pipe)	970	300	291	0	0	300	291	0	
	D=450 (Steel Pipe)	1160	240	278	0	0	240	278	0	
	D=500 (Steel Pipe)	1330	290	386	0	0	290	386	0	
	D=600 (Steel Pipe)	1600	1360	2176	0	0	1360	2176	0	
	D=700 (Steel Pipe)	1910	350	669	0	0	350	669	0	
	RIVER CROSSING CD=1.5m	1658	120	199	0	0	120	199	300	
	D=450 Materials	626	120	75	0	0	120	75	0	
	D=250 Materials	340	0	0	0	0	0	0	300	
	2) Valves									
	D=150 (Gate Valve)	5300	0	0	6	32	6	32	14	
	D=200 (Gate Valve)	6700	0	0	6	40	6	40	3	
	D=250 (Gate Valve)	11200	0	0	2	22	2	22	22	
	D=300 (Butterfly Valve)	34800	2	70	10	348	12	418	0	
	D=350 (Butterfly Valve)	74400	2	149	1	74	3	223	0	
	D=400 (Butterfly Valve)	95200	1	95	0	0	1	95	0	
	D=450 (Butterfly Valve)	125900	1	126	0	0	1	126	0	
	D=500 (Butterfly Valve)	174000	1	174	0	0	1	174	0	
	D=600 (Butterfly Valve)	243600	5	1218	0	0	5	1218	0	
	D=700 (Butterfly Valve)	313200	1	313	0	0	1	313	0	
	3) Internal Network									
	UPTO 1990			5049		0		5049		
	UPTO 1995			0		898		898		
	4) Service Connections									
	D=1/2	810	2279	1846	3811	3086	6090	4932	8940	
	D=3/4	1280	17	22	7	9	24	31	16	
	5) Rehabilitation									
	Water Meter 1/2''	400	1392	557	0	0	1392	557		
	Water Meter 3/4''	880	16	14	0	0	16	14		
	Old Laterals			571	0	0	0	571		
	Service Connect.wo/Metr	480	724	348	0	0	724	348		
	Service Connect.w/Meter	880	1401	1233	0	0	1401	1233		
	6) Flow Meter									
	D=600	215000	0	0	0	0	0	0	1	
	7) Fire Protection									
	D=150	16800	0	0	0	0	0	0	62	
	D=100	9400	0	0	0	0	0	0	281	
	SUB-TOTAL			26301		9382		35683		34939
5	1) Administration Bldg								1	1610
	2) Operation Center		1	1380			1	1380	0	0
	SUB-TOTAL			1380				1380		1610
6	Land Acquisition	60	2200	132	0	0	2200	132	22000	1320
	Vehicle	300000	2	600	1	300	3	900	3	900
	Stored Material & Equip.		0	503	0	247	0	750		898
	SUB-TOTAL			1235		547		1782		3118
7	Replacement of Equipment			0		0		0		14562
	TOTAL			48400		21569		69989		120400
8	Leakage Detection	240	4250	1020	0	0	4250	1020		0
	GRAND TOTAL			49420		21569		70989		120400

(Unit: thousand Pesos)

Davao	ITEM	UNIT COST	1988		1989		1990		1991	
			NO	COST	NO	COST	NO	COST	NO	COST
<b>1 SOURCE FACILITY</b>										
	(1) DEEP WELL CONSTRUCTION	640000		0	4	2580	4	2560	2	1280
	(2) DEEP WELL PUMP w/HOUSE	450000		0	4	1800	4	1800	2	900
	Flow Meter D=100	25000		0	4	100	4	100	2	50
	(3) DEEP WELL PUMP REPAIR	252000		0	10	2520		0		0
	Flow Meter D=100	25000		0	10	250		0		0
	(4) RADIAL WELL	1760000		0		0		0		0
	WELL PUMP	403000		0		0		0		0
	RADIAL WELL PUMP HOUSE	634000		0		0		0		0
	SUB-TOTAL			0		7230		4460		2230
<b>2 TRANSMISSION FACILITIES</b>										
	(1) Main Pipe D=600 (Steel)	1600		0		0		0		0
	(2) Main Pipe									
	D=150 (PVC Pipe)	410		0	2900	1189	2500	1025	1050	431
	D=200 (Steel Pipe)	520		0	1500	780	0	0	0	0
	D=250 (Steel Pipe)	630		0	1000	630	0	0	0	0
	D=300 (Steel Pipe)	780		0	750	570	0	0	550	418
	D=350 (Steel Pipe)	900		0	2500	2250	1500	1350	700	630
	SUB-TOTAL			0		5419		2375		1479
<b>3 Slow Sand Filtration Plant</b>										
<b>4 DISTRIBUTION FACILITIES</b>										
	(1) Reservoir				(2400)	2898				
	(2) Pump Facility (Engrg.)					1784				800
	-do- (Civil)					1331				
	(3) Chlorination Facility	98100			11	1079				
	(4) Electric Sub-station				1	2620				
	(5) Distribution pipes		1988		1989		1990		1991	
	1) Main Pipes									
	D=150 (PVC Pipe)	410		0		0		0		0
	D=200 (Steel Pipe)	520		0		0		0	1780	926
	D=250 (Steel Pipe)	630		0		0		0	550	347
	D=300 (Steel Pipe)	760		0		0	440	334	3210	2440
	D=350 (Steel Pipe)	900		0		0	440	386	400	360
	D=400 (Steel Pipe)	970		0		0	300	291		0
	D=450 (Steel Pipe)	1160		0		0	240	273		0
	D=500 (Steel Pipe)	1330		0		0	290	386		0
	D=600 (Steel Pipe)	1600		0	1360	2176		0		0
	D=700 (Steel Pipe)	1910		0	350	669		0		0
	RIVER CROSSING CD=1.5m	1658		0		0	120	199		0
	D=450 Materials	626		0		0	120	75		0
	D=250 Materials	340		0		0		0		0
	2) Valves									
	D=150 (Gate Valve)	5300		0		0		0	6	32
	D=200 (Gate Valve)	6700		0		0		0	6	40
	D=250 (Gate Valve)	11200		0		0		0	2	22
	D=300 (Butterfly Valve)	34800		0		0	2	70	10	348
	D=350 (Butterfly Valve)	74400		0		0	2	149	1	74
	D=400 (Butterfly Valve)	95200		0		0	1	95		0
	D=450 (Butterfly Valve)	125900		0		0	1	126		0
	D=500 (Butterfly Valve)	174000		0		0	1	174		0
	D=600 (Butterfly Valve)	243600		0	5	1218		0		0
	D=700 (Butterfly Valve)	313200		0	1	313		0		0
	3) Internal Network					2525		2524		180
	UPTO 1990									
	UPTO 1995									
	4) Service Connections									
	D=1/2	810		0	1139	923	1140	923	763	618
	D=3/4	1280		0	8	10	9	12	1	1
	5) Rehabilitation									
	Water Meter 1/2"	400	1392	557	0	0	0	0		
	Water Meter 3/4"	880	16	14	0	0	0	0		
	Old Laterals					286		285		
	Service Connect.w/Meter	480	242	116	241	116	241	116		
	Service Connect.w/Meter	880	467	411	467	411	467	411		
	6) Flow Meter									
	D=100	215000		0		0		0		0
	7) Fire Protection									
	D=150	16800								
	D=100	9400								
	SUB-TOTAL			1098		18359		6844		6188
<b>5 Administration Bldg</b>										
	(1) Administration Bldg				1	1380				
	(2) Operation Center									
	SUB-TOTAL			0	1	1380		0		0
<b>6 Land Acquisition</b>										
	Vehicle	300000		300		300		0		300
	Stored Material & Equip.			20		331		140		118
	SUB-TOTAL			452		634		140		418
<b>7 Replacement of Equipment</b>										
	TOTAL			1550		33022		13828		10315
<b>8 Leakage Detection</b>										
	TOTAL	240	1420	341	1420	341	1410	338		0
	GRAND TOTAL			1891		33363		14166		10315

(Unit: thousand Pesos)

Maximan	ITEM	UNIT COST	1992		1993		1994		1995	
			NO	COST	NO	COST	NO	COST	NO	COST
<b>1 SOURCE FACILITY</b>										
	(1)DEEP WELL CONSTRUCTION	640000	1	640	1	640	2	1280	1	640
	(2)DEEP WELL PUMP w/HOUSE	450000	1	450	1	450	2	900	1	450
	Flow Meter D=100	25000	1	25	1	25	2	50	1	25
	(3)DEEP WELL PUMP REPAIR	252000		0		0		0		0
	Flow Meter D=100	25000		0		0		0		0
	(4)RADIAL WELL	1760000		0		0		0		0
	WELL PUMP	403000		0		0		0		0
	RADIAL WELL PUMP HOUSE	634000		0		0		0		0
	SUB-TOTAL			1115		1115		2230		1115
<b>2 TRANSMISSION FACILITIES</b>										
	(1)Main Pipe D=600(Steel)	1600		0		0		0		0
	(2)Main Pipe			0		0		0		0
	D=150 (PVC Pipe)	410	1100	451	400	164	900	369	400	164
	D=200 (Steel Pipe)	520	0	0	0	0	450	234	600	312
	D=250 (Steel Pipe)	630	0	0	550	347	500	315	0	0
	D=300 (Steel Pipe)	760	0	0	0	0	0	0	0	0
	D=350 (Steel Pipe)	900	0	0	0	0	0	0	0	0
	SUB-TOTAL			451		311		918		476
<b>3 Slow Sand Filtration Plant</b>										
<b>4 DISTRIBUTION FACILITIES</b>										
	(1)Reservoir									
	(2)Pump Facility (Equip.)									
	do- (Civil)									
	(3)Chlorination Facility	98100								
	(4)Electric Sub-station									
	(5)Distribution pipes		1992		1993		1994		1995	
	1)Main Pipes									
	D=150 (PVC Pipe)	410		0		0		0		0
	D=200 (Steel Pipe)	520		0		0		0		0
	D=250 (Steel Pipe)	630		0		0		0		0
	D=300 (Steel Pipe)	760		0		0		0		0
	D=350 (Steel Pipe)	900		0		0		0		0
	D=400 (Steel Pipe)	970		0		0		0		0
	D=450 (Steel Pipe)	1160		0		0		0		0
	D=500 (Steel Pipe)	1330		0		0		0		0
	D=600 (Steel Pipe)	1600		0		0		0		0
	D=700 (Steel Pipe)	1910		0		0		0		0
	RIVER CROSSING CD=1.5m	1658		0		0		0		0
	D=450 Materials	626		0		0		0		0
	D=250 Materials	340		0		0		0		0
	2)Valves									
	D=150 (Gate Valve)	5300		0		0		0		0
	D=200 (Gate Valve)	6700		0		0		0		0
	D=250 (Gate Valve)	11200		0		0		0		0
	D=300 (Butterfly Valve)	34800		0		0		0		0
	D=350 (Butterfly Valve)	74400		0		0		0		0
	D=400 (Butterfly Valve)	95200		0		0		0		0
	D=450 (Butterfly Valve)	125900		0		0		0		0
	D=500 (Butterfly Valve)	174000		0		0		0		0
	D=600 (Butterfly Valve)	243600		0		0		0		0
	D=700 (Butterfly Valve)	313200		0		0		0		0
	3)Internal Network									
	UPTO 1990									
	UPTO 1995			180		180		179		179
	4)Service Connections									
	D=1/2	810	762	617	762	617	762	617	762	617
	D=3/4	1280	2	3	1	1	2	3	1	1
	5)Renabilitation									
	Water Meter 1/2"	400								
	Water Meter 3/4"	880								
	Old Laterals									
	Service Connect.w/Metr	480								
	Service Connect.w/Meter	880								
	6)Flow Meter									
	D=600	215000		0		0		0		0
	7)Fire Protection									
	D=150	16800								
	D=100	9400								
	SUB-TOTAL			800		798		799		797
<b>5 Administration Bldg</b>										
<b>2)Operation Center</b>										
	SUB-TOTAL			0		0		0		0
<b>6 Land Acquisition</b>										
	Vehicle	300000		0		0		0		0
	Stored Material & Equip.			28		29		14		28
	SUB-TOTAL			28		29		14		28
<b>7 Replacement of Equipment</b>										
	TOTAL			2394		2153		2091		2116
<b>8 Leakage Detection</b>										
		240		0		0		0		0
	GRAND TOTAL			2394		2153		2091		2116