


B-2 Kathmandu Transmitting Station
Electric Work

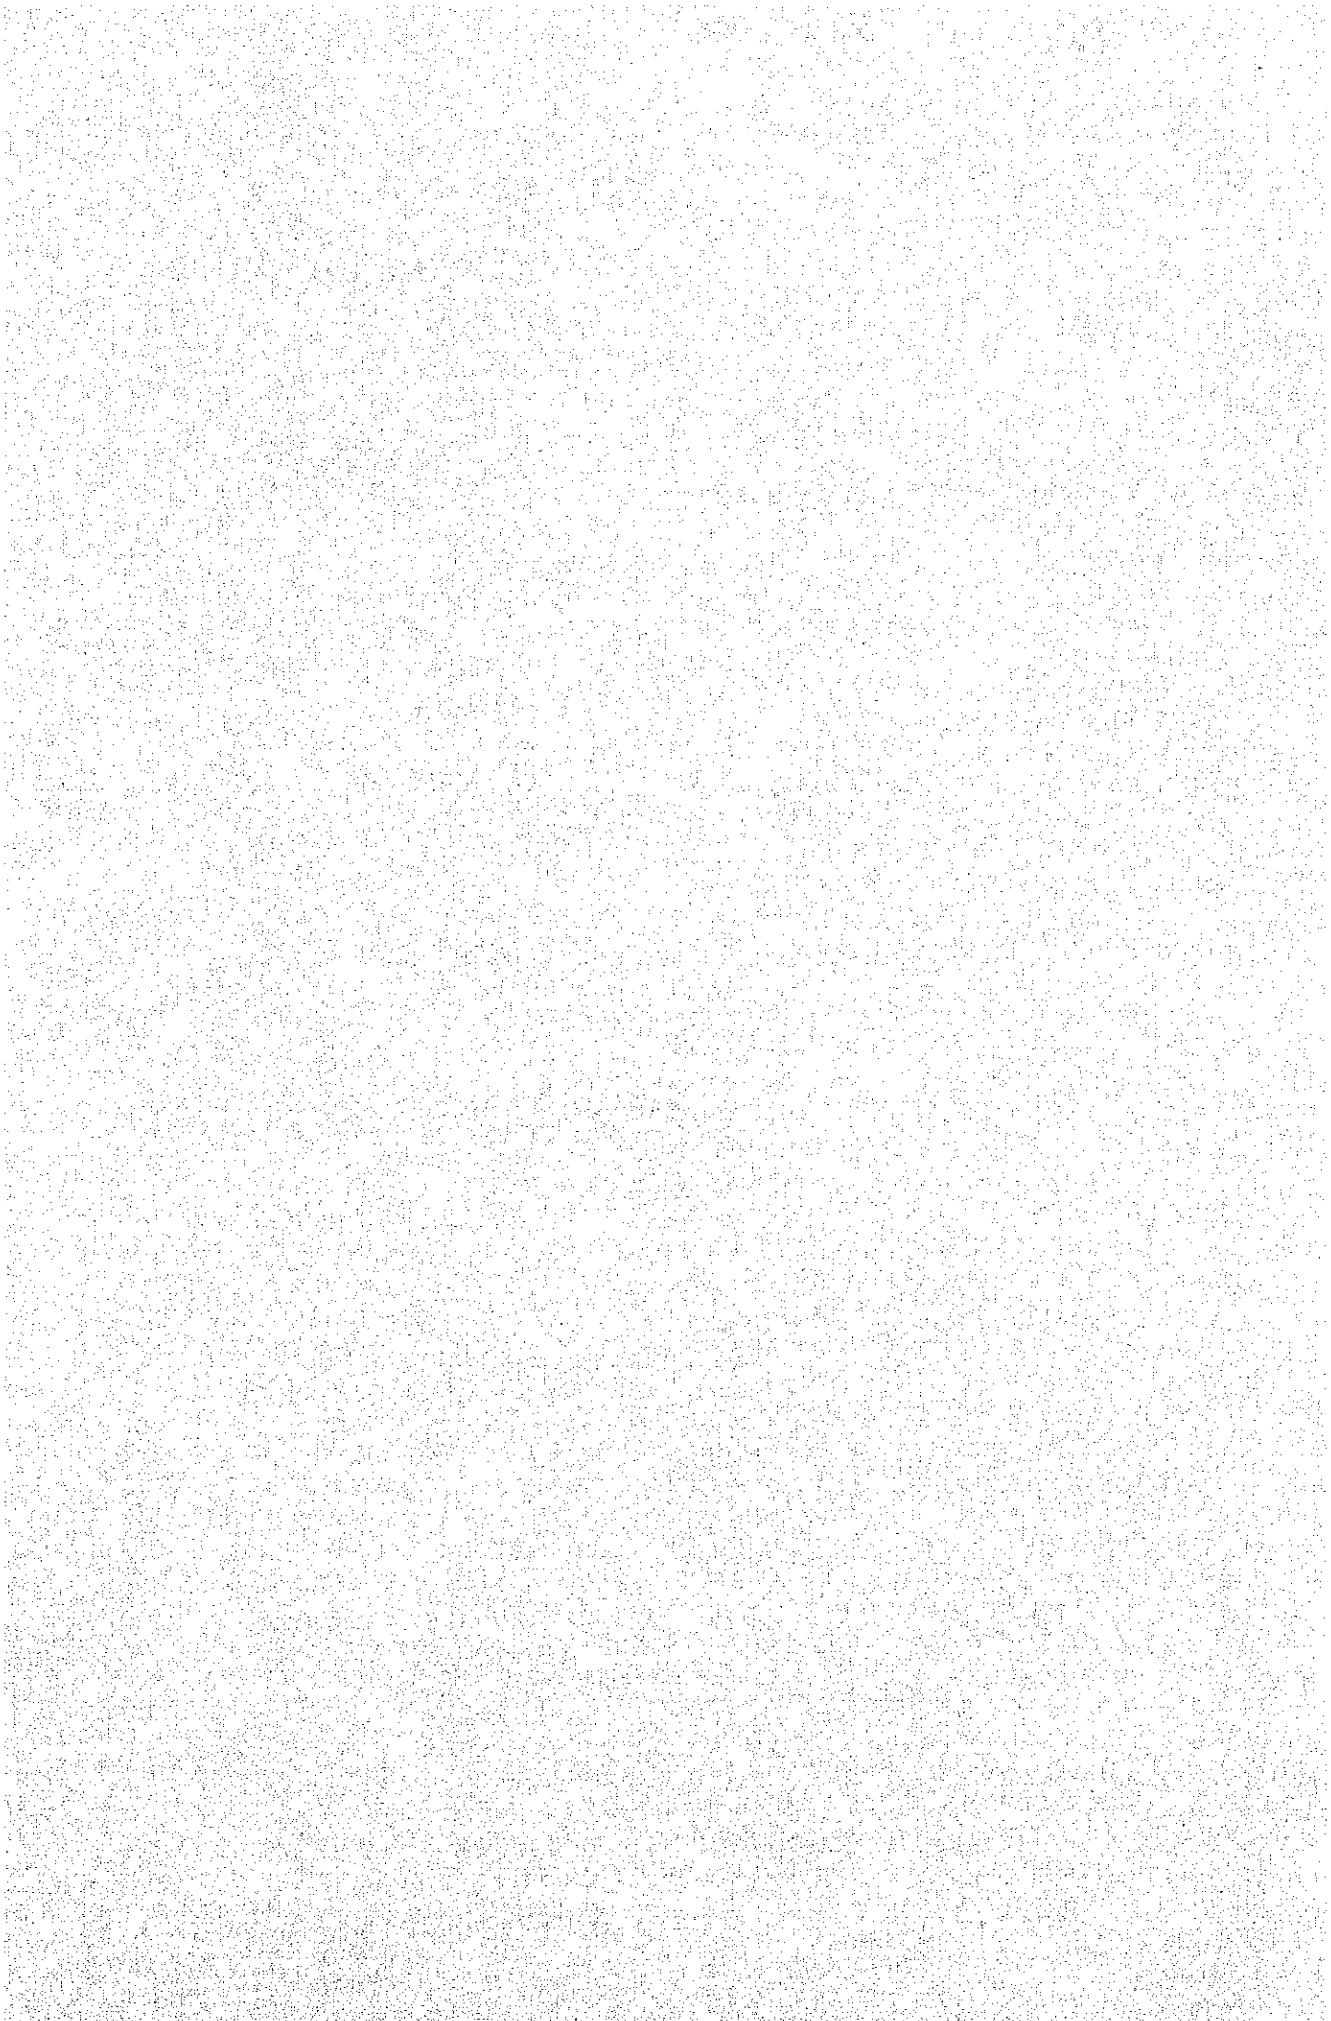

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|--|------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| B-2 KATHMANDU TRANSMITTING STATION | | | | | | | |
| ELECTRIC WORK | | | | | | | |
| (1) 配線設備工事 Feeder Wiring Installation | lot | 1 | | | | | |
| (2) 動力設備工事 Power Wiring Installation | lot | 1 | | | | | |
| (3) 接地設備工事 Earthing Installation | lot | 1 | | | | | |
| (4) 管内配電設備 Lighting & socket Outlet Installation 工事 | lot | 1 | | | | | |
| (5) 電話配線設備 Telephone Conduit Installation 工事 | lot | 1 | | | | | |
| (6) A-A 配電設備 Interphone Installation Lot | lot | 1 | | | | | |
| (7) 火報設備工事 Fire Alarm System lot | lot | 1 | | | | | |

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|-----------------------------|-----------------------------|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| B-7 KATHMANDU STUDIO CENTER | | | | | | | |
| (1) 幹線設備工事 | | | | | | | |
| Feeder Wiring Installation | | | | | | | |
| 電線, H-IV | Wire & Cable | | | | | | |
| | 1000V IV 5.5mm ² | LM | | | | | |
| | " 14mm ² | " | | | | | |
| | " 22mm ² | " | | | | | |
| | " 38mm ² | " | | | | | |
| | 1000V CV 5.5P-2C | " | | | | | |
| | " 5.5P-2C | " | | | | | |
| | " 9P-4C | " | | | | | |
| | " 3P-2C | " | | | | | |
| | 1000V FP 2P-2C | " | | | | | |
| H-IV 設備 | Cable Rack | | | | | | |
| | 600W | LM | | | | | |
| | 400W | " | | | | | |
| | 200W | " | | | | | |
| 同上 設備 | Accessory for the Above Lot | Lot | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|--|------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| カネテック 754φ 分岐 Branch & Bend for Cable Rack | | | | | | | |
| L Bend 400W | pc | 1 | | | | | |
| " 200W | " | 1 | | | | | |
| T Branch 600W | " | 1 | | | | | |
| 400W | " | 3 | | | | | |
| T Branch 600W | " | 1 | | | | | |
| 電線管 Conduit Tube | | | | | | | |
| 19φ 3.66 m | pc | 4 | | | | | |
| 25φ " | " | 1 | | | | | |
| 31φ " | " | 9 | | | | | |
| 39φ " | " | 1 | | | | | |
| 51φ " | " | 1 | | | | | |
| 54φ PE coating 3.66 m | " | 3 | | | | | |
| 82φ " | " | 4 | | | | | |
| カネテック 754φ 分岐 Accessory for the Above Lot | | 1 | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) | |
|----------|--|----------|---------------|--------|-------------|--------|-------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | TOTAL | TOTAL |
| 1-300パイプ | Conduit Tube Bend | | | | | | | |
| | 3/4" | 4 | | | | | | |
| | 3/4" | 1 | | | | | | |
| | 5/4" | 1 | | | | | | |
| | 54 PE coating | 2 | | | | | | |
| | 82 " | 4 | | | | | | |
| 出口ボックス | Outlet Box | | | | | | | |
| | 1 Deep | 1 | | | | | | |
| 銅板 | CUPPER PLATE | | | | | | | |
| | 0.3T | 18 | | | | | | |
| 金属ワケ | WIRING DUCT | | | | | | | |
| | 450 ^w x 200 ^p x 2.750 ^H | 1 | | | | | | |
| | 700 ^w x 150 ^p x 2.750 ^H | 1 | | | | | | |
| 配管支持板 | SUPPORTING MATERIALS Lot | | | | | | | |
| 接地板 | Earthing Materials Lot | 1 | | | | | | |
| 塗料 | PAINT | 1 | | | | | | |
| 雑材 | MISCELLANEOUS MATERIALS | 1 | | | | | | |
| 小計 | SUBTOTAL | | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) | |
|----------------------------|------|----------|---------------|--------|-------------|--------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | AMOUNT | TOTAL |
| (2) 動力設備工事 | | | | | | | | |
| Power Winding Installation | | | | | | | | |
| 電線 H-71L | | | | | | | | |
| Wire & Cable | | | | | | | | |
| 600V 1.6mm | LM | 364 | | | | | | |
| " 2.0mm | " | 930 | | | | | | |
| 600V 2.5P-4C | " | 12 | | | | | | |
| " 2P-4C | " | 6 | | | | | | |
| CW 2P-2C | " | 16 | | | | | | |
| 電線管 | | | | | | | | |
| Conduit Tube | | | | | | | | |
| 19φ 366 ML | PL | 12 | | | | | | |
| 25φ | " | 42 | | | | | | |
| 31φ | " | 4 | | | | | | |
| 39φ | " | 6 | | | | | | |
| 22φ PE Coating 366 ML | " | 2 | | | | | | |
| 28φ | " | 3 | | | | | | |
| 同上材料 | | | | | | | | |
| Accessory for the Above | Lot | 1 | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|----------|---------------------|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| 1-211421 | Conduit Tube bend | | | | | | |
| | 31P | 2 | | | | | |
| | 32P | 4 | | | | | |
| | 32P PE Coating | 2 | | | | | |
| | Pull Box | | | | | | |
| | 300x300x100 | 2 | | | | | |
| | Outlet Box | | | | | | |
| | M shallow | 6 | | | | | |
| | Blind plate | 6 | | | | | |
| | Fleat-less Switch | | | | | | |
| | 3-poles | 1 | | | | | |
| | 5-poles | 1 | | | | | |
| | Alarm Indicator | 1 | | | | | |
| | Power Central Board | | | | | | |
| | P-1 | 1 | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|---------|------------------------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| P-2 | pc | 1 | | | | | |
| P-3 | " | 1 | | | | | |
| 配管支持板 | Supporting Materials | Lot | | | | | |
| 接地板 | Earthing Materials | Lot | | | | | |
| 塗料 | PAINT | Lot | | | | | |
| 雜項材料 | MISCELLANEOUS MATERIAL | Lot | | | | | |
| 小計 | SUB TOTAL | | | | | | |
| 前務費 | LABOR | Lot | | | | | |
| 電工 | ELECTRICIAN | | | | | | |
| 人工 | CARLIE | | | | | | |
| 計 | TOTAL | | | | | | |

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|------------|---|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| (3) 接地装置工事 | Earthing Installation | | | | | | |
| 電線 | Wire | | | | | | |
| | 600x 14 60mm ² LM | 12 | | | | | |
| H=110x70 | Vinyl Pipe | | | | | | |
| | 22φ 4m L | 17 | | | | | |
| 同工程材料 | Accessory for the Above Lot | 1 | | | | | |
| 接地板 | Earthing Materials Set | 4 | | | | | |
| | (U. Plate 2 ^m x 0.5 ^m - 16) | | | | | | |
| | (An. Rod 14φ x 3 ^m - 8) | | | | | | |
| 接地装置工事 | Earthing Terminal | 1 | | | | | |
| | Box For 3 Terminals | | | | | | |
| 接地装置材料 | Miscellaneous Materials Lot | 1 | | | | | |
| 小計 | Sub Total | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) | |
|--------------|-------------|----------|-----------------|--------|---------------|--------|---------|--|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | TOTAL | |
| 労働費 | | | | | | | | |
| 電工 | labor | | | | | | | |
| 木 | Electrician | 107 | | | | | | |
| | coolie | 107 | | | | | | |
| | | | | | | | | |
| 木 | | | | | | | | |
| Total | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|--|------|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| (4) 燈行以設備工事 Lighting & Socket- outlet Installation | | | | | | | |
| (A) 器具取付工事 Lighting Fixture Installation | | | | | | | |
| 照明器具 Lighting Fixture | pc | 14 | | | | | |
| A1 | " | 2 | | | | | |
| A2 | " | 3 | | | | | |
| A3 | " | 9 | | | | | |
| B | " | 2 | | | | | |
| D | " | 3 | | | | | |
| E | " | 43 | | | | | |
| F | " | 4 | | | | | |
| G | " | 6 | | | | | |
| H | " | 2 | | | | | |
| I | " | 2 | | | | | |
| J | " | 2 | | | | | |
| K | " | 2 | | | | | |
| L | " | 1 | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|--|-------------|----------|-----------------|--------|---------------|--------|---------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | TOTAL |
| M type | pc | 14 | | | | | |
| " | " | 4 | | | | | |
| " | " | " | | | | | |
| 照明器具取付金物 Fitting Metal for Lighting Fixture | Lot | 1 | | | | | |
| 雑材料若手品 Miscellaneous Materials | Lot | 1 | | | | | |
| 小計 | Sub Total | | | | | | |
| 労務費 | Labor | | | | | | |
| 監工 | Electrician | 1 | | | | | |
| 計 | Total | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) | TOTAL |
|-------------------------|------|----------|---------------|--------|-------------|--------|-------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | | |
| (B) 配管配線工事 | | | | | | | | |
| Piping & Wiring Works | | | | | | | | |
| 電線 仕立 | | | | | | | | |
| Wire & Cable | | | | | | | | |
| 600V 1X 16mm | LM | 11317 | | | | | | |
| " 20mm | " | 721 | | | | | | |
| 600V FP 2.0-2C | " | 91 | | | | | | |
| Conduit Tube | | | | | | | | |
| 19φ 366 mL | PC | 164 | | | | | | |
| 25φ " | " | 66 | | | | | | |
| 器具材料 | | | | | | | | |
| Accessory for the Above | Lot | 1 | | | | | | |
| 出口ボックス | | | | | | | | |
| Outlet Box | | | | | | | | |
| M Shallow | PC | 150 | | | | | | |
| L Deep | " | 25 | | | | | | |
| ソケット | | | | | | | | |
| Socket Outlet | | | | | | | | |
| 230V 2P15A X 2 | PC | 39 | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|---------|-------------------------|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| スイッチ | Switch, Flash Mounting | | | | | | |
| | IP-10A | 13 | | | | | |
| | " , 2gang | 11 | | | | | |
| | " , 3gang | 1 | | | | | |
| | 2way-10A 2gang | 2 | | | | | |
| スイッチ | Photo switch 3A | 1 | | | | | |
| 分電盤 | Lighting Panel | | | | | | |
| | L-1 | 1 | | | | | |
| 配管支持板 | Supporting Materials | 1 | | | | | |
| 接地板 | Earthing Materials | 1 | | | | | |
| 雑材料費程取 | Miscellaneous Materials | 1 | | | | | |
| 小計 | Sub Total | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) | |
|-------------------|------|----------|---------------|--------|-------------|--------|-------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | TOTAL | TOTAL |
| 劳務費 Labor | . | | | | | | | |
| 電工 Electrician | lot | 1 | | | | | | |
| 計 Total | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|------------------------------|------|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| (5) 電話設備工事 TELEPHONE CONDUIT | | | | | | | |
| INSTALATION | | | | | | | |
| 商線 4-Tile | | | | | | | |
| WIRE & CABLE | | | | | | | |
| 600' IV 5.5 mm ² | KM | 15 | | | | | |
| 電信管 | | | | | | | |
| Conduit Tube | | | | | | | |
| 250 3.66 ML | PC | 15 | | | | | |
| 300 PE Coating 3.66 ML | " | 11 | | | | | |
| ビニルパイプ | | | | | | | |
| VINYL PIPE | PC | 5 | | | | | |
| 160 4ML | " | | | | | | |
| 目上付属品 | | | | | | | |
| ACCESSORY FOR THE ABOVE LOT | | 1 | | | | | |
| 1-300バンド | | | | | | | |
| Conduit Tube Bend | | | | | | | |
| 300 PE Coating | PC | 2 | | | | | |
| 300 PE Coating | | | | | | | |
| 300 PE Coating | | | | | | | |
| Outlet Box | | | | | | | |
| M shallow | " | 8 | | | | | |
| 1200Vト | | | | | | | |
| Telephone Cord Outlet | " | 2 | | | | | |
| 低電圧 | | | | | | | |
| Low-Tension | " | 6 | | | | | |


| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|---------|-------------------------------|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| 電話端子箱 | Telephone-Terminal Box | | | | | | |
| | pc | 1 | | | | | |
| ハンドホール | Hand-Hole | | | | | | |
| | 900 x 900 x 1500 ^D | 1 | | | | | |
| | w/middle weight lid | | | | | | |
| 配管支持板 | Supporting Materials | 1 | | | | | |
| 接地板 | Earthing Materials | 1 | | | | | |
| 材料消耗品 | Miscellaneous Materials | 1 | | | | | |
| | 小計 | | | | | | |
| | Sub Total | | | | | | |
| 労務費 | Labor | | | | | | |
| | Electrician | 1 | | | | | |
| | Coolie | 1 | | | | | |
| | 計 | | | | | | |
| | Total | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) | |
|---|------|----------|---------------|--------|-------------|--------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | AMOUNT | TOTAL |
| 16) 1-A-10 設備工事 Interphone Installation | | | | | | | | |
| 配線管 Conduit Tube | pc | 157 | | | | | | |
| 25P 36mm | | | | | | | | |
| 同工付属品 Accessory for the Above | Lot | 1 | | | | | | |
| 出口ボックス Outlet Box | pc | 8 | | | | | | |
| M Shallow | | | | | | | | |
| 250-20-1 Telephone Cord Outlet | pc | 8 | | | | | | |
| 配管支持板 Supporting Materials | Lot | 1 | | | | | | |
| 材料消耗品 Miscellaneous Materials | Lot | 1 | | | | | | |
| 小計 Sub Total | | | | | | | | |
| 労務費 Labor | Lot | 1 | | | | | | |
| Electrician | | | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|---|------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| (1) 警報設備工事 Fire Alarm System Installation | | | | | | | |
| 電線, H-FIL Wire & Cable | LM | 307 | | | | | |
| 600x14 1.2mm " H14 1.2mm | " | 104 | | | | | |
| 電線管 Conduit Tube | pc | 42 | | | | | |
| 100 3.66ml 250 " | " | 3 | | | | | |
| 同上作業品 Accessory for the Above | lot | 1 | | | | | |
| Outlet Box M shallow | pc | 35 | | | | | |
| 警報盤 Control Panel | pc | 1 | | | | | |
| P-type 1st class 5 Zones | | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|---------|-------------------------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| 組合錠 | Combination Box | Lot | | | | | |
| 感知器 | Fire Detector | | | | | | |
| 定温式 | Fixed-Temperature | | | | | | |
| | Spd type, 1st class | 12 | | | | | |
| 并温防水式 | Ditto, Water proof | 2 | | | | | |
| 并温式 | Rate-of-Rise Spot | | | | | | |
| | type, 2nd class | 21 | | | | | |
| 配管材料 | Supporting Materials | Lot | | | | | |
| 雑材等 | Miscellaneous Materials | Lot | | | | | |
| 小計 | Sub Total | | | | | | |
| 労務費 | Lebor | | | | | | |
| | Electrician | 1 | | | | | |
| 計 | Total | | | | | | |

B-3 Pokhara Transmitting Station
Electric Work

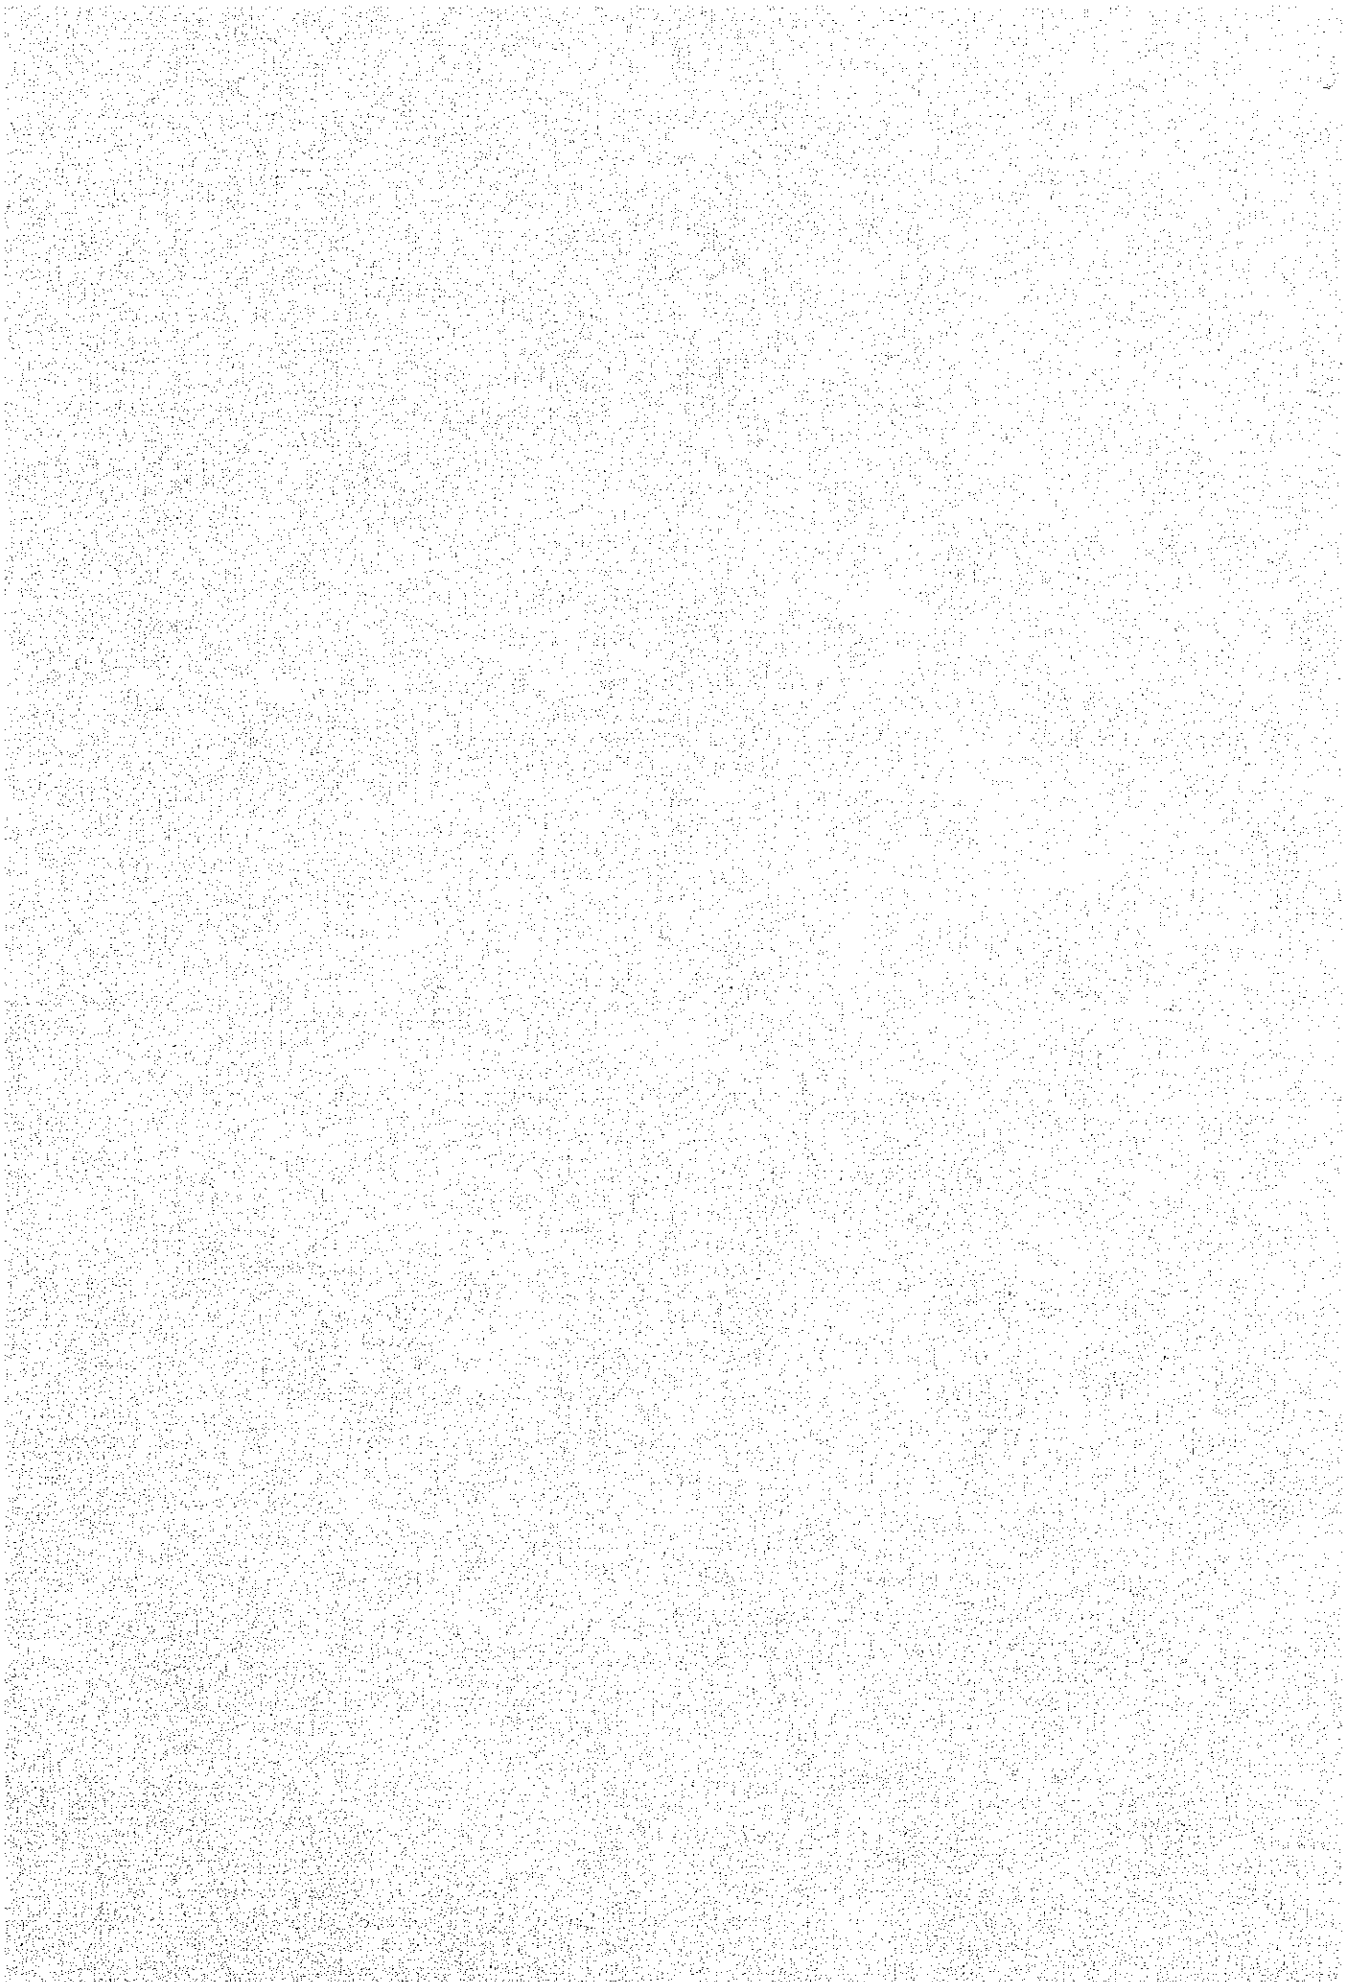

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|--|------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| B-3 POKHARA TRANSMITTING STATION | | | | | | | |
| ELECTRIC WORK | | | | | | | |
| (1) 新架設工事・Feeder Wiring Installation | Lot | 1 | | | | | |
| (2) 架設工事 Power Wiring Installation | Lot | 1 | | | | | |
| (3) 接地工事 Earthing Installation | Lot | 1 | | | | | |
| (4) 燈門・コンセント工事 Lighting & Socket outlet Installation | Lot | 1 | | | | | |
| (5) 電話配線工事 Telephone Conduit Installation | Lot | 1 | | | | | |
| (6) 1-A 市電工事 Interphone Installation | Lot | 1 | | | | | |
| (7) 火災警報工事 Fire Alarm System | Lot | 1 | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) | |
|-----------------------------|------|----------|---------------|--------|-------------|--------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | AMOUNT | TOTAL |
| (9) 放映機設備 Piping for Studio | lot | 1 | | | | | | |
| 工事 | | | | | | | | |
| 訂 subtotal | | | | | | | | |
| | | | | | | | | |
| (10) 仮設工事 TEMPORARY | lot | 1 | | | | | | |
| WORK | | | | | | | | |
| | | | | | | | | |
| 合計 TOTAL | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|--|------|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| B-3 POKHARA TRANSMITTING STATION | | | | | | | |
| (1) 電線敷設工事 Feeder Wiring Installation | | | | | | | |
| 電線, H-710 Wire & Cable | | | | | | | |
| 600V IV 5.5mm ² | LM | 73 | | | | | |
| " 14mm ² | " | 68 | | | | | |
| " 22mm ² | " | 58 | | | | | |
| " 38mm ² | " | 5 | | | | | |
| 600V CV 5.5 ^o -AC | " | 33 | | | | | |
| " 5.5 ^o -3C | " | 39 | | | | | |
| " 5.5 ^o -2C | " | 25 | | | | | |
| " 8 ^o -AC | " | 50 | | | | | |
| " 38 ^o -3C | " | 18 | | | | | |
| 600V FP 22 ^o -2C | " | 25 | | | | | |
| H-710 Cable Rack | LM | | | | | | |
| 600W | " | 18 | | | | | |
| 900W | " | 34 | | | | | |
| 200W | " | 3 | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|--|------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| 同上 Accessory for the Above Lot | Lot | 1 | | | | | |
| ケーブルジョイント、バンド Branch & Bend for Cable Rack | | | | | | | |
| E-Bend 400W | pc | 1 | | | | | |
| " 200W | " | 1 | | | | | |
| T Branch 600W | " | 1 | | | | | |
| " 400W | " | 3 | | | | | |
| F Branch 600W | " | 1 | | | | | |
| 導線管 Conduit Tube | | | | | | | |
| 10φ 366ML | pc | 5 | | | | | |
| 25φ " | " | 1 | | | | | |
| 31φ " | " | 4 | | | | | |
| 39φ " | " | 1 | | | | | |
| 51φ " | " | 1 | | | | | |
| 54φ PE Coating 366ML | " | 3 | | | | | |
| 92φ " | " | 4 | | | | | |
| 同上 Accessory for the Above Lot | Lot | 1 | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|------------|-------------------------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| 1-2100-1-1 | Conduit Tube Bend | | | | | | |
| | 3/4" | 7 | | | | | |
| | 3/4" | 1 | | | | | |
| | 5/8" | 1 | | | | | |
| | 5/8" PE Coating | 2 | | | | | |
| | 3/2" | 4 | | | | | |
| 2-1100-1-1 | Outlet Box | | | | | | |
| | L Deep | 1 | | | | | |
| 銅板 | CUPPER PLATE | | | | | | |
| | 0.3t | 18 | | | | | |
| 金属ダクト | WIRING DUCT | | | | | | |
| | 450" x 200" x 2.750" H | 1 | | | | | |
| | 700" x 150" x 2.750" H | 1 | | | | | |
| 配管支持材 | SUPPORTING MATERIALS | | | | | | |
| 接地材 | EARTHING MATERIALS | 1 | | | | | |
| 塗料 | PAINT | 1 | | | | | |
| 雑材消耗品 | MISCELLANEOUS MATERIALS | 1 | | | | | |
| 小計 | SUB TOTAL | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) | |
|------------|----------------------------|----------|---------------|--------|-------------|--------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | AMOUNT | TOTAL |
| (2) 動力設備工事 | Power Wiring Installation | | | | | | | |
| 電線工 | Wire & Cable | | | | | | | |
| | LM | 656 | | | | | | |
| | 600V IV 1.6mm | 072 | | | | | | |
| | " 2.0mm | 28 | | | | | | |
| | " 5.5mm ² | 20 | | | | | | |
| | 600V CV 35 ^o AC | 13 | | | | | | |
| | " 2 ^o - AC | 16 | | | | | | |
| | 600V 2 ^o - TC | 8 | | | | | | |
| | " 2 ^o - TC | | | | | | | |
| 電線管 | Conduit Tube | | | | | | | |
| | 190 3.66 x 1/2 | 18 | | | | | | |
| | 250 " | 57 | | | | | | |
| | 310 " | 4 | | | | | | |
| | 510 " | 3 | | | | | | |
| | 120 PE Coating 3.66 x 1/2 | 4 | | | | | | |
| | 280 " | 12 | | | | | | |
| 工事付属品 | Accessory for the Above | 1 | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|-------------------|------|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| 1-2ILBAND | | | | | | | |
| Conduit Tube bend | | | | | | | |
| 3/4" | pc | 2 | | | | | |
| 5/8" | " | 2 | | | | | |
| 200 PE Casting | " | 6 | | | | | |
| 7ILBAND | | | | | | | |
| Pull Box | | | | | | | |
| 450 x 450 x 700 | pc | 1 | | | | | |
| 300 x 300 x 100 | " | 2 | | | | | |
| Outlet Box | | | | | | | |
| M Shallow | pc | 6 | | | | | |
| Blind plate | pc | 6 | | | | | |
| Float-less switch | | | | | | | |
| 3-poles | pc | 1 | | | | | |
| 5-poles | " | 1 | | | | | |
| Alarm Indicator | pc | 1 | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) | |
|---------|-----------------------------|----------|---------------|--------|-------------|--------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | AMOUNT | TOTAL |
| 電力用銅板 | Power Control Board | | | | | | | |
| | P-1 | 1 | | | | | | |
| | P-2 | 1 | | | | | | |
| | P-3 | 1 | | | | | | |
| 配電材料 | Supporting Materials Lot | 1 | | | | | | |
| 接地板 | Earthing Materials | 1 | | | | | | |
| 塗料 | PAINT | 1 | | | | | | |
| 粗成消耗品 | MISCELLANEOUS MATERIALS Lot | 1 | | | | | | |
| 小計 | Sub Total Lot | 1 | | | | | | |
| 労務費 | Labor | | | | | | | |
| 職工 | Electrician Lot | 1 | | | | | | |
| 人夫 | Coolie Lot | 1 | | | | | | |
| 計 | Total | | | | | | | |

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|------------|--|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| (3) 接地設備工事 | Earthing Installation | | | | | | |
| 電線 | Wire | | | | | | |
| | 600x 14 60mm ² LM | 52 | | | | | |
| H=V1870 | Vinyl Pipe | | | | | | |
| | 22φ 4m L PC | 17 | | | | | |
| 同左材料 | Accessory for the Above Lot | 1 | | | | | |
| 接地材 | Earthing Materials Set | 4 | | | | | |
| | (Cu. Plate 2 ^m x 0.5 ^m - 16) | | | | | | |
| | (Cu. Rod 10φ x 3 ^m - 8) | | | | | | |
| 接地端子箱 | Earthing Terminal Box For 3 Terminals | 1 | | | | | |
| 接地設備工事 | Miscellaneous Materials Lot | 1 | | | | | |
| 小計 | Sub Total | | | | | | |

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|---------------------------------------|------|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| (4) 燈具及安裝工程 | | | | | | | |
| Lighting & Socket-outlet Installation | | | | | | | |
| (A) 燈具及安裝工程 | | | | | | | |
| Lighting Fixture Installation | | | | | | | |
| 照明器具 | | | | | | | |
| Lighting Fixture | | | | | | | |
| A1 Type | PC | 18 | | | | | |
| A2 " | " | 2 | | | | | |
| A3 " | " | 4 | | | | | |
| B " | " | 8 | | | | | |
| C " | " | 3 | | | | | |
| D " | " | 5 | | | | | |
| E " | " | 3 | | | | | |
| F " | " | 4 | | | | | |
| G " | " | 4 | | | | | |
| H " | " | 6 | | | | | |
| I " | " | 2 | | | | | |
| J " | " | 2 | | | | | |
| K " | " | 2 | | | | | |
| L " | " | 1 | | | | | |

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|---|-------------------------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| (B) 配管配線工事 Riping & Wiring works. | | | | | | | |
| 電線 H-7il | Wire & Cable | | | | | | |
| | 600x 14 1.6mm | LM | | 1.781 | | | |
| | " 2.0mm | " | | 716 | | | |
| | 600x FP 1.0-2.0 | " | | 91 | | | |
| 電線管 | Conduit Tube | | | | | | |
| | 100 3.66 M.L. | pc. | | 165 | | | |
| | 250 " | " | | 62 | | | |
| 同上 付属品 | Accessory for the Above | Lot | | 1 | | | |
| 電圧器収納箱 | Ballast Box | | | | | | |
| | 200x200x100 | pc. | | 1 | | | |
| 出口ボックス | Outlet Box | | | | | | |
| | H shallow | pc. | | 152 | | | |
| | L Deep | " | | 24 | | | |

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|-------|------------------------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| ソケット | Socket Outlet | | | | | | |
| | 200 2P15A x 2 | pc | | 357 | | | |
| スイッチ | Switch, Flash Mounting | | | | | | |
| | 1P-10A | pc | | 14 | | | |
| | " 2 gang | " | | 10 | | | |
| | " 3 " | " | | 1 | | | |
| | 2way-10A 2gang | " | | 2 | | | |
| スイッチ | Photo switch 3A | " | | 1 | | | |
| 伝音管 | Sound Lock Pipe | | | | | | |
| | 1φ | " | | 5 | | | |
| 分電盤 | Lighting Panel | | | | | | |
| | 1-1 | " | | 1 | | | |
| 配管支持材 | Supporting Materials | Lot | | 1 | | | |
| 接地材 | Earthing Materials | Lot | | 1 | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) | |
|------------------------|-----------------------------|----------|---------------|--------|-------------|--------|-------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | TOTAL | TOTAL |
| (5) 電話配管敷設工事 | TELEPHONE CONDUIT | | | | | | | |
| | INSTALLATION | | | | | | | |
| 電線、4-7ilv | WIRES CABLE | | | | | | | |
| 600V 11/55° | LM | 15 | | | | | | |
| 電線管 | Conduit Tube | | | | | | | |
| 25φ 3.66 ml | PC | 14 | | | | | | |
| 36φ PE Coating 3.66 ml | " | 11 | | | | | | |
| E=11/517° | VINYL PIPE | | | | | | | |
| 16φ 4MB | PC | 5 | | | | | | |
| 同上材料品 | ACCESSORY FOR THE ABOVE LOT | 1 | | | | | | |
| 1-3ilv 本 | Conduit tube Bend | | | | | | | |
| 36φ PE Coating | PC | 2 | | | | | | |
| 36φ 本 | Outlet Box | | | | | | | |
| M shallow | PC | 7 | | | | | | |
| 12ilv 本 | Telephone Cord Outlet | 3 | | | | | | |
| 12ilv 本 | Low-Tension | 4 | | | | | | |

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|--------|-------------------------------|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| 電話端子箱 | Telephone-Terminal Box | | | | | | |
| | IT | 1 | | | | | |
| | pc | | | | | | |
| ハンドホール | Hand-Hole | | | | | | |
| | 900 x 900 x 1500 ^φ | 1 | | | | | |
| | w/middle weight lid | | | | | | |
| 配線支持材 | Supporting Materials Lot | 1 | | | | | |
| 接地材 | Earthing Materials Lot | 1 | | | | | |
| 雑材等類品 | Miscellaneous Materials Lot | 1 | | | | | |
| | 小計 | | | | | | |
| | Sub Total | | | | | | |
| 労務費 | Labor | | | | | | |
| | Electrician Lot | 1 | | | | | |
| | Coolie Lot | 1 | | | | | |
| | Total | | | | | | |
| 合計 | Total | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|-------------------------------------|------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| (b) 入内本設備工事 Interphone Installation | | | | | | | |
| 電線管 Conduit Tube | pc | 16 | | | | | |
| 25φ 3.66mL | | | | | | | |
| 同上材料品 Accessory for the Above | Lot | 1 | | | | | |
| 出口箱 Outlet Box | | | | | | | |
| 4 shallow | pc | 6 | | | | | |
| 12il 79c-1 Telephone Cord Outlet | pc | 6 | | | | | |
| 取付材料 Supporting Materials | Lot | 1 | | | | | |
| 雑材料品 Miscellaneous Materials | Lot | 1 | | | | | |
| 小計 Sub Total | | | | | | | |
| 労務費 Labor | | | | | | | |
| Electrician | Lot | 1 | | | | | |

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|------------|--------------------------------|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| (1) 火警設備工事 | Fire Alarm System Installation | | | | | | |
| (2) 配線, 配管 | Wire & Cable | | | | | | |
| | 1.2mm KM | 2072 | | | | | |
| | " 1.2mm " | 104 | | | | | |
| (3) 配管 | Conduit Tube | | | | | | |
| | 1.98 3.66 m | 42 | | | | | |
| | 2.54 " " | 3 | | | | | |
| (4) 工器具 | Accessory for the Above Lot | 1 | | | | | |
| (5) 出口ボックス | Outlet Box | | | | | | |
| | M shallow pc | 35 | | | | | |
| (6) 制御盤 | Control Panel | | | | | | |
| | P-Type 1st Class | 1 | | | | | |
| | 5-Zones | | | | | | |

| I T E M | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|---------|-------------------------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| 鐵合箱 | Combination Box | lot | | | | | |
| 感煙器 | Fire Detector | | | | | | |
| 定溫式 | Fixed-Temperature | | | | | | |
| | Spot type, 1st class | pc | | | | | |
| | Ditto, Water-proof | pc | | | | | |
| | Rate-of-Rise Spot | | | | | | |
| | type, 2nd Class | pc | | | | | |
| 吸音管 | Sound Lock pipe | | | | | | |
| | (1A) | pc | | | | | |
| 配管材料 | Supporting Materials | lot | | | | | |
| 雜項材料 | Miscellaneous Materials | lot | | | | | |
| 小計 | Sub Total | | | | | | |
| 勞務費 | Labor | | | | | | |
| | Electrician | lot | | | | | |

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) |
|-----------------------------------|------|----------|---------------|--------|-------------|--------|-------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| (8) 放送用配管工事 Piping for Studio | | | | | | | |
| 電線、ケーブル Wire & Cable | | | | | | | |
| IV 16mm | LM | 46 | | | | | |
| 電線管 Conduit Tube | | | | | | | |
| 1φ 3.66μL | PC | 9 | | | | | |
| 25φ | " | 3 | | | | | |
| 31φ | " | 34 | | | | | |
| 同上附屬品 Accessory for the Above Lot | | 1 | | | | | |
| 1200×1200 | | | | | | | |
| Conduit Tube Bend | PC | 8 | | | | | |
| 31φ | | | | | | | |
| 200×150mm Outlet Box | | | | | | | |
| M shallow | PC | 6 | | | | | |
| 表示灯 Studio Indicator | | | | | | | |
| Type O | PC | 3 | | | | | |

| ITEM | UNIT | QUANTITY | LOCAL (RUPEE) | | JAPAN (YEN) | | (YEN) TOTAL |
|----------|-------------------------|----------|---------------|--------|-------------|--------|-------------|
| | | | UNIT PRICE | AMOUNT | UNIT PRICE | AMOUNT | |
| 29=14分要機 | Distribution Board | | | | | | |
| | for Studio B-1 | 1 | | | | | |
| 端子盤 | TERMINAL BOARD | | | | | | |
| | 80P | 1 | | | | | |
| 金属ダクト | WIRING DUCT | | | | | | |
| | 300 x 100 x 750 M | 2 | | | | | |
| 配管支持材 | Supporting Materials | 1 | | | | | |
| 塗料 | PAINT | 1 | | | | | |
| 接地板 | Earthing Materials | 1 | | | | | |
| 雑材並工程 | Miscellaneous Materials | 1 | | | | | |
| 小計 | Sub Total | | | | | | |
| 労務費 | labor | | | | | | |
| | Electrician | 1 | | | | | |
| 計 | Total | | | | | | |

1. The first part of the document discusses the importance of maintaining accurate records of all transactions and activities. It emphasizes that proper record-keeping is essential for transparency and accountability, particularly in the context of public administration or corporate governance. The text suggests that without reliable records, it becomes difficult to track progress, identify issues, and ensure that resources are being used effectively.

2. The second part of the document addresses the challenges associated with data collection and analysis. It notes that while modern technology offers powerful tools for gathering and processing information, the quality of the data and the skills of the personnel involved are critical factors. The document highlights the need for standardized procedures and training to ensure that the data collected is consistent and reliable.

3. The third part of the document focuses on the role of communication in the success of any project or organization. It argues that clear and frequent communication is necessary to keep all stakeholders informed, to resolve conflicts, and to foster a collaborative environment. The text suggests that effective communication can help to align goals, manage expectations, and ensure that everyone is working towards the same objectives.

4. The fourth part of the document discusses the importance of flexibility and adaptability in a rapidly changing environment. It notes that while having a solid plan is important, it is also necessary to be able to adjust that plan as circumstances change. The document suggests that organizations should regularly review their strategies and be prepared to make adjustments when needed.

5. The fifth part of the document concludes by emphasizing the need for a strong leadership team. It argues that effective leaders are those who can inspire and motivate their teams, set a clear vision, and make difficult decisions when necessary. The text suggests that leadership is not just a role, but a responsibility that requires ongoing development and a commitment to the well-being of the organization.

C. PLUMBING WORK

