



Figure G2.8 Hydrauric Profile of Morong Water Treatment Plant

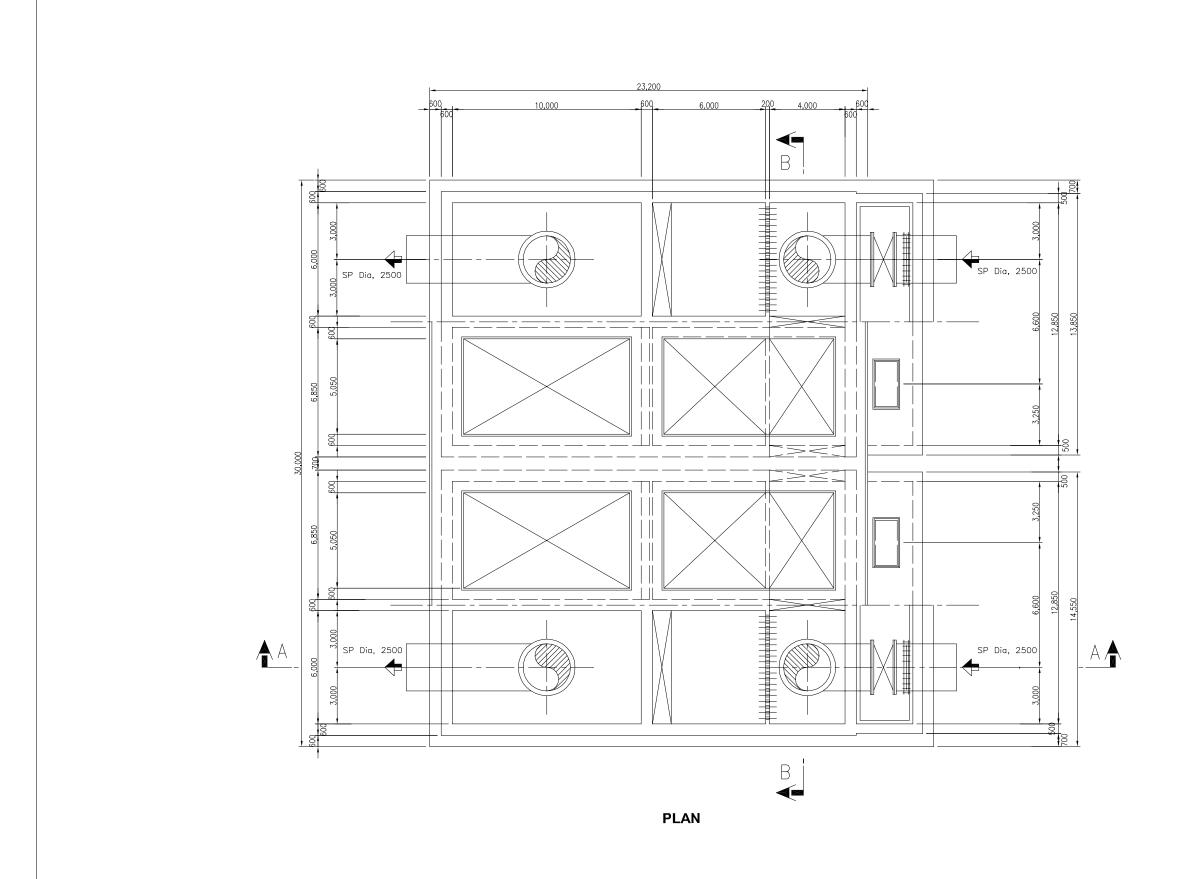


SCALE A 0 5m 10m 15m 20m

Figure G2.9 Morong Water Treatment Plant Receiving Well Plan

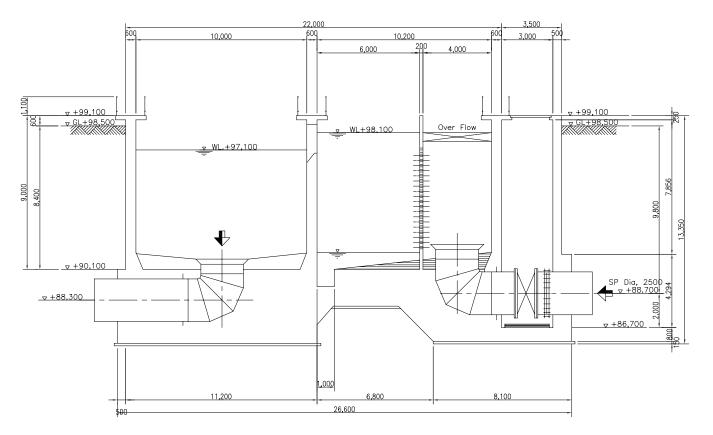


SECTION A - A

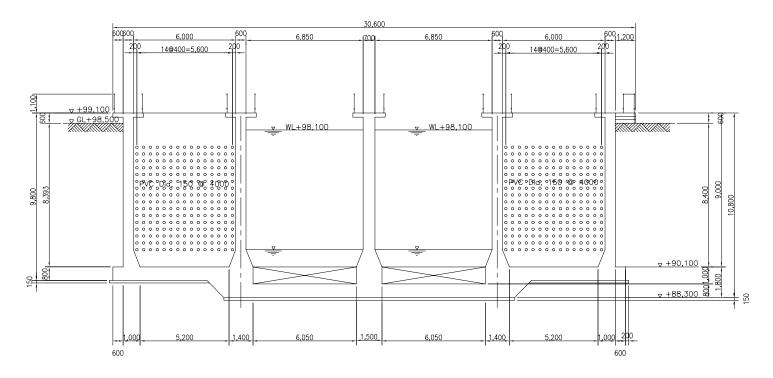

**SECTION B - B** 

SCALE A 0 5m 10m 15m 20m

Figure G2.10 Morong Water Treatment Plant Receiving Well Section A-A, B-B

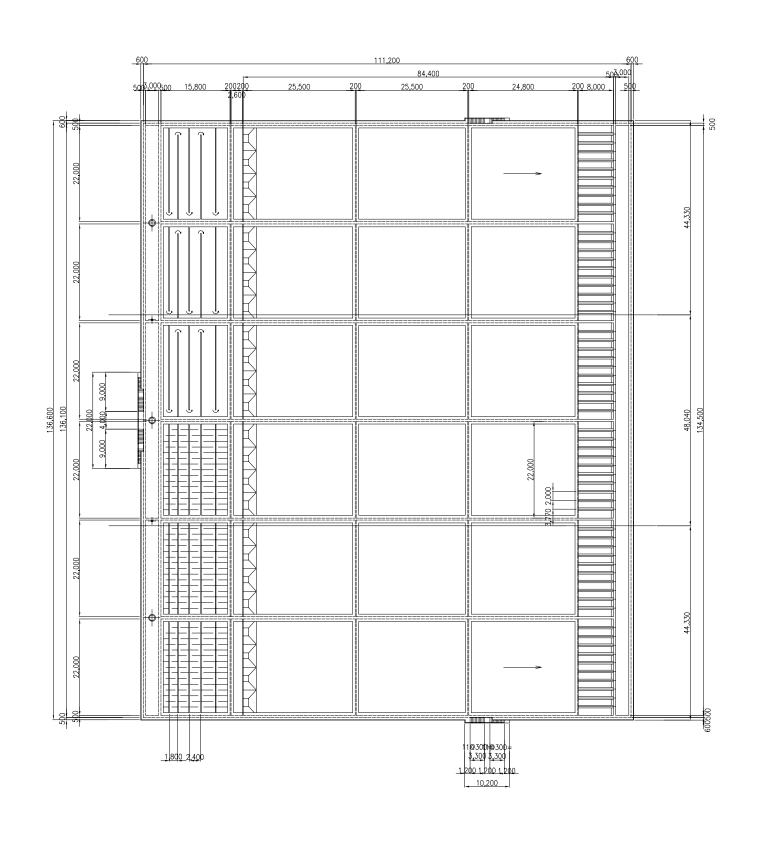

SCALE A 0 5m 10m 15m 20m

Figure G2.11 Morong Water Treatment Plant Flocculation and Sedimentation Basin Plan