




Section A-A

Figure G2.12 Morong Water Treatment Plant Flocculation and Sedimentation Basin Section A-A

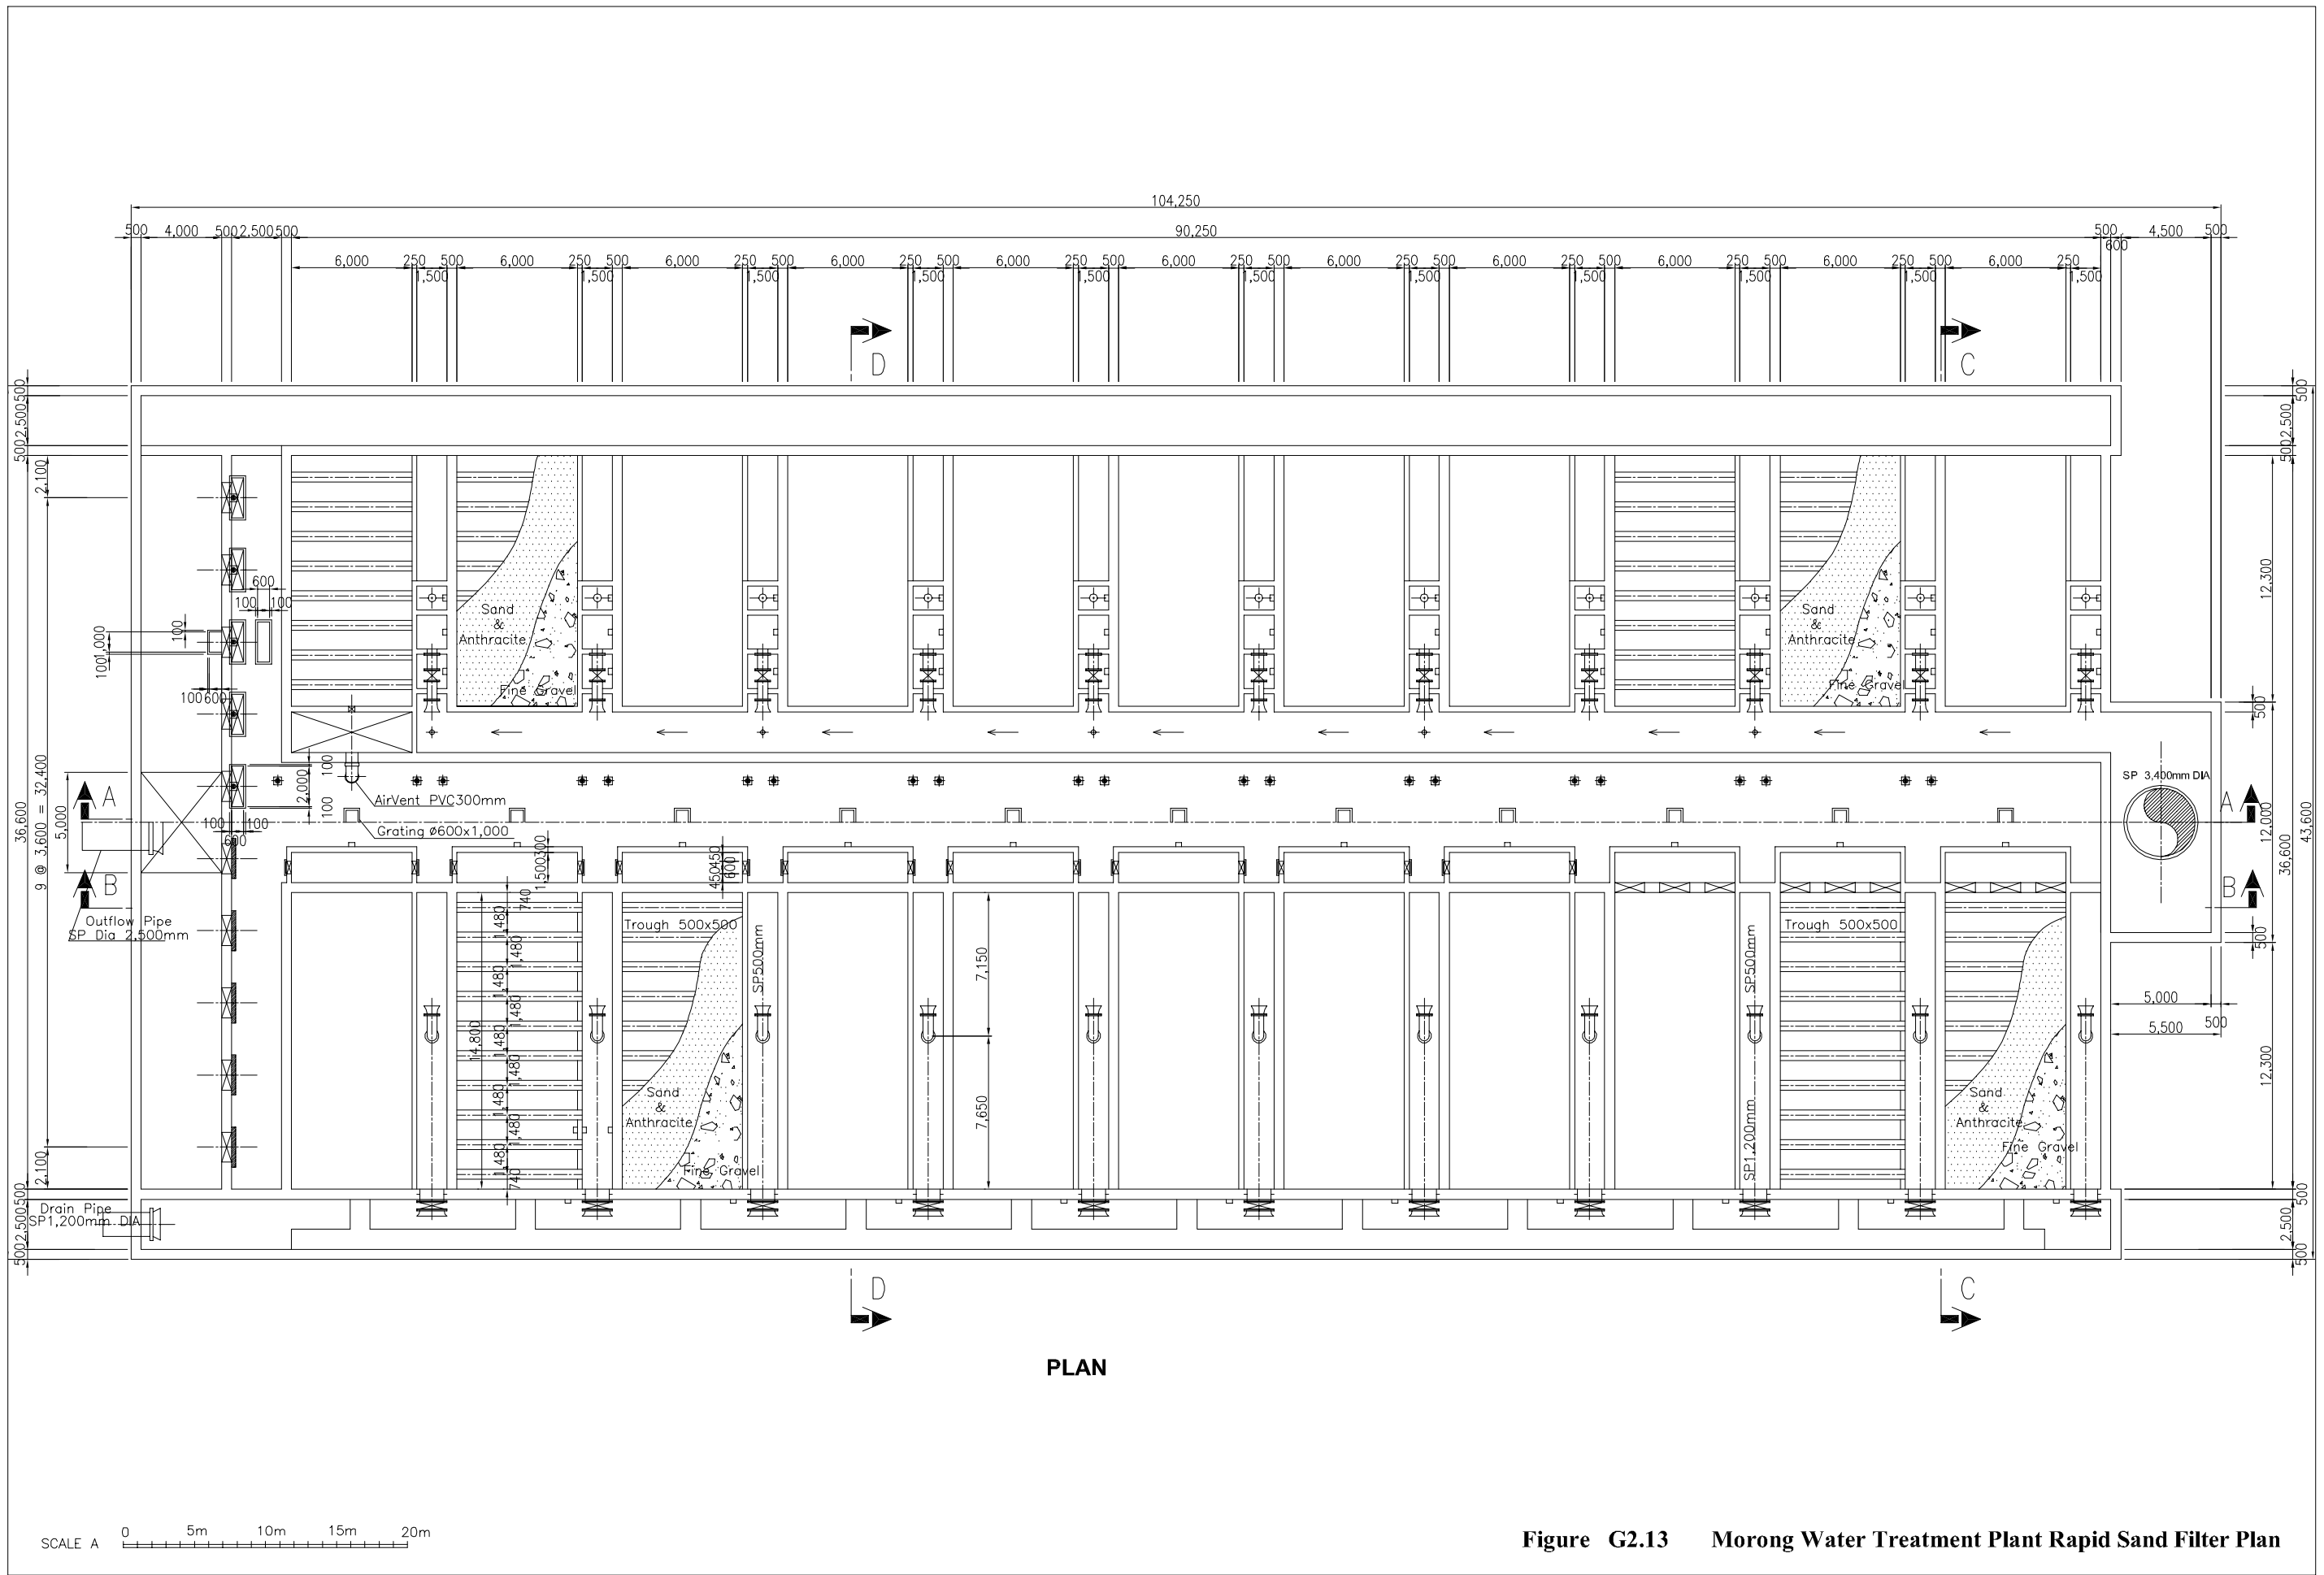

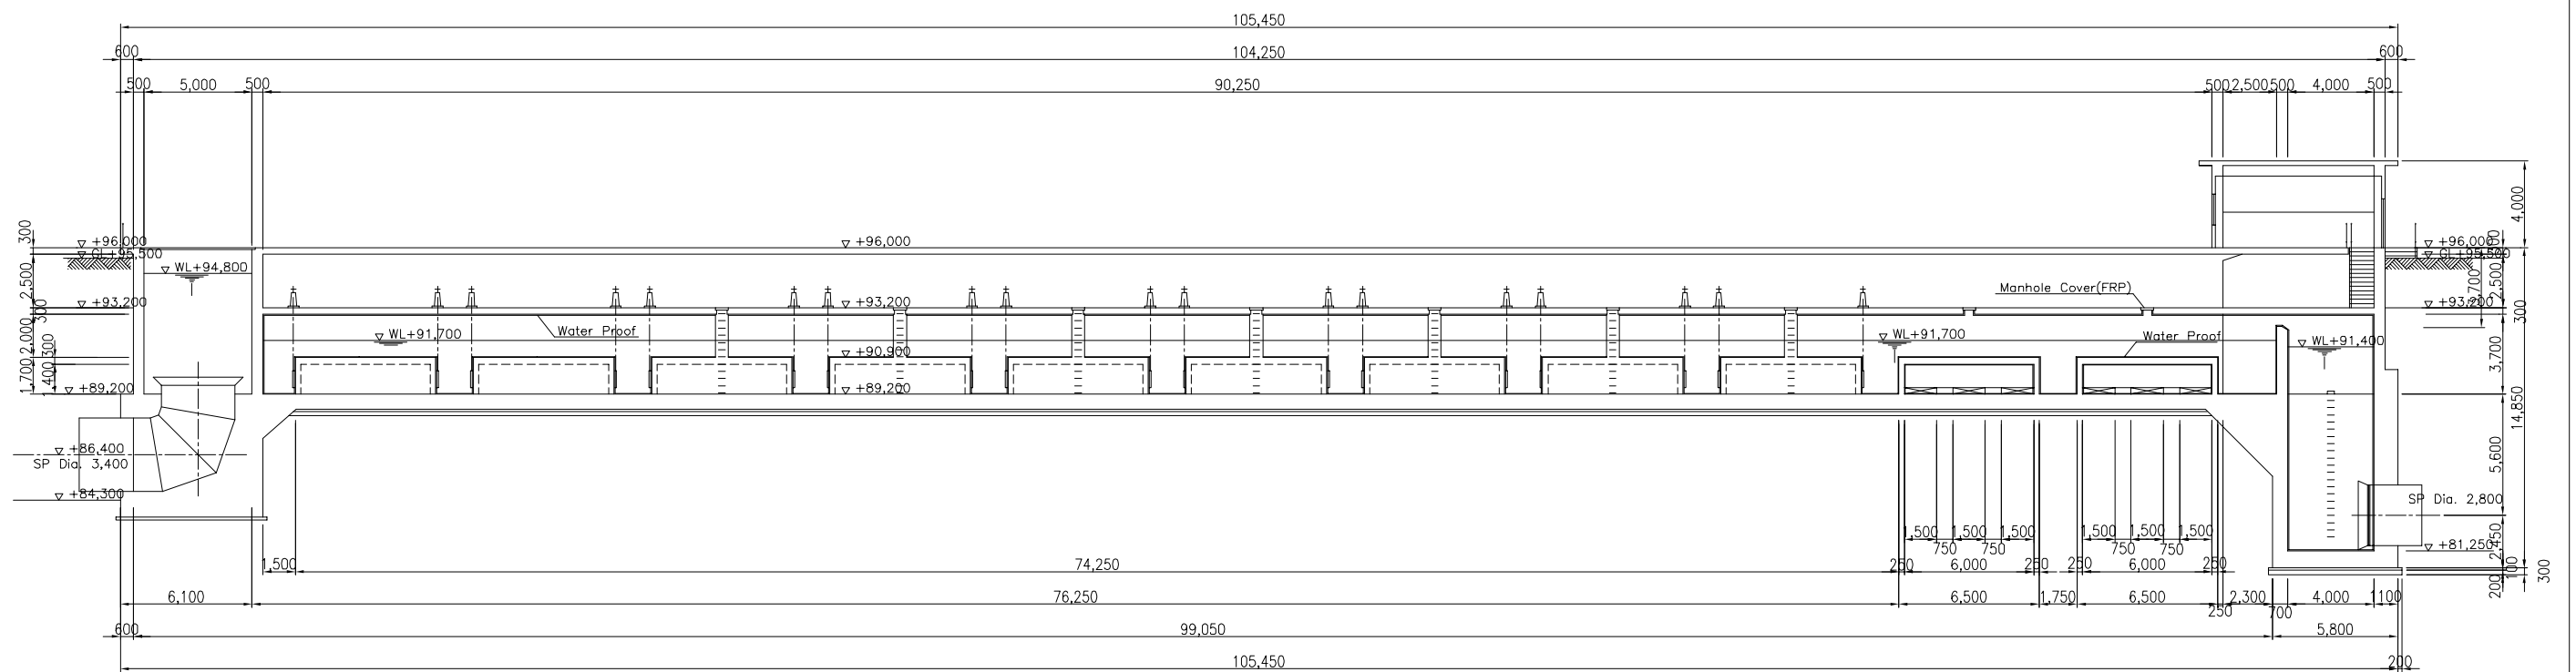


SECTION A - A

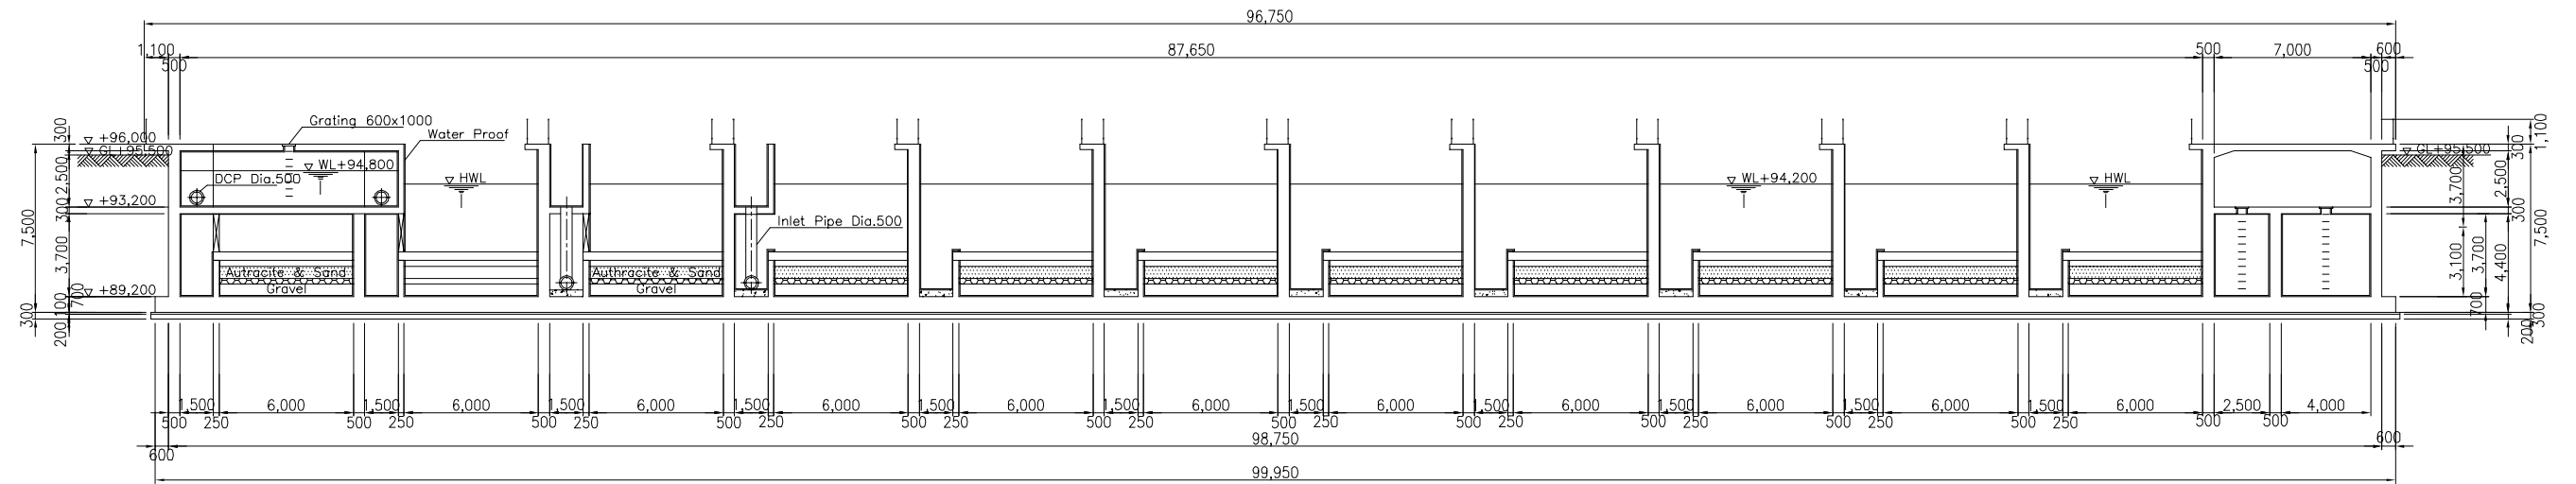


SECTION B - B

SCALE A 0 5m 10m 15m 20m

Figure G2.14 Morong Water Treatment Plant Rapid Sand Filter Section, A-A, B-B

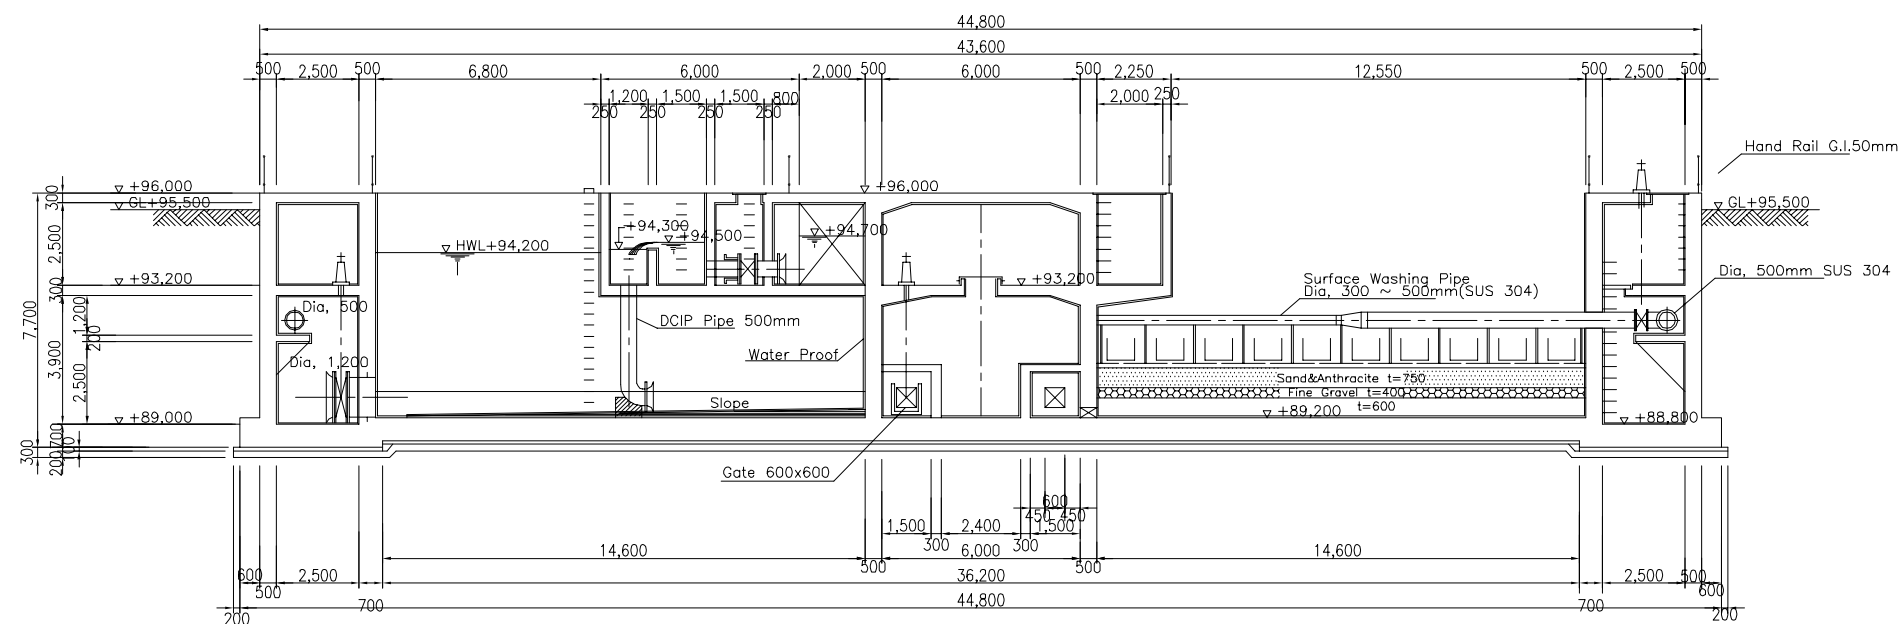


SECTION C - C

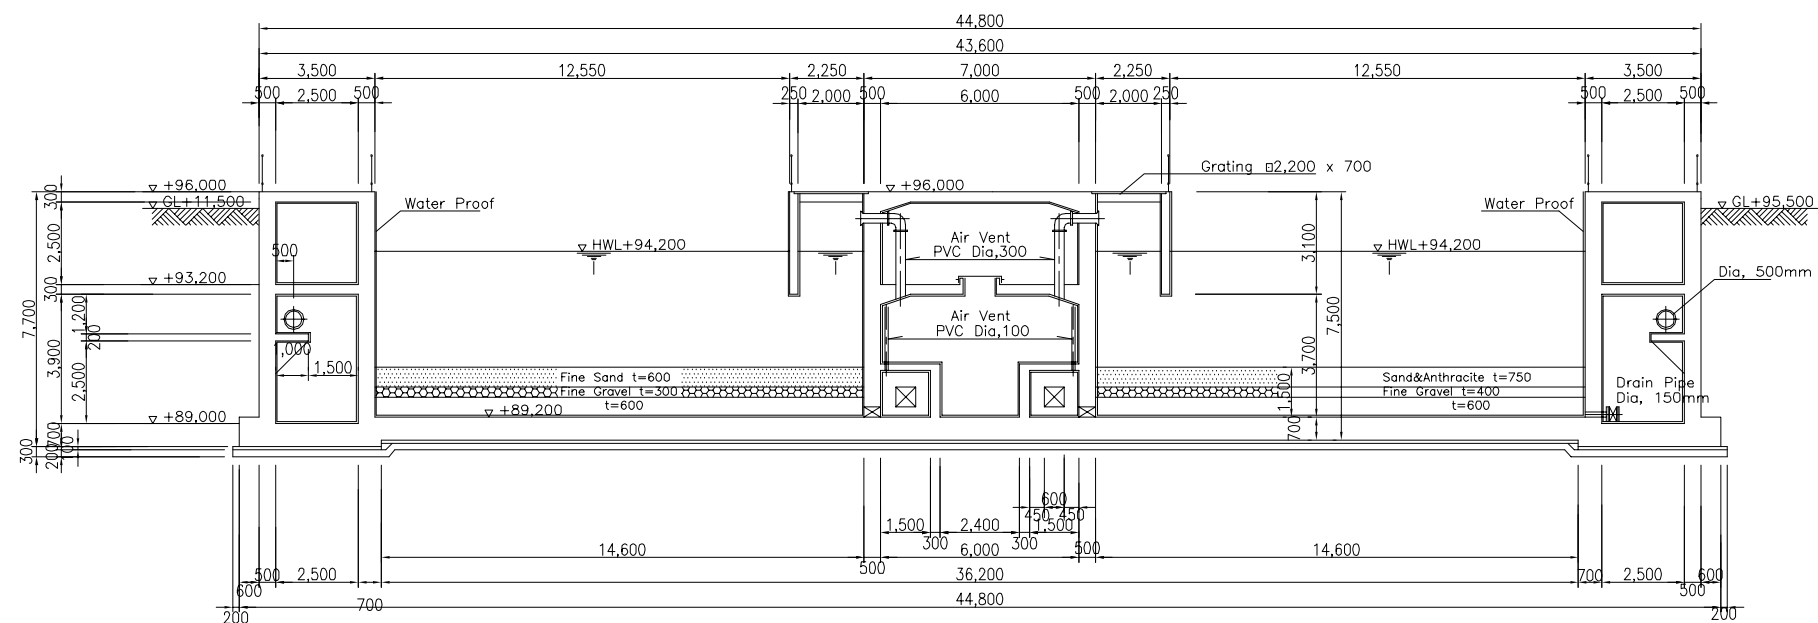

SECTION D - D

SCALE A 0 5m 10m 15m 20m


Figure G2.15 Morong Water Treatment Plant Rapid Sand Filter Section C-C, D-D

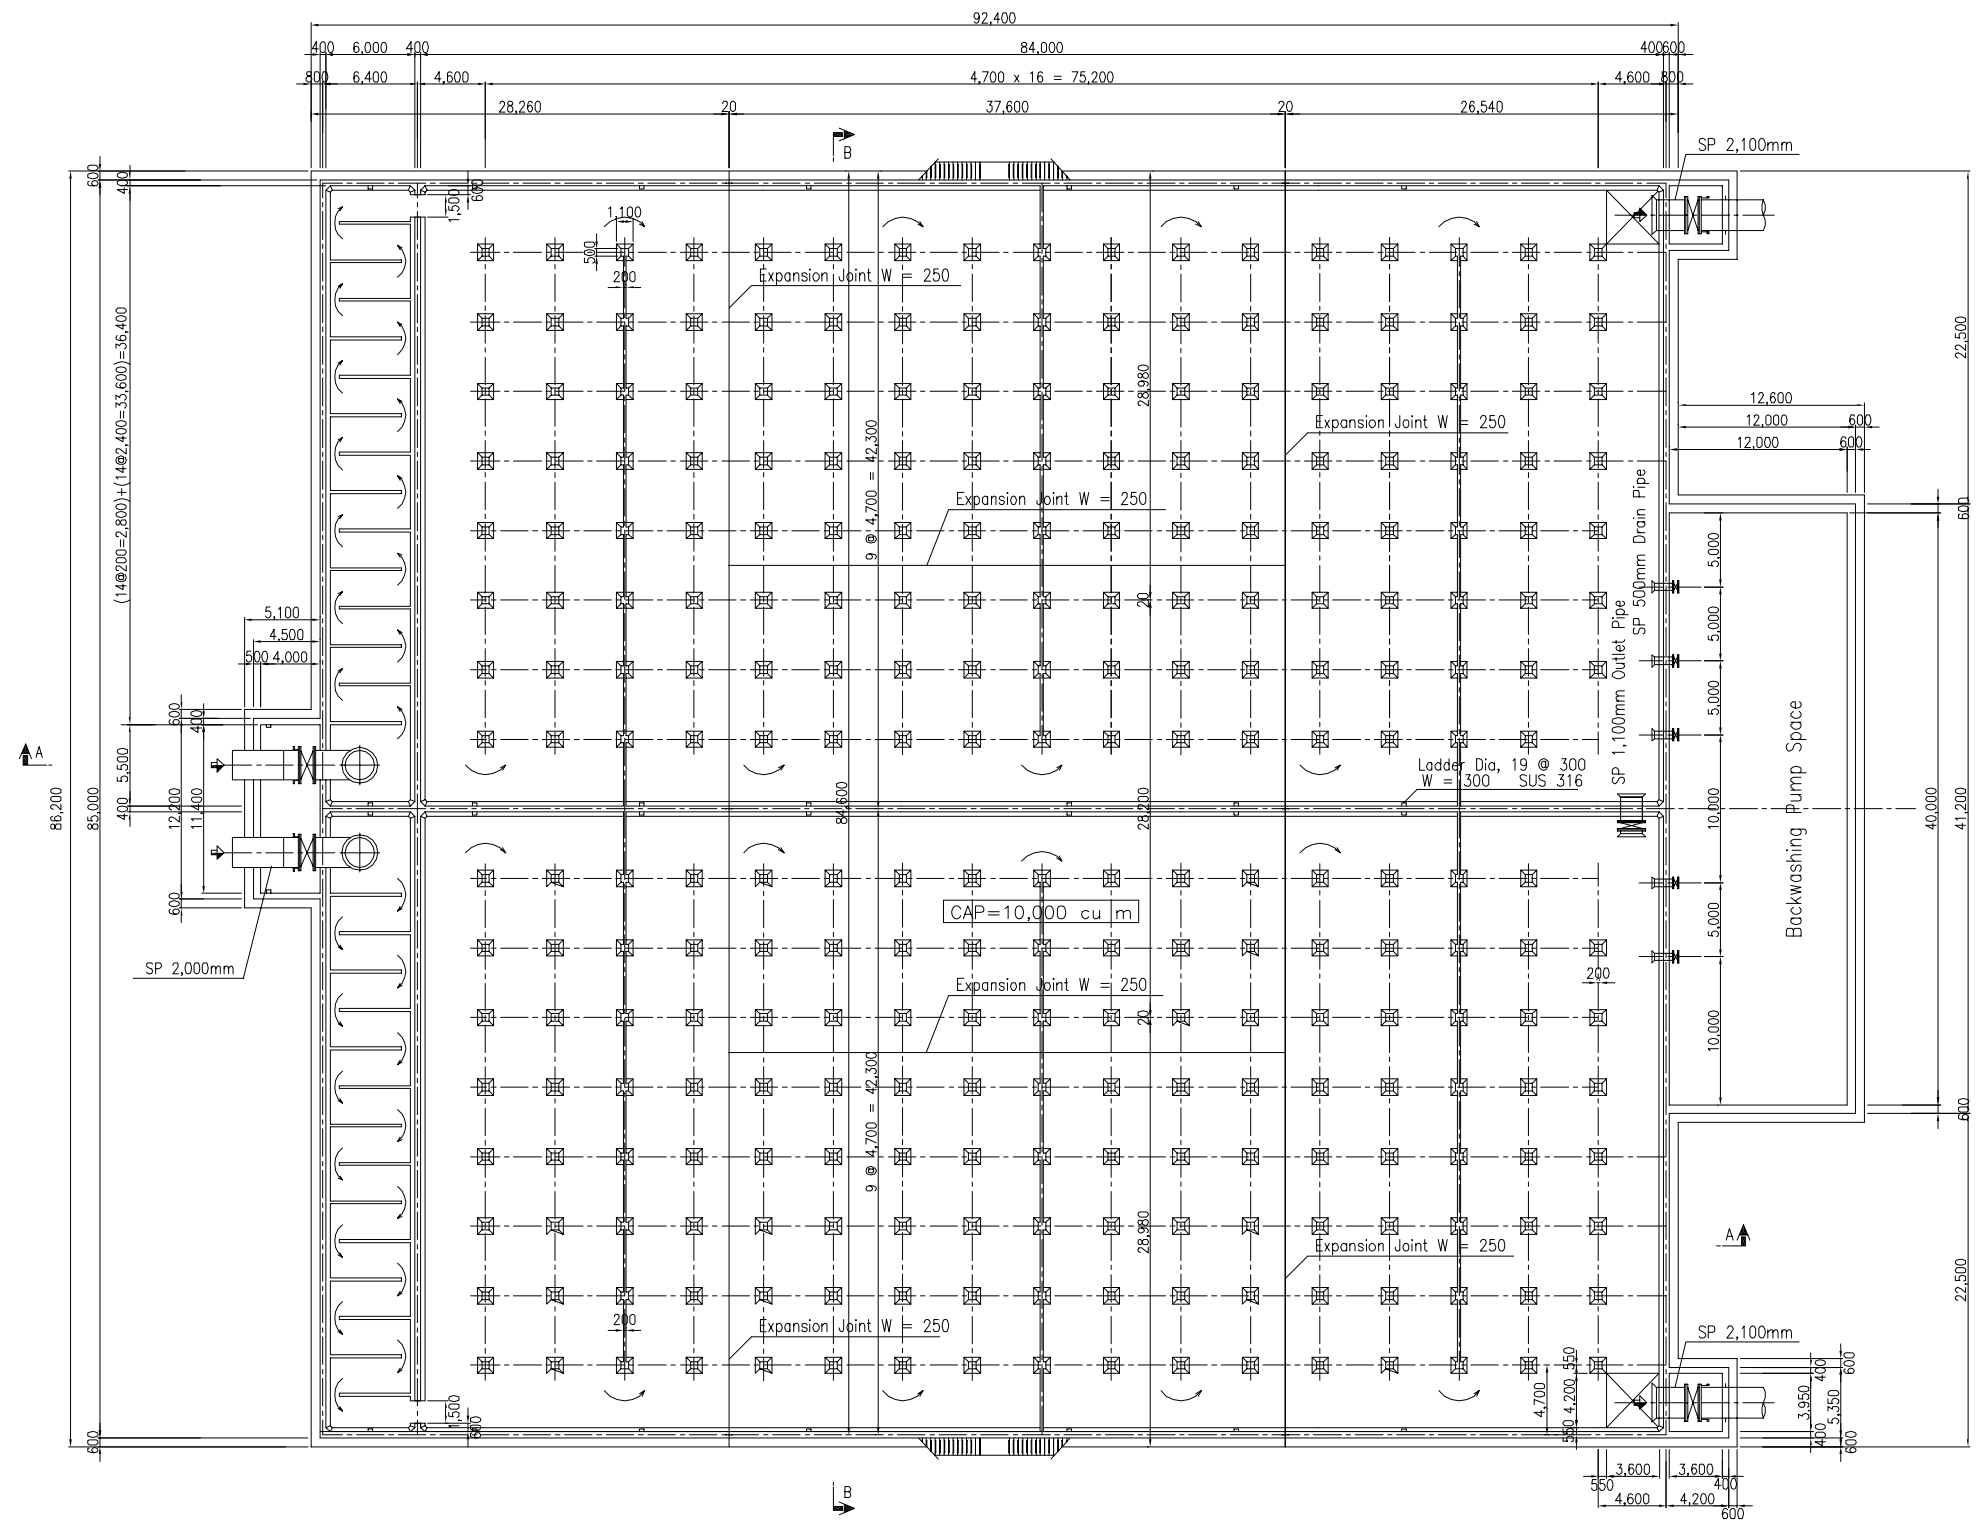


**BOTTOM PLAN**

**Figure G2.16 Morong Water Treatment Plant Clear Water Reservoir Plan**

SCALE A 0 5m 10m 15m 20m

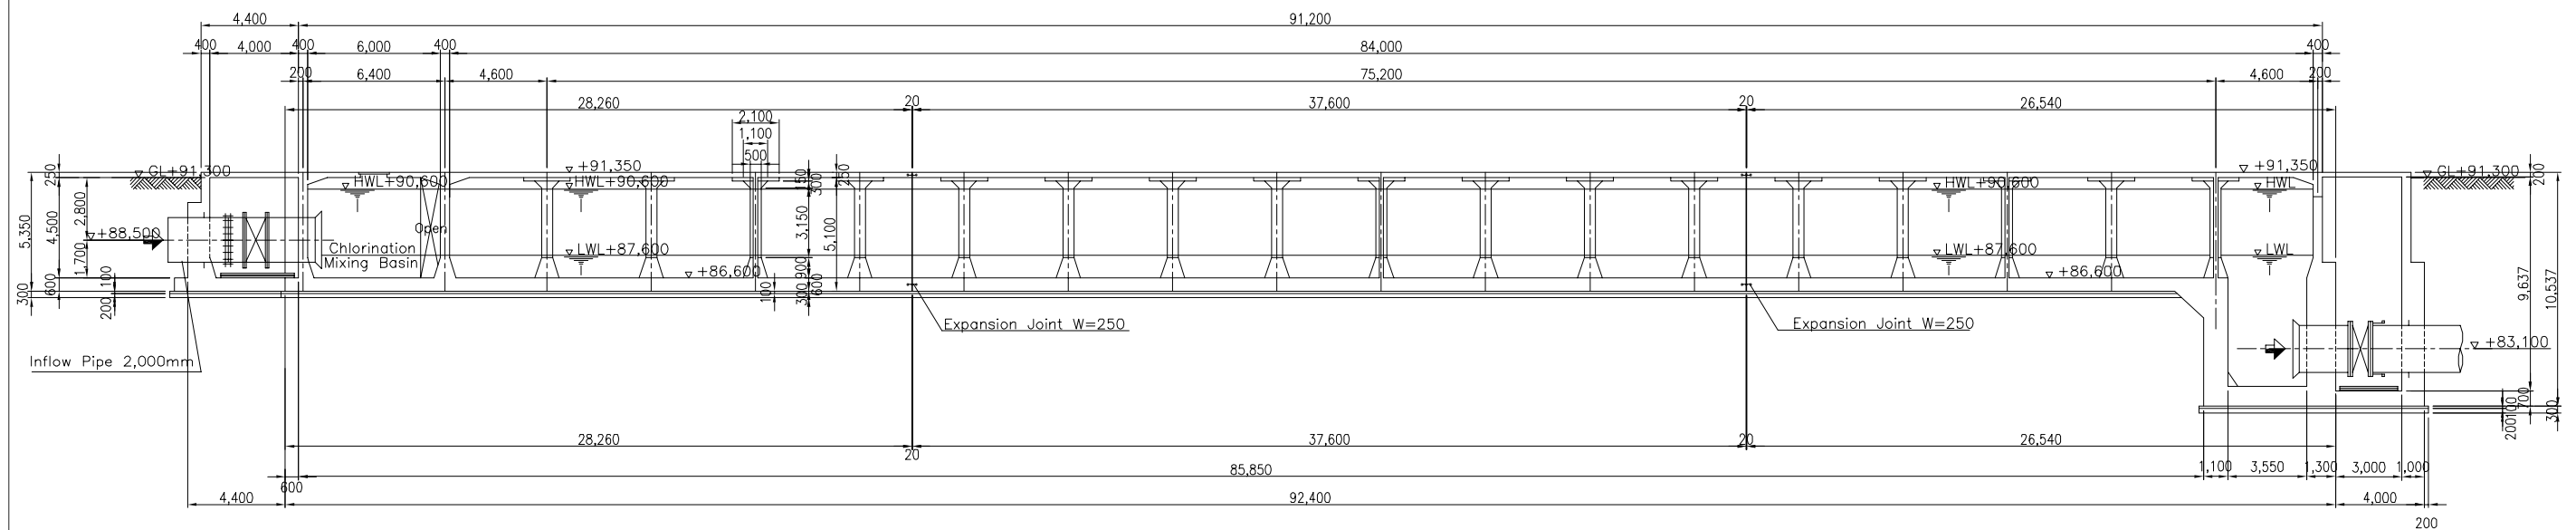


SECTION A - A

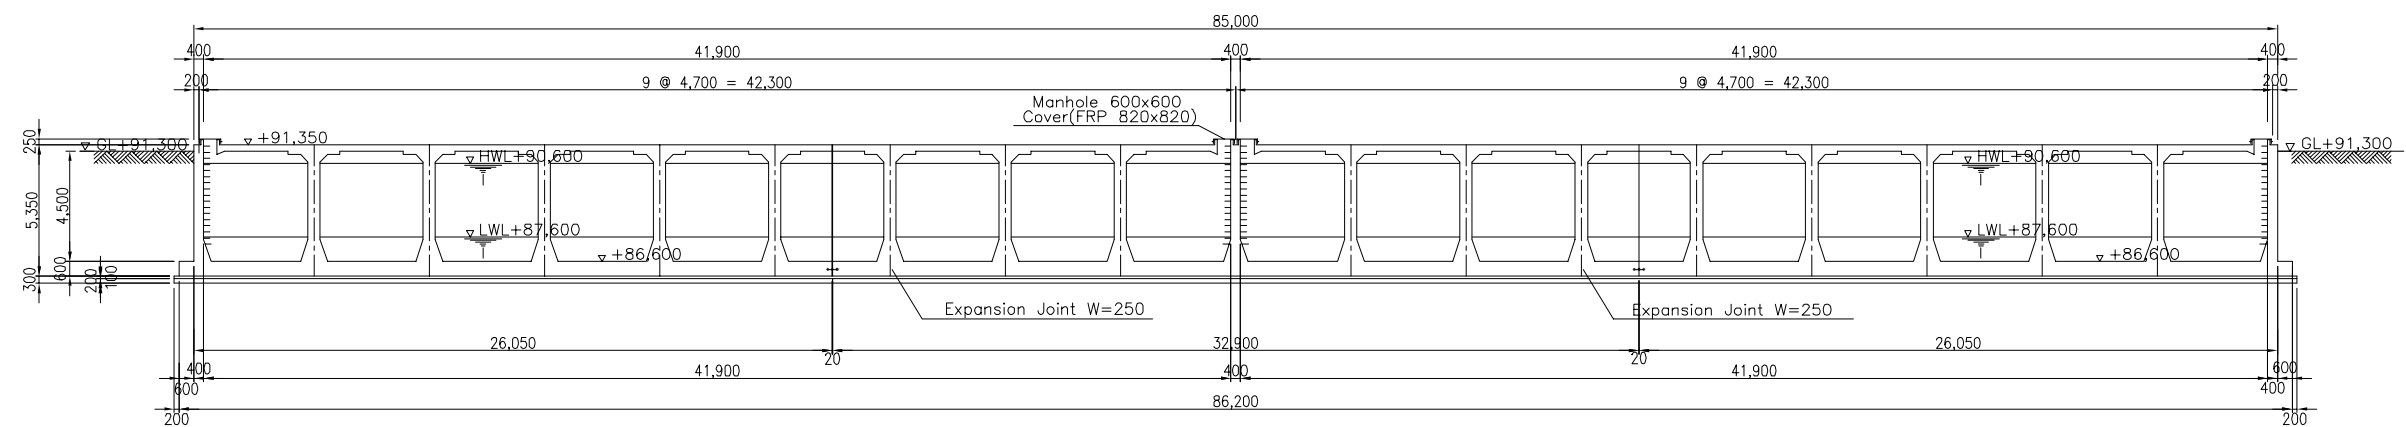

SECTION B - B


SCALE A 0 5m 10m 15m 20m

Figure G2.17 Morong Water Treatment Plant Clear Water Reservoir Section A-A, B-B

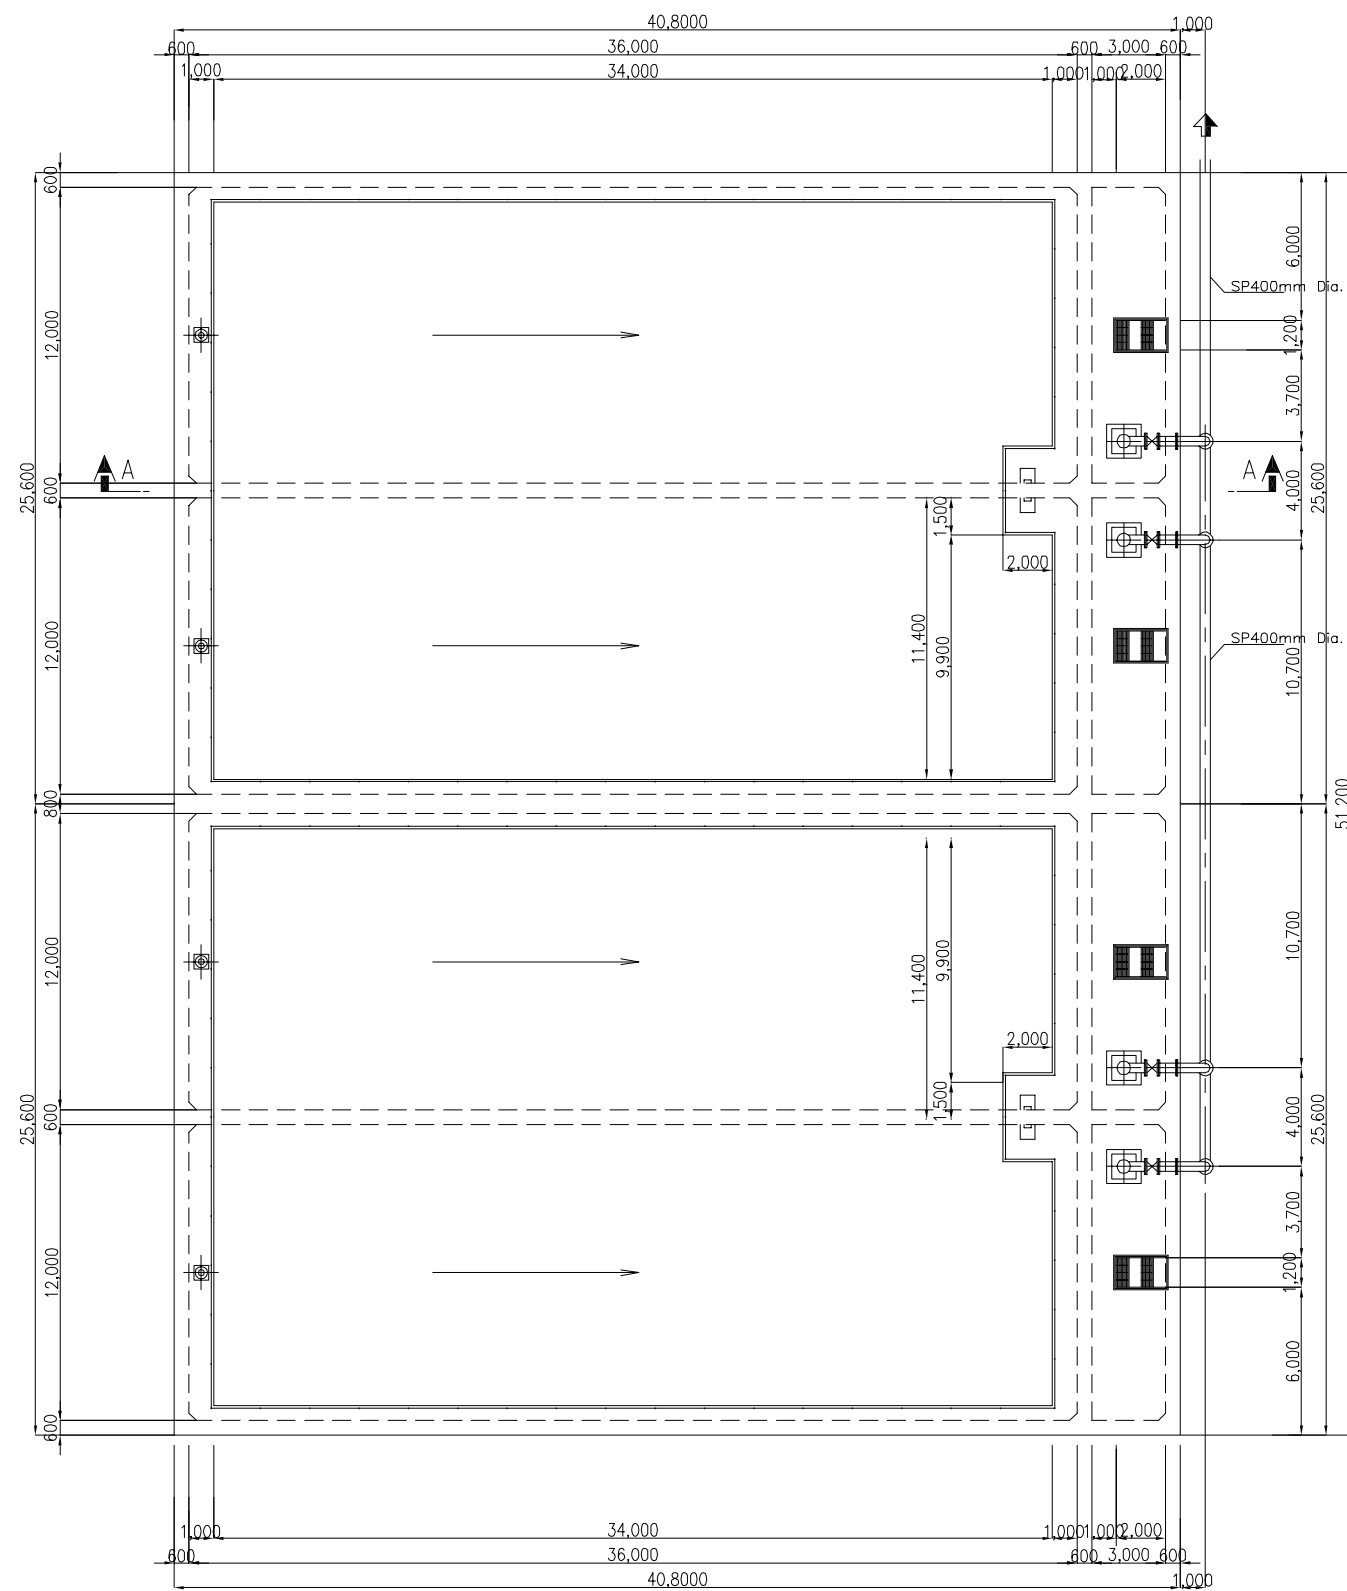


PLAN

SCALE A 0 5m 10m 15m 20m

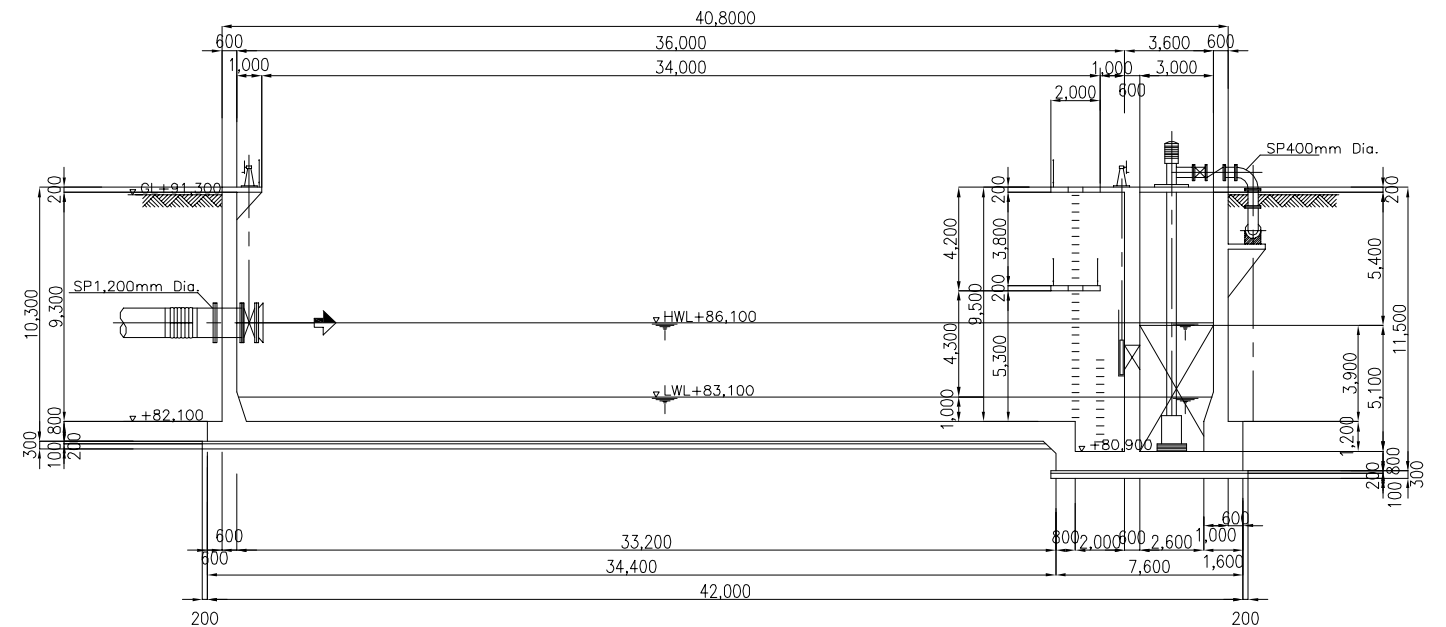

SECTION A - A


Figure G2.18 Morong Water Treatment Plant Backwashing Storage Basin Plan and Section

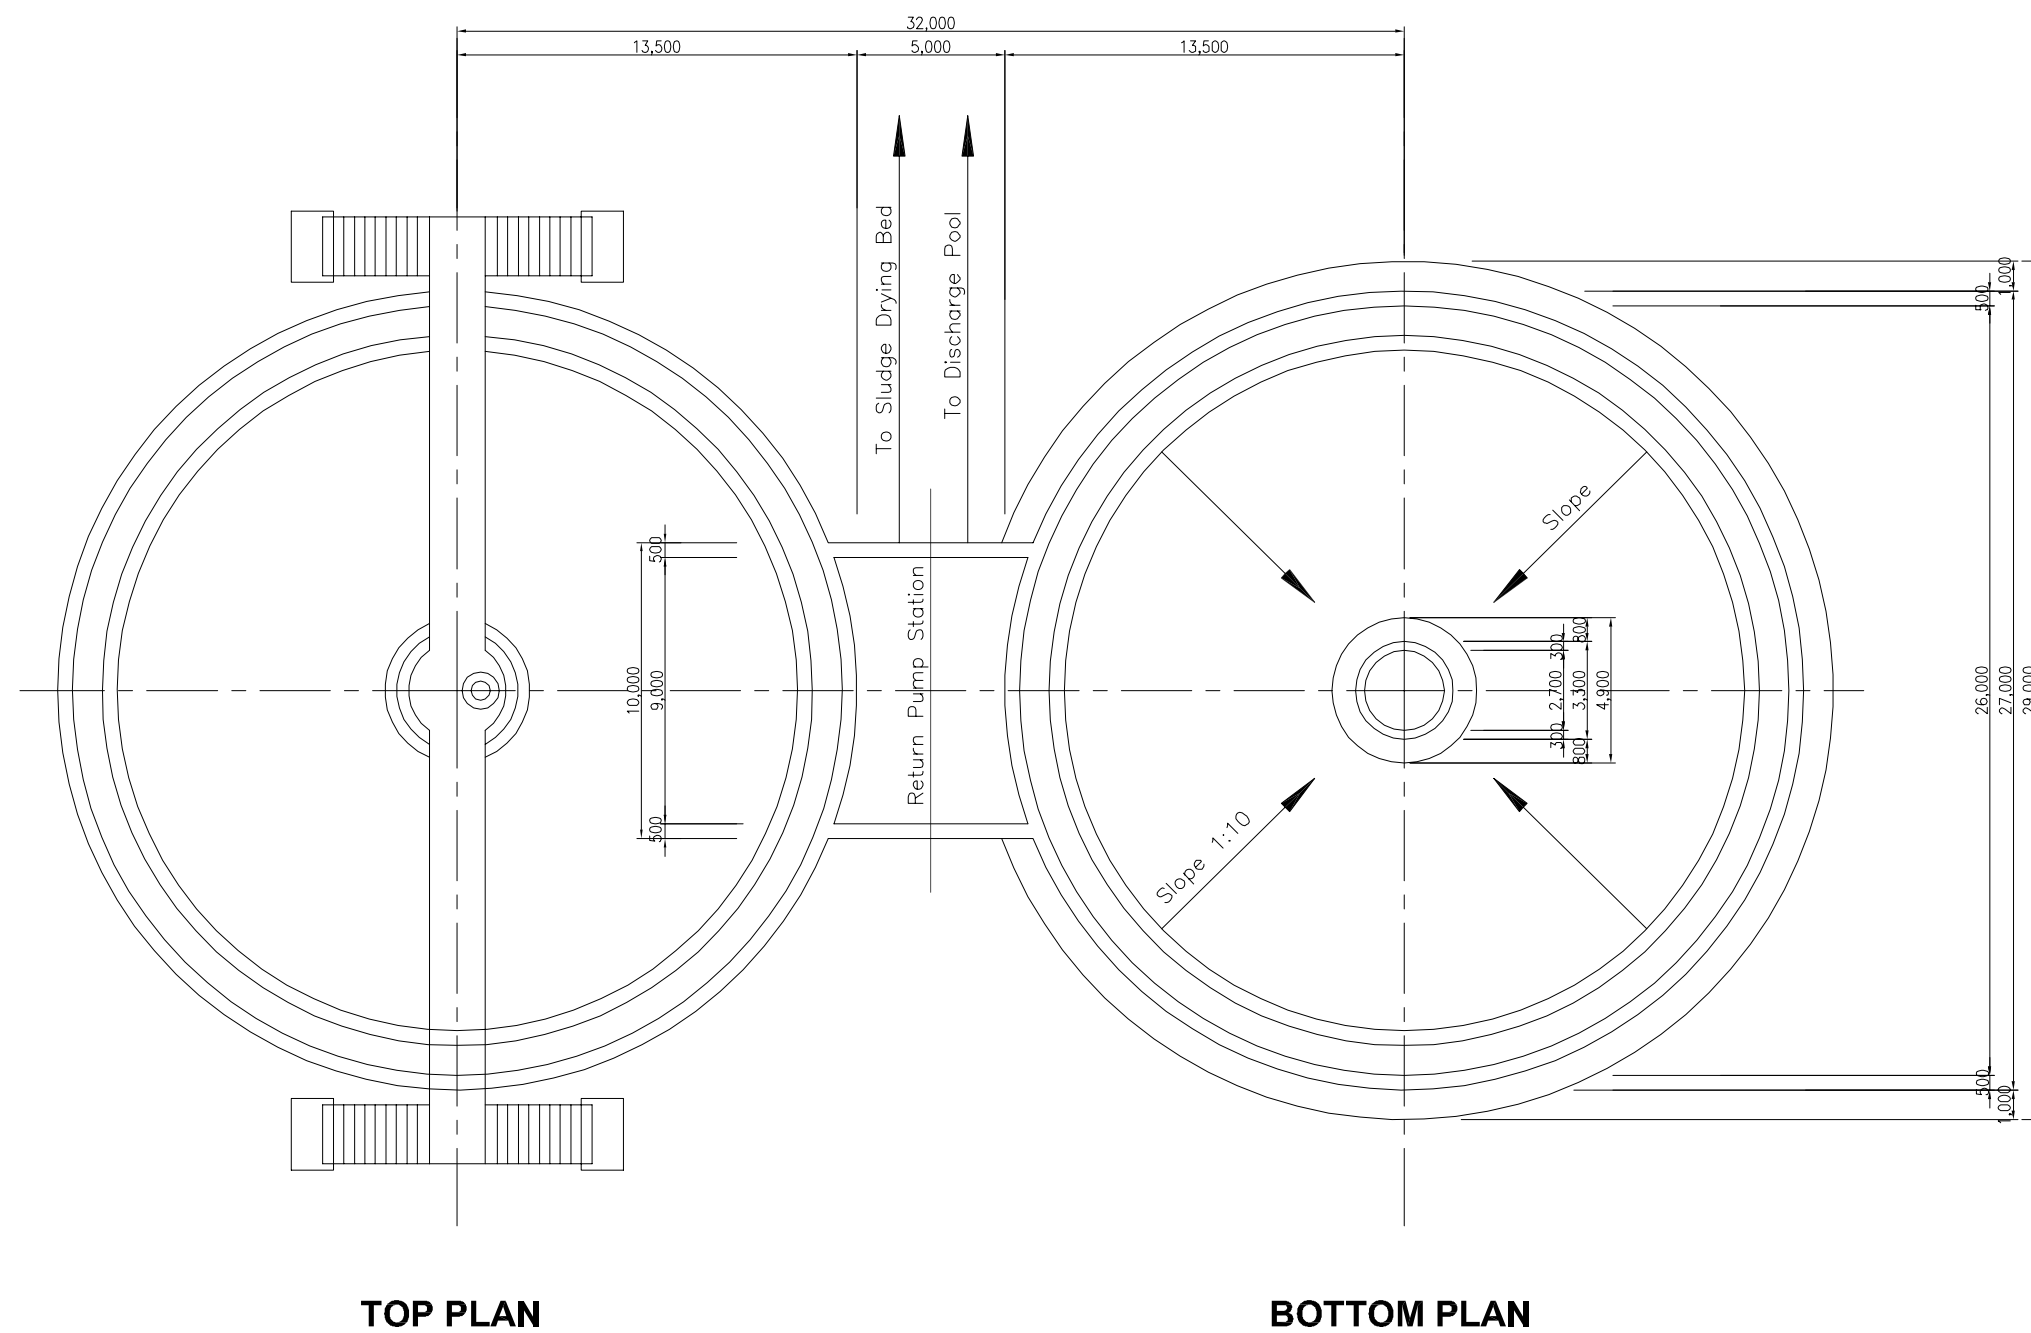


SCALE A 0 5m 10m 15m 20m

Figure G2.19 Morong Water Treatment Plant Thickening Tank Plan




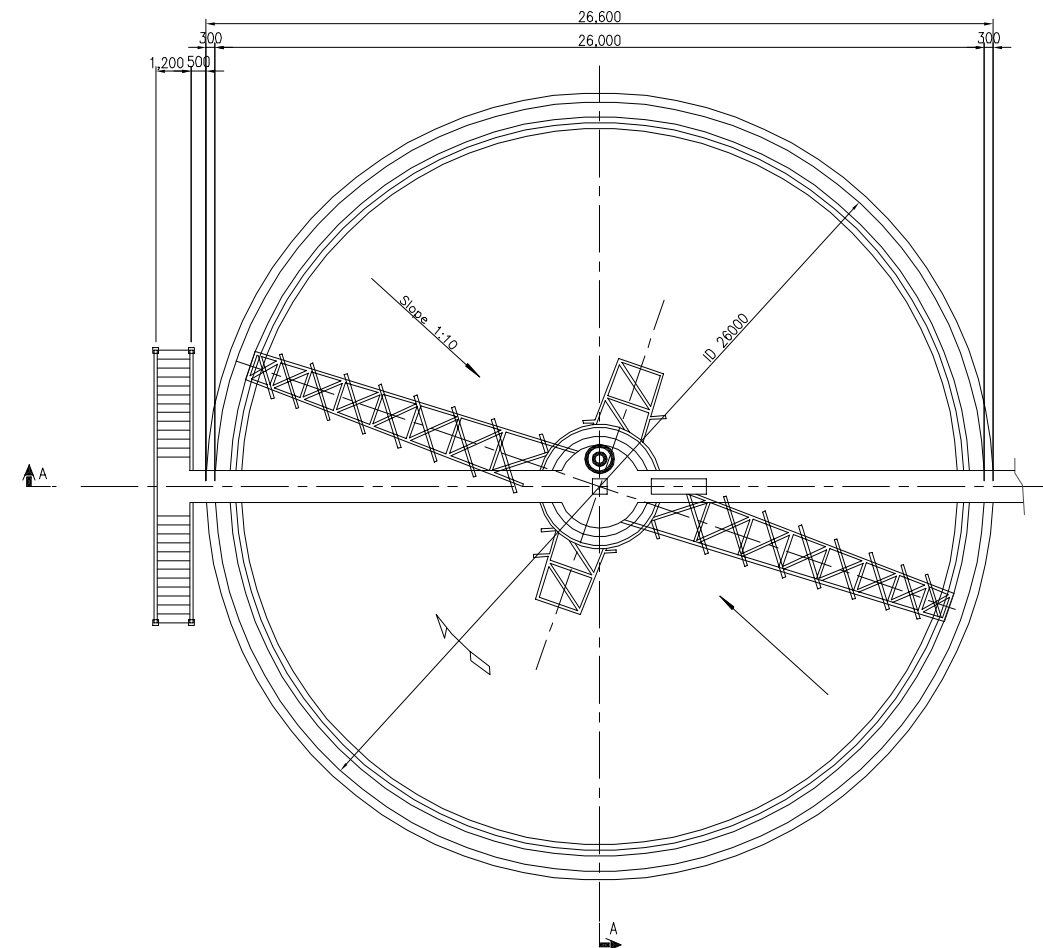

TOP PLAN

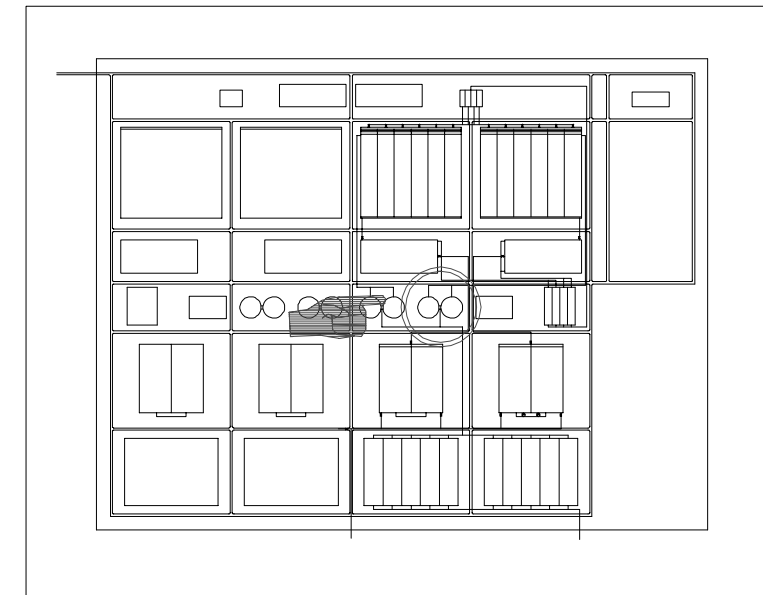

GENERAL PLAN

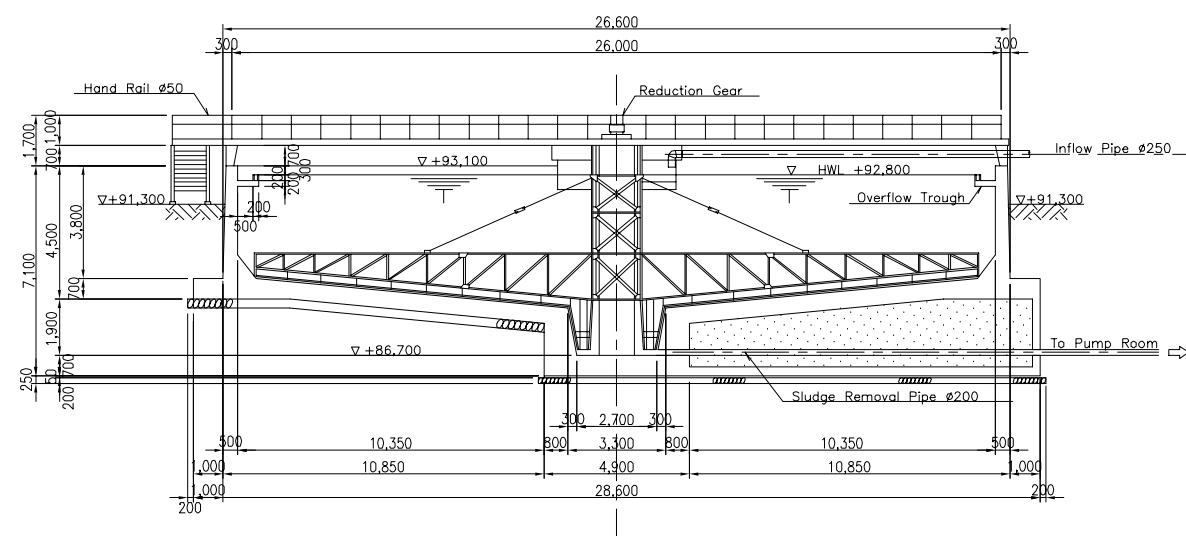

SECTION A-A







Figure G2.20 Morong Water Treatment Plant Thickening Tank Section

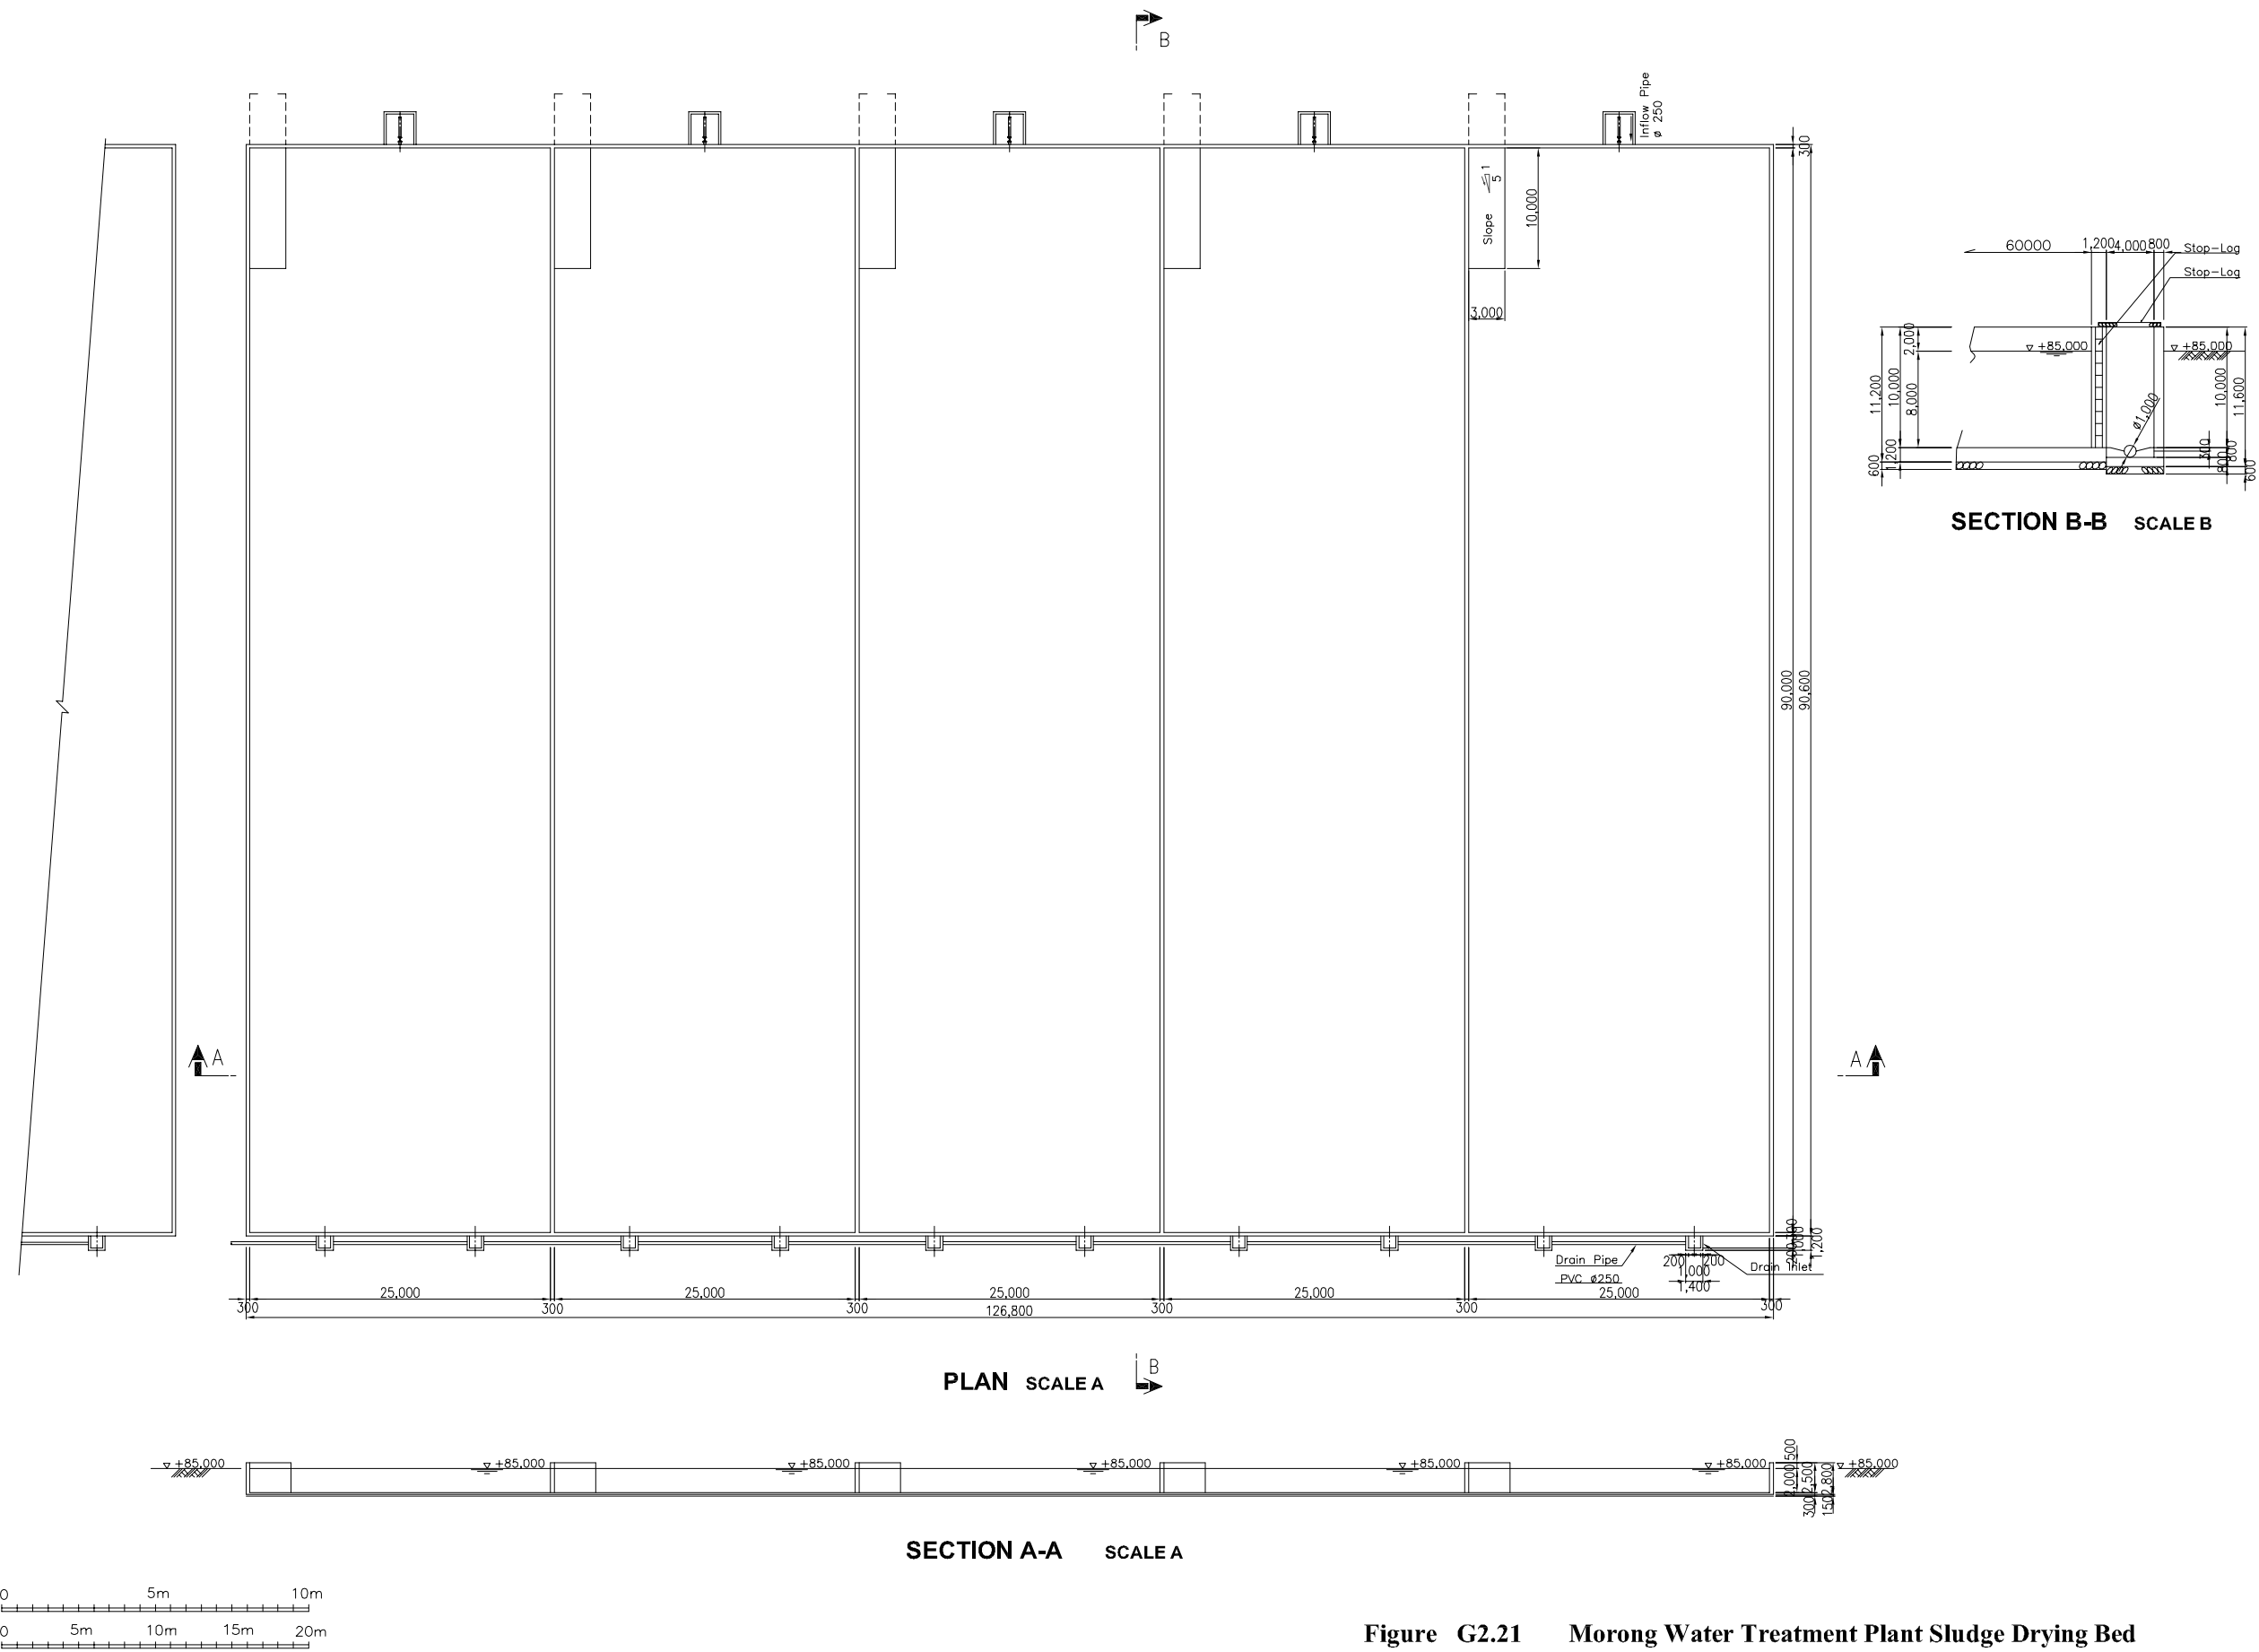


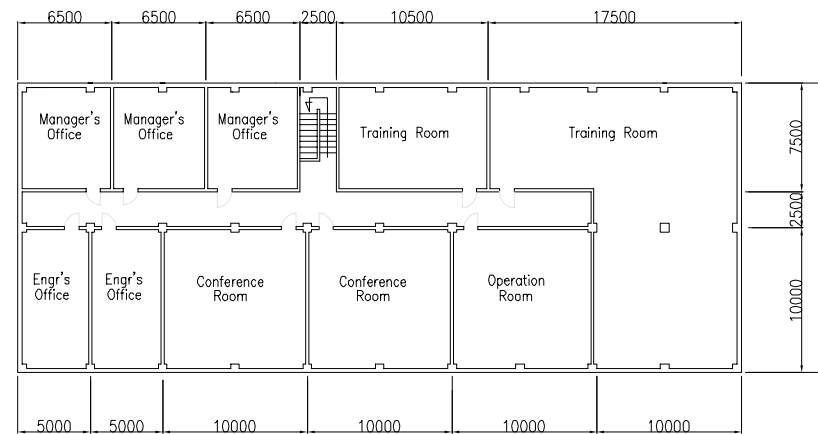


2F

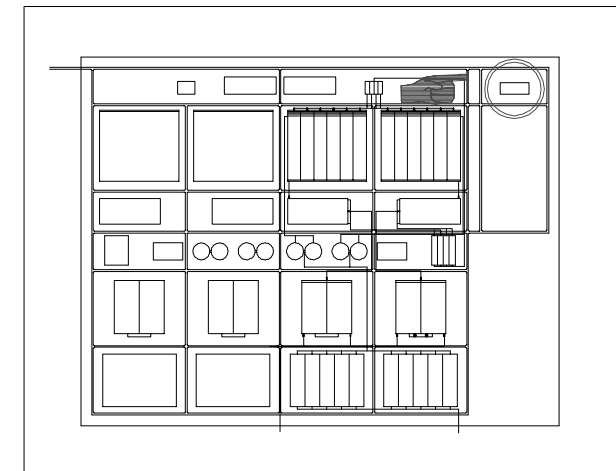

GENERAL PLAN

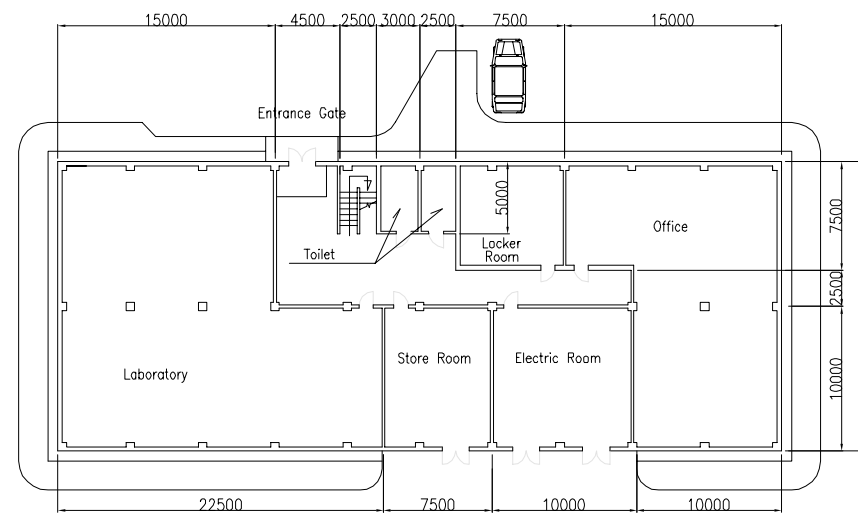

1F

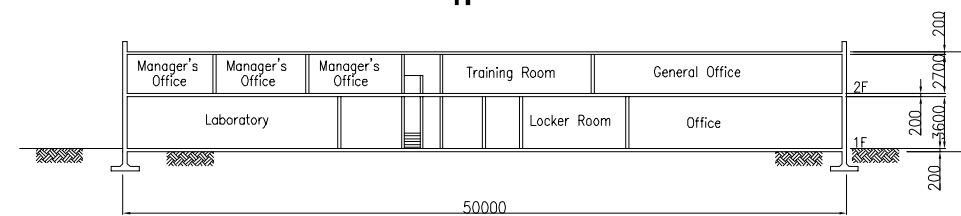

CROSS SECTION






Figure G2.22 Morong Water Treatment Plant Administrative Building

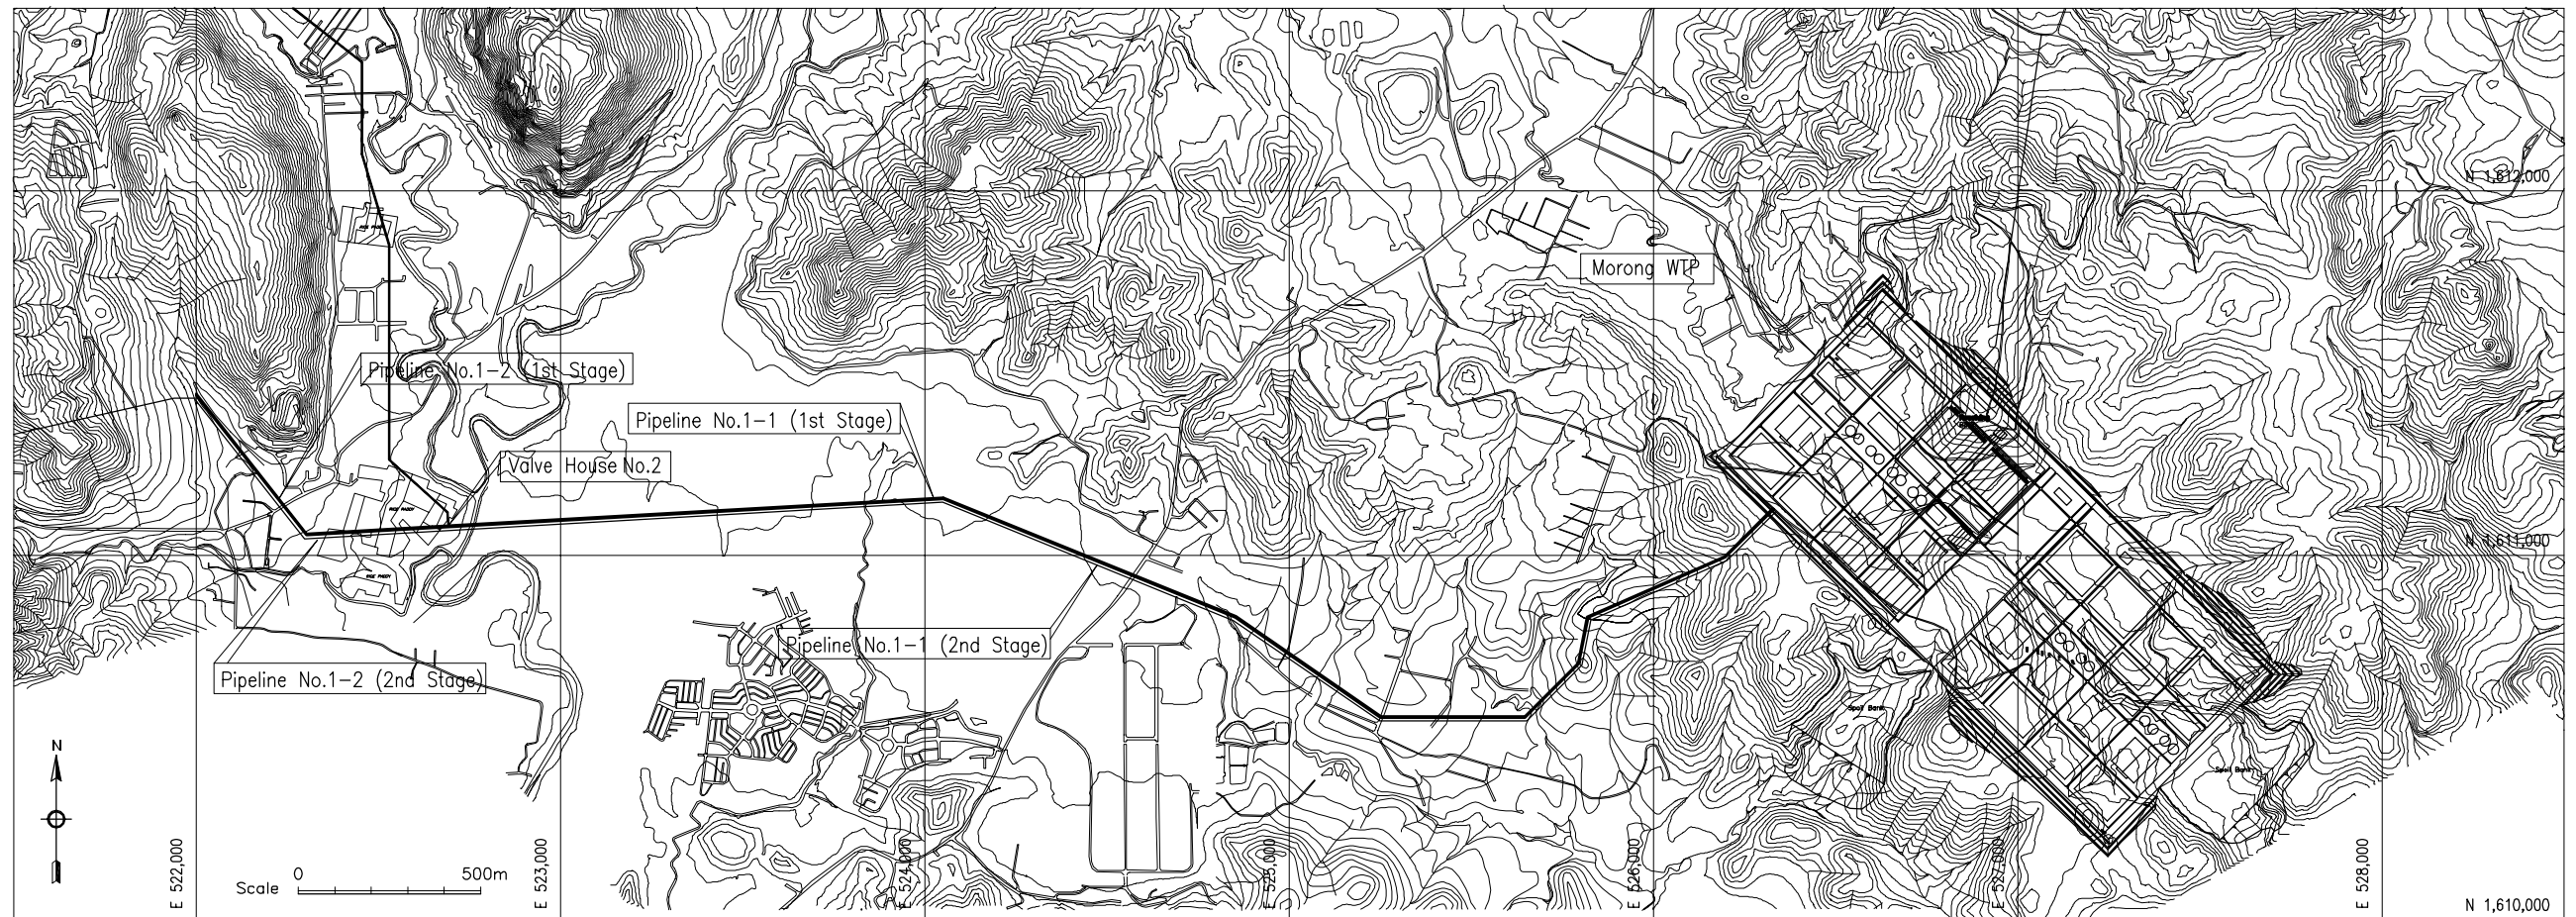

Plan

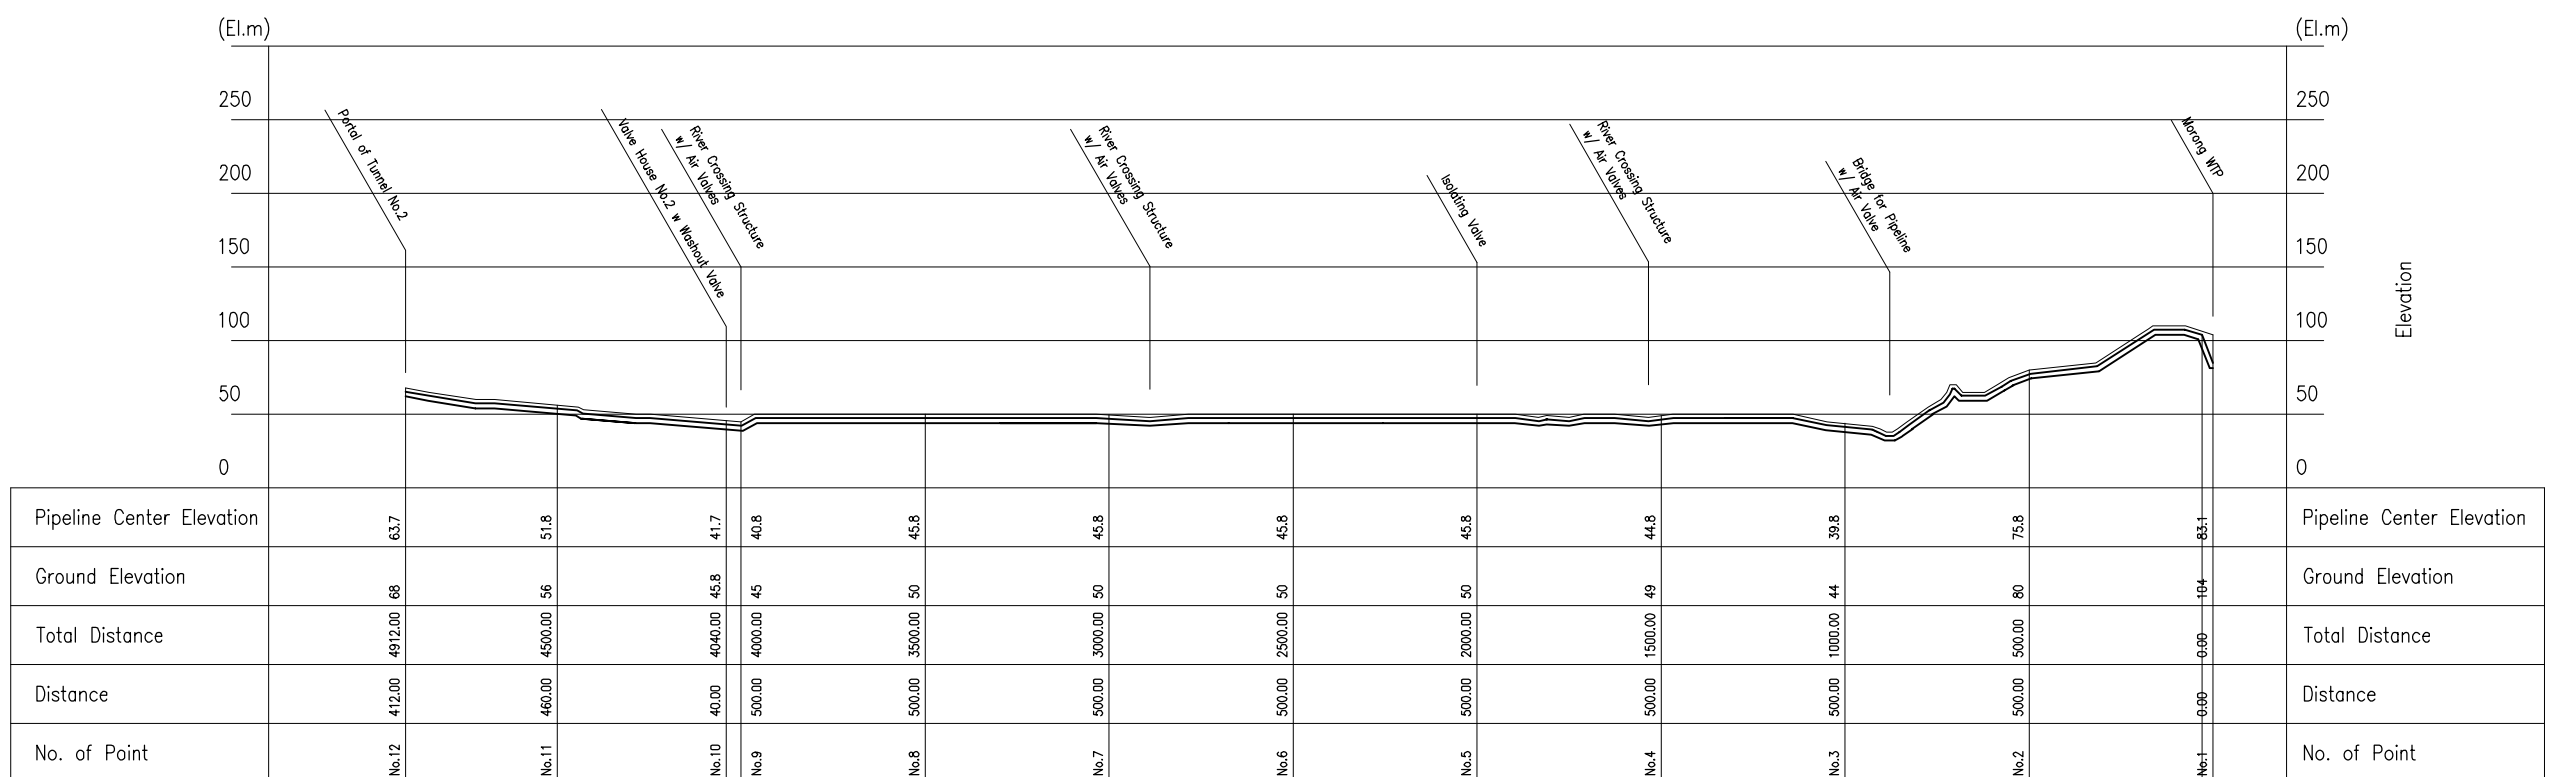

Profile




Figure G2.23 Plan and Profile of Pipeline No.1