


- Legend**
- Classified Village**
- ▲ Electrified by EDL Grid
 - ▲ Electrified by Import Electricity
 - ▲ Electrified by Off-grid (Hydro power)
 - ▲ Electrified by Off-grid (Pico)
 - ▲ Electrified by Off-grid (Diesel)
 - ▲ Electrified by Off-grid (Solar)
 - None
 - EDL Short Term
 - EDL Long Term
 - JICA Off-grid Pre-F/S
 - Potential site (Village Hydro Class)
 - Existing Plan of Pico-hydro and Diesel
 - Existing Plan of Solar Power
 - Others
- Road**
- Paved Road
 - Street Road
 - Improved Unpaved Road
 - Unpaved Road
 - Temporary Road
 - Footpath
- 115kv Transmission line**
- Existing
 - Under Construction
 - Planning
- 22kv Transmission line**
- Existing
 - Planning
 - PTD2 Long Term Plan
 - Demand of Province
- 35kv Transmission line**
- Existing
 - Planning

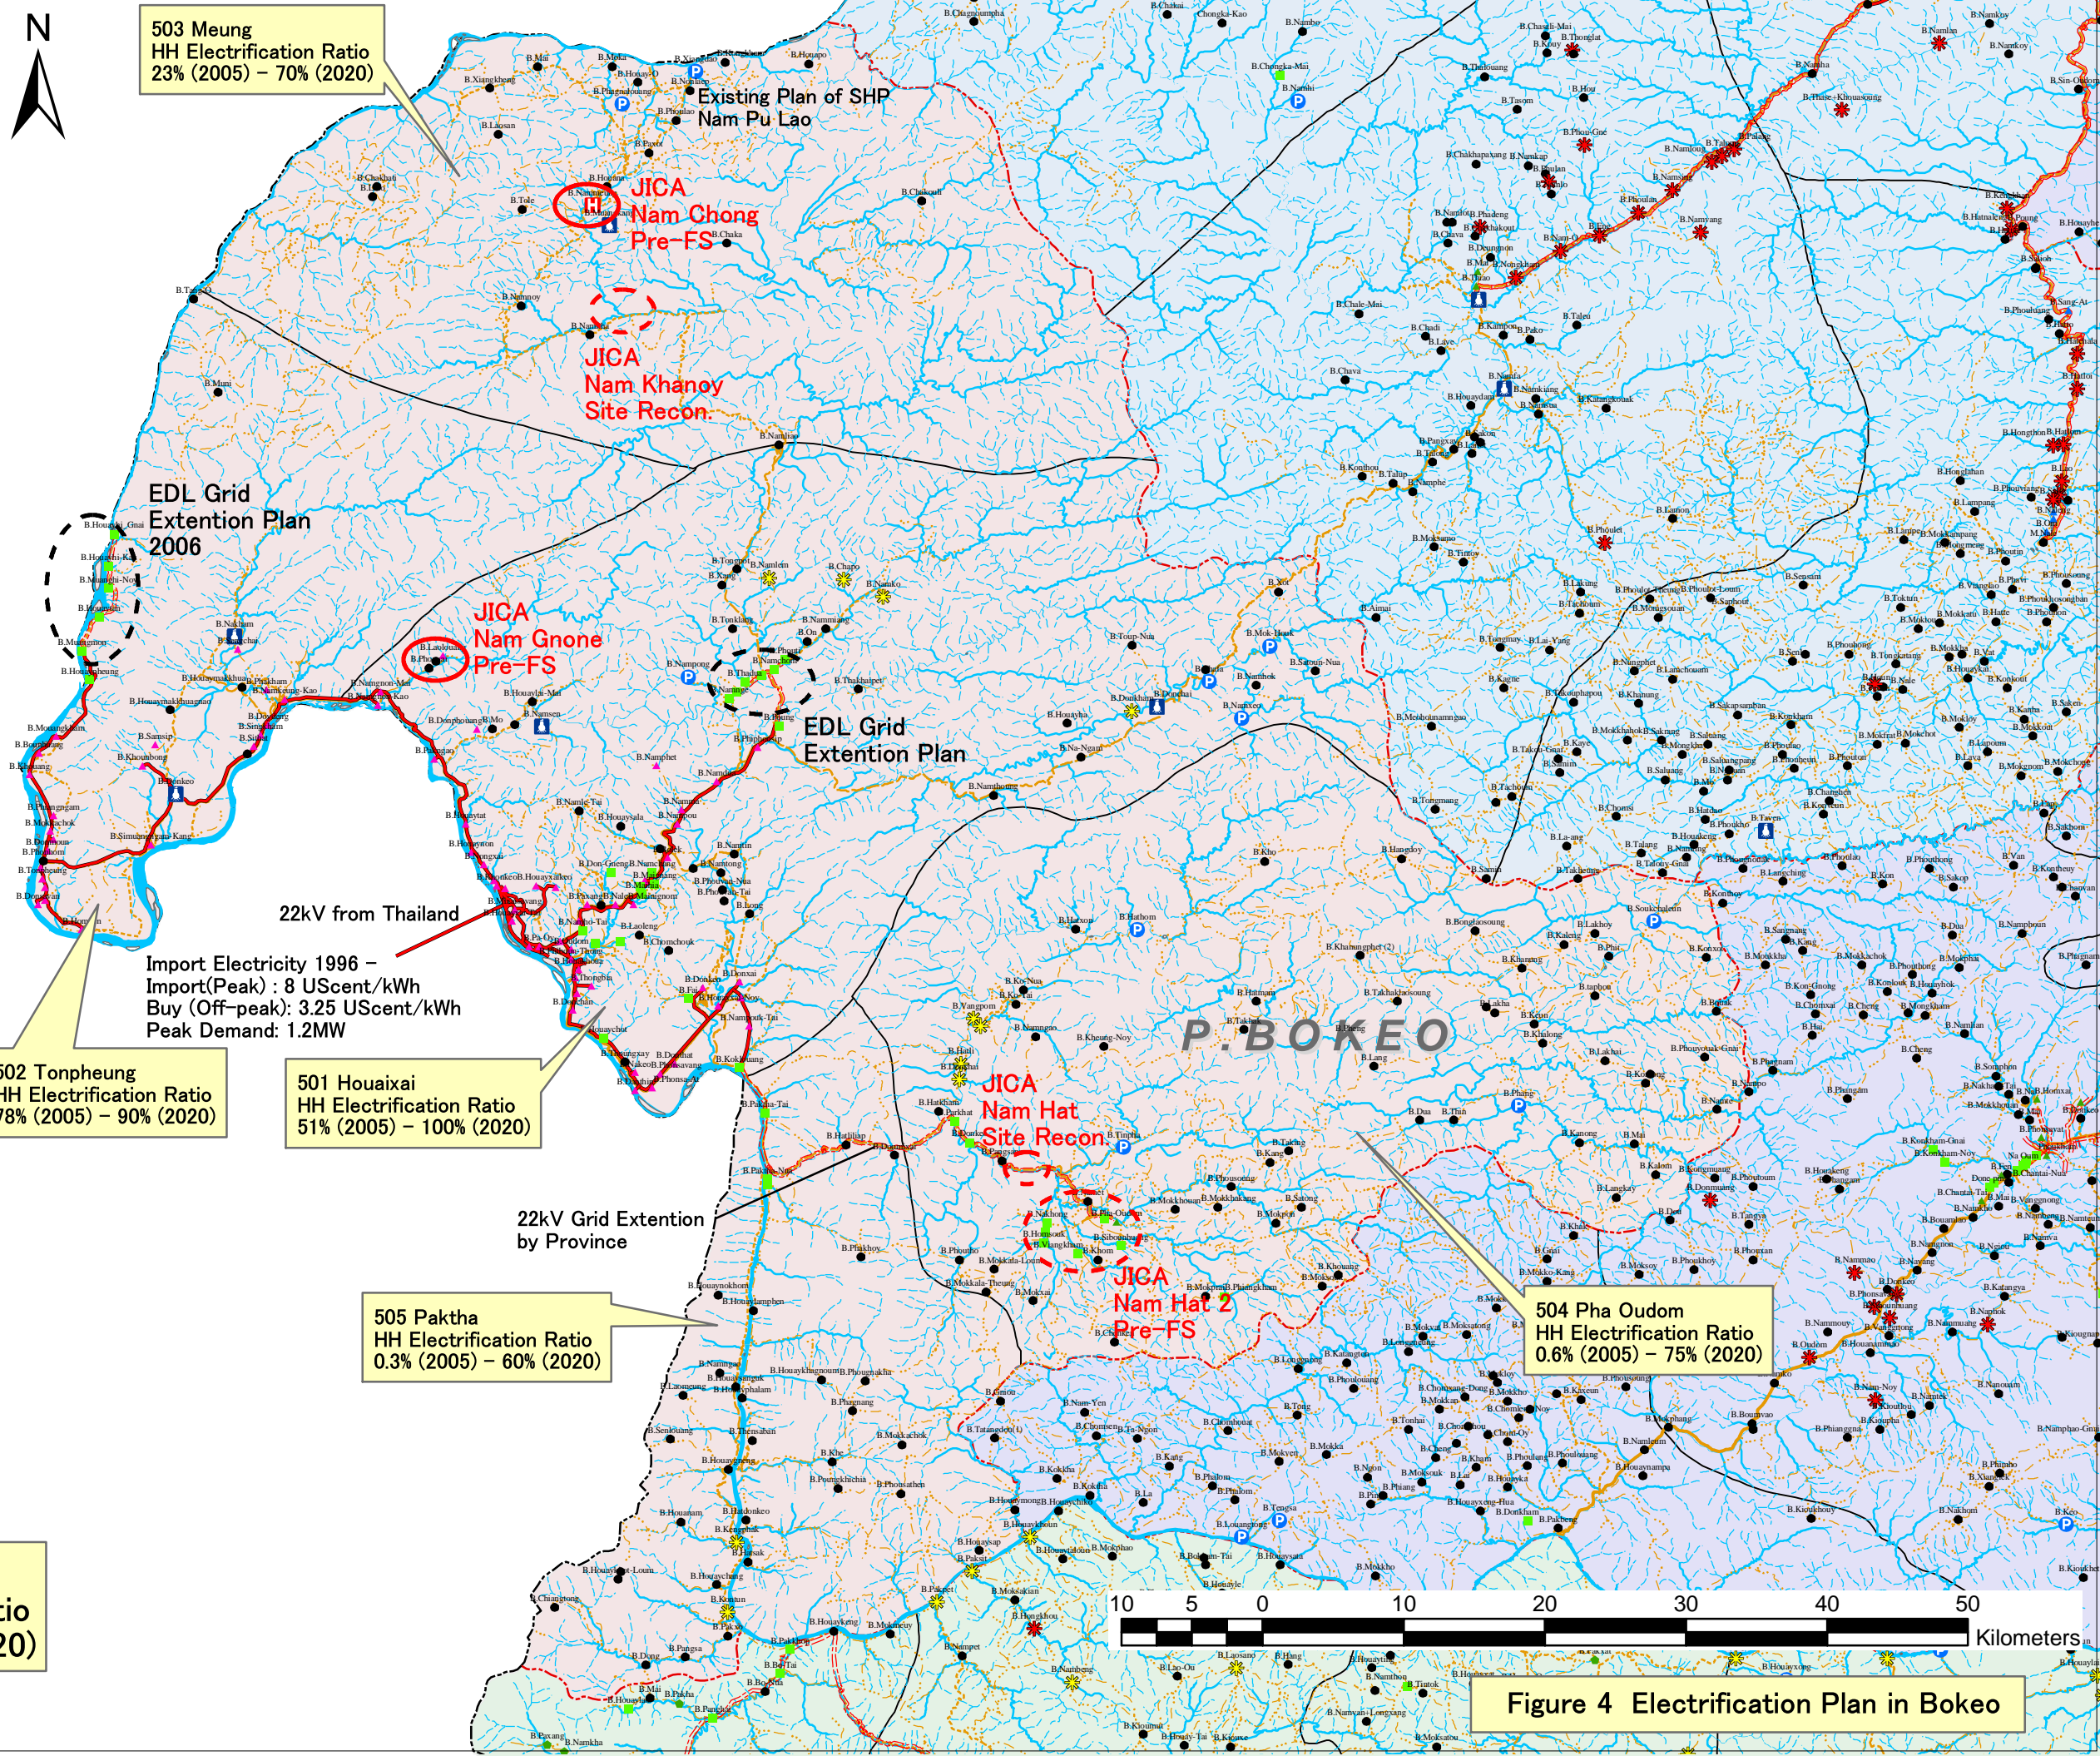

500 Bokeo
HH Electrification Ratio
37% (2005) – 85% (2020)

502 Tonpheung
HH Electrification Ratio
78% (2005) – 90% (2020)

501 Houaixai
HH Electrification Ratio
51% (2005) – 100% (2020)

505 Paktha
HH Electrification Ratio
0.3% (2005) – 60% (2020)

504 Pha Oudom
HH Electrification Ratio
0.6% (2005) – 75% (2020)



Figure 4 Electrification Plan in Bokeo