



Source : JICA Study Team

Annex-6 Proposed Location of Boreholes for Honiara City

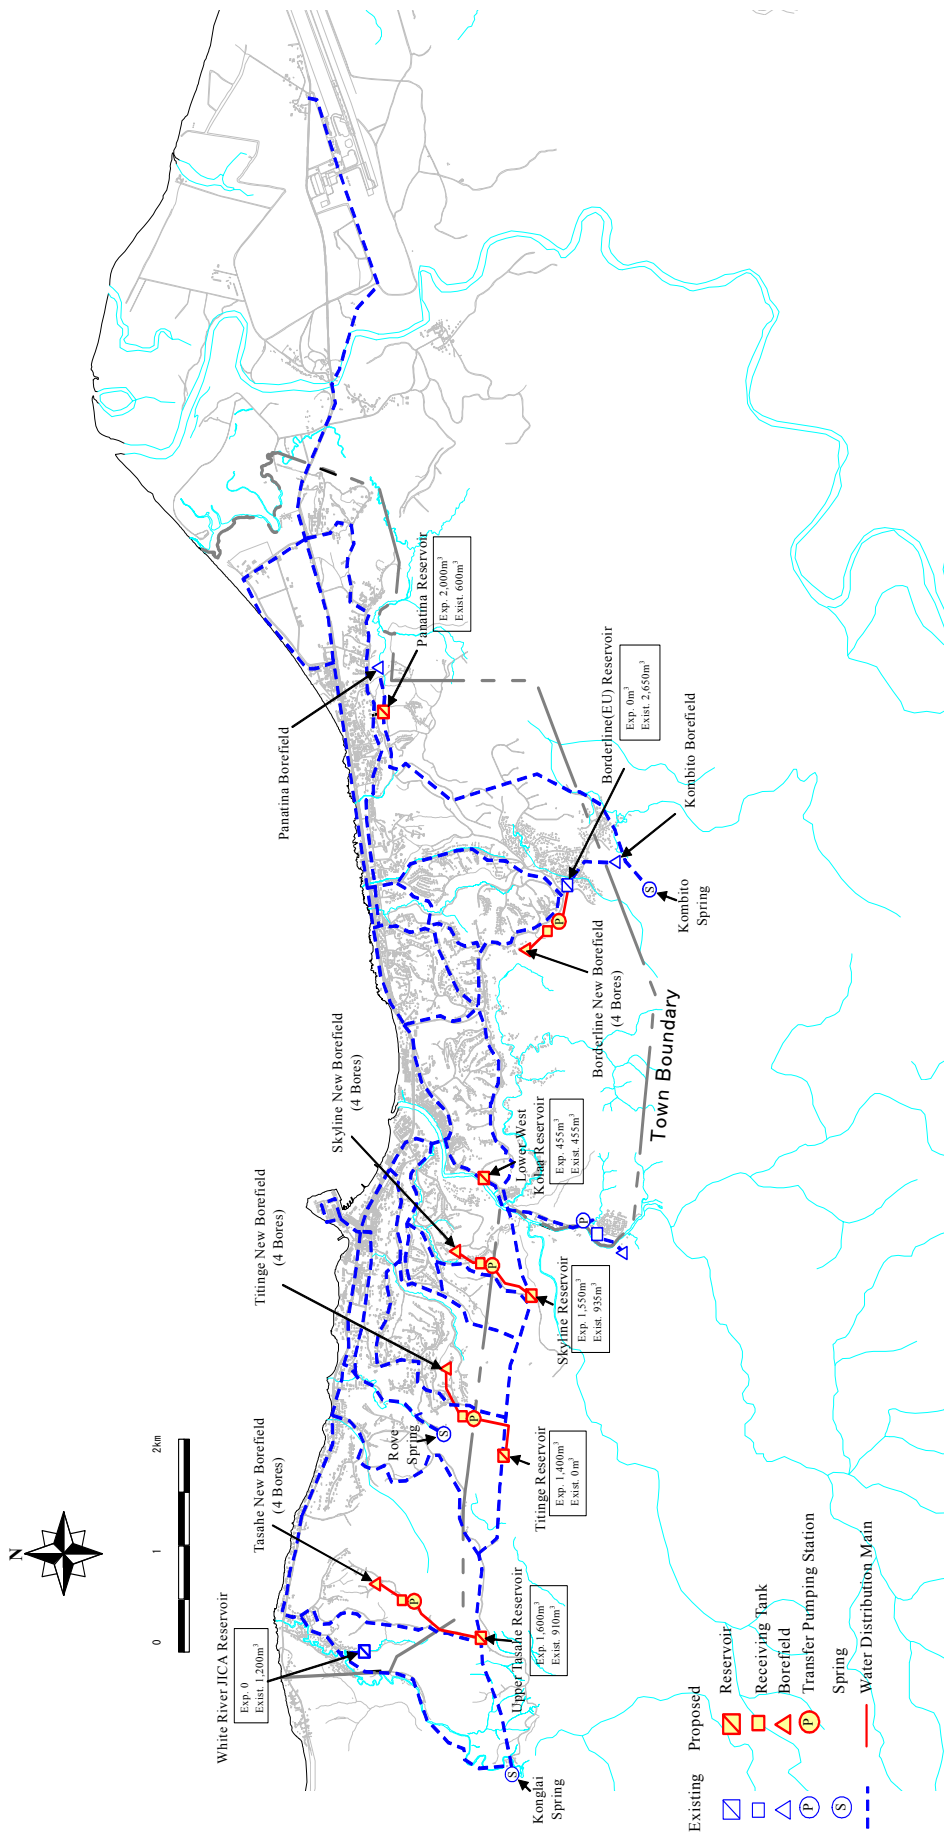


Annex-7 Option J-1 : General Layout of Water Supply Facilities in 2010

Source : JICA Study Team

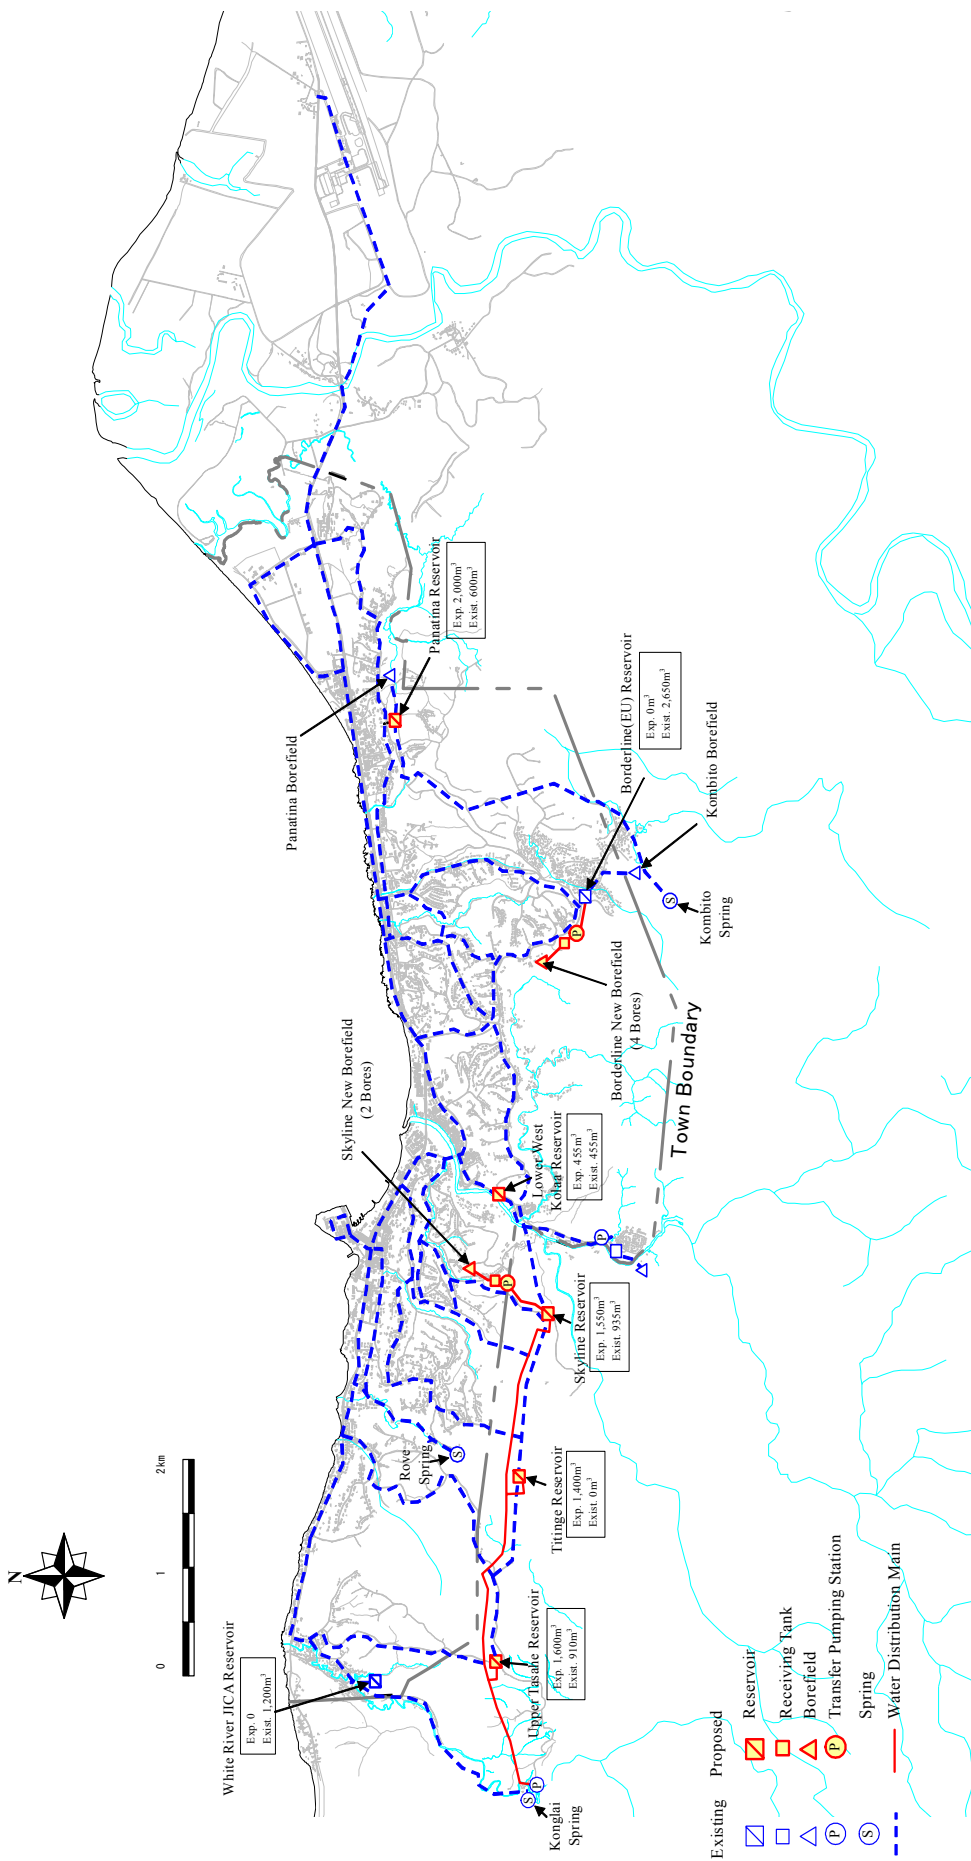


Annex-8 Option J-2 : General Layout of Water Supply Facilities in 2010

Source : JICA Study Team

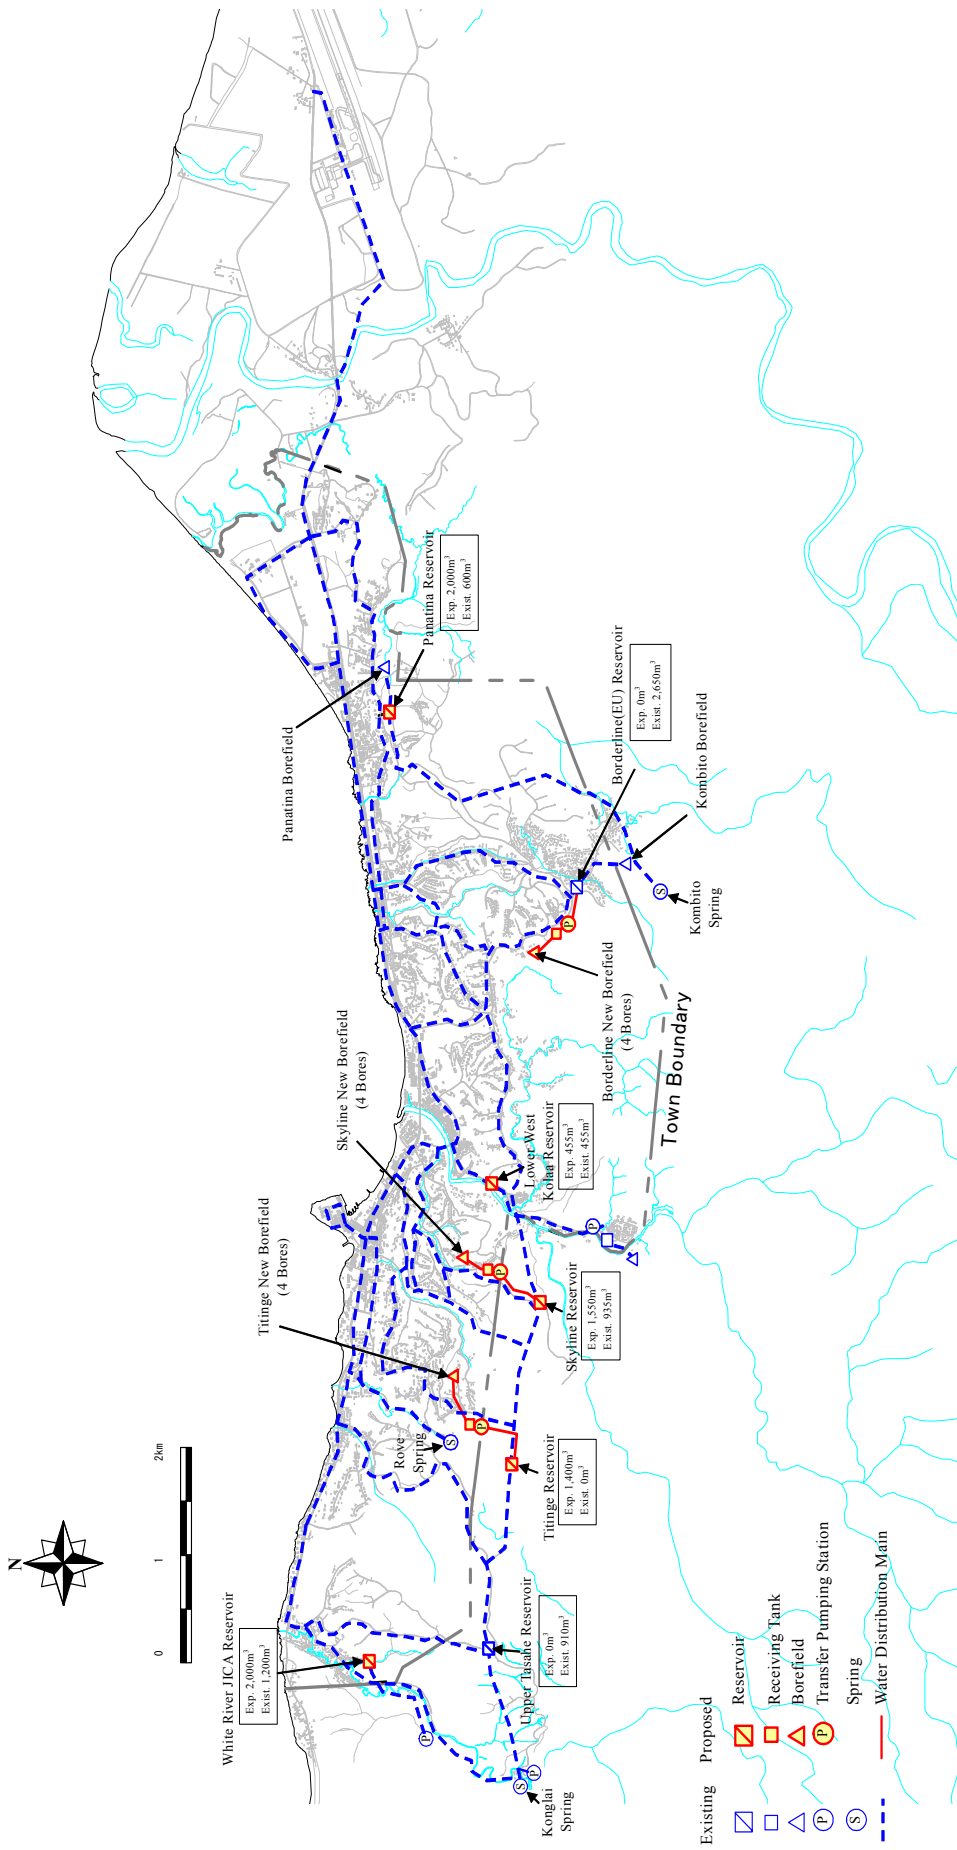


Annex-9 Option J-3 : General Layout of Water Supply Facilities in 2010

Source : JICA Study Team

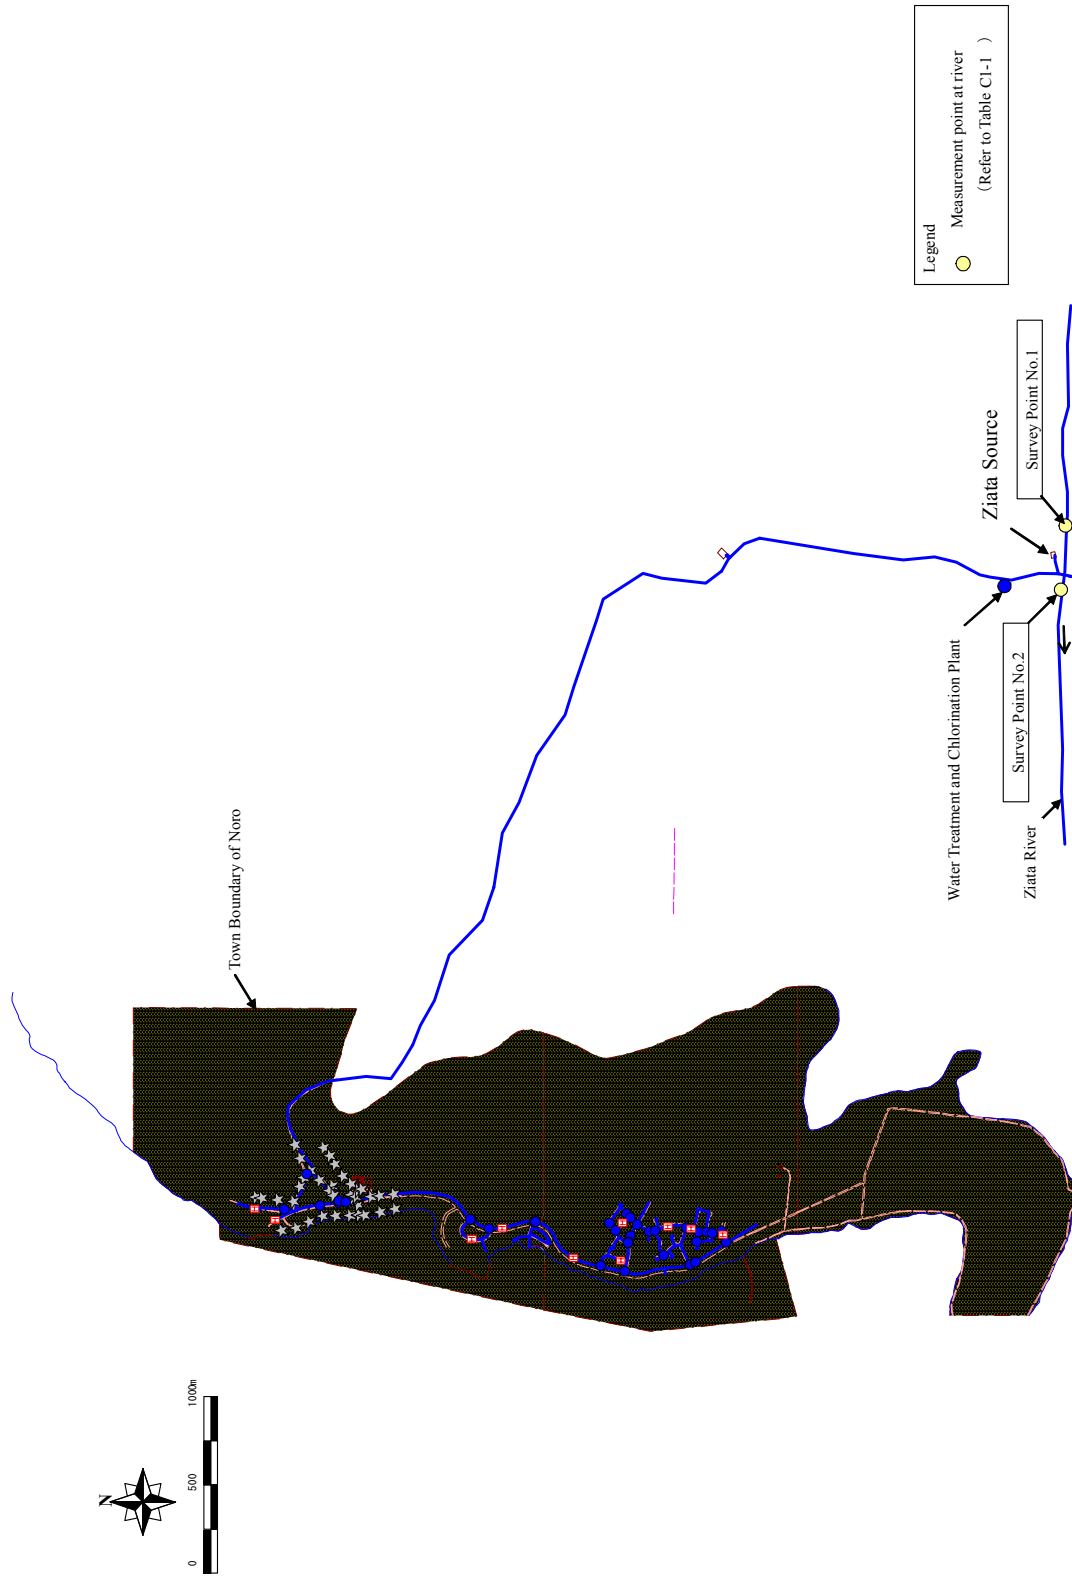


Source : JICA Study Team

Annex-10 Surface Water Discharge Measurement Points in Noro

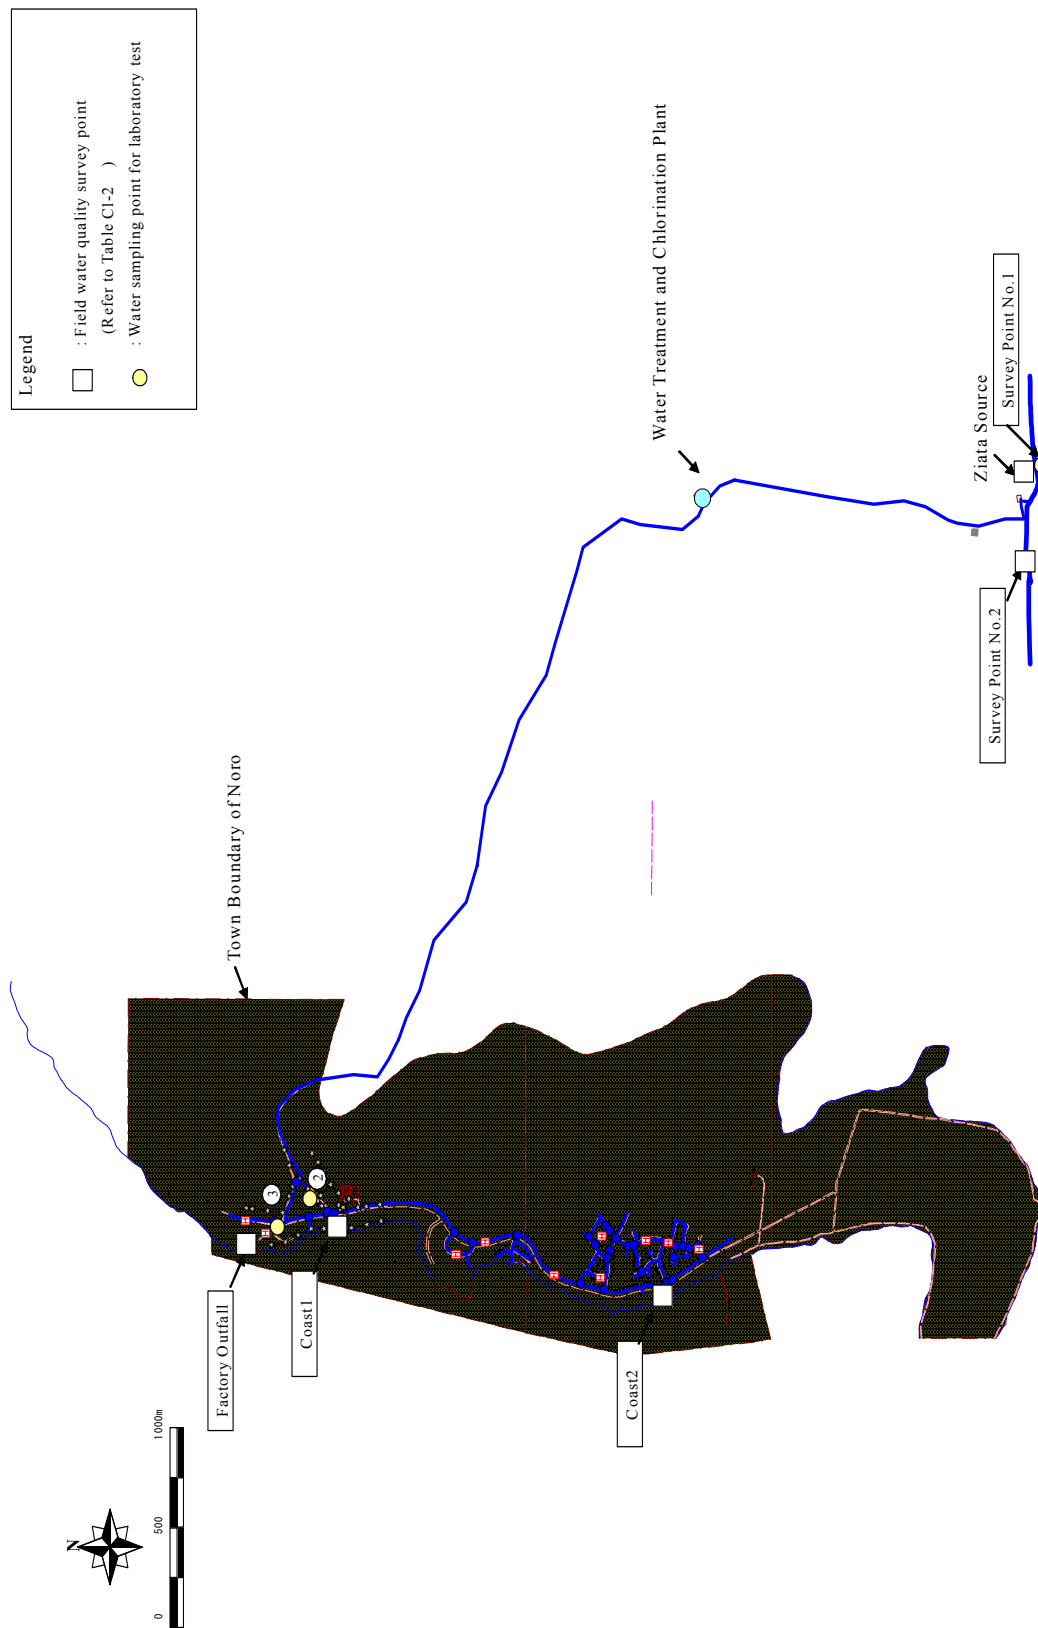


Source : JICA Study Team


Annex-11 Field Water Quality Survey Points and Water Sampling Points for Water Quality Analysis in Laboratory in Noro

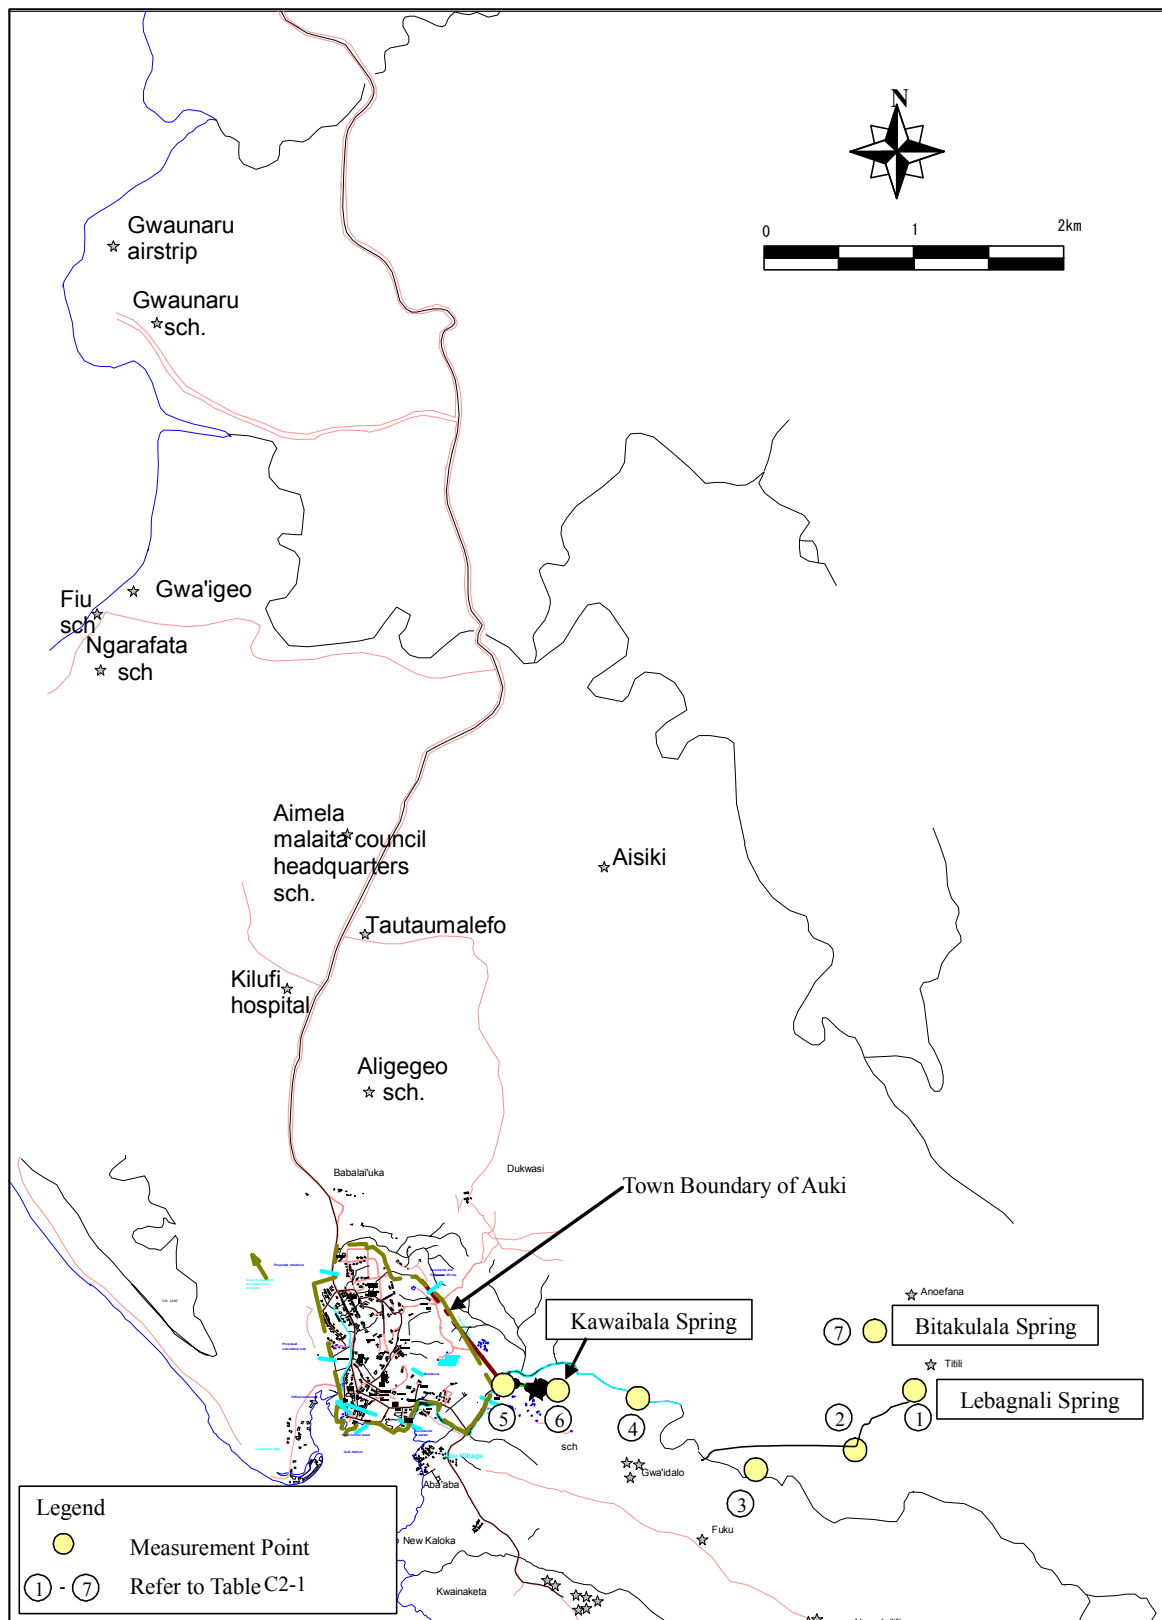

Annex-12 Surface Water Discharge Measurement Points in Auki

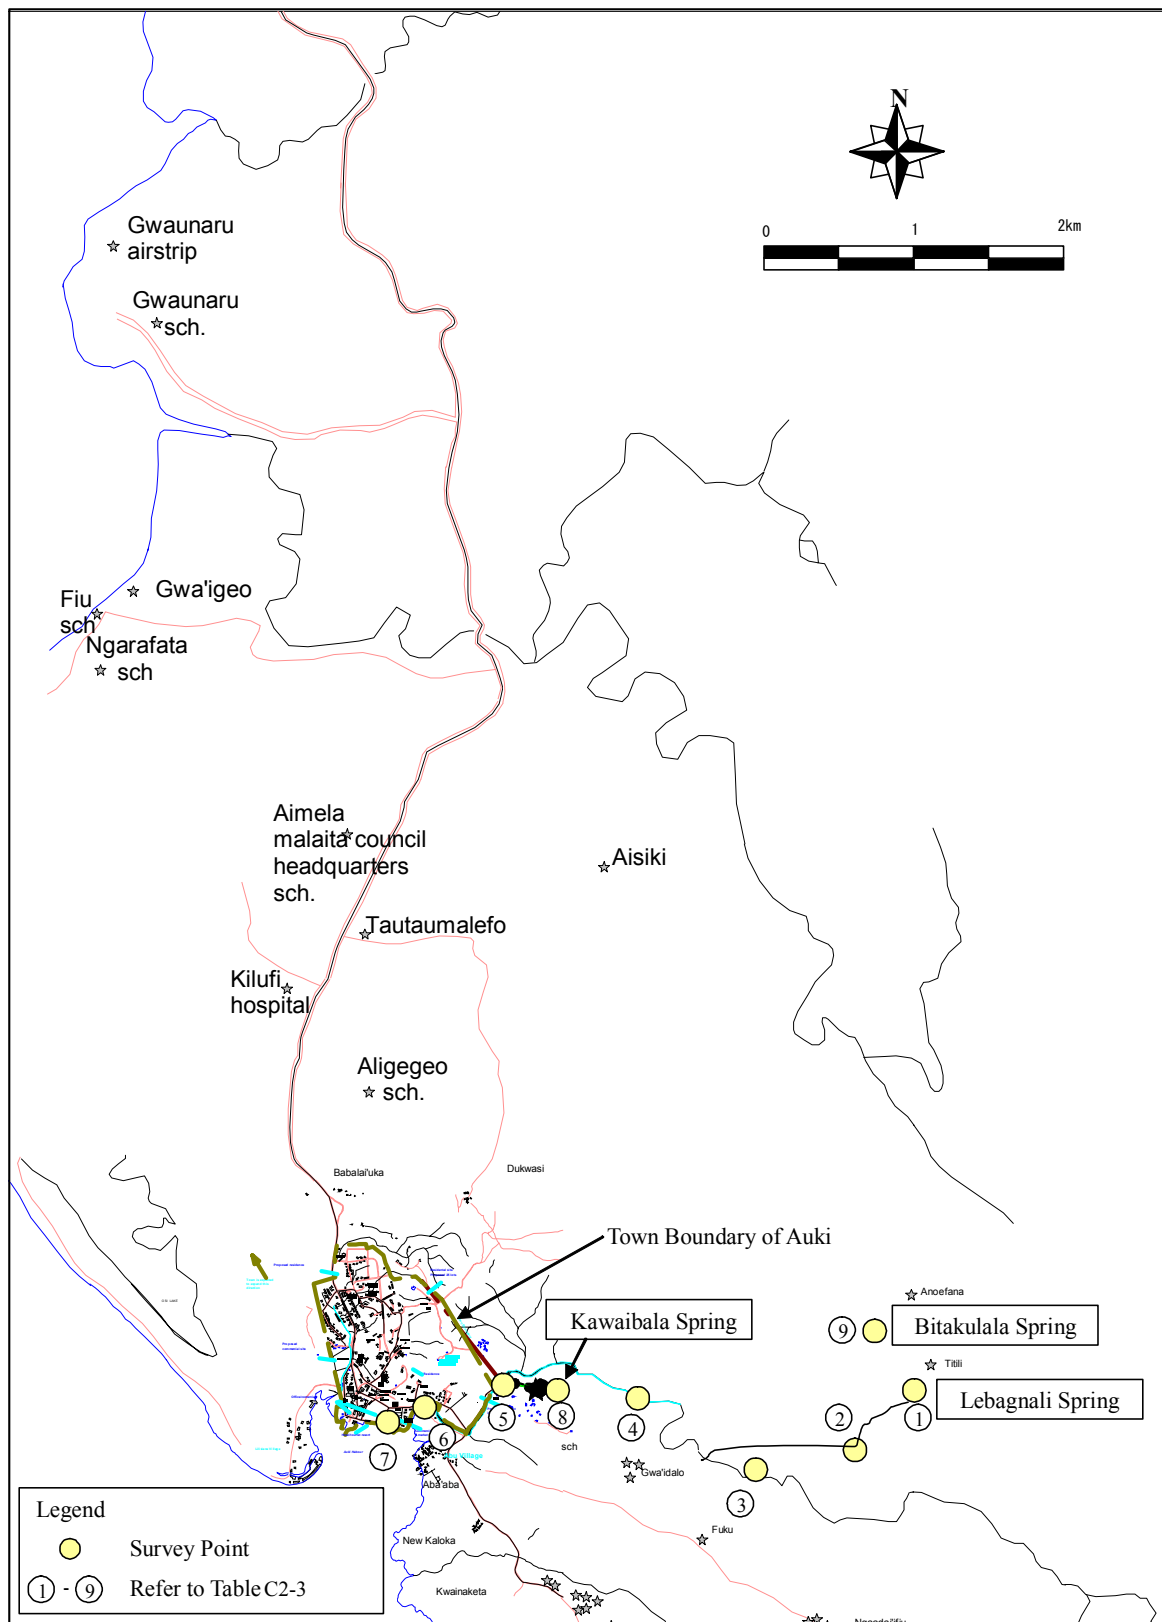


Annex-13 Field Water Quality Survey Points in Auki

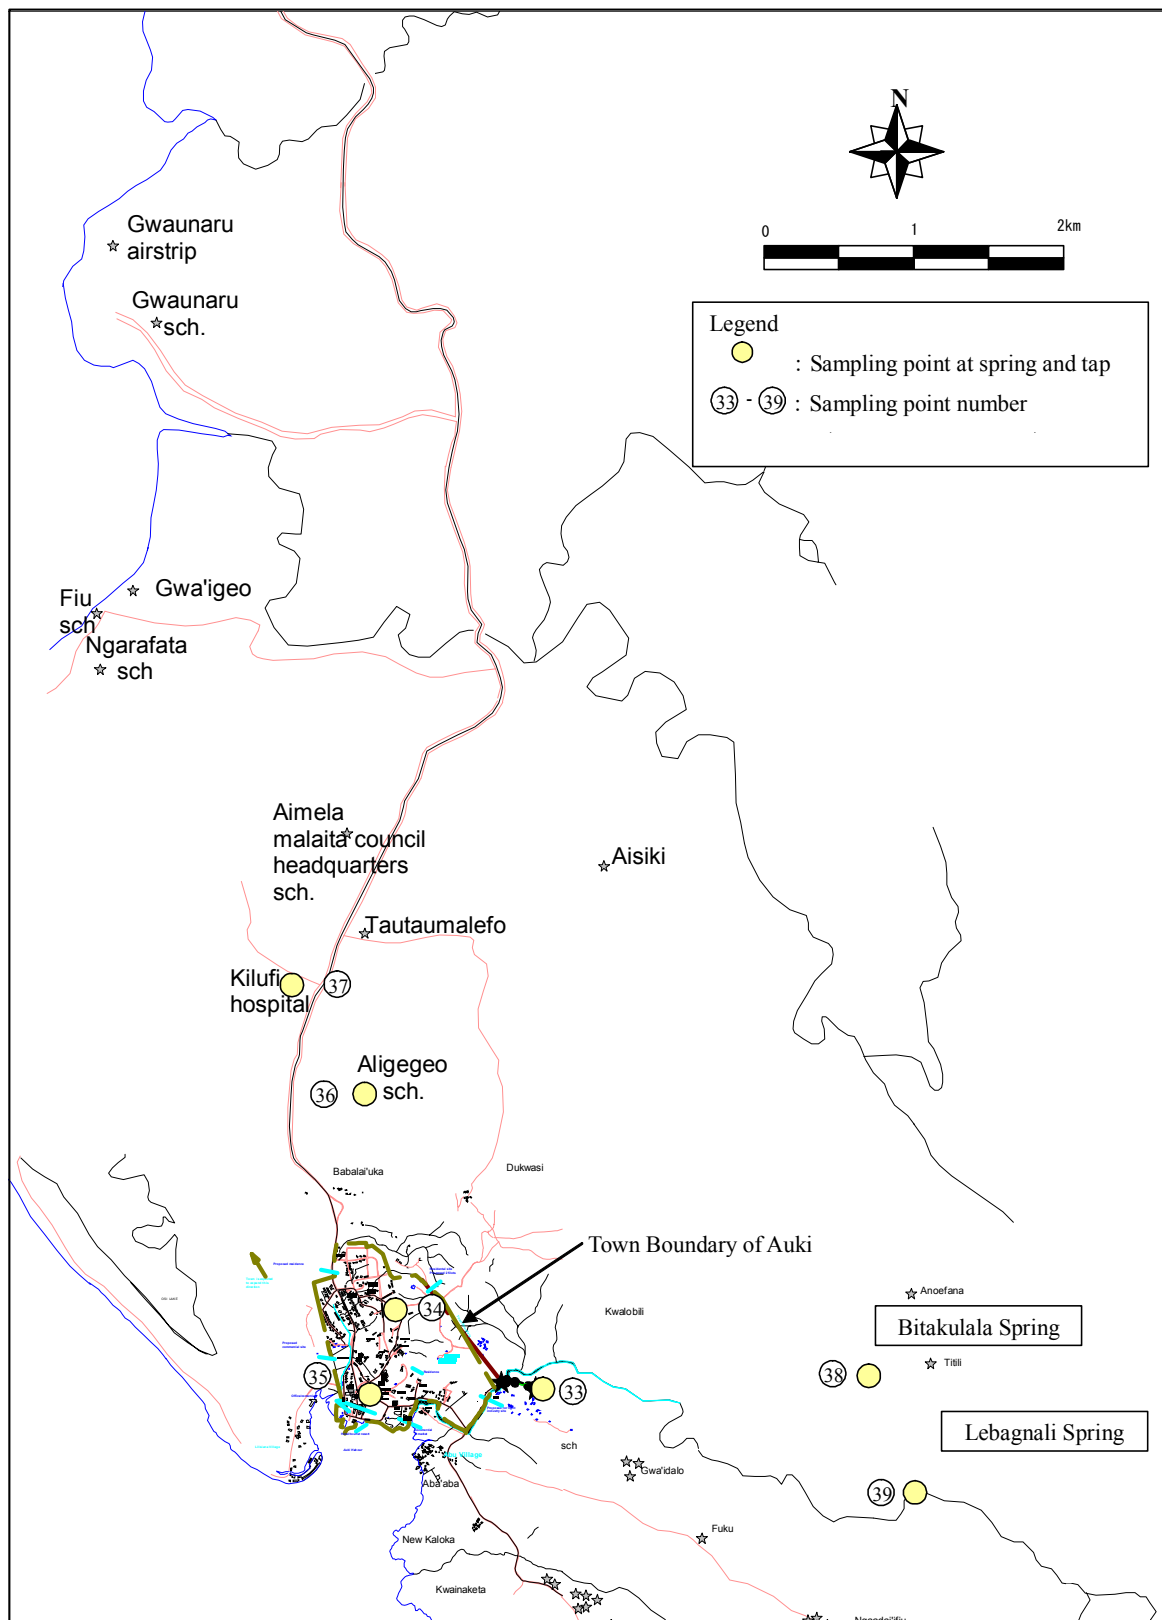


Source : JICA Study Team

Annex-14 Water Sampling Points for Water Quality Analysis in Laboratory in Auki

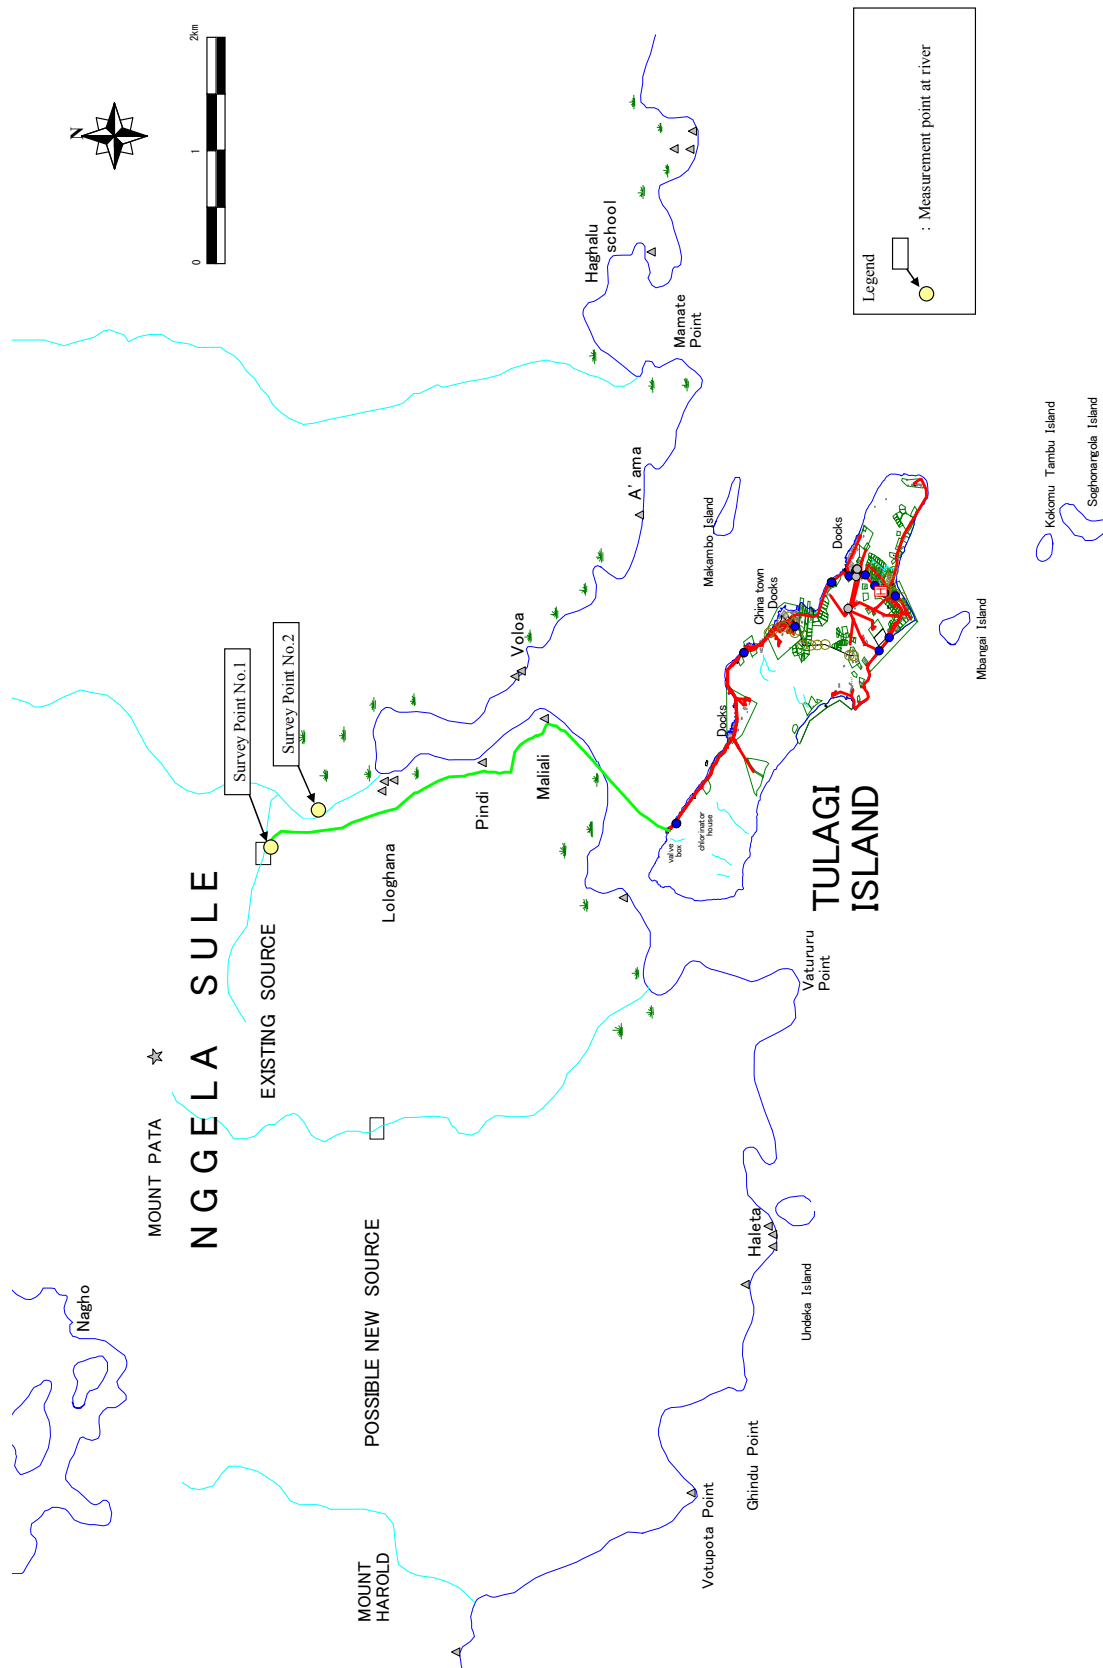


Source : JICA Study Team

Annex-15 Surface Water Discharge Measurement Points in Tulagi

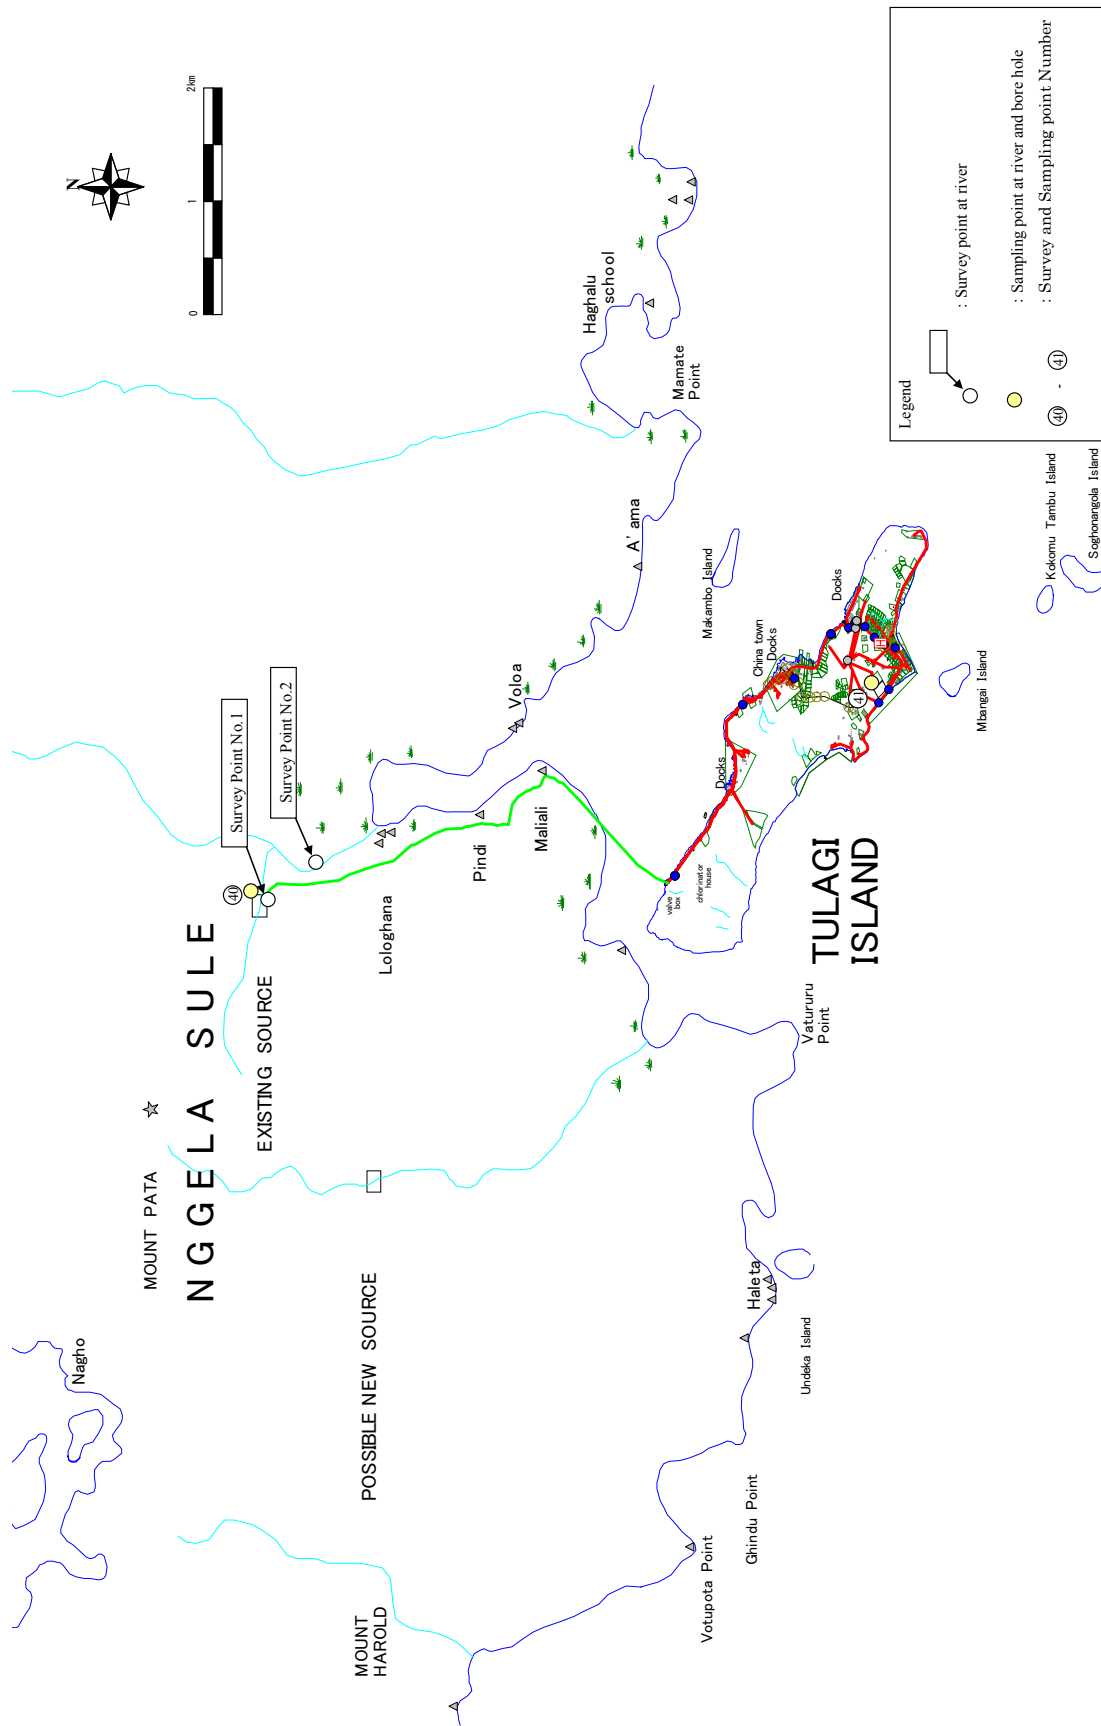

Source : JICA Study Team

Annex-16 Field Water Quality Survey Points and Water Sampling Points for Water Quality Analysis in Tulagi

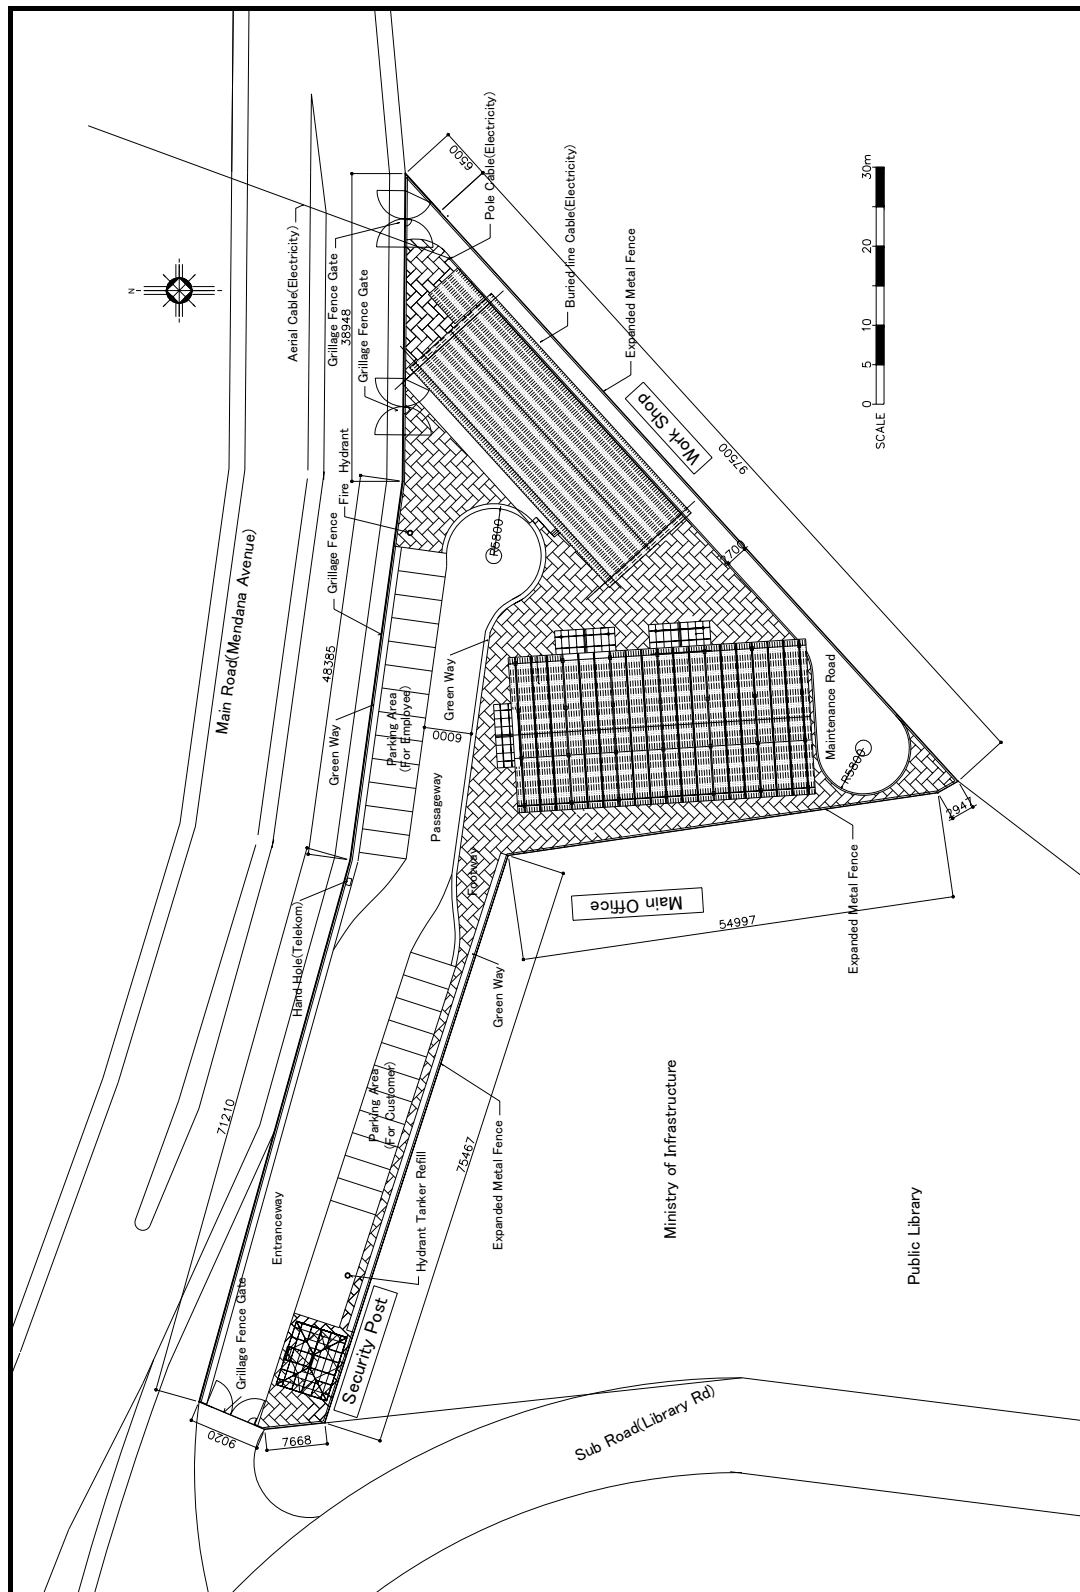

Annex-17 Layout Plan for New Buildings for SIWA

Source : JICA Study Team