


Technical Data


| No. | Title |
|-----|--|
| 1 | DMA |
| 2 | SCADA System Configuration |
| 3 | Equipment List for SCADA System |
| 4 | Work Demarcation for SCADA System between Japan and Montenegro |
| 5 | I/O list for SCADA System |

5 7/1.

DMA

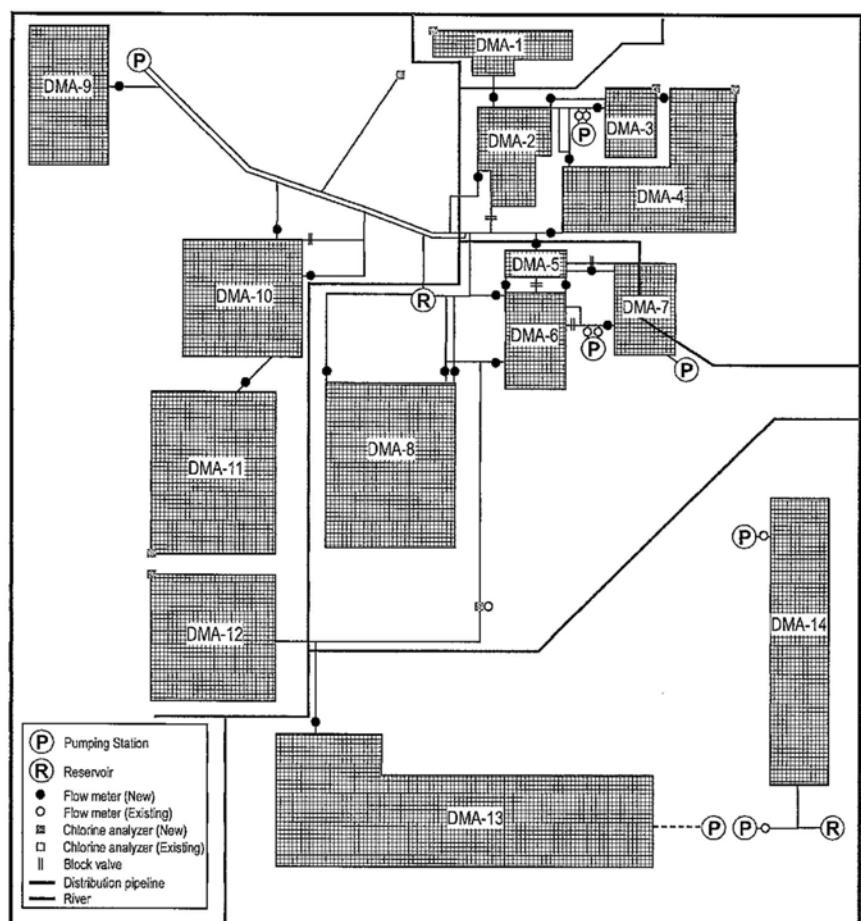

SCADA System Configuration

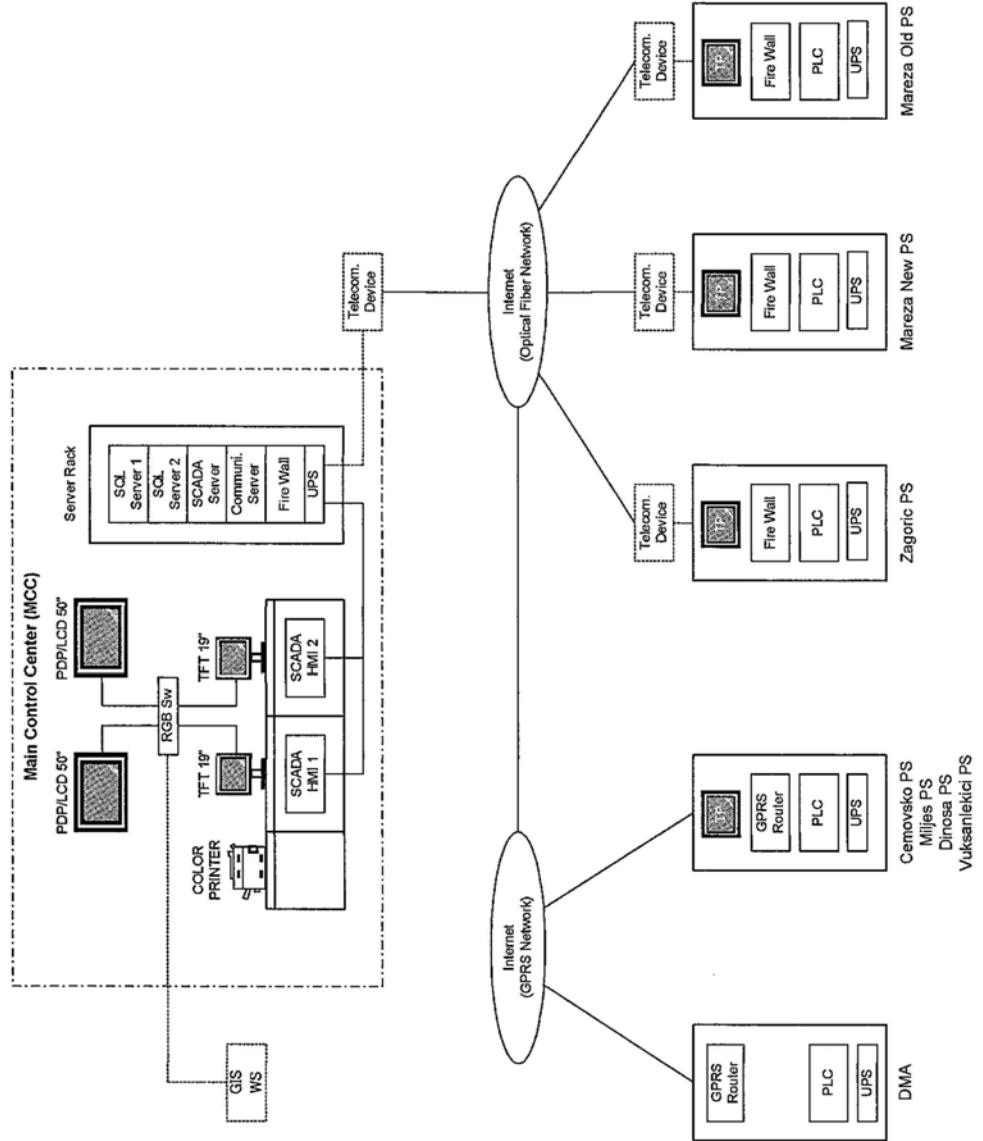

Equipment List for SCADA System


| No. | Location of Equipment | Equipment for SCADA System | | | | | | | | | | | | Instrumentation | | | | | | | |
|--------------------------|-----------------------|----------------------------|--------------|----------------------|-----------|-----------|-------------|-------------|------------|---------------|-------------|-----|-------------|-----------------|-------------|---------------|-----------------|-----------------|--------------------------|-------------|--------------------|
| | | SQL Server | SCADA Server | Communication Server | SCADA HMI | Fire Wall | TFT Monitor | 50" Display | RGB Switch | Color Printer | GPRS Router | UPS | Touch Panel | PLC | Server Rack | Monitor Table | Interface Panel | Pressure Trans. | Residual Chlorine Trans. | Flow Trans. | Level Inst./Trans. |
| Main Control Center | | 2 | 1 | 1 | 2 | 1 | 2 | 2 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 3 | | | | | |
| Mareza Old Pump Station | | | | | 1 | | | | | | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | |
| Mareza New Pump Station | | | | | | 1 | | | | | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | |
| Zagoric Pump Station | | | | | | | | | | | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | |
| Cenovsko Pump Station | | | | | | | | | | | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | |
| Milice Pump Station | | | | | | | | | | | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | |
| Dinose Pump Station | | | | | | | | | | | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | |
| Vukšanskiči Pump Station | | | | | | | | | | | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | |
| DMA (PTr and Chlorine) | | | | | | | | | | | | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | |
| DMA (PTr and F7) | | | | | | | | | | | | 29 | 29 | 29 | 29 | 29 | 29 | 29 | 29 | 29 | |
| Reservoir | | | | | | | | | | | | 3 | 3 | 1 | 3 | 3 | 3 | 3 | 3 | 3 | 6 |
| TOTAL | | 2 | 1 | 1 | 2 | 4 | 2 | 2 | 1 | 1 | 1 | 43 | 47 | 8 | 46 | 1 | 3 | 46 | 36 | 22 | 7 |

58 f.

Work Demarcation for SCADA System between Japan and Montenegro

1. Work Demarcation of Main Control Center

| | |
|------------|---|
| Japan side | Supply, installation and connection, and site commissioning of the following equipment indicated by solid line. |
| | -2 - SQL Servers |
| | - Communication Server |
| | -2 - SCADA HMI |
| | -2 - TFT Monitors |
| | -2 - PDP/LCD 50" Monitor |
| | -Server Rack |
| | -SCADA Server |
| | -Fire Wall |
| | -UPS |
| | -Color Printer |
| | -RGB Switch |
| | -Monitor Tables and Chairs |

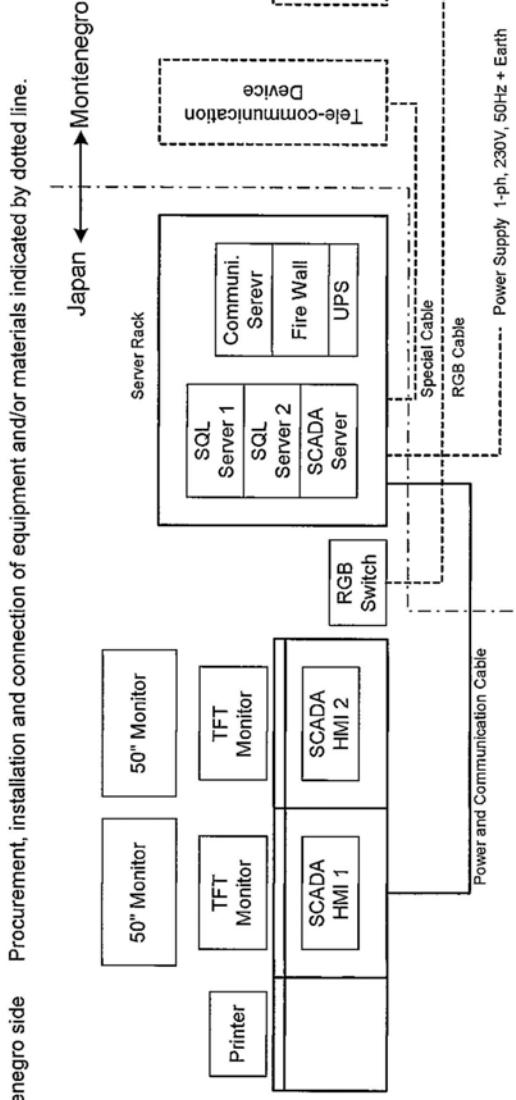

Work Demarcation for SCADA System between Japan and Montenegro


2. Work Demarcation of Pump Station listed below

- Mareza New Pump Station
- Mareza Old Pump Station
- Zagoric Pump Station

Japan side Supply of the following equipment indicated by solid line.

- PLC
- Touch Panel
- Fire Wall
- UPS
- Interface Panel

Montenegro side 1. Installation of equipment supplied by Japan side
 2. Procurement, installation and connection of equipment and/or materials indicated by dotted line.

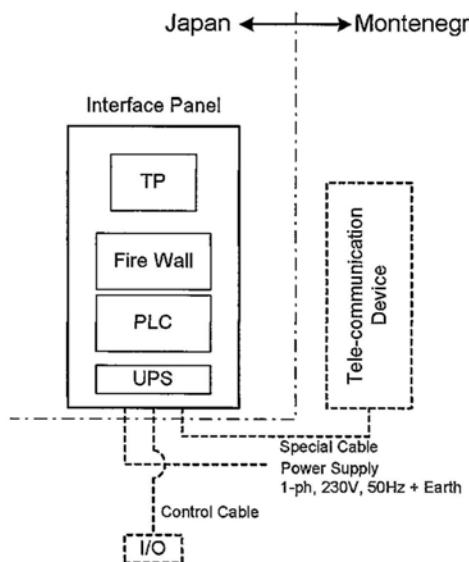

✓ 8/8

Work Demarcation for SCADA System between Japan and Montenegro


3. Work Demarcation of Pump Station listed below

- Cemovsko Pump Station
- Miljes Pump Station
- Dinoa Pump Station
- Vuksanlekici Pump Station

Japan side Supply of the following equipment indicated by solid line.

- PLC
- Touch Panels
- GPRS Router
- UPS
- Interface Panel

Montenegro side 1. Installation of equipment supplied by Japan side.
 2. Procurement, installation and connection of equipment and/or materials indicated by dotted line.

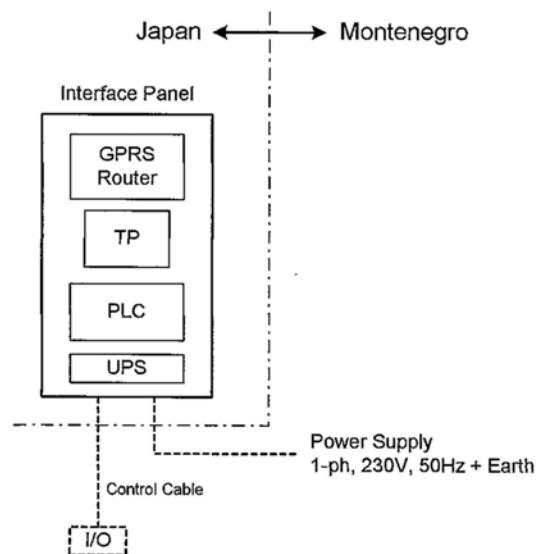

← 8/8


Work Demarcation for SCADA System between Japan and Montenegro

4. Work Demarcation of DMA (Pressure and Flow)

Japan side Supply and site commissioning of the following equipment indicated by solid line.

- PLC
- GPRS Router
- UPS
- Interface Panels
- Pressure Transmitter
- Flowmeter and Flow Transmitter

Montenegro side 1. Installation of equipment supplied by Japan side.
 2. Procurement, installation and connection of equipment and/or materials indicated by dotted line.
 3. Procurement and connection of cables and sampling pipes.
 4. Procurement and installation of kiosk

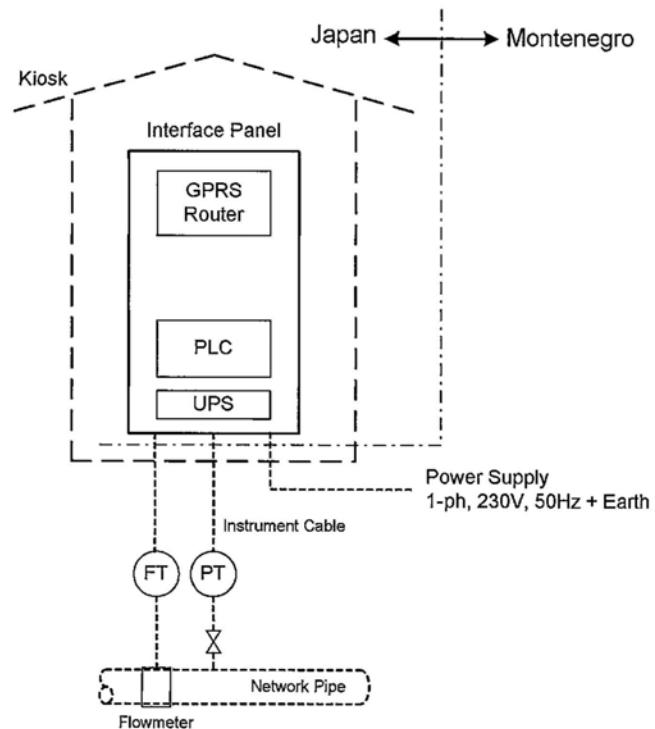


Work Demarcation for SCADA System between Japan and Montenegro

5. Work Demarcation of DMA (Pressure and Residual Chlorine)

Japan side Supply and site commissioning of the following equipment indicated by solid line.

- PLC
- GPRS Router
- UPS
- Interface Panels
- Residual Chlorine Analyzer
- Pressure Transmitter

Montenegro side 1. Installation of equipment supplied by Japan side.
 2. Procurement, installation and connection of equipment and/or materials indicated by dotted line.
 3. Procurement and connection of cables and sampling pipes.
 4. Procurement and installation of kiosk

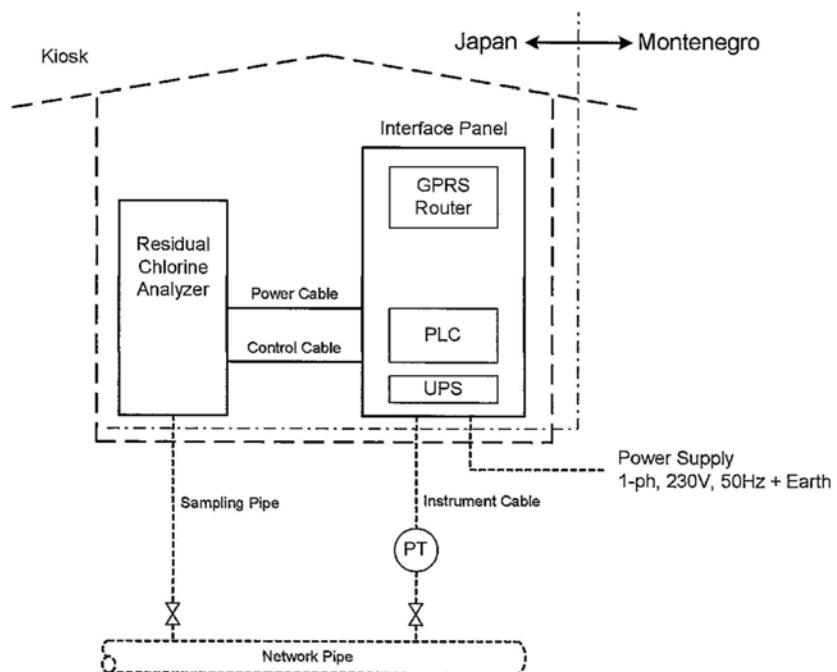

15 Mr f.

I/O List for SCADA System

| No. | Item | Input | | Output Digital | Remarks |
|-----|------------------------------------|---------|--------|-------------------|---------|
| | | Digital | Analog | | |
| | Milješ PS | | | | |
| | Electrical System | | | | |
| 1 | Incoming voltage | 1 | | | |
| 2 | Incoming current (A) | 1 | | | |
| 3 | Incoming frequency | 1 | | | |
| 4 | Power factor | 1 | | | |
| 5 | Electric power (kW) | 1 | | | |
| 6 | Electric energy (kWh) | 1 | | | |
| 7 | Overcurrent | 1 | | | |
| 8 | Oversupply | 1 | | | |
| 9 | Undervoltage | 1 | | | |
| 10 | Earth fault | 1 | | | |
| 11 | Circuit breaker ON | 1 | | | |
| 12 | Load break switch ON | 1 | | | |
| 13 | Disconnecting switch ON | 1 | | | |
| | Pump Signal/Measurement | | | | |
| 1 | Pump stop | 3 | | | |
| 2 | Pump running | 3 | | | |
| 3 | Pump fault | 3 | | | |
| 4 | Motor current | | 3 | | |
| 5 | Motor power | 3 | | | |
| 6 | Motor winding temperature | | 3 | | |
| 7 | Motor winding temperature high | 3 | | | |
| 8 | Motor winding temperature trip | 3 | | | |
| 9 | Well water level | | 3 | | |
| 10 | Well water level low alarm | 3 | | | |
| 11 | Well water level low low trip | 3 | | | |
| 12 | Chlorine pump discharge pressure | | 1 | | |
| 13 | Chlorine pump stop | 2 | | | |
| 14 | Chlorine pump running | 2 | | | |
| 15 | Chlorine pump fault | 2 | | | |
| | Station Signal/Measurment | | | | |
| 1 | Pump discharge header pressure | | 2 | | |
| 2 | Pump discharge header flow | | 2 | | |
| 3 | Residual chlorine contents | | 2 | | |
| 4 | Chlorine gas leakage alarm | 1 | | | |
| | Frequency converter (1 set) | | | | |
| 1 | FC start | 1 | | | |
| 2 | FC stop | 1 | | | |
| 3 | Running mode local | 1 | | RS 485 | |
| 4 | Running mode remote | 1 | | RS 485 | |
| 5 | Level set point (m) | 1 | | RS 485 | |
| 6 | Pressure set point (bar) | 1 | | RS 485 | |
| 7 | Flow set point (l/s) | 1 | | RS 485 | |
| 8 | Actual setup | 4 | | RS 485 | |
| 9 | Frequency converter running | 1 | | RS 485 | |
| 10 | Frequency converter sleep mode | 1 | | RS 485 | |
| 11 | Frequency converter stopped | 1 | | RS 485 | |
| 12 | Frequency converter failure | 1 | | RS 485 | |
| 13 | Frequency (Hz) | 1 | | RS 485 | |
| 14 | Frequency converter warning | 1 | | RS 485 | |
| 15 | Frequency converter alarm | 1 | | RS 485 | |

5 8 f

| Soft starter (2 set) | | | | |
|--------------------------|----|----|--|--------|
| 1 SS start | 2 | | | |
| 2 SS stop | 2 | | | |
| 3 Runing mode local | 2 | | | RS 485 |
| 4 Runing mode remote | 2 | | | RS 485 |
| 5 Soft starter starting | 2 | | | RS 485 |
| 6 Soft starter by passed | 2 | | | RS 485 |
| 7 Soft starter ready | 2 | | | RS 485 |
| 8 Soft starter failure | 2 | | | RS 485 |
| TOTAL: | 78 | 16 | | |

15 878

I/O List for SCADA System

| No. | Item | Input | | Output Digital | Napomene | | | |
|--|--------------------------------------|---------|--------|-------------------|----------|--|--|--|
| | | Digital | Analog | | | | | |
| Cemovska Polje PS | | | | | | | | |
| Electrical System (Električni sistem) | | | | | | | | |
| 1 | Incoming voltage | 1 | | | | | | |
| 2 | Voltage | 1 | | | | | | |
| 3 | Incoming frequency | 1 | | | | | | |
| 4 | Power factor | 1 | | | | | | |
| 5 | Electric power (kW) | 1 | | | | | | |
| 6 | Electric energy (kWh) | 1 | | | | | | |
| 7 | Overscurrent | 1 | | | | | | |
| 8 | Oversvoltage | 1 | | | | | | |
| 9 | Undervoltage | 1 | | | | | | |
| 10 | Earth fault | 1 | | | | | | |
| 11 | Circuit breaker ON | 1 | | | | | | |
| 12 | Load break switch ON | 1 | | | | | | |
| 13 | Disconnecting switch ON | 1 | | | | | | |
| 14 | Transformer winding temperature high | 1 | | | | | | |
| 15 | Transformer buchholz relay operated | 1 | | | | | | |
| Pump Signal/Measurement | | | | | | | | |
| 1 | Well water level | | 5 | | | | | |
| 2 | Well water level low alarm | 5 | | | | | | |
| 3 | Well water level low low trip | 5 | | | | | | |
| 4 | Motor current | | 5 | | | | | |
| 5 | Motor power | 5 | | | | | | |
| 6 | Motor winding temperature | | 5 | | | | | |
| 7 | Motor winding temperature high | 5 | | | | | | |
| 8 | Motor winding temperature trip | 5 | | | | | | |
| 12 | Pump stop | 5 | | | | | | |
| 13 | Pump running | 5 | | | | | | |
| 14 | Pump fault | 5 | | | | | | |
| 15 | Chlorine pump discharge pressure | | 1 | | | | | |
| 16 | Chlorine pump stop | 3 | | | | | | |
| 17 | Chlorine pump running | 3 | | | | | | |
| 18 | Chlorine pump fault | 3 | | | | | | |
| Station Signal/Measurment (Signal stanice/mjerenja) | | | | | | | | |
| 1 | Pump discharge header pressure | | 2 | | | | | |
| 2 | Pump discharge header flow | | 2 | | | | | |
| 3 | Residual chlorine contents | | 2 | | | | | |
| 4 | Chlorine gas leakage alarm | 1 | | | | | | |
| Frequency converter (1 set) | | | | | | | | |
| 1 | FC start | 1 | | | | | | |
| 2 | FC stop | 1 | | | | | | |
| 3 | Running mode local | 1 | | RS 485 | | | | |
| 4 | Running mode remote | 1 | | RS 485 | | | | |
| 5 | Level set point (m) | 1 | | RS 485 | | | | |
| 6 | Pressure set point (bar) | 1 | | RS 485 | | | | |
| 7 | Flow set point (l/s) | 1 | | RS 485 | | | | |
| 8 | Actual setup | 4 | | RS 485 | | | | |
| 9 | Frequency converter running | 1 | | RS 485 | | | | |
| 10 | Frequency converter sleep mode | 1 | | RS 485 | | | | |
| 11 | Frequency converter stopped | 1 | | RS 485 | | | | |
| 12 | Frequency converter failure | 1 | | RS 485 | | | | |
| 13 | Frequency (Hz) | 1 | | RS 485 | | | | |
| 14 | Frequency converter warning | 1 | | RS 485 | | | | |
| 15 | Frequency converter alarm | 1 | | RS 485 | | | | |

to 85 f

| Soft starter (1 set) | | | | |
|----------------------|------------------------|----|----|--------|
| 1 | SS start | 1 | | |
| 2 | SS stop | 1 | | |
| 3 | Runing mode local | 1 | | RS 485 |
| 4 | Runing mode remote | 1 | | RS 485 |
| 5 | Soft starter starting | 1 | | RS 485 |
| 6 | Soft starter by passed | 1 | | RS 485 |
| 7 | Soft starter ready | 1 | | RS 485 |
| 8 | Soft starter failure | 1 | | RS 485 |
| | TOTAL: | 91 | 22 | |

5 81f

I/O List for SCADA System

| No. | Item | Input | | Output Digital | Napomene | | | |
|----------------------------------|--------------------------------------|---------|--------|-------------------|----------|--|--|--|
| | | Digital | Analog | | | | | |
| Mareza Old PS | | | | | | | | |
| Electrical System | | | | | | | | |
| 1 | Incoming voltage (10 KV) | | 2 | | | | | |
| 2 | Voltage (0,4 KV) | | 2 | | | | | |
| 3 | Incoming frequency | | 1 | | | | | |
| 4 | Power factor | | 1 | | | | | |
| 5 | Electric power (kW) | | 1 | | | | | |
| 6 | Electric energy (kWh) | | 1 | | | | | |
| 7 | Overscurrent | | 1 | | | | | |
| 8 | Oversupply | | 1 | | | | | |
| 9 | Undervoltage | | 1 | | | | | |
| 10 | Earth fault | | 1 | | | | | |
| 11 | Circuit breaker ON | | 1 | | | | | |
| 12 | Load break switch ON | | 1 | | | | | |
| 13 | Disconnecting switch ON | | 1 | | | | | |
| 14 | Transformer winding temperature high | | 1 | | | | | |
| 15 | Transformer buchholz relay operated | | 1 | | | | | |
| Pump Signal/Measurement | | | | | | | | |
| 1 | Pool water level | | | 1 | | | | |
| 2 | Pool water level low alarm | | | 1 | | | | |
| 3 | Pool water level low low trip | | | 1 | | | | |
| 4 | Motor current | | | 5 | | | | |
| 5 | Motor power | | | 5 | | | | |
| 6 | Motor winding temperature | | | 15 | | | | |
| 7 | Motor winding temperature high | | | 15 | | | | |
| 8 | Motor winding temperature trip | | | 15 | | | | |
| 9 | Motor bearing temperature | | | 10 | | | | |
| 10 | Motor bearing temperature high | | | 10 | | | | |
| 11 | Motor bearing temperature trip | | | 10 | | | | |
| 12 | Pump bearing temperature | | | 5 | | | | |
| 13 | Pump bearing temperature high | | | 5 | | | | |
| 14 | Pump bearing temperature trip | | | 5 | | | | |
| 15 | Pump stop | | | 5 | | | | |
| 16 | Pump running | | | 5 | | | | |
| 17 | Pump fault | | | 5 | | | | |
| 18 | Chlorine pump discharge pressure | | | 1 | | | | |
| 19 | Chlorine pump stop | | | 4 | | | | |
| 20 | Chlorine pump running | | | 4 | | | | |
| 21 | Chlorine pump fault | | | 4 | | | | |
| Station Signal/Measurment | | | | | | | | |
| 1 | Pump discharge header pressure | | | 3 | | | | |
| 2 | Pump discharge header flow | | | 3 | | | | |
| 3 | Residual chlorine contents | | | 3 | | | | |
| 4 | Chlorine gas leakage alarm | | | 1 | | | | |

✓ 8/8

| Frequency converter (2 set) | | | | |
|------------------------------------|--------------------------------|-----|----|--------|
| 1 | FC start | 2 | | |
| 2 | FC stop | 2 | | |
| 3 | Runing mode local | 2 | | RS 485 |
| 4 | Runing mode remote | 2 | | RS 485 |
| 5 | Level set point (m) | 2 | | RS 485 |
| 6 | Pressure set point (bar) | 2 | | RS 485 |
| 7 | Flow set point (l/s) | 2 | | RS 485 |
| 8 | Actual setup | 8 | | RS 485 |
| 9 | Frequency converter running | 2 | | RS 485 |
| 10 | Frequency converter sleep mode | 2 | | RS 485 |
| 11 | Frequency converter stoped | 2 | | RS 485 |
| 12 | Frequency converter failure | 2 | | RS 485 |
| 13 | Frequency (Hz) | 2 | | RS 485 |
| 14 | Frequency converter warning | 2 | | RS 485 |
| 15 | Frequency converter alarm | 2 | | RS 485 |
| Soft starter (3 set) | | | | |
| 1 | SS start | 3 | | |
| 2 | SS stop | 3 | | |
| 3 | Runing mode local | 3 | | RS 485 |
| 4 | Runing mode remote | 3 | | RS 485 |
| 5 | Soft starter starting | 3 | | RS 485 |
| 6 | Soft starter by passed | 3 | | RS 485 |
| 7 | Soft starter ready | 3 | | RS 485 |
| 8 | Soft starter failure | 3 | | RS 485 |
| | TOTAL: | 187 | 31 | |

15 88 f.

I/O List for SCADA System

| No. | Item | Input | | Output Digital | Remarks |
|----------------------|--------------------------------------|---------|--------|-------------------|---------|
| | | Digital | Analog | | |
| Mareza New PS | | | | | |
| | Electrical System | | | | |
| 1 | Incoming voltage (10 KV) | | 2 | | |
| 2 | Voltage (6 KV) | | 2 | | |
| 3 | Incoming frequency | | 1 | | |
| 4 | Power factor | | 1 | | |
| 5 | Electric power (kW) | | 1 | | |
| 6 | Electric energy (kWh) | | 1 | | |
| 7 | Overcurrent | | 1 | | |
| 8 | Oversupply | | 1 | | |
| 9 | Undervoltage | | 1 | | |
| 10 | Earth fault | | 1 | | |
| 11 | Circuit breaker ON | | 1 | | |
| 12 | Load break switch ON | | 1 | | |
| 13 | Disconnecting switch ON | | 1 | | |
| 14 | Transformer winding temperature high | | 1 | | |
| 15 | Transformer buchholz relay operated | | 1 | | |
| | Pump Signal/Measurement | | | | |
| 1 | Pool water level | | 2 | | |
| 2 | Pool water level low alarm | | 2 | | |
| 3 | Pool water level low low trip | | 2 | | |
| 4 | Motor current | | 4 | | |
| 5 | Motor winding temperature | | 12 | | |
| 6 | Motor winding temperature high | | 12 | | |
| 7 | Motor winding temperature trip | | 12 | | |
| 8 | Motor upper bearing temperature | | 4 | | |
| 9 | Motor upper bearing temperature high | | 4 | | |
| 10 | Motor upper bearing temperature trip | | 4 | | |
| 11 | Motor lower bearing temperature | | 4 | | |
| 12 | Motor lower bearing temperature high | | 4 | | |
| 13 | Motor lower bearing temperature trip | | 4 | | |
| 14 | Pump bearing temperature | | 4 | | |
| 15 | Pump bearing temperature high | | 4 | | |
| 16 | Pump bearing temperature trip | | 4 | | |
| 17 | Pump stop | | 4 | | |
| 18 | Pump running | | 4 | | |
| 19 | Pump fault | | 4 | | |
| 20 | Chlorine pump discharge pressure | | 1 | | |
| 21 | Chlorine pump stop | | 2 | | |
| 22 | Chlorine pump running | | 2 | | |
| 23 | Chlorine pump fault | | 2 | | |
| | Station Signal/Measurement | | | | |
| 1 | Pump discharge header pressure | | 1 | | |
| 2 | Compressor running | | 1 | | |
| 3 | Compressor stop | | 1 | | |
| 4 | Compressor fault | | 1 | | |
| 5 | Pump discharge header flow | | 1 | | |
| 6 | Residual chlorine contents | | 1 | | |
| 7 | Chlorine gas leakage alarm | | 1 | | |
| 8 | Air chamber pressure | | 2 | | |
| 9 | Air chamber pressure low | | 2 | | |
| 10 | Air chamber water level | | 2 | | |
| | TOTAL: | 93 | 38 | | |

5 8/8

I/O List for SCADA System

| No. | Item | Input | | Output Digital | Napomene |
|-------------------|--------------------------------------|---------|--------|-------------------|----------|
| | | Digital | Analog | | |
| Zagorič PS | | | | | |
| | Electrical System | | | | |
| 1 | Incoming voltage (10 KV) | 2 | | | |
| 2 | Voltage | 2 | | | |
| 3 | Incoming frequency | 1 | | | |
| 4 | Power factor | 1 | | | |
| 5 | Electric power (kW) | 1 | | | |
| 6 | Electric energy (kWh) | 1 | | | |
| 7 | Overshoot | 1 | | | |
| 8 | Oversupply | 1 | | | |
| 9 | Undervoltage | 1 | | | |
| 10 | Earth fault | 1 | | | |
| 11 | Circuit breaker ON | 1 | | | |
| 12 | Load break switch ON | 1 | | | |
| 13 | Disconnecting switch ON | 1 | | | |
| 14 | Transformer winding temperature high | 1 | | | |
| 15 | Transformer Buchholz relay operated | 1 | | | |
| | Pump Signal/Measurement | | | | |
| 1 | Well water level | | | 5 | |
| 2 | Well water level low alarm | | | 5 | |
| 3 | Well water level low low trip | | | 5 | |
| 4 | Motor current | | | 5 | |
| 5 | Motor power | | | 5 | |
| 6 | Motor winding temperature | | | 9 | |
| 7 | Motor winding temperature high | | | 9 | |
| 8 | Motor winding temperature trip | | | 9 | |
| 9 | Motor bearing temperature | | | 4 | |
| 10 | Motor bearing temperature high | | | 4 | |
| 11 | Motor bearing temperature trip | | | 4 | |
| 12 | Pump stop | | | 5 | |
| 13 | Pump running | | | 5 | |
| 14 | Pump fault | | | 5 | |
| 15 | Chlorine pump discharge pressure | | | 1 | |
| 16 | Chlorine pump stop | | | 2 | |
| 17 | Chlorine pump running | | | 2 | |
| 18 | Chlorine pump fault | | | 2 | |
| | Station Signal/Measurement | | | | |
| 1 | Pump discharge header pressure | | | 1 | |
| 2 | Compressor running | | | 1 | |
| 3 | Compressor stop | | | 1 | |
| 4 | Compressor fault | | | 1 | |
| 5 | Pump discharge header flow | | | 2 | |
| 6 | Residual chlorine contents | | | 2 | |
| 7 | Chlorine gas leakage alarm | | | 1 | |
| 8 | Air chamber pressure | | | 1 | |
| 9 | Air chamber pressure low | | | 1 | |
| 10 | Air chamber water level | | | 1 | |

15 JMF.

| Frequency converter (1 set) | | | | |
|------------------------------------|------------|-----------|--------|--|
| 1 FC start | 1 | | | |
| 2 FC stop | 1 | | | |
| 3 Runing mode local | 1 | | RS 485 | |
| 4 Runing mode remote | 1 | | RS 485 | |
| 5 Level set point (m) | 1 | | RS 485 | |
| 6 Pressure set point (bar) | 1 | | RS 485 | |
| 7 Flow set point (l/s) | 1 | | RS 485 | |
| 8 Actual setup | 4 | | RS 485 | |
| 9 Frequency converter running | 1 | | RS 485 | |
| 10 Frequency converter sleep mode | 1 | | RS 485 | |
| 11 Frequency converter stoped | 1 | | RS 485 | |
| 12 Frequency converter failure | 1 | | RS 485 | |
| 13 Frequency (Hz) | 1 | | RS 485 | |
| 14 Frequency converter warning | 1 | | RS 485 | |
| 15 Frequency converter alarm | 1 | | RS 485 | |
| Soft starter (4 set) | | | | |
| 1 SS start | 4 | | | |
| 2 SS stop | 4 | | | |
| 3 Runing mode local | 4 | | RS 485 | |
| 4 Runing mode remote | 4 | | RS 485 | |
| 5 Soft starter starting | 4 | | RS 485 | |
| 6 Soft starter by passed | 4 | | RS 485 | |
| 7 Soft starter ready | 4 | | RS 485 | |
| 8 Soft starter failure | 4 | | RS 485 | |
| TOTAL: | 134 | 31 | | |

5 m.f.

I/O List for SCADA System

| No. | Item | Input | | Output Digital | Napomene | | | |
|-----------------------------------|--------------------------------------|---------|--------|-------------------|----------|--|--|--|
| | | Digital | Analog | | | | | |
| Dinoša PS | | | | | | | | |
| Electrical System | | | | | | | | |
| 1 | Incoming voltage | 1 | | | | | | |
| 2 | Incoming current (A) | 1 | | | | | | |
| 3 | Incoming frequency | 1 | | | | | | |
| 4 | Power factor | 1 | | | | | | |
| 5 | Electric power (kW) | 1 | | | | | | |
| 6 | Electric energy (kWh) | 1 | | | | | | |
| 7 | Overscurrent | 1 | | | | | | |
| 8 | Oversupply | 1 | | | | | | |
| 9 | Undervoltage | 1 | | | | | | |
| 10 | Earth fault | 1 | | | | | | |
| 11 | Circuit breaker ON | 1 | | | | | | |
| 12 | Load break switch ON | 1 | | | | | | |
| 13 | Disconnecting switch ON | 1 | | | | | | |
| 14 | Transformer winding temperature high | 1 | | | | | | |
| 15 | Transformer Buchholz relay operated | 1 | | | | | | |
| Pump Signal/Measurement | | | | | | | | |
| 1 | Pump running mode auto | 1 | | | | | | |
| 2 | Pump running mode manual | 1 | | | | | | |
| 3 | Pump stop | 2 | | | | | | |
| 4 | Pump running | 2 | | | | | | |
| 5 | Pump fault | 2 | | | | | | |
| 6 | Motor current | | 2 | | | | | |
| 7 | Motor power | 2 | | | | | | |
| 8 | Motor winding temperature | | 2 | | | | | |
| 9 | Motor winding temperature high | 2 | | | | | | |
| 10 | Motor winding temperature trip | 2 | | | | | | |
| 11 | Well water level | | 2 | | | | | |
| 12 | Well water level low alarm | 2 | | | | | | |
| 13 | Well water level low low trip | 2 | | | | | | |
| 14 | Chlorine pump discharge pressure | | 1 | | | | | |
| 15 | Chlorine pump stop | 2 | | | | | | |
| 16 | Chlorine pump running | 2 | | | | | | |
| 17 | Chlorine pump fault | 2 | | | | | | |
| Station Signal/Measurement | | | | | | | | |
| 1 | Pump discharge header pressure | | 2 | | | | | |
| 2 | Pump discharge header flow | | 2 | | | | | |
| 3 | Residual chlorine contents | | 2 | | | | | |
| 4 | Chlorine gas leakage alarm | 1 | | | | | | |
| 5 | Water level reservoir | | 1 | | | | | |
| 6 | Water level reservoir high | 1 | | | | | | |
| 7 | Water level reservoir low | 1 | | | | | | |
| Soft starter (2 set) | | | | | | | | |
| 1 | SS start | 2 | | | | | | |
| 2 | SS stop | 2 | | | | | | |
| 5 | Soft starter starting | 2 | | RS 485 | | | | |
| 6 | Soft starter bypassed | 2 | | RS 485 | | | | |
| 7 | Soft starter ready | 2 | | RS 485 | | | | |
| 8 | Soft starter failure | 2 | | RS 485 | | | | |
| | TOTAL: | 54 | 14 | | | | | |

86 f.

I/O List for SCADA System

| No. | Item | Input | | Output Digital | Napomene | | | |
|------------------------------------|--------------------------------------|---------|--------|-------------------|----------|--|--|--|
| | | Digital | Analog | | | | | |
| Vuksanlekici PS | | | | | | | | |
| Electrical System | | | | | | | | |
| 1 | Incoming voltage | 1 | | | | | | |
| 2 | Incoming current (A) | 1 | | | | | | |
| 3 | Incoming frequency | 1 | | | | | | |
| 4 | Power factor | 1 | | | | | | |
| 5 | Electric power (kW) | 1 | | | | | | |
| 6 | Electric energy (kWh) | 1 | | | | | | |
| 7 | Overscurrent | 1 | | | | | | |
| 8 | Oversupply | 1 | | | | | | |
| 9 | Undervoltage | 1 | | | | | | |
| 10 | Earth fault | 1 | | | | | | |
| 11 | Circuit breaker ON | 1 | | | | | | |
| 12 | Load break switch ON | 1 | | | | | | |
| 13 | Disconnecting switch ON | 1 | | | | | | |
| 14 | Transformer winding temperature high | 1 | | | | | | |
| 15 | Transformer buchholtz relay operated | 1 | | | | | | |
| Pump Signal/Measurement | | | | | | | | |
| 1 | Pump stop | 2 | | | | | | |
| 2 | Pump running | 2 | | | | | | |
| 3 | Pump fault | 2 | | | | | | |
| 4 | Motor current | | 2 | | | | | |
| 5 | Motor power | 2 | | | | | | |
| 6 | Motor winding temperature | | 2 | | | | | |
| 7 | Motor winding temperature high | 2 | | | | | | |
| 8 | Motor winding temperature trip | 2 | | | | | | |
| 9 | Well water level | | 2 | | | | | |
| 10 | Well water level low alarm | 2 | | | | | | |
| 11 | Well water level low low trip | 2 | | | | | | |
| 12 | Chlorine pump discharge pressure | | 2 | | | | | |
| 13 | Chlorine pump stop | 2 | | | | | | |
| 14 | Chlorine pump running | 2 | | | | | | |
| 15 | Chlorine pump fault | 2 | | | | | | |
| Station Signal/Measurment (| | | | | | | | |
| 1 | Pump discharge header pressure | | 2 | | | | | |
| 2 | Pump discharge header flow | | 2 | | | | | |
| 3 | Residual chlorine contents | | 2 | | | | | |
| 4 | Chlorine gas leakage alarm | 1 | | | | | | |

15 87 f.

| Soft starter (1 set) | | | | |
|------------------------------------|--------------------------------|----|----|--------|
| 1 | SS start | 1 | | |
| 2 | SS stop | 1 | | |
| 3 | Soft starter starting | 1 | | RS 485 |
| 4 | Soft starter by passed | 1 | | RS 485 |
| 5 | Soft starter ready | 1 | | RS 485 |
| 6 | Soft starter failure | 1 | | RS 485 |
| Frequency converter (1 set) | | | | |
| 1 | FC start | 1 | | |
| 2 | FC stop | 1 | | |
| 3 | Runing mode local | 1 | | RS 485 |
| 4 | Runing mode remote | 1 | | RS 485 |
| 5 | Level set point (m) | 1 | | RS 485 |
| 6 | Pressure set point (bar) | 1 | | RS 485 |
| 7 | Flow set point (l/s) | 1 | | RS 485 |
| 8 | Actual setup | 4 | | RS 485 |
| 9 | Frequency converter running | 1 | | RS 485 |
| 10 | Frequency converter sleep mode | 1 | | RS 485 |
| 11 | Frequency converter stoped | 1 | | RS 485 |
| 12 | Frequency converter failure | 1 | | RS 485 |
| 13 | Frequency (Hz) | 1 | | RS 485 |
| 14 | Frequency converter warning | 1 | | RS 485 |
| 15 | Frequency converter alarm | 1 | | RS 485 |
| | TOTAL: | 62 | 14 | |

✓ 88 f.

I/O List for SCADA System

5 88 f.